



Air Conditioners

# Technical Data



Individual branch selector for VRV® heat recovery (Multi BS box)



EEDEN10-200

BSV6Q100PV



Air Conditioners

# Technical Data



Individual branch selector for VRV® heat recovery (Multi BS box)



EEDEN10-200

BSV6Q100PV

# TABLE OF CONTENTS

## BSVQ6P100PV

|   |   |   |
|---|---|---|
| 1 | Specifications .....                          | 2 |
|   | Technical Specifications .....                | 2 |
|   | Electrical Specifications .....               | 2 |
| 2 | Safety device settings .....                  | 3 |
| 3 | Dimensional drawing & centre of gravity ..... | 4 |
|   | Dimensional drawing .....                     | 4 |
|   | Centre of gravity .....                       | 5 |
| 4 | Piping diagram .....                          | 6 |
| 5 | Wiring diagram .....                          | 7 |
|   | Wiring diagram .....                          | 7 |
| 6 | Sound data .....                              | 8 |
|   | Sound pressure spectrum .....                 | 8 |

# 1 Specifications

| 1-1 Technical Specifications                                  |               |          |    | BSV6Q100PV1   |
|---|---------------|----------|----|---|
| Maximum capacity index of connectable indoor units            |               |          |    | 600   |
| Maximum capacity index of connectable indoor units per branch |               |          |    | 100   |
| Number of branches  |               |          |    | 6   |
| Maximum number of connectable indoor units                    |               |          |    | 30  |
| Maximum number of connectable indoor units per branch         |               |          |    | 5   |
| Power input (nominal)   | Cooling       | kW       |    | 0.030   |
|   | Heating       | kW       |    | 0.030   |
| Casing  | Material      |          |    | Galvanised steel  |
| Dimensions  | Unit          | Height   | mm | 209   |
|   |               | Width    | mm | 1,577   |
|   |               | Depth    | mm | 635   |
| Weight  | Unit          | kg       |    | 89  |
| Outdoor Unit  | Liquid (OD)   | Type     |    | Brazing connection  |
|   |               | Diameter | mm | 15.9  |
|   | Gas           | Type     |    | Brazing connection  |
|   |               | Diameter | mm | 28.6  |
|   | Discharge Gas | Type     |    | Brazing connection  |
|   |               | Diameter | mm | 28.6  |
| Indoor Units  | Liquid (OD)   | Type     |    | Brazing connection  |
|   |               | Diameter | mm | 9.5   |
|   | Gas           | Type     |    | Brazing connection  |
|   |               | Diameter | mm | 15.9  |
| Sound absorbing thermal insulation material                   |               |          |    | Foamed polyurethane, Flame resisting needle felt  |
| Standard Accessories  | Item          |          |    | Installation manual   |
|   |               |          |    | Connection pipes  |
|   |               |          |    | Insulation pipe cover   |
|   |               |          |    | Clamps  |
| Notes   |               |          |    | In case of connection with a 20~50 type indoor unit, match to the size of the field pipe using the attached pipe. Connection between the attached pipe and the field pipe must be brazed. |
|   |               |          |    | In case the joint diameter does not fit on the triple piping side, a reducer is needed (field supply)   |
|   |               |          |    | Insulators are necessary (field supply) for the triple piping side  |

| 1-2 Electrical Specifications |                            |    |  | BSV6Q100PV1  |
|-------------------------------|----------------------------|----|--|--|
| Power Supply                  | Name                       |    |  | V1   |
|                               | Phase                      |    |  | 1~   |
|                               | Frequency                  | Hz |  | 50   |
|                               | Voltage                    | V  |  | 220-240  |
| Voltage range                 | Minimum                    | V  |  | -10%   |
|                               | Maximum                    | V  |  | +10%   |
| Total circuit                 | Minimum circuit amps (MCA) | A  |  | 0.8  |
|                               | Maximum Fuse Amps          | A  |  | 15   |
| Notes                         |                            |    |  | Voltage range : units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits |
|                               |                            |    |  | Maximum allowable voltage range variation between phases is 2%   |
|                               |                            |    |  | MCA / MFA : MCA = 1.25 x FLA   |
|                               |                            |    |  | MFA is smaller than or equal to 4 x FLA  |
|                               |                            |    |  | Next lower standard fuse rating minimum 15A  |
|                               |                            |    |  | Select wire size based on MCA  |
|                               |                            |    |  | Instead of a fuse, use a circuit breaker   |

## 2 Safety device settings

BSV4Q100PV  
BSV6Q100PV

| Model      | Safety devices |
|------------|----------------|
|            | PC board fuse  |
| BSV4Q100PV | 250V 3.15A     |
| BSV6Q100PV | 250V 3.15A     |

4D064144

### 3 Dimensional drawing & centre of gravity

#### 3 - 1 Dimensional drawing

**BSV6Q100PV**

(Suspension bolt pitch)

(Suspension bolt pitch)

(Servicing space)

Inspection door

Inspection door

(Servicing space)

(Servicing space)

(Servicing space)

(Servicing space)

(In case of use attached pipe (note 3))

(note 4)

(note 4)

6

7

8

9

10

Location of unit's name plate . . . Right side of electric box

| Nr | Name  | Description                |
|----|---|----------------------------|
| 1  | Suction gas pipe connection port (note 5,6) | ø28.6mm brazing connection |
| 2  | HP/LP gas pipe connection port (note 5,6)   | ø28.6mm brazing connection |
| 3  | Liquid pipe connection port (note 5,6)      | ø15.9mm brazing connection |
| 4  | Gas pipe connection port                    | ø15.9mm brazing connection |
| 5  | Liquid pipe connection port                 | ø9.5mm brazing connection  |
| 6  | Electric box (note 1.)                      |                            |
| 7  | Suspension brackets                         | M8 ~M10                    |
| 8  | Grounding terminal                          | M4                         |
| 9  | Attached pipe (1) (Note. 3)                 | ø12.7mm brazing connection |
| 10 | Attached pipe (2) (Note. 3)                 | ø6.4mm brazing connection  |


**NOTES**

- Be sure to install a inspection door at electric box side. Another door is necessary to unload the product.
- Install it at the place where small sound of refrigerant does not disturb. Must not install it at the space such as roof-space of room where persons exists.
- Attached pipe is only used in case of connecting with 20-50 class indoor unit.
- Occupy the space witch is possible to install field pipes.
- Reducer may be required (field supply) if joint diameter does not suit on the triple piping side.
- Insulators are necessary (field supply) for the triple piping side.
- This space is a space to keep a top panel when servicing.

3D064061A

### 3 Dimensional drawing & centre of gravity

#### 3 - 2 Centre of gravity

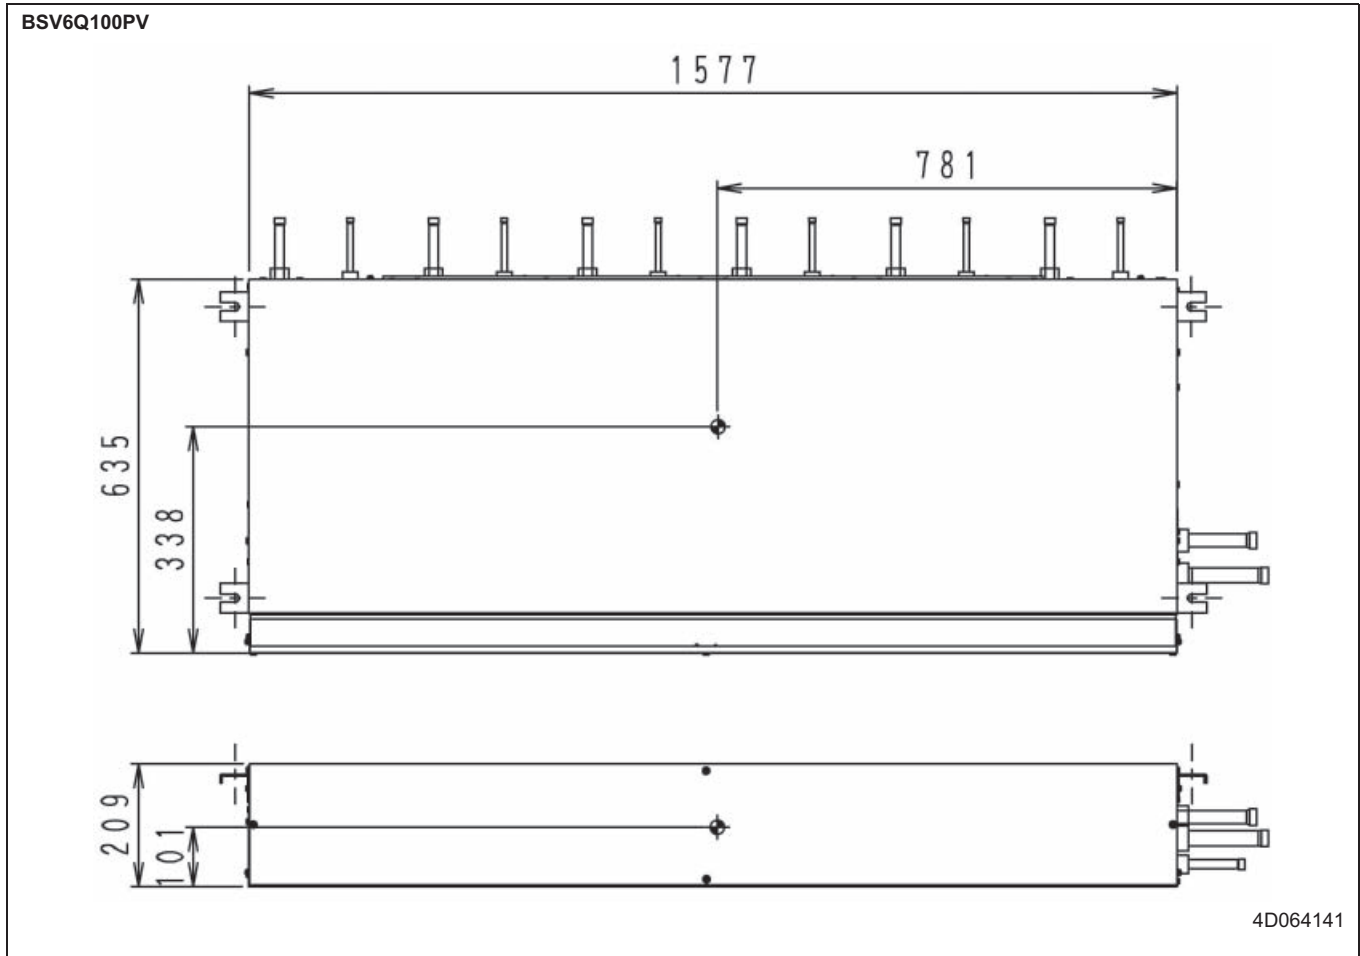






# 5 Wiring diagram

## 5 - 1 Wiring diagram

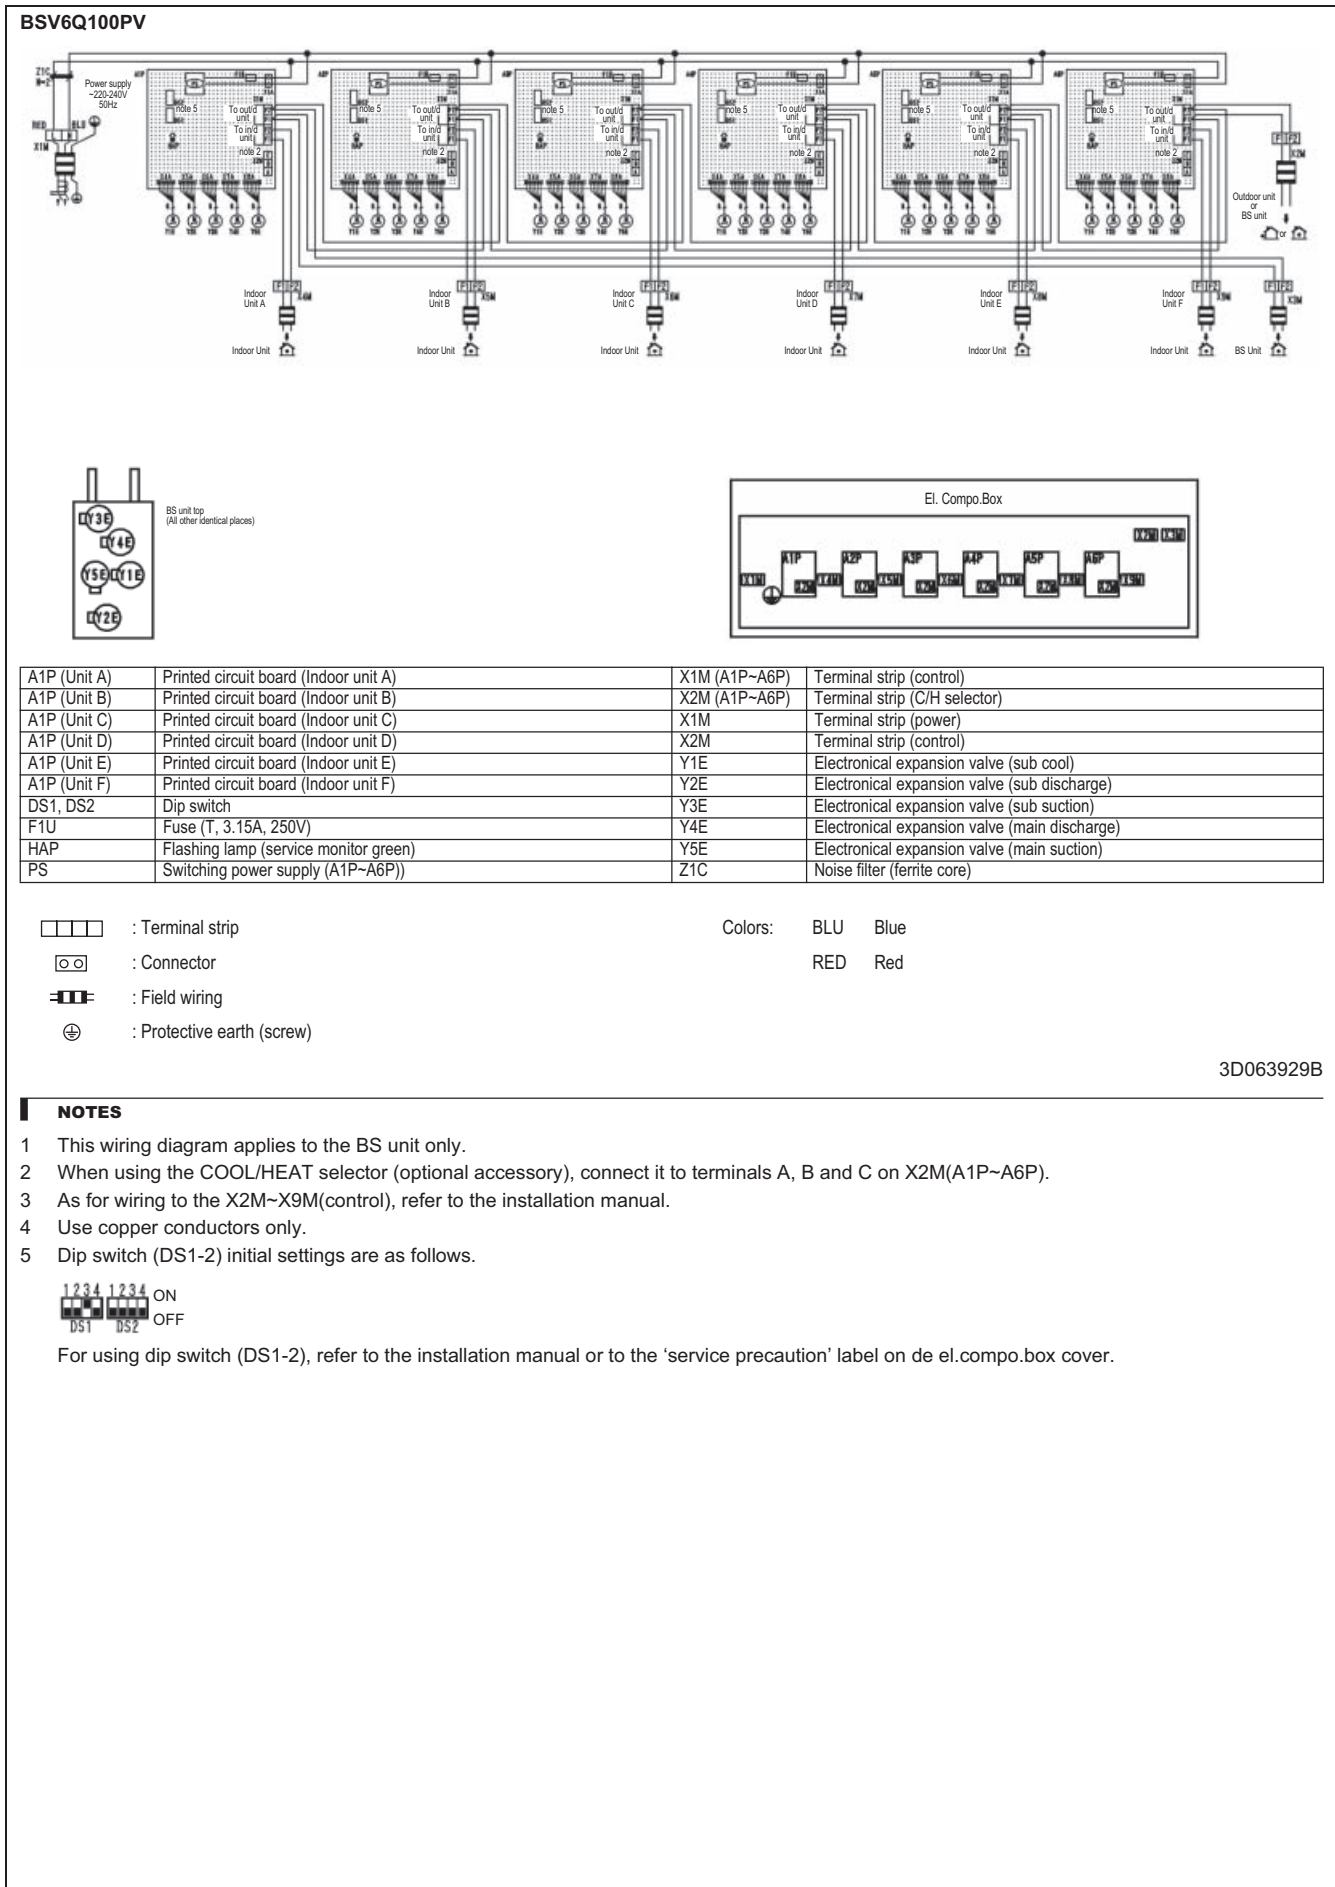

**NOTES**


- 1 This wiring diagram applies to the BS unit only.
- 2 When using the COOL/HEAT selector (optional accessory), connect it to terminals A, B and C on X2M(A1P~A6P).
- 3 As for wiring to the X2M~X9M(control), refer to the installation manual.
- 4 Use copper conductors only.
- 5 Dip switch (DS1-2) initial settings are as follows.



For using dip switch (DS1-2), refer to the installation manual or to the 'service precaution' label on the el.compo.box cover.

## 6 Sound data

### 6 - 1 Sound pressure spectrum

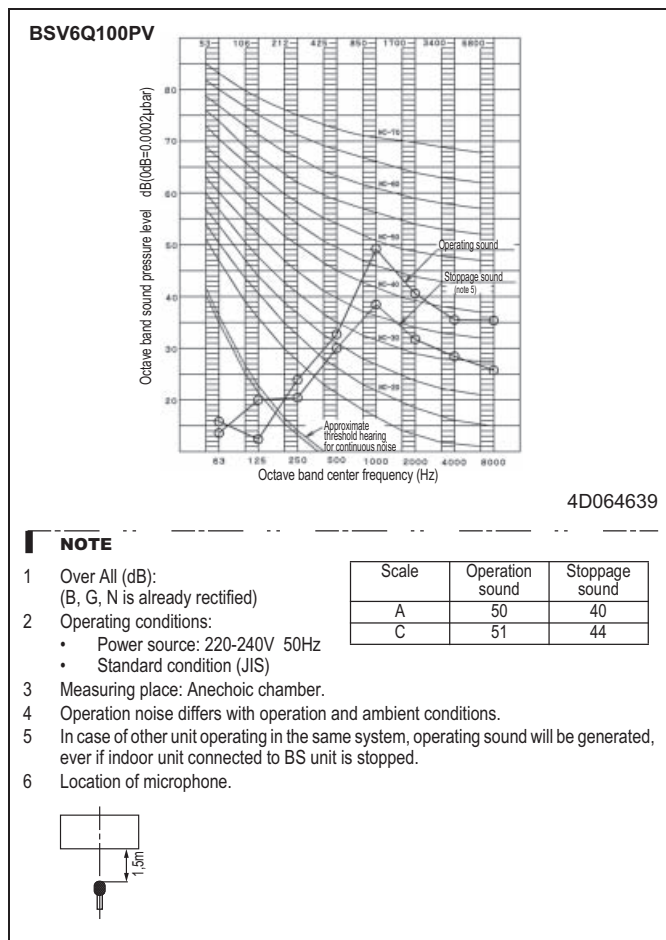




Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V.

Daikin products are distributed by:

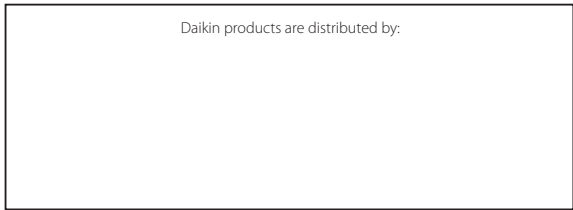

VRV® products are not within the scope of the Eurovent certification programme.

