



Chillers

# Technical Data

Small Inverter Chiller



EEDEN12-430

EWAQ/EWYQ-BA\*



Chillers

# Technical Data

Small Inverter Chiller



EEDEN12-430

EWAQ/EWYQ-BA\*

# EWAQ/EWYQ-BA\*

Air cooled inverter chiller .....	<b>1</b>	EWAQ-BA*	.....3	<b>1</b>
Air cooled heat pump inverter chiller .....	<b>2</b>	EWYQ-BA*	.....33	<b>2</b>



# TABLE OF CONTENTS

## EWAQ-BA\*

1	Features .....	4
2	Specifications .....	5
	Technical Specifications .....	5
	Electrical Specifications .....	7
3	Options .....	8
	Options .....	8
4	Capacity tables .....	10
	Cooling Capacity Tables .....	10
	Capacity Correction Factor .....	14
5	Dimensional drawings .....	15
	Dimensional Drawings .....	15
6	Piping diagrams .....	17
	Piping Diagrams .....	17
7	Wiring diagrams .....	22
	Wiring Diagrams - Three Phase .....	22
8	External connection diagrams .....	28
	External Connection Diagrams .....	28
9	Sound data .....	29
	Sound Power Spectrum .....	29
10	Installation .....	30
	Water Charge, Flow and Quality .....	30
11	Operation range .....	31
	Operation Range .....	31
12	Hydraulic performance .....	32
	Static Pressure Drop Unit .....	32

# 1 Features

- Inverter chiller
- High efficiency with leader-of-class ESEER (up to 4.75)
- Minimal starting currents and short payback times
- No buffertank required for standard applications
- Daikin scroll compressor
- Large operation range (ambient temperature up to 43°C)
- Digital remote controller



1

1

## 2 Specifications

2-1 Technical Specifications				EWAQ016BAW*	EWAQ021BAW*	EWAQ025BAW*	EWAQ032BAW*	EWAQ040BAW*	EWAQ050BAW*	EWAQ064BAW*		
Cooling capacity	Nom.		kW	16.8 (1)	21.0 (1)	25.2 (1)	31.5 (1)	42.0 (1)	50.4 (1)	63.0 (1)		
	Max.		kW	20.0 (1)	25.0 (1)	30.0 (1)	37.5 (1)	50.0 (1)	60.0 (1)	75.0 (1)		
Capacity control	Method		Inverter controlled									
	Minimum capacity		%	25								
	Maximum capacity		%	120								
Power input	Cooling	Nom.	kW	5.57 (2)	7.25 (2)	9.25 (2)	12.9 (2)	14.9 (2)	19.0 (2)	26.7 (2)		
EER				3.01 (1)	2.90 (1)	2.72 (1)	2.44 (1)	2.82 (1)	2.65 (1)	2.36 (1)		
ESEER				4.75	4.65	4.45	4.00	4.60	4.40	3.95		
Casing	Colour		Daikin White									
	Material		Polyester coated galvanised steel plate									
Dimensions	Unit	Height	mm	1,684								
		Width	mm	1,371		1,684	2,358		2,980			
		Depth	mm	774			780					
	Packed unit	Height	mm	1,860								
		Width	mm	1,394		1,707	2,377		2,997			
		Depth	mm	834			838					
Weight	Unit		kg	264	317	397	571	730				
	Operation weight		kg	267	320	401	577	738				
	Packed unit		kg	291	344	428	616	783				
Packing	Material		Carton / Wood / Plastic									
	Weight		kg	27			31	45	53			
Water heat exchanger	Type		Braze plate									
	Quantity		1				2					
	Filter	Material		Brass								
		Diameter perforations		mm	0.6							
	Water volume		l	1.9		2.9	3.8		5.7			
	Water flow rate		Min.	l/min		23	36	46		72		
	Nominal water flow		Cooling	l/min	48 (1)	60 (1)	72 (1)	90 (1)	120 (1)	144 (1)	181 (1)	
	Maximum water flow		Cooling	l/min	72	90	108	135	181	217	271	
	Nominal water pressure drop		Cooling	Total	kPa	20	30	42	30		42	30
	Insulation material		Nitrile rubber based elastomeric foam									
	Model		Type	ACH70-40H			ACH70-60H	ACH70-40H		ACH70-60H		
	Air heat exchanger	Length		mm	1,778			2,088	1,778		2,088	
Type		Hi-XSS (8)										
Rows		Quantity		2								
Stages		Quantity		54								
Fin pitch		mm	2.0									
Passes		Quantity		18		21	18		21			
Face area		m <sup>2</sup>	2.112			2.481	2.112		2.481			
Empty tubeplate hole		0										
Fin		Type		Non-symmetric waffle louvre								
		Treatment		Hydrophilic and anti-corrosion resistant								
Fan	Quantity		1			2		4				
	Type		Axial									
	Air flow rate	Cooling	Nom.	m <sup>3</sup> /min	171	185	233	370		466		
	Discharge direction		Vertical									
	External static pressure		Max.	Pa	78							
Fan motor	Model		Brushless DC motor									
	Output		W	750			350	750		350		
	Quantity		1			2		4				
	Position		Vertical									
	Drive		Direct drive									
Fan motor 2	Output		W	-			350	750		350		
Fan motor 3	Output		W	-			-		350			
Fan motor 4	Output		W	-			-		350			
Sound power level	Cooling	Nom.	dBA	78			80	81		83		

1  
2

## 2 Specifications

2-1 Technical Specifications					EWAQ016BAW*	EWAQ021BAW*	EWAQ025BAW*	EWAQ032BAW*	EWAQ040BAW*	EWAQ050BAW*	EWAQ064BAW*	
Compressor	Type				Hermetically sealed scroll compressor							
	Quantity				1	2	3	4	6			
	Motor (INV)	Crankcase heater		W	33							
		Model				Inverter						
		Quantity				1			2			
	Motor (ON-OFF)	Crankcase heater		W	-	33						
Model				-	ON/OFF							
Quantity				0	1	2		4				
Operation range	Water side	Cooling	Min.	°CDB	5							
			Max.	°CDB	20							
	Air side	Cooling	Min.	°CDB	-5							
			Max.	°CDB	43							
Refrigerant	Type				R-410A							
	Charge			kg	7.6		9.6	15.2		19.2		
	Control				Electronic expansion valve							
	Circuits		Quantity		1							
Water circuit	Piping connections diameter			inch	1-1/4" (female)			2" (female)				
	Piping			inch	1-1/4"			1-1/2"				
	Drain valve / fill valve				Yes							
	Shut off valve				Yes							
	Nominal water pressure drop		Cooling	kPa	44 (6)	66 (6)	92 (6)	106 (6)	53 (6)	71 (6)	67 (6)	
	Total water volume			l	3.2 (3)			4.2 (3)	5.8 (3)		7.7 (3)	
	Minimum water volume in the system for cooling			l	33 (4)			66 (4)				
	Air purge valve flowswitch				Yes yes							
Refrigerant oil	Type				Synthetic (ether) oil							
Defrost method				Reversed cycle								
Defrost control				Sensor for outdoor heat exchanger temperature								
Safety devices	Item	01		High pressure switch								
		02		Overcurrent relay								
		03		Inverter overload protector								
		04		Fuse								
PED	Category				Category II							
	Most critical part	Name			Accumulator							
		Ps*V	Bar*l		335		385	335		385		

1

2



## 2 Specifications

2-2 Electrical Specifications			EWAQ016BAW*	EWAQ021BAW*	EWAQ025BAW*	EWAQ032BAW*	EWAQ040BAW*	EWAQ050BAW*	EWAQ064BAW*	
Power supply	Name		W1							
	Phase		3N~							
	Frequency	Hz	50							
	Voltage		V							
	Voltage range	Min.	%	-10						
Max.		%	10							
Unit	Maximum starting current		A	0 (8)	77.7	78.7	88.7	99.8	101.9	120.7
	Current	Zmax	Text	-	0.27		0.24	0.25		0.22
	Maximum running current		A	22.2	25.3	26.4	35.2	47.4	49.6	67.2
	Minimum Ssc value			1,141	853		840	1,706		1,679
	Recommended fuses			25	32		40	50	63	80
Cable requirements	Power supply	Required number of conductors		4 + GND						
	Remote control	Quantity of wires		2						
		Maximum running current		Minimum cable section 0,75 mm <sup>2</sup>						
	Cooling/Heating output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Operation ON/OFF output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Error output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Pump ON/OFF output	Quantity of wires		2						
		Maximum running current	A	0.3						

### Notes

- (1) Condition: Ta 35°C - LWE 7°C ( DT = 5°C)
- (2) Pump is not included
- (3) Including piping + PHE; excluding expansion vessel
- (4) Excluding water volume in the unit. In most applications this minimum water volume will have a satisfying result. In critical processes or in rooms with a high heat load though, extra water volume might be required. Refer to operation range for more info.
- (5) Excluding the water volume in the unit. This volume will guarantee sufficient defrost energy for all applications, however, this volume can be multiplied by 0,66 if the heating setpoint is  $\geq 45^{\circ}\text{C}$  (eg. Fan coils)
- (6) This is PD between inlet & outlet connections of unit. It includes the water side heat exchanger pressure drop.
- (7) This is ESP between inlet & outlet connections of unit. It consists out of pump SP minus all internal PD's.
- (8) No peak current because of inverter compressor
- (9) In accordance with EN/IEC 61000-3-11, respectively EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with  $Z_{\text{sys}} \leq Z_{\text{max}}$ , respectively  $S_{\text{sc}} \geq \text{minimum } S_{\text{sc}}$  value.
- (10) EN/IEC 61000-3-11: European/international technical standard setting the limits for voltage changes, voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated  $\leq 75\text{A}$
- (11) EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current  $> 16\text{A}$  and  $\leq 75\text{A}$  per phase
- (12) Ssc: Short-circuit power
- (13) Zsys: system impedance

# 3 Options

## 3 - 1 Options

1  
3

### EWA/YQ-BA

TECHNICAL SPECIFICATIONS OF OPTICAL EQUIPMENT				016	021	025	032	040	050	064	
OPSP	Pump	Type		Horizontal multistage end-suction							
		Qty		1							
		Manufacturer		Grundfos							
		Model		CM5-3			CM5-4		CM10-2		
		Efficiency	%	-			77.4		79.6		
		Efficiency level		IE2							
		Rated speed	rpm	2770-2820			2840-2870		2820-2860		
		Rated output	kW	0.65			0.85		1.2		
	Water circuit	Safety valve	bar	3.0							
		Manometer		Yes							
		Expansion vessel	Volume	l	10			12			
			Pre-pressure	bar	1.0						
	Weight of unit	Nom. External Static Pressure	Cooling (1)	kPa	202	169	128	142	232	198	169
				kg	276	328	328	408	596	596	754
kg				303	355	355	440	641	641	807	
kg				279	331	331	412	602	602	762	
OPHP	Pump	Type		Horizontal multistage end-suction							
		Qty		1							
		Manufacturer		Grundfos							
		Model		CM5-5			CM10-3				
		Efficiency	%	79.6			83.2				
		Efficiency level		IE2							
		Rated speed	rpm	2820-2860			2890-2920				
		Rated output	kW	1.2					2.2		
	Water circuit	Safety valve	bar	3.0							
		Manometer		Yes							
		Expansion vessel	Volume	l	10			12			
			Pre-pressure	bar	1.0						
	Weight of unit	Nom. External Static Pressure	Cooling (1)	kPa	382	343	292	221	384	338	284
				kg	279	332	332	411	604	604	763
kg				306	359	359	443	648	648	815	
kg				282	335	335	415	610	610	771	
OP10	Operation range	Ambient	Min	°CDB refer to "operation range"							
OPZL	Operation range cooling	Ambient	Min	°CDB refer to "operation range"							
		Waterside	Min	°C refer to "operation range"							

### ELECTRICAL SPECIFICATIONS OF OPTICAL EQUIPMENT

				016	021	025	032	040	050	064
OPSP										
Current	Maximum starting current (cooling/heating)	A	(7)	79.5	80.5	90.5	102.8	104.9	123.7	
	Maximum running current	A	24.0	27.1	28.2	37.0	50.4	52.6	70.2	
	Recommended fuses	A	25	32	32	40	63	63	80	
OPHP										
Current	Maximum starting current (cooling/heating)	A	(7)	79.9	81.7	91.7	103.7	106.3	125.1	
	Maximum running current	A	24.4	27.5	29.4	38.2	51.3	54.0	71.6	
	Recommended fuses	A	32	32	32	40	63	63	80	
OP10										
Cable requirements	Water piping heater output	Quantity of wires		2						
		Maximum running current		1A						
EKRP1AHT*										
Cable requirements	Thermostat ON/OFF signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Thermostat cooling/heating signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Operation ON signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Operation OFF signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
EKRUAH*										
Cable requirements	Secondary remote control	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						

### NOTES

1. Additional or different specs compared to standard

3TW60711-1A

### 3 Options

#### 3 - 1 Options

EWA/YQ-BA														
Option availability														
Reference	Description	EW(A/Y)Q*BA							Availability	DIGIT				Numeric optioncodes
		016	021	025	032	040	050	064		11	12	13	14	
-	Standard hydraulic package Filter, shut-off valves, drain/fill valve, automatic air purge Flowswitch	○	○	○	○	○	○	○	Factory mounted	N				-
OPSP	Additional hydraulic components: pump, expansion vessel, safety valve, pressure gauge	○	○	○	○	○	○	○	Factory mounted	P				78
OPHP	= OPSP but pump with higher static pressure	○	○	○	○	○	○	○	Factory mounted	H				79
OP10	Heatertape for freeze prevention during winter standstill	○	○	○	○	○	○	○	Factory mounted			H		57
OPZL	Low leaving water operation down to -10°C	○	○	○	○	○	○	○	Factory mounted		B			08b
EKRP1AHT*	Demand PCB with additional inputs for: Remote ON/OFF Remote cooling/heating Remote thermo ON/OFF	○	○	○	○	○	○	○	KIT					
EKRUHT*	Additional remote user interface	○	○	○	○	○	○	○	KIT					
BHGP26A1	Digital pressure gauges	○	○	○	○	○	○	○	KIT					
DTA104A62	External control adapter for: Demand control Low noise control	○	○	○	○	○	○	○	KIT					

3TW60719-1A

# 4 Capacity tables

## 4 - 1 Cooling Capacity Tables

EWA/YQ-BA

Cooling - Maximum performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
5	016	20,0	5,82	20,0	6,47	20,0	7,48	20,0	8,69	19,4	9,38
	021	25,0	7,48	25,0	8,22	25,0	9,08	25,0	9,99	25,0	11,8
	025	28,2	9,03	28,0	9,94	28,0	10,8	27,3	11,5	26,1	12,7
	032	37,5	12,8	37,5	14,8	37,0	16,6	35,8	18,2	30,3	16,4
	040	50,0	15,6	50,0	16,8	50,0	18,7	50,0	21,0	50,0	24,9
	050	54,1	17,9	55,0	19,9	54,5	21,6	53,0	23,0	50,3	25,4
7	064	73,9	26,8	72,8	29,8	71,7	33,1	69,0	36,2	58,9	33,2
	016	20,0	5,11	20,0	5,64	20,0	6,42	20,0	7,45	20,0	8,76
	021	25,0	6,92	25,0	7,59	25,0	8,39	25,0	9,25	25,0	10,7
	025	30,0	8,94	30,0	10,3	30,0	11,3	30,0	12,7	28,2	13,6
	032	37,5	11,7	37,5	13,6	37,5	16,0	37,5	18,2	31,1	15,7
	040	50,0	14,3	50,0	15,6	50,0	17,2	50,0	19,3	50,0	22,4
10	050	60,0	18,7	60,0	21,3	60,0	23,5	60,0	27,4	54,7	27,2
	064	75,0	25,5	75,0	29,1	75,0	33,5	75,0	39,4	60,0	31,3
	016	20,0	4,56	20,0	4,97	20,0	5,62	20,0	6,37	20,0	7,18
	021	25,0	6,32	25,0	6,99	25,0	7,72	25,0	8,52	25,0	9,53
	025	30,0	8,14	30,0	9,45	30,0	10,6	30,0	11,5	29,0	12,3
	032	37,5	10,6	37,5	12,2	37,5	14,5	37,5	16,3	32,0	14,5
15	040	50,0	12,7	50,0	14,1	50,0	15,6	50,0	17,4	50,0	19,7
	050	60,0	16,6	60,0	19,2	60,0	21,5	60,0	23,5	57,6	25,7
	064	75,0	23,1	75,0	26,1	75,0	30,7	75,0	35,2	62,5	29,4
	016	20,0	3,66	20,0	4,23	20,0	4,78	20,0	5,38	20,0	6,09
	021	25,0	5,38	25,0	6,03	25,0	6,73	25,0	7,45	25,0	8,20
	025	30,0	6,62	30,0	7,66	30,0	8,80	30,0	9,73	30,0	10,7
18	032	37,5	9,17	37,5	10,5	37,5	12,0	37,5	13,8	33,1	12,6
	040	50,0	10,8	50,0	12,1	50,0	13,5	50,0	15,0	50,0	16,6
	050	60,0	13,8	60,0	15,8	60,0	18,1	60,0	19,8	60,0	22,0
	064	75,0	19,7	75,0	21,9	75,0	25,1	75,0	28,9	65,1	25,6
	016	20,0	3,33	20,0	3,76	20,0	4,29	20,0	4,89	20,0	5,53
	021	25,0	4,91	25,0	5,53	25,0	6,29	25,0	7,01	25,0	7,73
18	025	30,0	6,00	30,0	6,93	30,0	8,02	30,0	8,94	30,0	9,79
	032	37,5	8,25	37,5	9,48	37,5	10,8	37,5	12,5	34,1	11,7
	040	50,0	10,0	50,0	11,3	50,0	12,7	50,0	14,0	50,0	15,6
	050	60,0	12,5	60,0	14,3	60,0	16,6	60,0	18,6	60,0	20,2
	064	75,0	17,8	75,0	19,8	75,0	22,8	75,0	26,5	67,7	24,2

**NOTES**

- Cooling capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range Dt = 3 - 8°C
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

**SYMBOLS**

- CC : Cooling capacity (kW)
- PI : Power input (kW)
- LWE : Leaving Water Evaporator temperature (°C)
- Tamb : Ambient temperature (°C)

3TW60722-1(1)

## 4 Capacity tables

### 4 - 1 Cooling Capacity Tables

#### EWA/YQ-BA

Cooling OPZL - Maximum performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
-10	016	12,4	6,16	12,4	6,70	12,2	7,35	11,8	7,90	11,2	8,46
	021	17,6	8,21	17,5	8,66	17,0	9,40	16,3	10,1	15,3	11,1
	025	18,0	8,53	17,9	8,97	17,5	9,74	16,7	10,4	15,7	11,5
	032	25,3	12,2	24,5	13,5	22,6	14,9	20,7	16,3	16,7	14,3
	040	34,8	15,9	34,3	17,3	33,3	18,8	31,8	20,1	29,9	22,1
	050	35,2	16,3	34,9	17,9	33,9	19,4	32,5	20,8	30,6	22,8
-5	064	49,1	24,3	47,2	26,9	43,5	29,7	40,1	32,8	31,9	28,1
	016	15,3	6,49	15,2	6,97	14,9	7,63	14,3	8,19	13,5	8,76
	021	21,0	8,71	20,9	8,99	20,4	9,8	19,6	10,4	18,5	11,5
	025	21,4	8,58	21,3	9,30	20,9	10,1	19,9	10,8	18,8	11,8
	032	29,4	12,6	29,1	14,0	27,5	15,5	25,1	17,1	22,6	17,9
	040	41,3	16,4	41,0	18,0	39,8	19,5	38,1	20,8	36,0	22,9
050	41,8	16,9	41,6	18,6	40,5	20,1	38,9	21,5	36,7	23,6	
064	57,2	25,2	56,4	28,0	52,9	30,9	48,9	33,8	39,8	30,9	

#### NOTES

- Cooling capacity (kW)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range  $\Delta t = 3 - 8^\circ\text{C}$
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit
- Usage of glycol and other anti-freeze  
Correction factors for CC and PI are applicable according type and concentration of the used anti-freeze

#### SYMBOLS

- CC : Cooling capacity (kW)  
 PI : Power input (kW)  
 LWE : Leaving Water Evaporator temperature ( $^\circ\text{C}$ )  
 Tamb : Ambient temperature ( $^\circ\text{C}$ )

3TW60722-1(2)

# 4 Capacity tables

## 4 - 1 Cooling Capacity Tables

EWA/YQ-BA

Cooling - Nominal performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
5	016	16,8	4,08	16,8	4,64	16,8	5,31	16,8	6,05	16,8	6,82
	021	21,0	5,53	21,0	6,06	21,0	6,79	21,0	7,66	21,0	8,7
	025	25,2	7,22	25,2	8,05	25,2	8,9	25,2	10,0	25,2	11,7
	032	31,5	9,6	31,5	10,9	31,5	12,2	31,4	14,2	30,5	16,3
	040	42,0	11,3	42,0	12,5	42,0	14,1	42,0	16,0	42,0	18,1
	050	50,4	15,1	50,4	16,7	50,4	18,6	50,4	20,9	50,4	24,6
064	63,0	19,8	63,0	22,3	63,0	25,4	63,0	29,7	59,3	32,9	
7	016	16,8	3,81	16,8	4,31	16,8	4,92	16,8	5,58	16,8	6,33
	021	21,0	5,26	21,0	5,83	21,0	6,50	21,0	7,25	21,0	8,1
	025	25,2	6,77	25,2	7,6	25,2	8,4	25,2	9,3	25,2	10,5
	032	31,5	9,1	31,5	10,3	31,5	11,5	31,5	12,9	31,2	15,5
	040	42,0	10,8	42,0	11,8	42,0	13,2	42,0	14,9	42,0	16,7
	050	50,4	14,0	50,4	15,7	50,4	17,3	50,4	19,0	50,4	22,2
064	63,0	18,7	63,0	21,1	63,0	23,6	63,0	26,7	63,0	31,5	
10	016	16,8	3,36	16,8	3,80	16,8	4,31	16,8	5,01	16,8	5,69
	021	21,0	4,91	21,0	5,44	21,0	6,00	21,0	6,73	21,0	7,54
	025	25,2	6,03	25,2	6,99	25,2	7,6	25,2	8,6	25,2	9,6
	032	31,5	8,2	31,5	9,4	31,5	10,5	31,5	11,9	31,5	14,1
	040	42,0	9,9	42,0	11,0	42,0	12,2	42,0	13,6	42,0	15,2
	050	50,4	12,4	50,4	14,2	50,4	15,7	50,4	17,4	50,4	19,7
064	63,0	17,0	63,0	19,5	63,0	21,7	63,0	25,0	63,0	29,4	
15	016	16,8	2,59	16,8	3,06	16,8	3,50	16,8	4,04	16,8	4,63
	021	21,0	4,03	21,0	4,65	21,0	5,17	21,0	5,81	21,0	6,53
	025	25,2	5,26	25,2	5,90	25,2	6,72	25,2	7,51	25,2	8,2
	032	31,5	6,80	31,5	7,8	31,5	8,9	31,5	10,0	31,5	11,4
	040	42,0	8,2	42,0	9,6	42,0	10,7	42,0	11,9	42,0	13,4
	050	50,4	10,8	50,4	12,1	50,4	13,7	50,4	15,1	50,4	16,7
064	63,0	14,1	63,0	16,1	63,0	18,4	63,0	20,6	63,0	24,1	
18	016	16,8	2,31	16,8	2,72	16,8	3,13	16,8	3,63	16,8	4,20
	021	21,0	3,46	21,0	4,09	21,0	4,66	21,0	5,22	21,0	5,88
	025	25,2	4,96	25,2	5,51	25,2	6,28	25,2	7,00	25,2	7,74
	032	31,5	6,27	31,5	7,15	31,5	8,1	31,5	9,2	31,5	10,4
	040	42,0	7,1	42,0	8,4	42,0	9,5	42,0	10,6	42,0	12,1
	050	50,4	9,9	50,4	11,2	50,4	12,8	50,4	14,2	50,4	15,6
064	63,0	12,8	63,0	14,6	63,0	16,9	63,0	18,9	63,0	21,3	

**NOTES**

- Cooling capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range Dt = 3 - 8°C
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

**SYMBOLS**

- CC : Cooling capacity (kW)
- PI : Power input (kW)
- LWE : Leaving Water Evaporator temperature (°C)
- Tamb : Ambient temperature (°C)

3TW60722-4(1)

## 4 Capacity tables

### 4 - 1 Cooling Capacity Tables

EWA/YQ-BA

Cooling OPZL - Nominal performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
-10	016	12,5	6,18	12,5	6,72	12,3	7,36	11,9	7,91	11,3	8,48
	021	18,0	7,98	17,8	8,68	17,2	9,42	16,5	10,1	15,5	11,1
	025	18,1	8,24	18,0	8,98	17,5	9,75	16,8	10,4	15,8	11,4
	032	25,6	12,2	24,8	13,6	22,9	15,0	20,9	16,4	16,8	14,3
	040	35,2	15,9	34,8	17,3	33,7	18,8	32,2	20,1	30,3	22,2
	050	37,6	16,6	37,3	18,1	36,4	19,7	35,1	21,1	30,6	22,8
-5	064	49,6	24,4	47,8	26,9	44,0	29,8	40,6	32,6	32,3	28,0
	016	15,5	6,51	15,5	6,99	15,1	7,65	14,5	8,21	13,7	8,78
	021	21,0	8,31	21,0	9,02	20,7	9,8	19,8	10,5	18,7	11,5
	025	21,6	8,61	21,5	9,32	21,0	10,1	20,1	10,8	19,0	11,8
	032	29,7	12,7	29,5	14,1	27,8	15,6	25,5	17,1	23,0	18,0
	040	42,0	16,6	41,5	18,0	40,3	19,5	38,6	20,9	36,5	23,0
	050	42,3	17,2	42,0	18,6	41,0	20,2	39,3	21,5	37,1	23,6
	064	57,8	25,2	57,0	28,0	53,6	31,0	48,9	34,0	41,0	31,1

#### NOTES

- Cooling capacity (kW)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range  $\Delta t = 3 - 8^\circ\text{C}$
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit
- Usage of glycol and other anti-freeze  
Correction factors for CC and PI are applicable according type and concentration of the used anti-freeze

#### SYMBOLS


- CC : Cooling capacity (kW)  
 PI : Power input (kW)  
 LWE : Leaving Water Evaporator temperature ( $^\circ\text{C}$ )  
 Tamb : Ambient temperature ( $^\circ\text{C}$ )

3TW60722-4(2)

# 4 Capacity tables

## 4 - 2 Capacity Correction Factor

EWA/YQ-BA

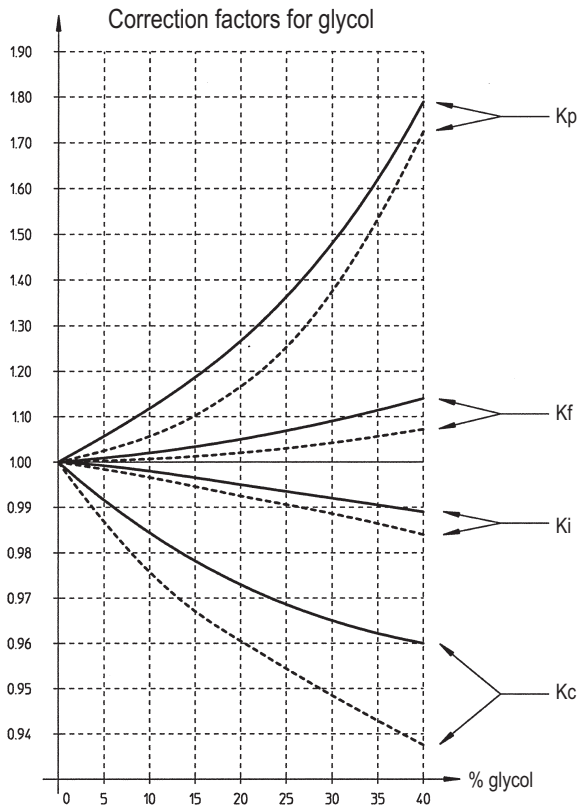

**SYMBOLS**

- Ethylene Glycol
- - - Propylene Glycol

- Kc Correction on cooling capacity
- Ki Correction on power input
- Kf Correction on flow rate
- Kp Correction on pressure drop

4TW50689-8



# 5 Dimensional drawings

## 5 - 1 Dimensional Drawings

### EWA/YQ16-25BA


Models	E	F	G
EWA/YQ016BAWN	736	619	371
EWA/YQ021BAWN	768	613	372
EWA/YQ025BAWN	768	613	372
EWA/YQ016BAWP	711	602	379
EWA/YQ021BAWP	745	599	379
EWA/YQ025BAWP	745	599	379

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES

	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

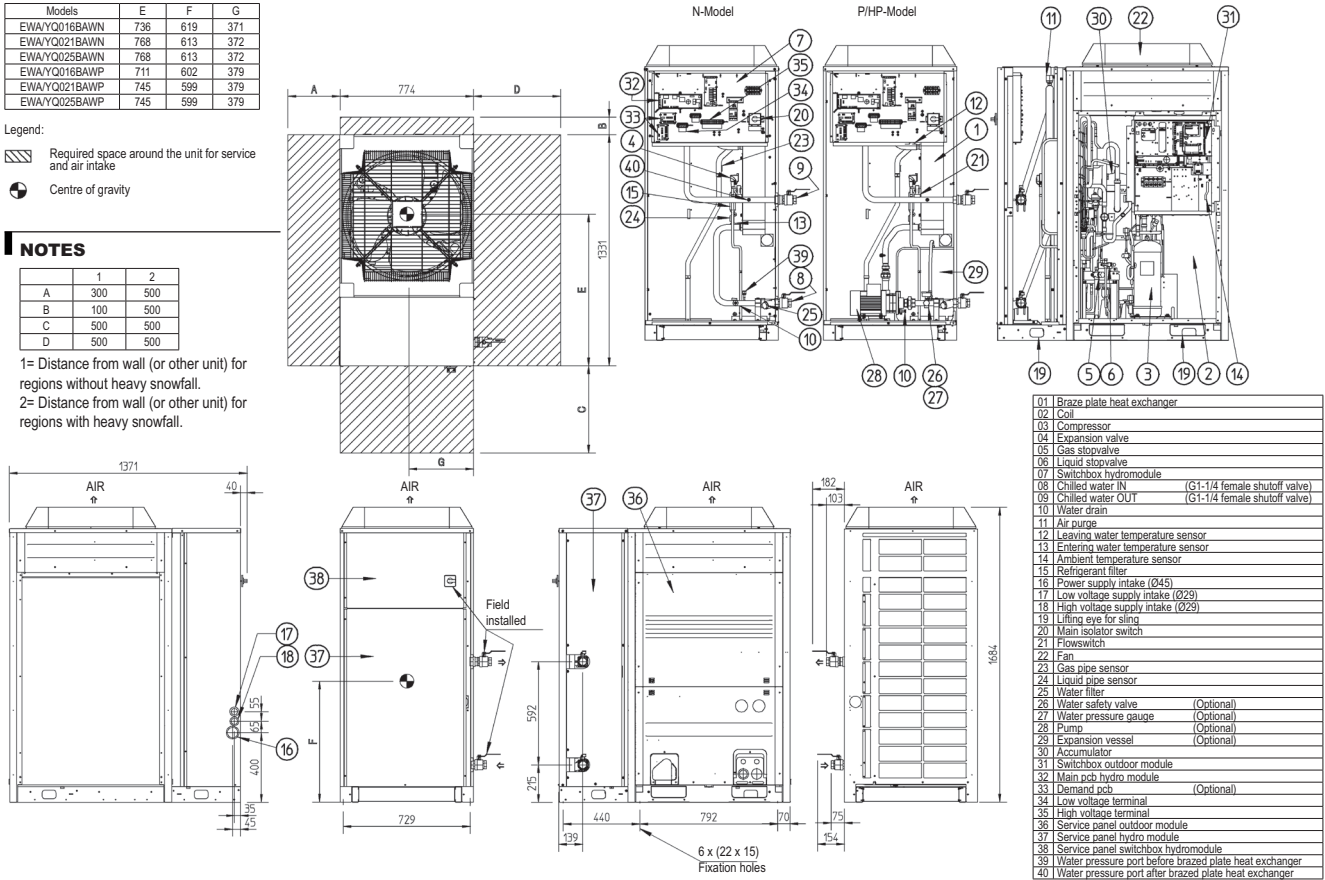

3TW60724-1A

### EWA/YQ32BA


Models	E	F	G
EWA/YQ032BAWN	870	606	380
EWA/YQ032BAWP	850	595	385

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES

	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

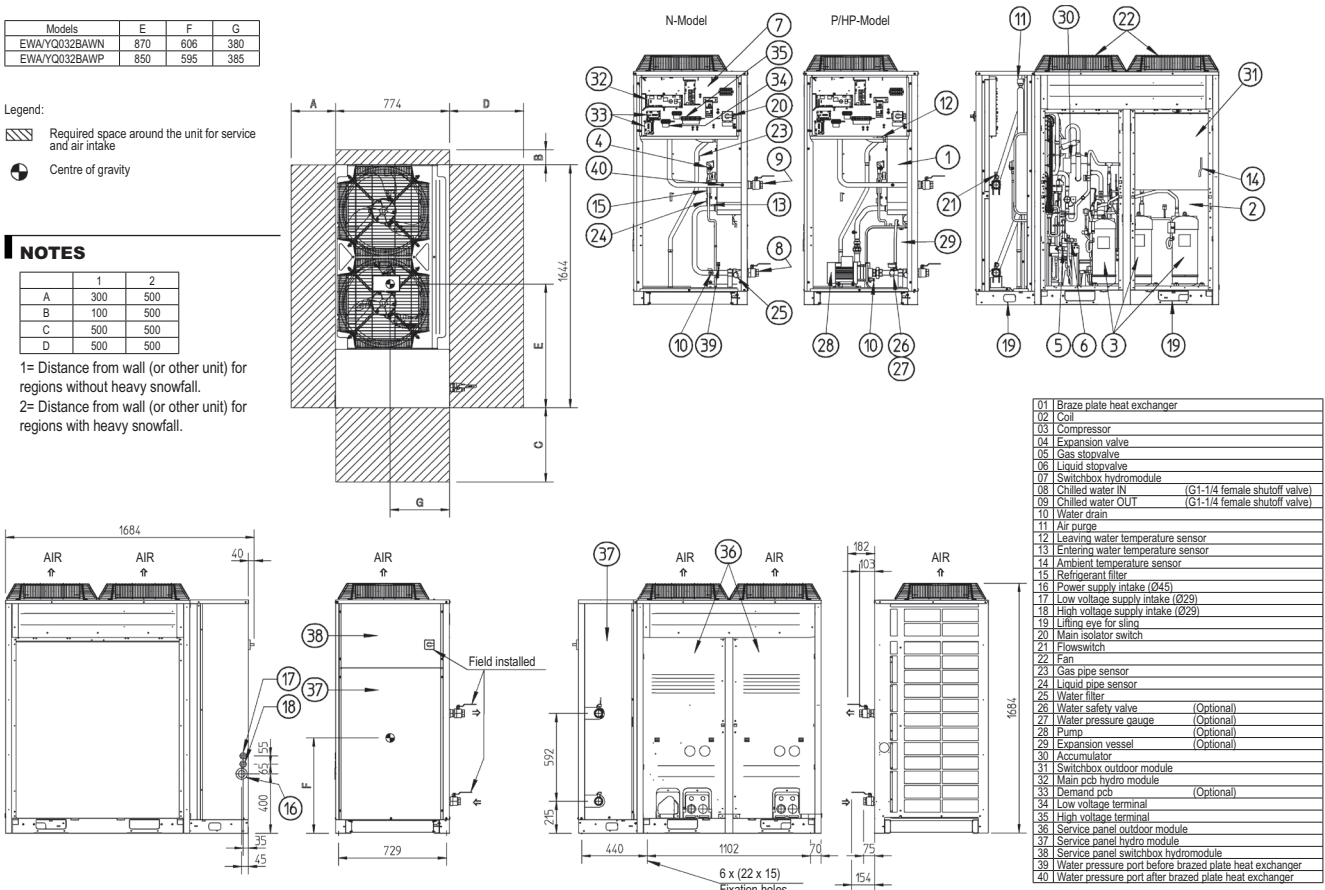


3TW60734-1A

# 5 Dimensional drawings


## 5 - 1 Dimensional Drawings

### EWA/YQ40,50BA

- 01 Braze plate heat exchanger
- 02 Coil
- 03 Compressor
- 04 Expansion valve
- 05 Gas stopvalve
- 06 Liquid stopvalve
- 07 Switchbox hydromodule
- 08 Chilled water IN (G2 female shutoff valve)
- 09 Chilled water OUT (G2 female shutoff valve)
- 10 Water drain
- 11 Air purge
- 12 Leaving water temperature sensor
- 13 Entering water temperature sensor
- 14 Ambient temperature sensor
- 15 Refrigerant filter
- 16 Power supply intake (Ø45)
- 17 Low voltage supply intake (Ø29)
- 18 High voltage supply intake (Ø29)
- 19 Lifting eye for sling
- 20 Main isolator switch
- 21 Flowswitch
- 22 Fan
- 23 Gas pipe sensor
- 24 Liquid pipe sensor
- 25 Water filter
- 26 Water safety valve (Optional)
- 27 Water pressure gauge (Optional)
- 28 Pump (Optional)
- 29 Expansion vessel (Optional)
- 30 Accumulator
- 31 Switchbox outdoor module
- 32 Main pcb hydromodule
- 33 Demand pcb (Optional)
- 34 Low voltage terminal
- 35 High voltage terminal
- 36 Service panel outdoor module
- 37 Service panel hydromodule
- 38 Service panel switchbox hydromodule
- 39 Water pressure port before brazed plate heat exchanger
- 40 Water pressure port after brazed plate heat exchanger

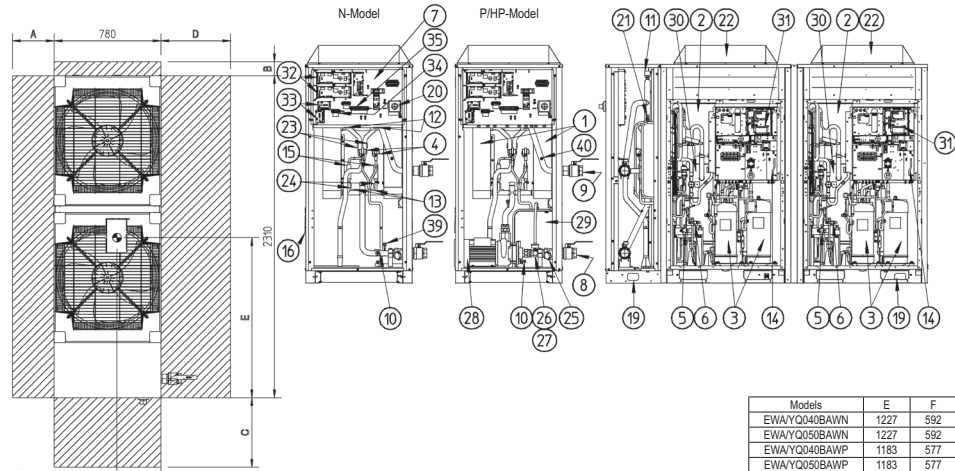

Models	E	F	G
EWA/YQ40BAWN	1227	592	380
EWA/YQ50BAWN	1227	592	380
EWA/YQ40BAWP	1183	577	387
EWA/YQ50BAWP	1183	577	387

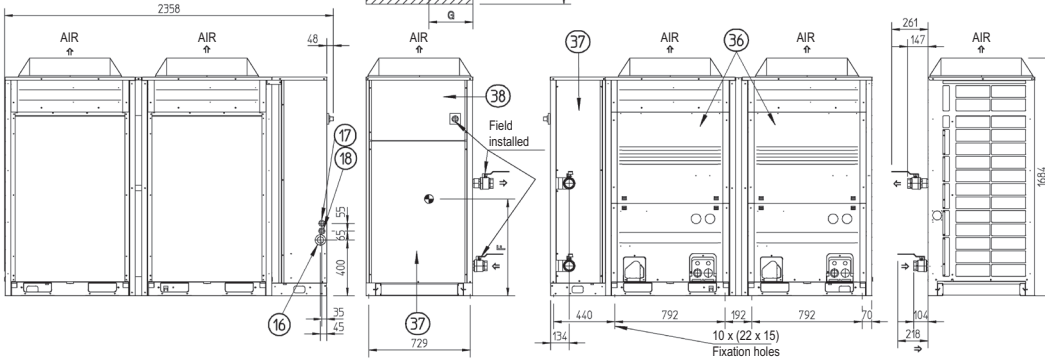

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES


	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.


3TW60754-1A

### EWA/YQ64BA

- 01 Braze plate heat exchanger
- 02 Coil
- 03 Compressor
- 04 Expansion valve
- 05 Gas stopvalve
- 06 Liquid stopvalve
- 07 Switchbox hydromodule
- 08 Chilled water IN (G2 female shutoff valve)
- 09 Chilled water OUT (G2 female shutoff valve)
- 10 Water drain
- 11 Air purge
- 12 Leaving water temperature sensor
- 13 Entering water temperature sensor
- 14 Ambient temperature sensor
- 15 Refrigerant filter
- 16 Power supply intake (Ø45)
- 17 Low voltage supply intake (Ø29)
- 18 High voltage supply intake (Ø29)
- 19 Lifting eye for sling
- 20 Main isolator switch
- 21 Flowswitch
- 22 Fan
- 23 Gas pipe sensor
- 24 Liquid pipe sensor
- 25 Water filter
- 26 Water safety valve (Optional)
- 27 Water pressure gauge (Optional)
- 28 Pump (Optional)
- 29 Expansion vessel (Optional)
- 30 Accumulator
- 31 Switchbox outdoor module
- 32 Main pcb hydromodule
- 33 Demand pcb (Optional)
- 34 Low voltage terminal
- 35 High voltage terminal
- 36 Service panel outdoor module
- 37 Service panel hydromodule
- 38 Service panel switchbox hydromodule
- 39 Water pressure port before brazed plate heat exchanger
- 40 Water pressure port after brazed plate heat exchanger

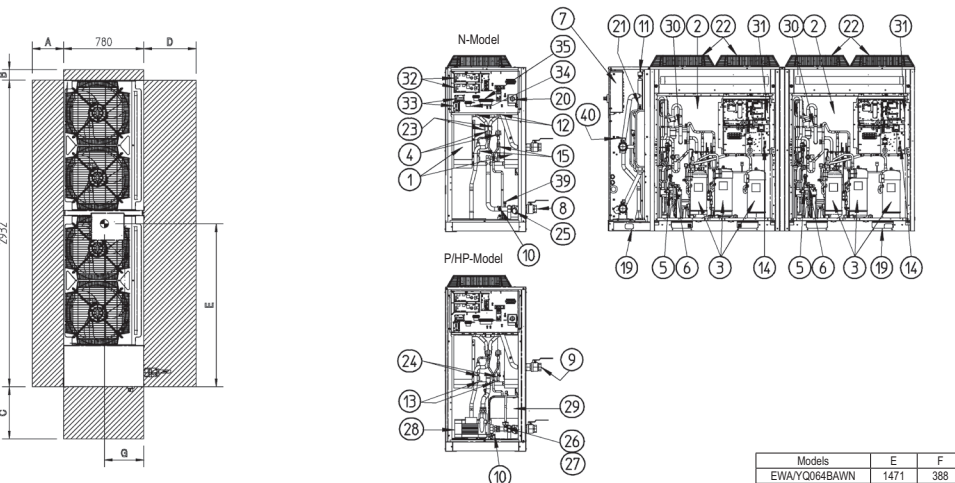

Models	E	F	G
EWA/YQ64BAWN	1471	388	590
EWA/YQ64BAWP	1430	394	578

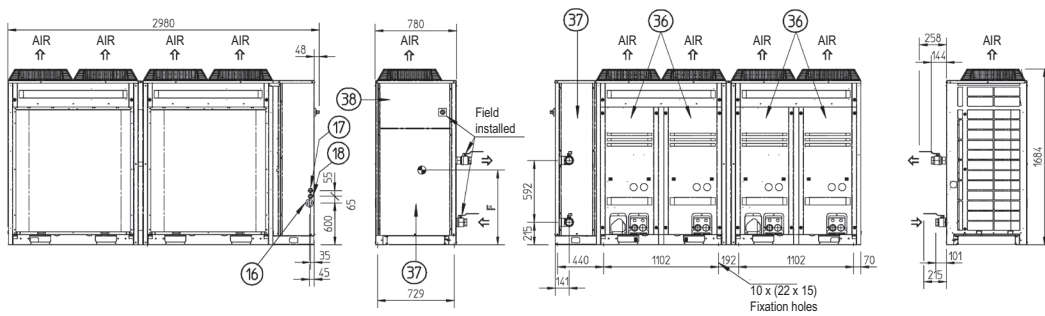

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES

	1	2
A	300	500
B	100	500
C	500	500
D	500	500


1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

3TW60774-1A

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

EWAQ16BA

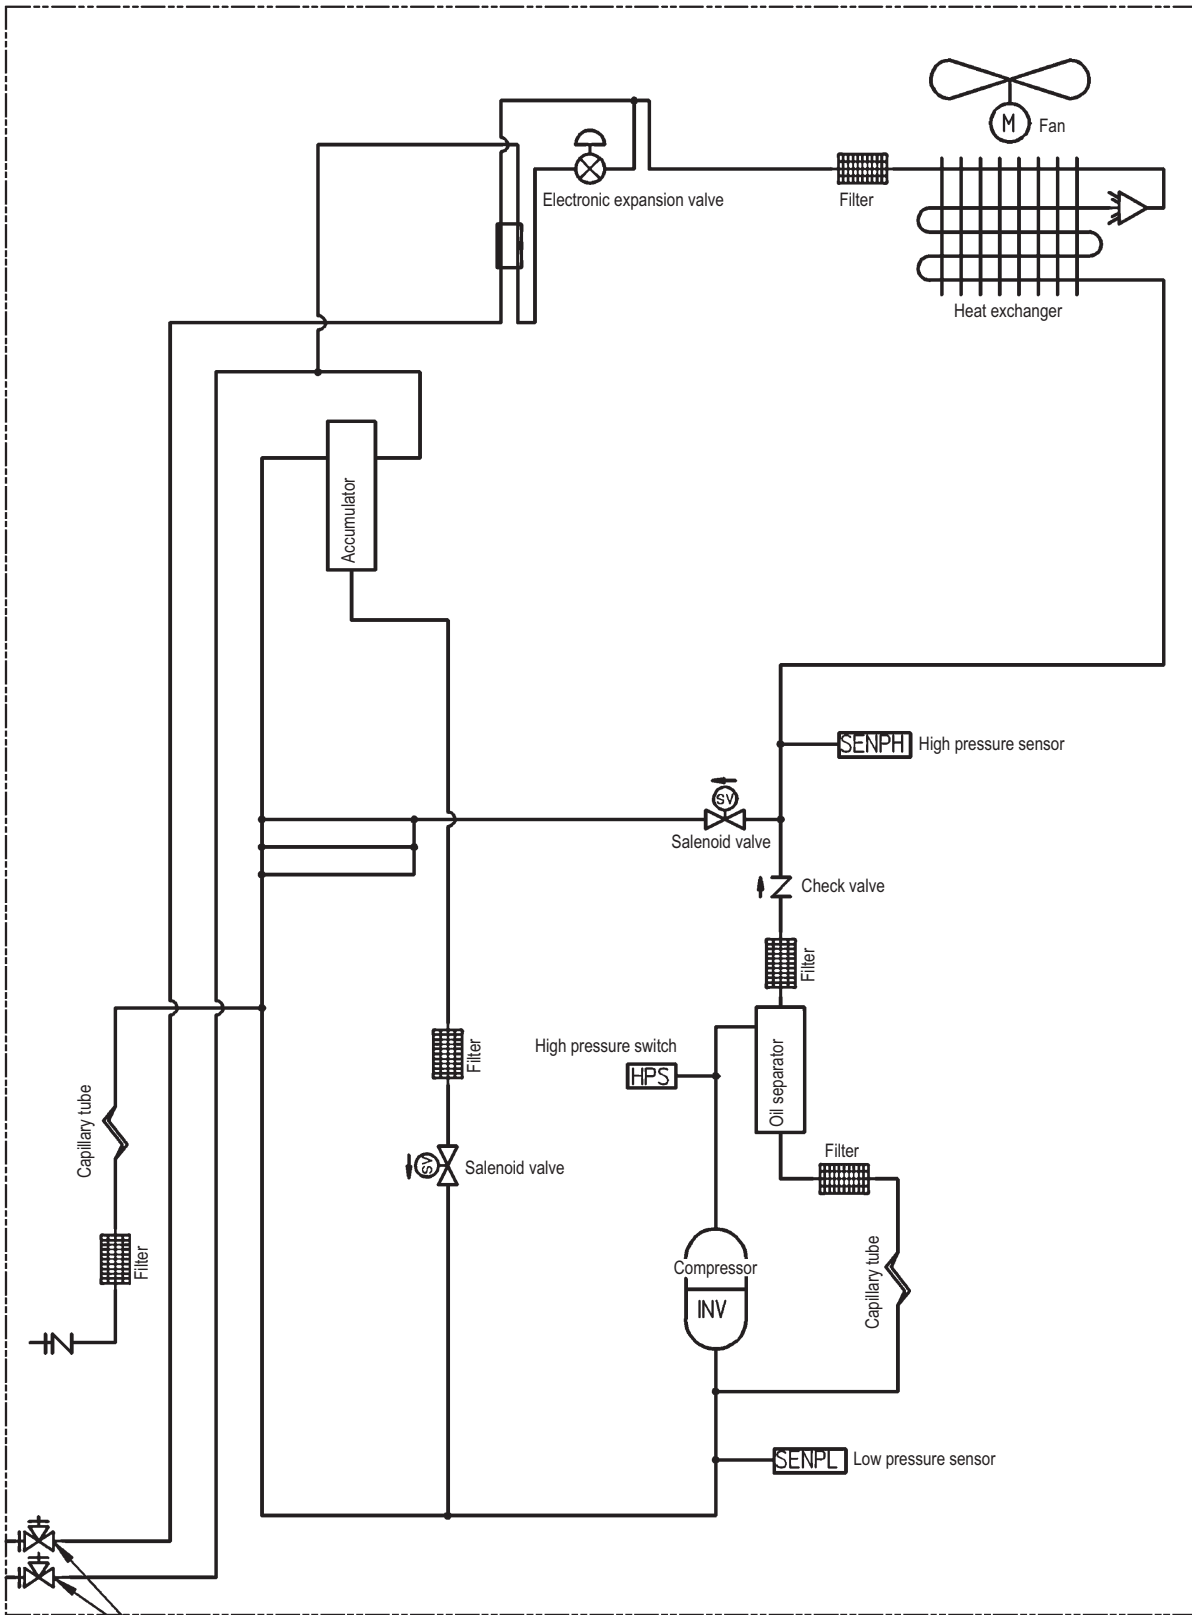

Stop valve  
(With service port on on-site piping side Ø 7.9mm flare connection)


1  
6

4TW27315-1A

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

EWAQ21,40BA

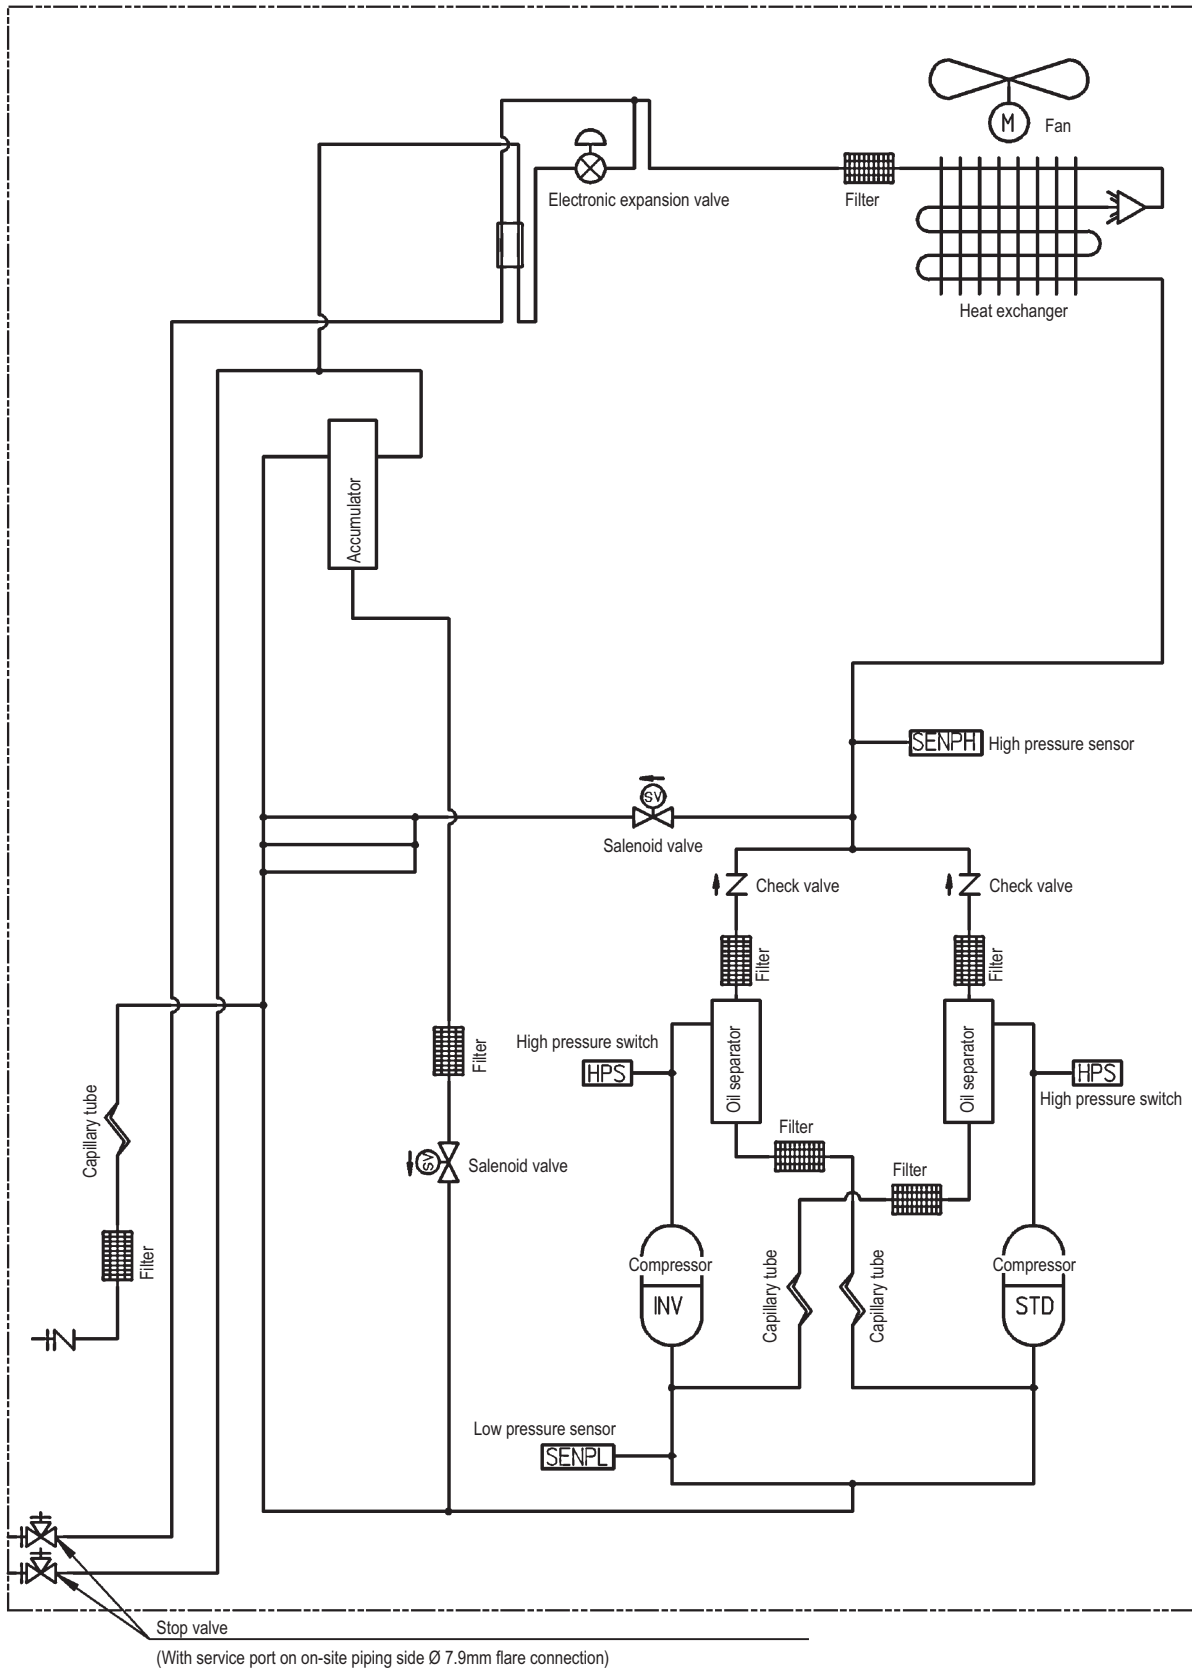


4TW27325-1A

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

EWAQ25,50BA  
EWYQ21,25,40,50BA

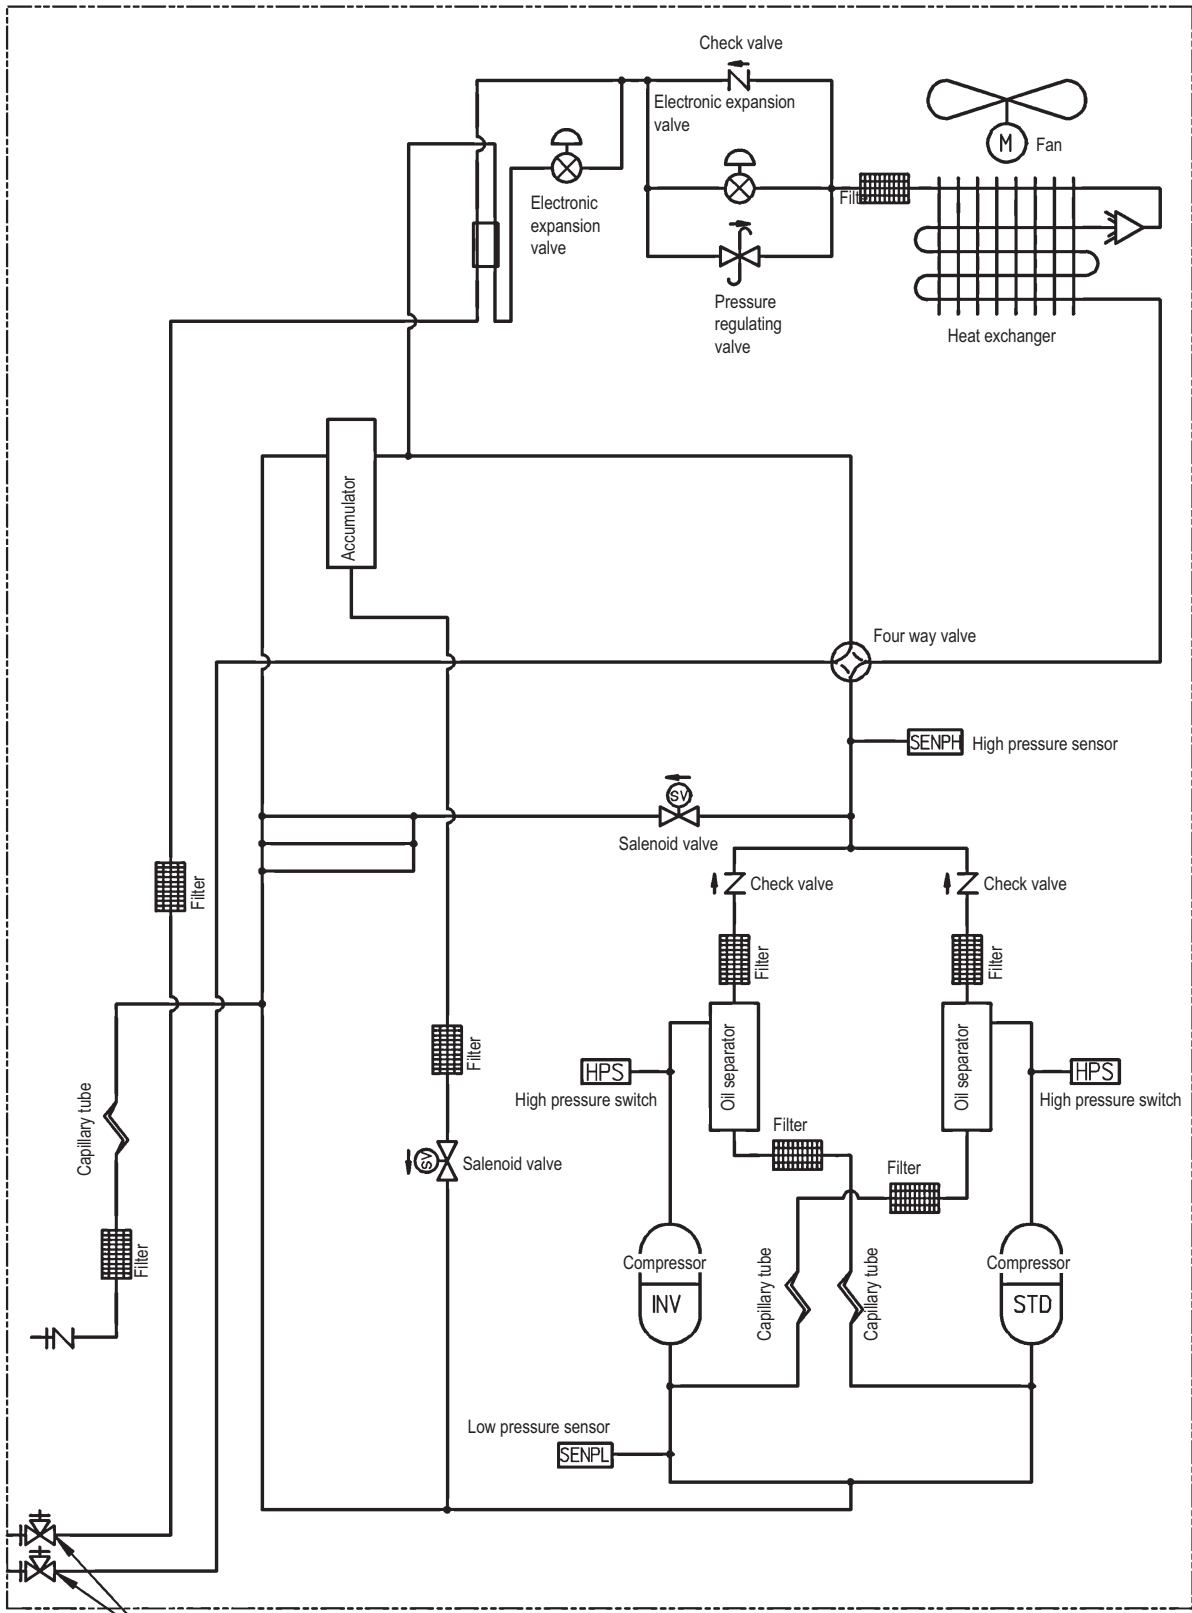


(With service port on on-site piping side Ø 7.9mm flare connection)

4TW27255-1

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

EWAQ32,64BA

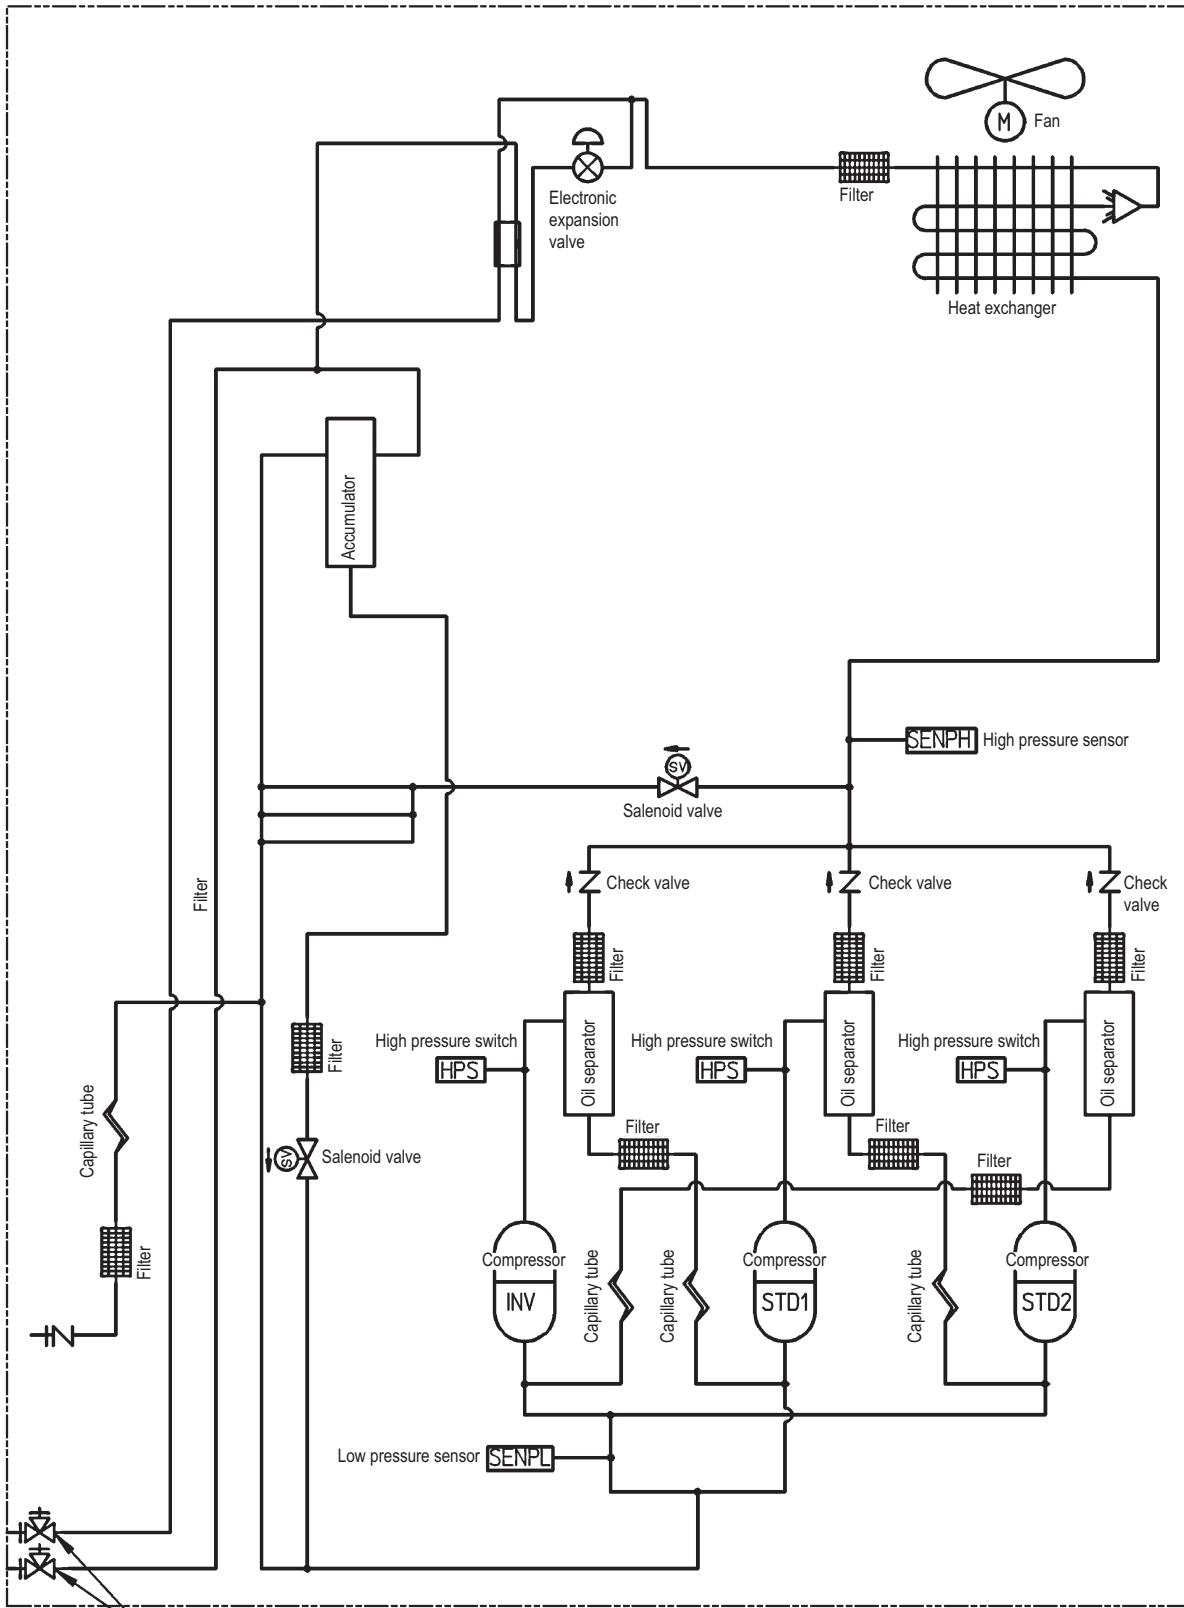

Stop valve  
(With service port on on-site piping side Ø 7.9mm flare connection)

4TW27345-1A

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

**EWA/YQ-BA Piping diagram - Hydromodule**

**Overview**

Outdoor module piping diagram		Small inverter chiller - Outdoor module combination						
		Single circuit			Double circuit			
C/O		16kW	21kW	25kW	32kW	40kW	50kW	64kW
C/O	4TW27315-1	•						
	4TW27325-1		•			•		
	4TW27255-1			•			•	
	4TW27345-1				•			•
H/P	4TW27245-1	•						
	4TW27255-1		•	•		•	•	
	4TW27275-1				•			•

**Single circuit**

**Description sensors**

R11T	Outlet water temperature sensor
R12T	Inlet water temperature sensor
R13T	Refrigerant liquid temperature sensor
R14T	Refrigerant gas temperature sensor

**Field installation**

Water outlet

Water inlet

Water side

Refrigerant side

Plate heat exchanger

Expansion vessel

Pump

Safety valve

Pressure gauge

Flow switch

Air purge

Check valve

Filter

Electronic expansion valve

see piping diagram outdoor module

Cooling ——— Heating - - - - -

3TW60715-1(1)

**EWA/YQ-BA Piping diagram - Hydromodule**

**Double circuit**

**Description sensors circuit 1**

R11T	Outlet water temperature sensor
R12T	Inlet water temperature sensor
R13T	Refrigerant liquid temperature sensor
R14T	Refrigerant gas temperature sensor

**Description sensors circuit 2**

R21T	Outlet water temperature sensor
R22T	Inlet water temperature sensor
R23T	Refrigerant liquid temperature sensor
R24T	Refrigerant gas temperature sensor

**Field installation**

Water outlet

Water inlet

Water side

Refrigerant side

Plate heat exchanger circuit1

Plate heat exchanger circuit2

Expansion vessel

Pump

Safety valve

Pressure gauge

Flow switch

Air purge

Check valve

Filter

Electronic expansion valve

see piping diagram outdoor module

Cooling ——— Heating - - - - -


3TW60715-1(2)



# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

EWAQ16BA

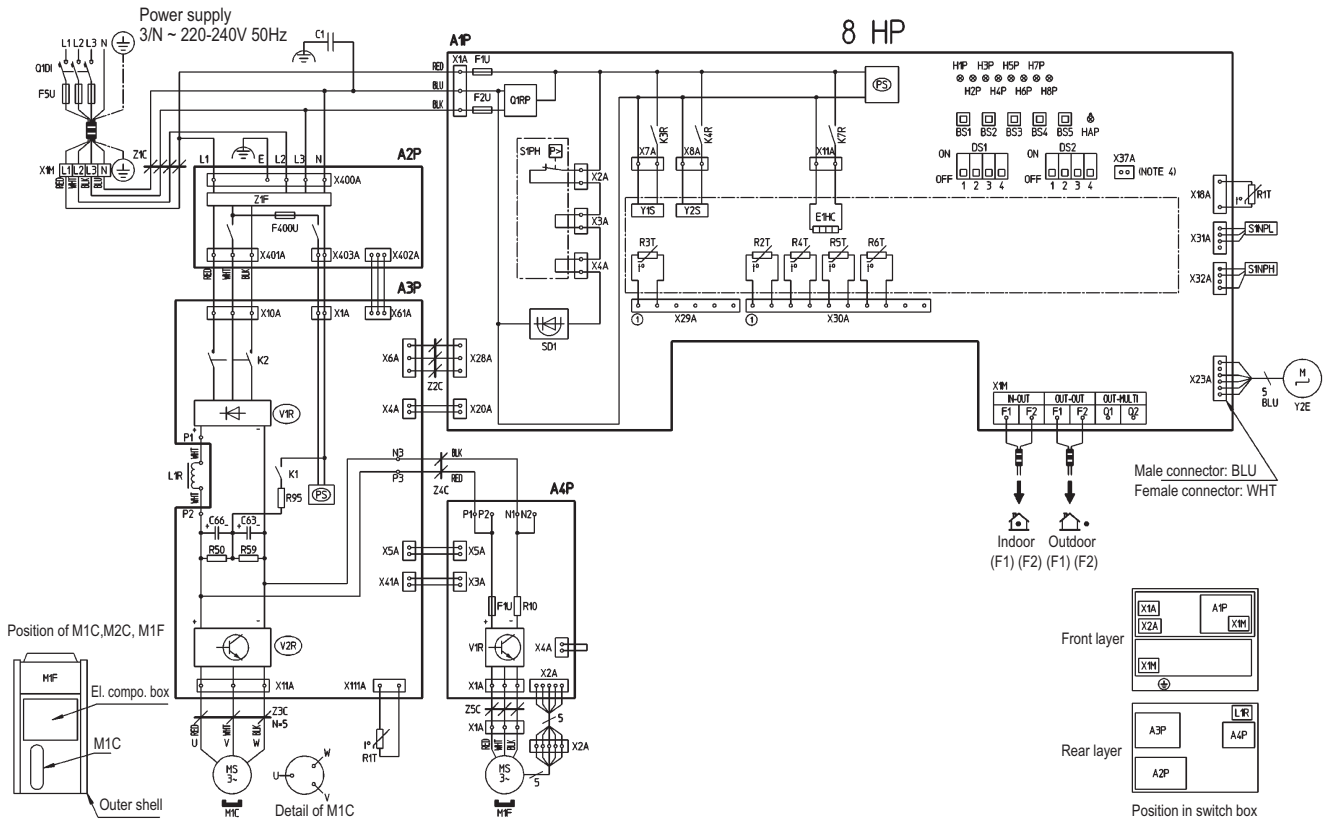

A1P-A4P	Printed circuit board	HAP	Pilotlamp (service monitor - green)	R50, R59	Resistor	
	A1P: Main	A4P: Fan	K1	Magnetic relay	R95	Resistor (current limiting)
	A2P: Noise filter		K2	Magnetic contactor (M1C)	S1NPH	Pressure sensor (high)
	A3P: Inverter		K3R-K7R	K3R: Y1S	K7R: E1HC	S1NPL
BS1-BS5	Push button switch (Mode, set, return, test, reset)	L1R	K4R: Y2S	S1PH	Pressure switch (high)	
			L1R	Reactor	SD1	Safety devices input
C1	Capacitor	M1C	Motor (Compressor)	V1R	Power module (A4P)	
C63, C66	Capacitor	M1F	Motor (Fan)	V1R, V2R	Power module (A3P)	
DS1, DS2	Dip switch	PS	Switching power supply (A1P, A3P)	X1A, X2A	Connector (M1F)	
E1HC	Crankcase heater	Q1RP	Phase reversal detect circuit	X1M	Terminal strip (power supply)	
F1U	Fuse (250V, 8A Ⓟ) (A4P)	Q1DI	Earth leakage breaker	X1M	Terminal strip (Control) (A1P)	
F1U, F2U	Fuse (250V, 3.15A Ⓟ) (A1P)	R1T-R6T	Thermistor	Y2E	Electronic expansion valve (subcool)	
F5U	Field fuse		R1T: AIR (A1P)	R4T: Heat exch. deicer		Solenoid valve
F400U	Fuse (250V, 6.3A Ⓟ) (A2P)		R1T: FIN (A3P)	R5T: Heat exch. outlet	Y1S-Y2S	Y1S: Hot gas
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test ----- Flickering Malfunction detection --- Light up		R2T: Suction	R6T: Liquid pipe	Y1S-Y2S	Y2S: Oil return
		R3T: M1C Discharge		Z1C-5C	Noise filter (ferrite core)	
		R10	Resistor (current sensor) (A4P)	Z1F	Noise filter (With surge absorber)	

2TW27316-1


### NOTES

- This wiring diagram only applies to the outdoor unit
- Field wiring: : field wiring, : indication of parts outside switchbox
- : terminal strip, : connector, : terminal, : Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange



# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

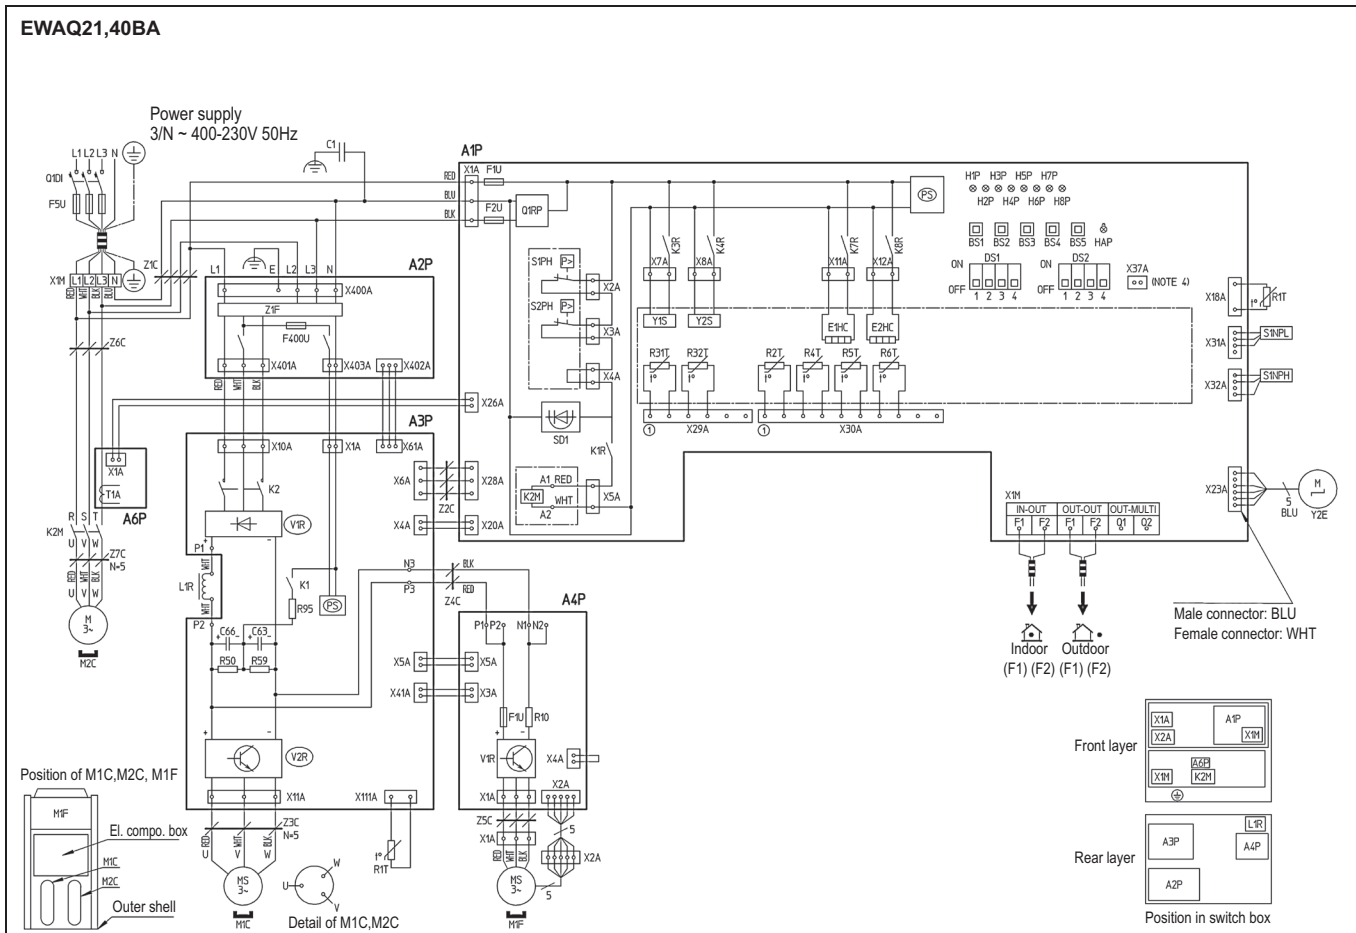

A1P-A6P	Printed circuit board	K2	Magnetic contactor (M1C)	S1NPH	Pressure sensor (high)	
	A1P: Main	A4P: Fan	K2M	Magnetic contactor (M2C)	S1NPL	Pressure sensor (low)
	A2P: Noise filter	A6P: Current sensor	K1R	Magnetic relai (K2M)	S1PH, S2PH	Pressure switch (high)
	A3P: Inverter		K3R-K8R	K3R: Y1S	K7R: E1HC	T1A
BS1-BS5	Push button switch (Mode, set, return, test, reset)	L1R	Reactor	V1R	Safety devices input	
				SD1	Safety devices input	
C1	Capacitor	M1C, M2C	Motor (Compressor)	V1R, V2R	Power module (A4P)	
C63, C66	Capacitor	M1F	Motor (Fan)	X1A, X2A	Connector (M1F)	
DS1, DS2	Dip switch	PS	Switching power supply (A1P, A3P)	X1M	Terminal strip (power supply)	
E1HC, E2HC	Crankcase heater	Q1RP	Phase reversal detect circuit	X1M	Terminal strip (Control) (A1P)	
F1U	Fuse (250V, 8A ⊕) (A4P)	Q1DI	Earth leakage breaker	Y2E	Electronic expansion valve (subcool)	
F1U, F2U	Fuse (250V, 3.15A ⊕) (A1P)	R10	Resistor (current sensor) (A4P)	Y1S-Y2S	Solenoid valve	
F5U	Field fuse	R50, R59	Resistor		Y1S: Hot gas	
F400U	Fuse (250V, 6.3A ⊕) (A2P)	R95	Resistor (current limiting)	Y2S: Oil return		
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test ----- Flickering Malfunction detection --- Light up	R1T-R6T R31T, R32T	Thermistor		Z1C-Z7C	Noise filter (ferrite core)
			R1T: AIR (A1P)	R4T: Heat exch. deicer	Z1F	Noise filter (With surge absorber)
HAP	Pilotlamp (service monitor - green)	R1T: FIN (A3P)	R5T: Heat exch. outlet			
			R2T: Suction	R6T: Liquid pipe		
K1	Magnetic relay	R31T: M1C Discharge	R32T: M2C discharge			

2TW27326-1


**NOTES**

- This wiring diagram only applies to the outdoor unit
- ▬▬▬: field wiring, □: indication of parts outside switchbox
- : terminal strip, □○□: connector, ○-: terminal, ⊕ Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange

# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

EWA-YQ25,50BA

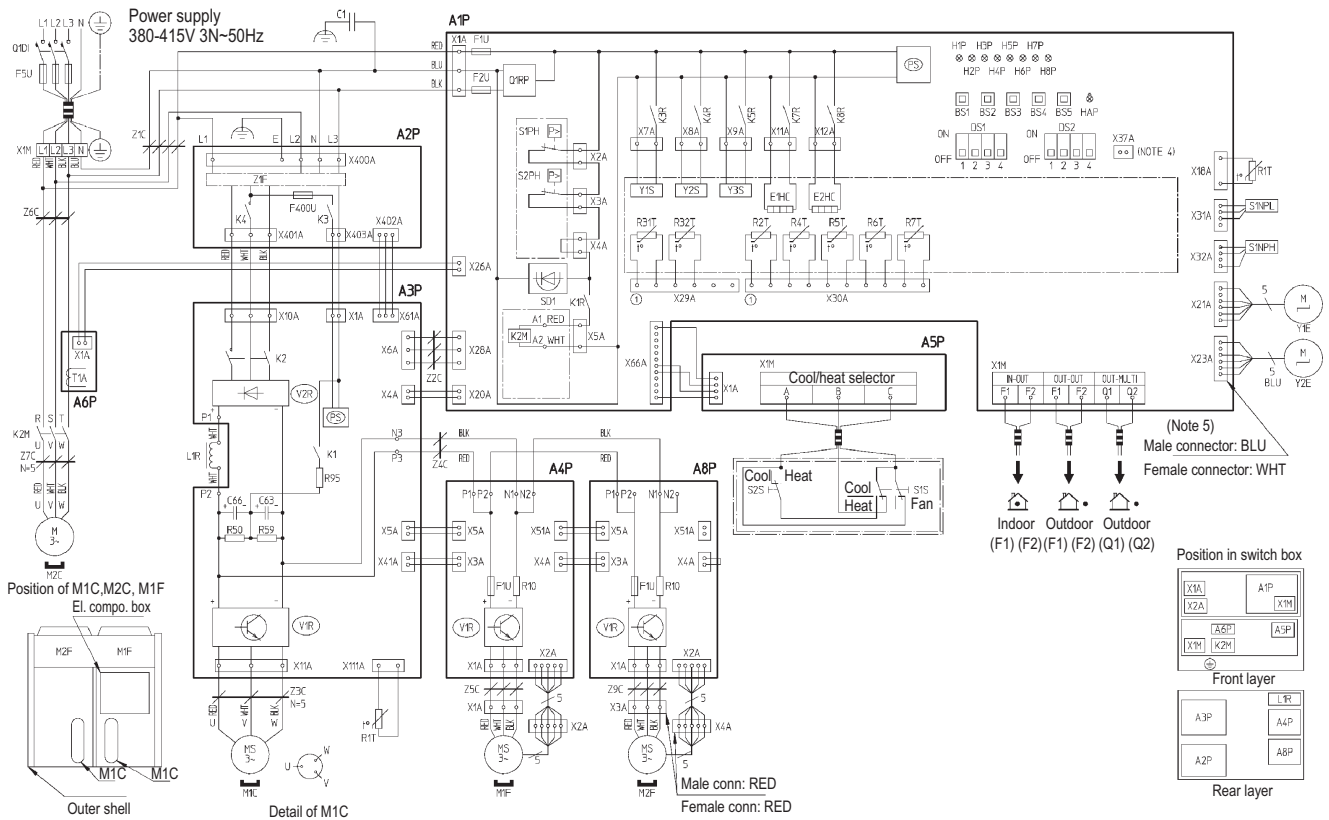

A1P-A6P	Printed circuit board	K1R	Magnetic relays (K2M)	S1PH, S2PH	Pressure switch (high)		
	A1P: Main	A4P, A8P: Fan	K3R-K7R	K3R: Y1S	K7R: E1HC	T1A	Current sensor (A6P)
	A2P: Noise filter	A5P: ABC I/P		K4R: Y2S	K8R: E2HC	SD1	Safety devices input
BS1-BS5	Push button switch (Mode, set, return, test, reset)	L1R	Reactor	V2R	Diode bridge (A3P)		
		M1C, M2C	Motor (Compressor)	X1A-X4A	Connector (M1F, M2F)		
C1	Capacitor	M1F, M2F	Motor (Fan)	X1M	Terminal strip (power supply)		
C63, C66	Capacitor	PS	Switching power supply (A1P, A3P)	X1M	Terminal strip (Control) (A1P)		
DS1, DS2	Dip switch	Q1RP	Phase reversal detect circuit	X1M	Terminal strip (A5P)		
E1HC	Crankcase heater	Q1DI	Earth leakage breaker	Y1E	Electronic expansion valve (main)		
F1U	Fuse (DC 650V, 8A ⊕) (A4P, A8P)	R1T-R7T R31T-R32T	Thermistor	Y2E	Electronic expansion valve (subcool)		
F1U, F2U	Fuse (250V, 3.15A ⊕) (A1P)		R1T: AIR (A1P)	R4T: Heat exch. deicer	Y1S-Y3S	Solenoid valve	
F5U	Field fuse		R1T: FIN (A3P)	R5T: Heat exch. outlet		Y1S: Hot gas	Y3S: 4 way valve
F400U	Fuse (250V, 6.3A ⊕) (A2P)		R2T: Suction	R6T: Liquid pipe		Y2S: Oil return	
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test ----- Flickering Malfunction detection --- Light up	R10	Resistor (current sensor) (A4P)	Z1C-Z9C		Noise filter (ferrite core)	
		K1, K3	Magnetic relay	Z1F	Noise filter (With surge absorber)		
		K2, K4	Magnetic contactor (M1C)	R31T: M1C Discharge	R7T: Accumulator		
K2M	Magnetic contactor (M2C)	R95	Resistor	Cool/heat selector			
		R95	Resistor (current limiting)	S1S	Selector switch (fan/cool-heat)		
		S1NPH	Pressure sensor (high)	S2S	Selector switch (cool-heat)		
		S1NPL	Pressure sensor (low)				

2TW31476-1


**NOTES**

- This wiring diagram only applies to the outdoor unit
- ⊕: field wiring
- : terminal strip, □○□: connector, ○-○: terminal, ⊕ Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange

# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

EWAQ32,64BA

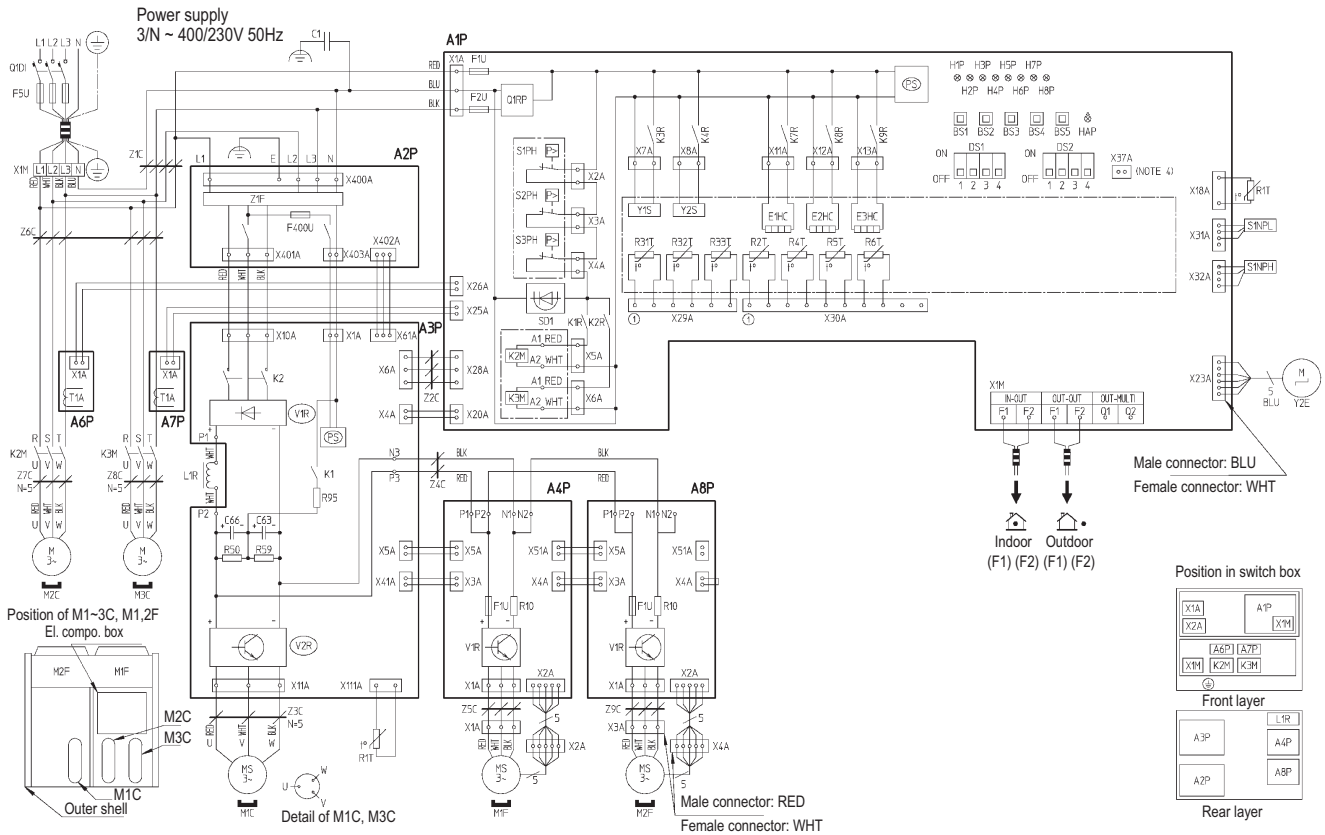

A1P-A7P	Printed circuit board	K2	Magnetic contactor (M1C)	R50, R59	Resistor	
	A1P: Main	A4P, A8P: Fan	K2H, K3H	Magnetic contactor (M2C, M3C)	R95	Resistor (current limiting)
	A2P: Noise filter	A6P, A7P: Current sensor	K1R, K2R	Magnetic relays (K2M, K3M)	S1NPH	Pressure sensor (high)
	A3P: Inverter			K3R: Y1S	K8R: E2HC	S1NPL
BS1-BS5	Push button switch (Mode, set, return, test, reset)	K3R-K9R	K4R: Y2S	K9R: E3HC	S1PH, S2PH	Pressure switch (high)
			K7R: E1HC		T1A	Current sensor (A6P, A7P)
C1	Capacitor	L1R	Reactor	SD1	Safety devices input	
C63, C66	Capacitor	M1C-M3C	Motor (Compressor)	V1R	Power module (A4P, A8P)	
DS1, DS2	Dip switch	M1F, M2F	Motor (Fan)	V1R, V2R	Power module (A3P)	
E1HC-E3HC	Crankcase heater	PS	Switching power supply (A1P, A3P)	X1A, X4A	Connector (M1F, M2F)	
F1U	Fuse (250V, 8A Ⓟ) (A4P, A8P)	Q1RP	Phase reversal detect circuit	X1M	Terminal strip (power supply)	
F1U, F2U	Fuse (250V, 3.15A Ⓟ) (A1P)	Q1DI	Earth leakage breaker	X1M	Terminal strip (control) (A1P)	
F5U	Field fuse	R10	Resistor (current sensor) (A4P, A8P)	Y2E	Electronic expansion valve (subcool)	
F400U	Fuse (250V, 6.3A Ⓟ) (A2P)		Thermistor		Solenoid valve	
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test ----- Flickering Malfunction detection --- Light up	R1T-R6T R31T-R33T	R1T: AIR (A1P)	R33T: M3C discharge	Y1S-Y2S	Y1S: Hot gas
			R1T: FIN (A3P)	R4T: Heat exch. deicer		Y2S: Oil return
			R2T: Suction	R5T: Heat exch. outlet	Z1C-Z5C	Noise filter (ferrite core)
			R31T: M1C Discharge	R6T: Liquid pipe	Z1F	Noise filter (With surge absorber)
HAP	Pilotlamp (service monitor - green)					
K1	Magnetic relay					

2TW27346-1

### NOTES

- This wiring diagram only applies to the outdoor unit
- ▬▬▬: field wiring, □: indication of parts outside switchbox
- : terminal strip, □□: connector, ○: terminal, ⊕: Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange

# 7 Wiring diagrams



## 7 - 1 Wiring Diagrams - Three Phase

EWA/YQ-BA

Wiring diagram - Hydromodule

Part number	Description
A1P	Main PCB (master)
A2P	User interface PCB
A3P	Control PCB
A4P	* Demand PCB
A5P	Main PCB (slave)
A6P	* Demand PCB
A7P	* Remote user Interface PCB
C1 - C3	Filter capacitor
E1H	Switch box heater
E2H	Plate heat exchanger heater (circuit 1)
E3H	Plate heat exchanger heater (circuit 2)
E4H	Water piping heater
E5H	Expansion vessel heater
F1 - F2	Fuse (F, 1A, 250V)
F1U (A*P)	Fuse (T, 3.15A, 250V)
HAP (A*P)	PCB LED
K11E	Electronic expansion valve (circuit 1)
K21E	Electronic expansion valve (circuit 2)
K1P	Pump contactor
K1S	Pump overcurrent relay
K*R (A3P)	PCB relay
M1P	Pump
PS (A*P)	Switching power supply
Q1DI	# Earth leakage circuit breaker
Q1T	Thermostat for expansion vessel heater
R11T	Leaving water thermistor (Circuit 1)
R12T	Returning water thermistor (Circuit 1)
R13T	Refrigerant liquid thermistor (Circuit 1)
R14T	Refrigerant gas thermistor (Circuit 1)
R21T	Leaving water thermistor (Circuit 2)
R22T	Returning water thermistor (Circuit 2)
R23T	Refrigerant liquid thermistor (Circuit 2)
R24T	Refrigerant gas thermistor (Circuit 2)
S1L	Flow switch (Circuit 1)
S2L	Flow switch (Circuit 2)
S1M	Main switch
S1S	# Thermostat Input 1
S2S	# Thermostat input 2
S3S	# Operation ON input
S4S	# Operation OFF input
SS1 (A1P, A5P)	Selector switch (emergency)
SS1 (A2P)	Selector switch (main / sub)
SS1 (A7P)	* Selector switch (main / sub)
V1C - V2C	Ferrite core noise filter
X1M - X4M	Terminal strip
X801M (A*P)	* PCB terminal strip
Z1F - Z2F (A*P)	Noisefilter

\*: field installed option #: field supplied

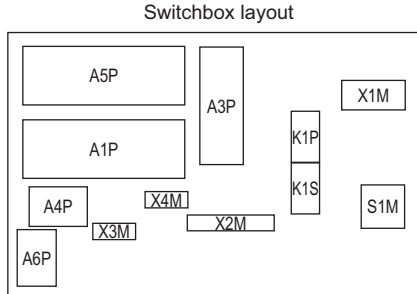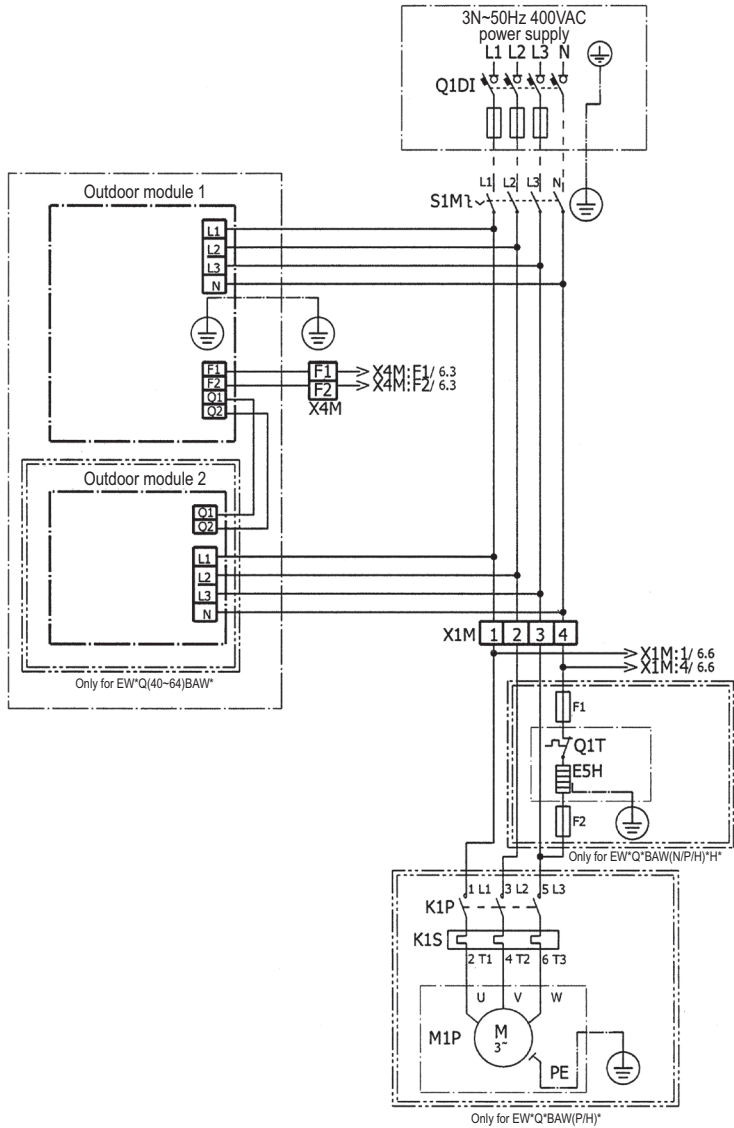

4TW60726-1 (1)


**NOTES**

1. X1M: Terminal; X2M: Field wiring terminal for high voltage; X3M: Field wiring terminal for low voltage; X4M: Factory wiring terminal for low voltage
2. ———— : Earth wiring; - - - - - : Field supply; [ ] : Option; [ ] : Wiring depending on model; [ ] : Not mounted in switch box; [ ] : PCB; 1: Several wiring possibilities
3. User installed options:

- EKRUAHT\* = Remote user interface
- 1x EKRP1AHT\* = Demand PCB (only for EW\*Q(16~32)BAW\*)
- 2x EKRP1AHT\* = Demand PCB's (only for EW\*Q(40~64)BAW\*)

# 7 Wiring diagrams


## 7 - 1 Wiring Diagrams - Three Phase

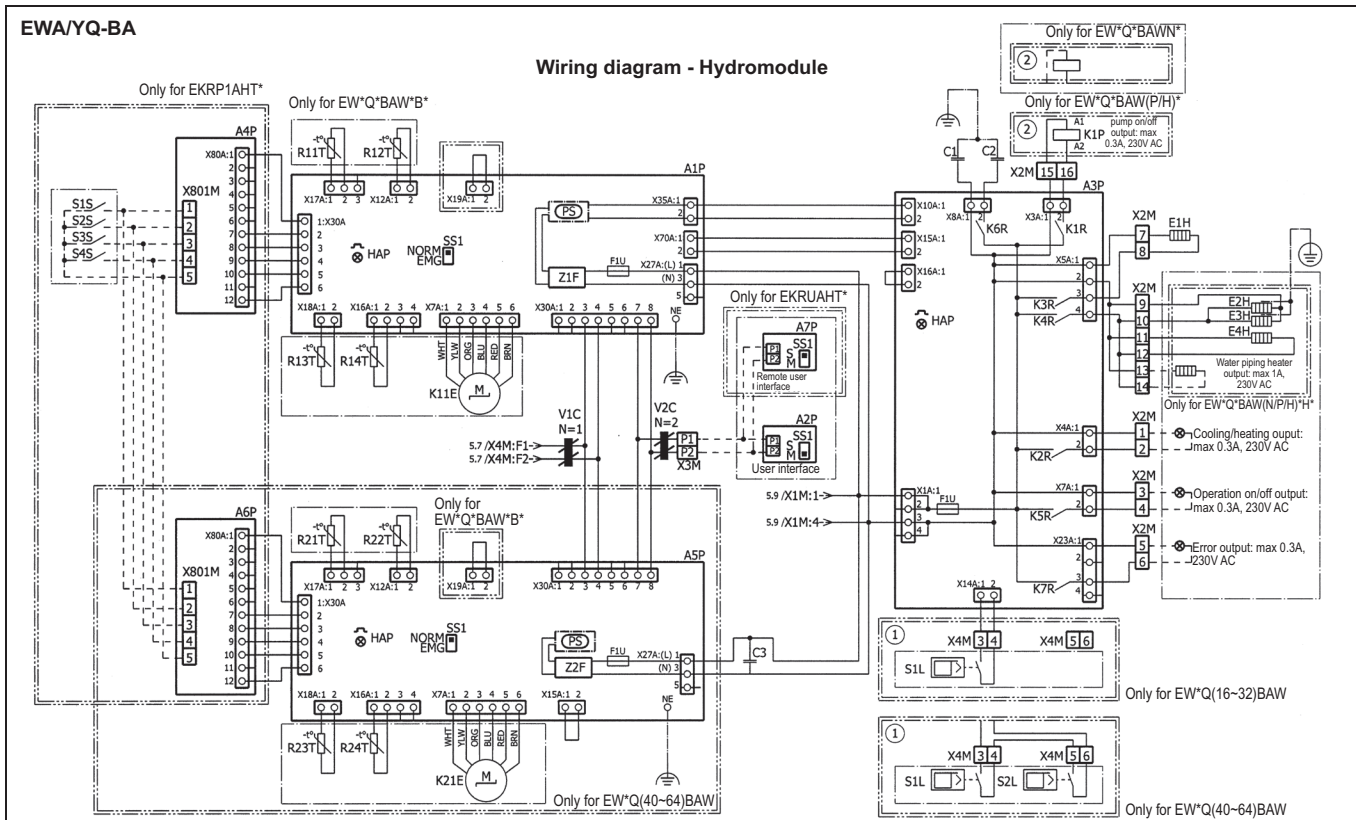

Part number	Description
A1P	Main PCB (master)
A2P	User interface PCB
A3P	Control PCB
A4P	* Demand PCB
A5P	Main PCB (slave)
A6P	* Demand PCB
A7P	* Remote user Interface PCB
C1 - C3	Filter capacitor
E1H	Switch box heater
E2H	Plate heat exchanger heater (circuit 1)
E3H	Plate heat exchanger heater (circuit 2)
E4H	Water piping heater
E5H	Expansion vessel heater
F1 - F2	Fuse (F, 1A, 250V)
F1U (A*P)	Fuse (T, 3.15A, 250V)
HAP (A*P)	PCB LED
K11E	Electronic expansion valve (circuit 1)
K21E	Electronic expansion valve (circuit 2)
K1P	Pump contactor
K1S	Pump overcurrent relay
K*R (A3P)	PCB relay
M1P	Pump
PS (A*P)	Switching power supply
Q1DI	# Earth leakage circuit breaker
Q1T	Thermostat for expansion vessel heater
R11T	Leaving water thermistor (Circuit 1)
R12T	Returning water thermistor (Circuit 1)
R13T	Refrigerant liquid thermistor (Circuit 1)

R14T	Refrigerant gas thermistor (Circuit 1)
R21T	Leaving water thermistor (Circuit 2)
R22T	Returning water thermistor (Circuit 2)
R23T	Refrigerant liquid thermistor (Circuit 2)
R24T	Refrigerant gas thermistor (Circuit 2)
S1L	Flow switch (Circuit 1)
S2L	Flow switch (Circuit 2)
S1M	Main switch
S1S	# Thermostat Input 1
S2S	# Thermostat input 2
S3S	# Operation ON input
S4S	# Operation OFF input
SS1 (A1P, A5P)	Selector switch (emergency)
SS1 (A2P)	Selector switch (main / sub)
SS1 (A7P)	* Selector switch (main / sub)
V1C - V2C	Ferrite core noise filter
X1M - X4M	Terminal strip
X801M (A*P)	* PCB terminal strip
Z1F - Z2F (A*P)	Noisefilter

\*: field installed option #: field supplied

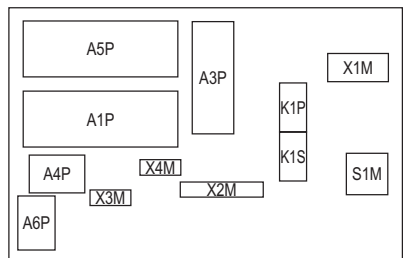

Switchbox layout

4TW60726-1 (2)

### NOTES

- X1M: Terminal; X2M: Field wiring terminal for high voltage; X3M: Field wiring terminal for low voltage; X4M: Factory wiring terminal for low voltage
- : Earth wiring; - - -: Field supply; [ ]: Option; [ ]: Wiring depending on model; [ ]: Not mounted in switch box; [ ]: PCB; 1: Several wiring possibilities
- User installed options:

- EKRUAH\* = Remote user interface
- 1x EKRP1AHT\* = Demand PCB (only for EW\*Q(16-32)BAW\*)
- 2x EKRP1AHT\* = Demand PCB's (only for EW\*Q(40-64)BAW\*)


# 8 External connection diagrams

## 8 - 1 External Connection Diagrams

EWA/YQ-BA

Electrical connection diagram

For more details please check unit wiring diagram

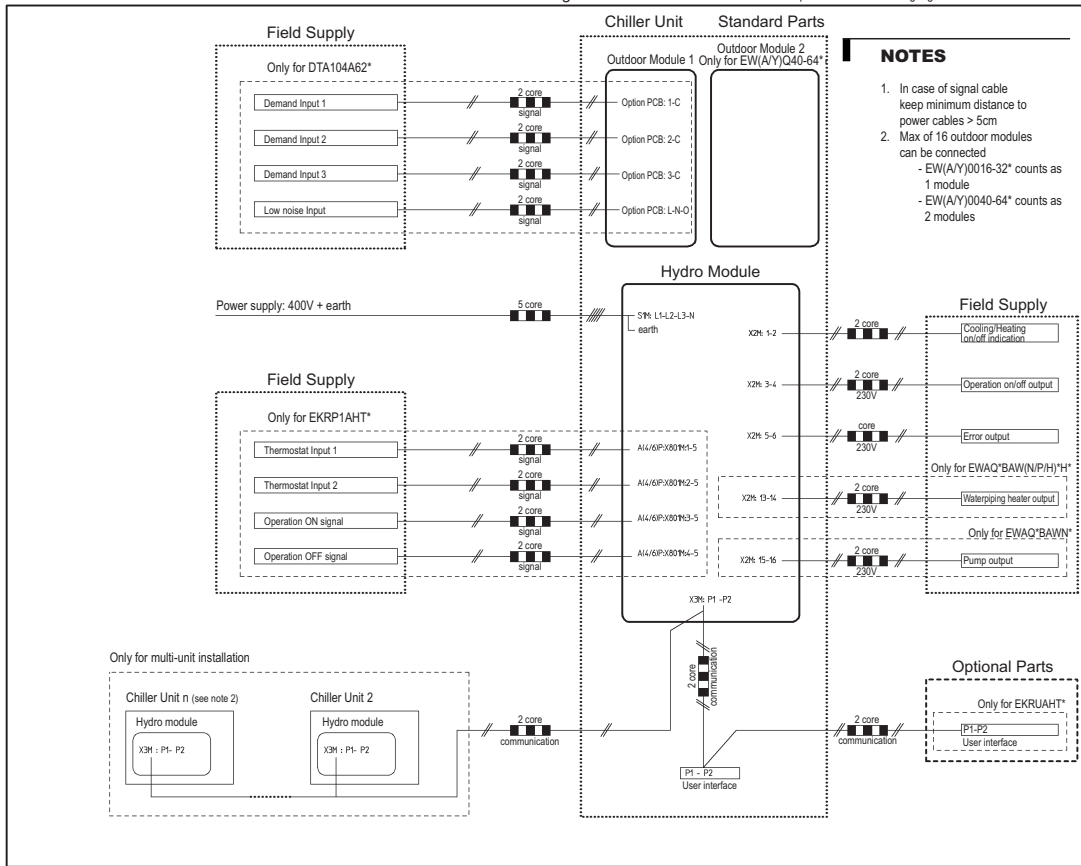

**NOTES**

- In case of signal cable keep minimum distance to power cables > 5cm
- Max of 16 outdoor modules can be connected
  - EWA(Y)0016-32\* counts as 1 module
  - EWA(Y)0040-64\* counts as 2 modules

1  
8

3TW60726-2

## 9 Sound data

### 9 - 1 Sound Power Spectrum

#### EWA/YQ-BA

Models LWE=7°C / Tamb=35°C								Total (dBA)
	125	250	500	1000	2000	4000	8000	LwA
EW(A/Y)Q016BAW*	84	79	76	73	67	65	61	78
EW(A/Y)Q021BAW*	84	80	77	73	66	60	53	78
EW(A/Y)Q025BAW*	84	80	77	73	66	60	53	78
EW(A/Y)Q032BAW*	84	80	80	75	68	63	62	80
EW(A/Y)Q040BAW*	87	83	80	76	69	63	56	81
EW(A/Y)Q050BAW*	87	83	80	76	69	63	56	81
EW(A/Y)Q064BAW*	87	83	83	78	71	66	65	83

#### NOTES

1. Values of Sound power according to **ISO3744**
2. LWE = Leaving water evaporator temperature  
Tamb = Ambient temperature

4TW60717-1A



# 10 Installation

## 10 - 1 Water Charge, Flow and Quality

### EWA/YQ-BA

This table is from JRA GL-02-1994

JRA: Japanese Refrigerant Association

ITEMS (1) (5)	Cooling water (3)			Cooled water		Heated water (2)				Tendency if out of criteria		
	Circulating system		Once flow	Circulating water [below 20°C]	Supply water (4)	Low temperature		High temperature				
	Circulating water	Supply water (4)	Flowing water			Circulating water [20°C~60°C]	Supply water (4)	Circulating water [60°C~80°C]	Supply water (4)			
pH	at 25°C		6.5~8.2	6.0~8.0	6.8~8.0	6.8~8.0	7.0~8.0	7.0~8.0	7.0~8.0	7.0~8.0	corrosion + scale	
Electrical conductivity	[mS/m] at 25°C		below 80	below 30	below 40	below 40	below 30	below 30	below 30	below 30	corrosion + scale	
	(µS/cm) At 25°C(1)		(below 800)	(below 300)	(below 400)	(below 400)	(below 300)	(below 300)	(below 300)	(below 300)	corrosion + scale	
Chloride ion	[mgCl <sup>-</sup> /l]		below 200	below 50	below 50	below 50	below 50	below 50	below 50	below 30	below 30	corrosion
Sulfate ion	[mgSO <sub>4</sub> <sup>2-</sup> /l]		below 200	below 50	below 50	below 50	below 50	below 50	below 50	below 30	below 30	corrosion
M-alkalinity (pH4.8)	[mgCaCO <sub>3</sub> /l]		below 100	below 50	below 50	below 50	below 50	below 50	below 50	below 50	below 50	scale
Total hardness	[mgCaCO <sub>3</sub> /l]		below 200	below 70	below 70	below 70	below 70	below 70	below 70	below 70	below 70	scale
Calcium hardness	[mgCaCO <sub>3</sub> /l]		below 150	below 50	below 50	below 50	below 50	below 50	below 50	below 50	below 50	scale
Silica ion	[mgSiO <sub>2</sub> /l]		below 50	below 30	below 30	below 30	below 30	below 30	below 30	below 30	below 30	scale
Iron	[mgFe/l]		below 1.0	below 0.3	below 1.0	below 1.0	below 0.3	below 1.0	below 0.3	below 1.0	below 0.3	corrosion + scale
Copper	[mgCu/l]		below 0.3	below 0.1	below 1.0	below 1.0	below 0.1	below 1.0	below 0.1	below 1.0	below 0.1	corrosion
Sulfide ion	[mgS <sup>2-</sup> /l]		not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	corrosion
Ammonium ion	[mgNH <sub>4</sub> <sup>+</sup> /l]		below 1.0	below 0.1	below 1.0	below 1.0	below 0.1	below 0.3	below 0.1	below 0.1	below 0.1	corrosion
Remaining chloride	[mgCl/l]		below 0.3	below 0.3	below 0.3	below 0.3	below 0.3	below 0.25	below 0.3	below 0.1	below 0.3	corrosion
Free carbide	[mgCo <sub>3</sub> /l]		below 4.0	below 4.0	below 4.0	below 4.0	below 4.0	below 0.4	below 4.0	below 0.4	below 4.0	corrosion
Stability index			6.0~7.0	---	---	---	---	---	---	---	---	corrosion + scale

#### NOTES


- Names, definitions and units are according to JIS K 0101. Units and figures between brackets are old units published as reference only.
- In case of using heated water (more than 40°C), corrosion is generally noticeable. Especially when the iron material is in direct contact with water without any protection shields, it is desirable to give the valid measures for corrosion. e.g. chemical measure,...
- In the cooling water using hermetic cooling tower, closed circuit water is according to heated water standard, and scattered water is according to cooling water standard.
- Supply water is considered drink water, industrial water and ground water except for genuine water, neutral water and soft water.
- The above mentioned items are representable items in corrosion and scale cases.

3TW50179-1



# 11 Operation range




## 11 - 1 Operation Range

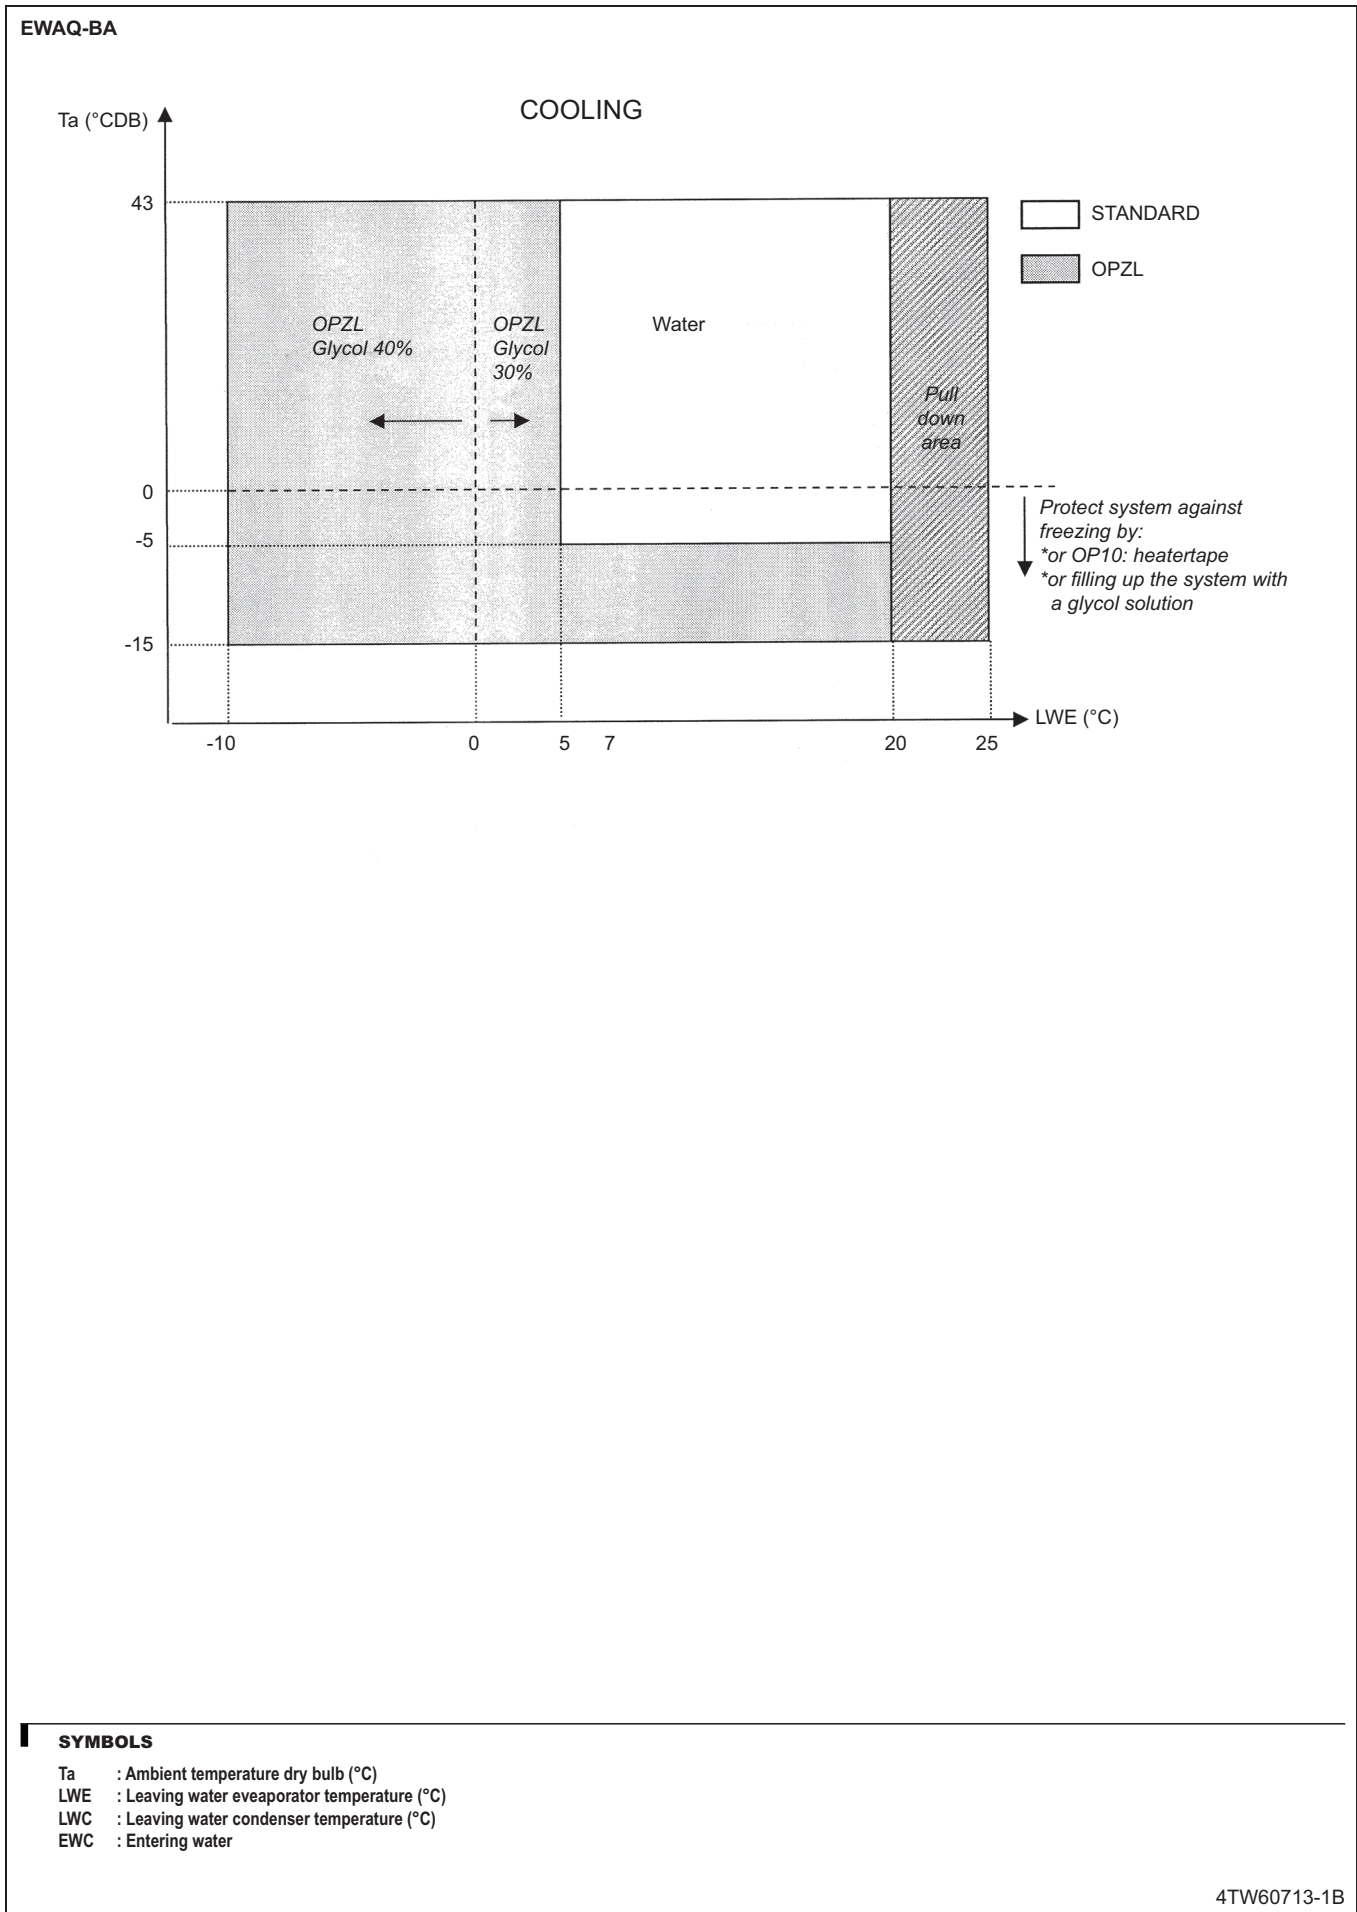

# 12 Hydraulic performance

## 12 - 1 Static Pressure Drop Unit

1  
12

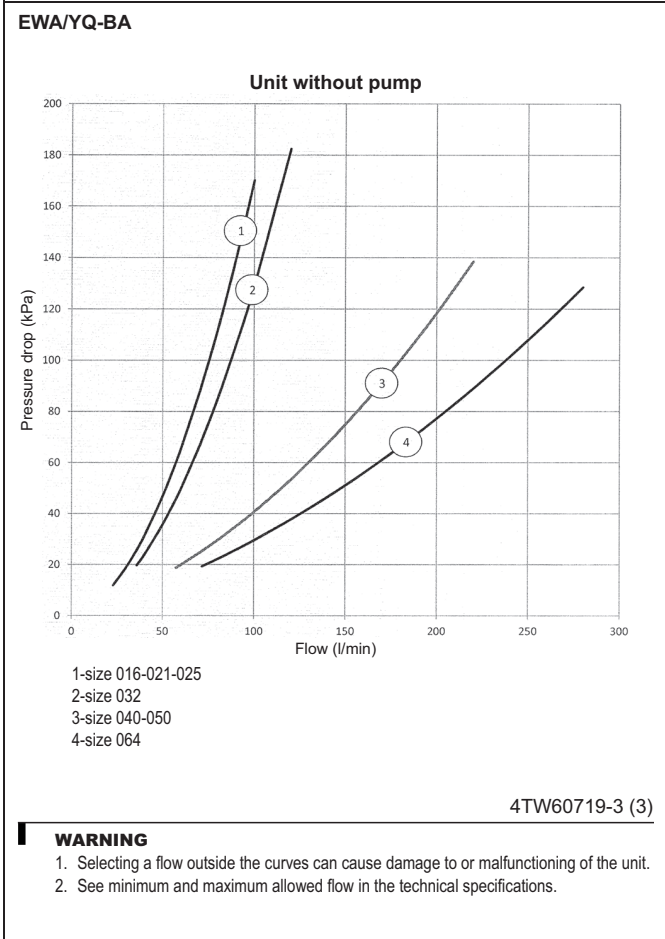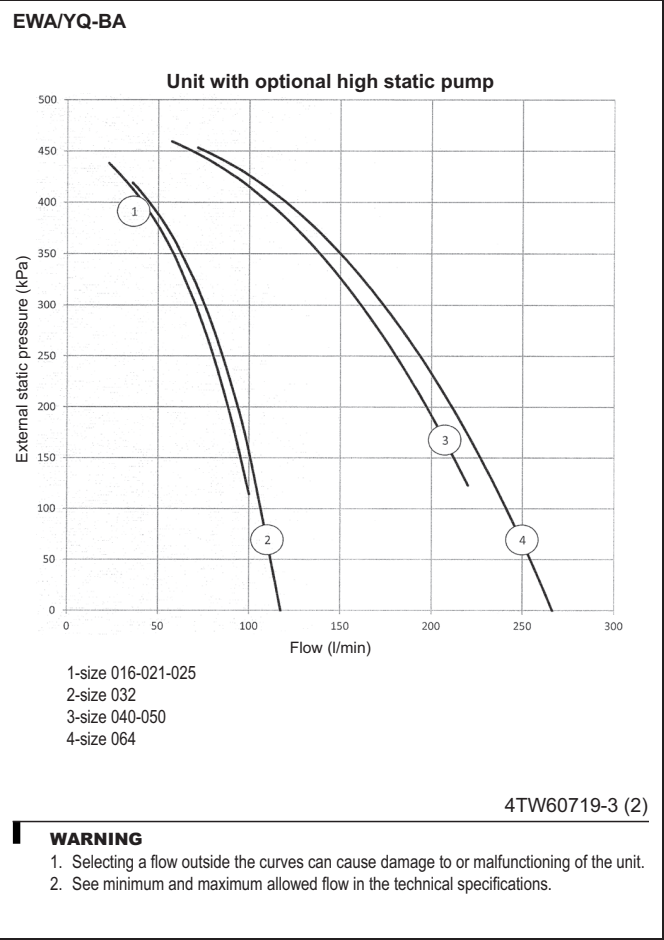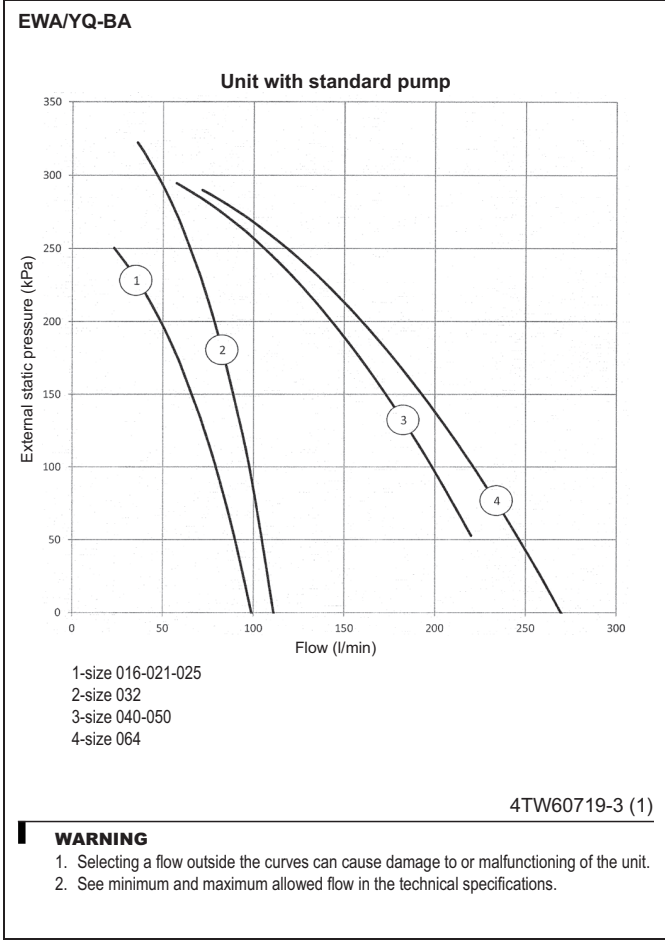

# TABLE OF CONTENTS

## EWYQ-BA\*

1	Features .....	34
2	Specifications .....	35
	Technical Specifications .....	35
	Electrical Specifications .....	37
3	Options .....	38
	Options .....	38
4	Capacity tables .....	40
	Cooling Capacity Tables .....	40
	Heating Capacity Tables .....	44
	Capacity Correction Factor .....	46
5	Dimensional drawings .....	47
	Dimensional Drawings .....	47
6	Piping diagrams .....	49
	Piping Diagrams .....	49
7	Wiring diagrams .....	53
	Wiring Diagrams - Three Phase .....	53
8	External connection diagrams .....	59
	External Connection Diagrams .....	59
9	Sound data .....	60
	Sound Power Spectrum .....	60
10	Installation .....	61
	Water Charge, Flow and Quality .....	61
11	Operation range .....	62
	Operation Range .....	62
12	Hydraulic performance .....	63
	Static Pressure Drop Unit .....	63

# 1 Features

- Inverter chiller
- High efficiency with leader-of-class ESEER (up to 4.75)
- Minimal starting currents and short payback times
- No buffertank required for standard applications
- Daikin scroll compressor
- Large operation range (ambient temperature up to 43°C)
- Digital remote controller



2

1

## 2 Specifications

2-1 Technical Specifications				EWYQ016BAW*	EWYQ021BAW*	EWYQ025BAW*	EWYQ032BAW*	EWYQ040BAW*	EWYQ050BAW*	EWYQ064BAW*	
Cooling capacity	Nom.		kW	16.8 (1)	21.0 (1)	25.2 (1)	31.5 (1)	42.0 (1)	50.4 (1)	63.0 (1)	
	Max.		kW	20.0 (1)	25.0 (1)	30.0 (1)	37.5 (1)	50.0 (1)	60.0 (1)	75.0 (1)	
Heating capacity	Nom.		kW	16.8 (2)	21.0 (2)	25.2 (2)	31.5 (2)	42.0 (2)	50.4 (2)	63.0 (2)	
	Max.		kW	20.0 (2)	25.0 (2)	30.0 (2)	37.5 (2)	50.0 (2)	60.0 (2)	75.0 (2)	
Capacity control	Method			Inverter controlled							
	Minimum capacity		%	25							
	Maximum capacity		%	120							
Power input	Cooling	Nom.	kW	5.57 (3)	7.25 (3)	9.25 (3)	12.9 (3)	14.9 (3)	19.0 (3)	26.7 (3)	
	Heating	Nom.	kW	5.51 (3)	7.09 (3)	8.87 (3)	10.5 (3)	14.2 (3)	17.8 (3)	21.0 (3)	
EER				3.01 (1)	2.90 (1)	2.72 (1)	2.44 (1)	2.82 (1)	2.65 (1)	2.36 (1)	
ESEER				4.75	4.65	4.45	4.00	4.60	4.40	3.95	
COP				3.05 (2)	2.96 (2)	2.84 (2)	3.00 (2)	2.96 (2)	2.83 (2)	3.00 (2)	
Casing	Colour			Daikin White							
	Material			Polyester coated galvanised steel plate							
Dimensions	Unit	Height	mm	1,684							
		Width	mm	1,371			1,684	2,358		2,980	
		Depth	mm	774				780			
	Packed unit	Height	mm	1,860							
		Width	mm	1,394			1,707	2,377		2,997	
		Depth	mm	834				838			
Weight	Unit		kg	264	317	397	571	730			
	Operation weight		kg	267	320	401	577	738			
	Packed unit		kg	291	344	428	616	783			
Packing	Material			Carton / Wood / Plastic							
	Weight		kg	27			31	45	53		
Water heat exchanger	Type			Brazen plate							
	Quantity			1				2			
	Filter	Material			Brass						
		Diameter perforations	mm	0.6							
	Water volume		l	1.9			2.9	3.8		5.7	
	Water flow rate	Min.	l/min	23			36	46		72	
	Nominal water flow	Cooling	l/min	48 (1)	60 (1)	72 (1)	90 (1)	120 (1)	144 (1)	181 (1)	
		Heating	l/min	48	60	72	90	120	144	181	
	Maximum water flow	Cooling	l/min	72	90	108	135	181	217	271	
		Heating	l/min	72	90	108	135	181	217	271	
	Nominal water pressure drop	Cooling	Total	kPa	20	30	42	30		42	30
		Insulation material			Nitrile rubber based elastomeric foam						
	Model	Type		ACH70-40H			ACH70-60H	ACH70-40H		ACH70-60H	
Air heat exchanger	Length		mm	1,778			2,088	1,778		2,088	
	Type			Hi-XSS (8)							
	Rows	Quantity		2							
	Stages	Quantity		54							
	Fin pitch		mm	2.0							
	Passes	Quantity		18			21	18	21		
	Face area		m <sup>2</sup>	2.112			2.481	2.112		2.481	
	Empty tubeplate hole			0							
	Fin	Type			Non-symmetric waffle louvre						
		Treatment			Hydrophilic and anti-corrosion resistant						
	Fan	Quantity			1			2		4	
Type			Axial								
Air flow rate		Cooling	Nom.	m <sup>3</sup> /min	171	185	233	370		466	
		Heating	Nom.	m <sup>3</sup> /min	171	185	233	370		466	
Discharge direction			Vertical								
External static pressure	Max.	Pa	78								

2  
2

## 2 Specifications

2-1 Technical Specifications				EWYQ016BAW*	EWYQ021BAW*	EWYQ025BAW*	EWYQ032BAW*	EWYQ040BAW*	EWYQ050BAW*	EWYQ064BAW*		
Fan motor	Model			Brushless DC motor								
	Output	W		750		350		750		350		
	Quantity				1				2		4	
	Position	Vertical										
	Drive	Direct drive										
Fan motor 2	Output	W		-		350		750		350		
Fan motor 3	Output	W		-								
Fan motor 4	Output	W		-								
Sound power level	Cooling	Nom.	dBA	78		80		81		83		
Compressor	Type			Hermetically sealed scroll compressor								
	Quantity			1	2		3		4		6	
	Motor (INV)	Crankcase heater	W		33							
		Model			Inverter							
		Quantity			1			2				
	Motor (ON-OFF)	Crankcase heater	W		33							
		Model			ON/OFF							
Quantity			0	1		2		4				
Operation range	Water side	Cooling	Min.	°CDB	5							
			Max.	°CDB	20							
		Heating	Min.	°CDB	25							
			Max.	°CDB	50							
	Air side	Cooling	Min.	°CDB	-5							
			Max.	°CDB	43							
		Heating	Min.	°CDB	-15							
			Max.	°CDB	35							
Refrigerant	Type			R-410A								
	Charge			kg		7.6		9.6		15.2		19.2
	Control			Electronic expansion valve								
	Circuits	Quantity		1								
Water circuit	Piping connections diameter		inch	1-1/4" (female)				2" (female)				
	Piping		inch	1-1/4"						1-1/2"		
	Drain valve / fill valve			Yes								
	Shut off valve			Yes								
	Nominal water pressure drop	Cooling	kPa	44 (7)	66 (7)	92 (7)	106 (7)	53 (7)	71 (7)	67 (7)		
	Total water volume			l		3.2 (4)		4.2 (4)		5.8 (4)		7.7 (4)
	Minimum water volume in the system for cooling			l			33 (5)			66 (5)		
	Minimum water volume in the system for heating			l		76 (6)		110 (6)		152 (6)		220 (6)
	Air purge valve			Yes								
	flowswitch			yes								
Refrigerant oil	Type			Synthetic (ether) oil								
Defrost method				Reversed cycle								
Defrost control				Sensor for outdoor heat exchanger temperature								
Safety devices	Item	01		High pressure switch								
		02		Overcurrent relay								
		03		Inverter overload protector								
		04		Fuse								
PED	Category			Category II								
	Most critical part	Name		Accumulator								
		Ps*V	Bar*l	335		385		335		385		

## 2 Specifications

2-2 Electrical Specifications			EWYQ016BAW*	EWYQ021BAW*	EWYQ025BAW*	EWYQ032BAW*	EWYQ040BAW*	EWYQ050BAW*	EWYQ064BAW*	
Power supply	Name		W1							
	Phase		3N~							
	Frequency	Hz	50							
	Voltage		V							
	Voltage range	Min.	%	-10						
Max.		%	10							
Unit	Maximum starting current		A	0 (9)	77.7	78.7	88.7	99.8	101.9	120.7
	Current	Zmax	Text	-	0.27		0.24	0.25		0.22
	Maximum running current		A	22.2	25.3	26.4	35.2	47.4	49.6	67.2
	Minimum Ssc value			1,141	853		840	1,706		1,679
	Recommended fuses			25	32		40	50	63	80
Cable requirements	Power supply	Required number of conductors		4 + GND						
	Remote control	Quantity of wires		2						
		Maximum running current		Minimum cable section 0,75 mm <sup>2</sup>						
	Cooling/Heating output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Operation ON/OFF output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Error output	Quantity of wires		2						
		Maximum running current	A	0.3						
	Pump ON/OFF output	Quantity of wires		2						
		Maximum running current	A	0.3						

### Notes

- (1) Condition: Ta 35°C - LWE 7°C ( DT = 5°C)
- (2) Condition: Ta DB/WB 7°C/6°C - LWC 45°C (Dt=5°C)
- (3) Pump is not included
- (4) Including piping + PHE; excluding expansion vessel
- (5) Excluding water volume in the unit. In most applications this minimum water volume will have a satisfying result. In critical processes or in rooms with a high heat load though, extra water volume might be required. Refer to operation range for more info.
- (6) Excluding the water volume in the unit. This volume will guarantee sufficient defrost energy for all applications, however, this volume can be multiplied by 0,66 if the heating sepoint is  $\geq 45^\circ\text{C}$  (eg. Fan coils)
- (7) This is PD between inlet & outlet connections of unit. It includes the water side heat exchanger pressure drop.
- (8) This is ESP between inlet & outlet connections of unit. It consists out of pump SP minus all internal PD's.
- (9) No peak current because of inverter compressor
- (10) In accordance with EN/IEC 61000-3-11, respectively EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with  $Z_{\text{sys}} \leq Z_{\text{max}}$ , respectively  $S_{\text{sc}} \geq \text{minimum } S_{\text{sc}}$  value.
- (11) EN/IEC 61000-3-11: European/international technical standard setting the limits for voltage changes, voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated  $\leq 75\text{A}$
- (12) EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current  $> 16\text{A}$  and  $\leq 75\text{A}$  per phase
- (13) Ssc: Short-circuit power
- (14) Zsys: system impedance

### 3 Options

#### 3 - 1 Options

2  
3

EWA/YQ-BA											
TECHNICAL SPECIFICATIONS OF OPTICAL EQUIPMENT											
			016	021	025	032	040	050	064		
OPSP	Pump	Type	Horizontal multistage end-suction								
		Qty	1								
		Manufacturer	Grundfos								
		Model	CM5-3				CM5-4		CM10-2		
		Efficiency	%		-		77.4		79.6		
		Efficiency level	IE2								
		Rated speed	rpm		2770-2820		2840-2870		2820-2860		
		Rated output	kW		0.65		0.85		1.2		
	Water circuit	Safety valve	bar		3.0						
		Manometer	Yes								
		Expansion vessel	Volume	l				10		12	
			Pre-pressure	bar							
	Nom. External Static Pressure	Cooling (1)	kPa	202	169	128	142	232	198	169	
	Weight of unit	Machine net weight	kg		276	328	328	408	596	596	754
Packed machine weight		kg		303	355	355	440	641	641	807	
Operating weight		kg		279	331	331	412	602	602	762	
OPHP	Pump	Type	Horizontal multistage end-suction								
		Qty	1								
		Manufacturer	Grundfos								
		Model	CM5-5				CM10-3				
		Efficiency	%		79.6				83.2		
		Efficiency level	IE2								
		Rated speed	rpm		2820-2860				2890-2920		
		Rated output	kW		1.2				2.2		
	Water circuit	Safety valve	bar		3.0						
		Manometer	Yes								
		Expansion vessel	Volume	l				10		12	
			Pre-pressure	bar							
	Nom. External Static Pressure	Cooling (1)	kPa	382	343	292	221	384	338	284	
	Weight of unit	Machine net weight	kg		279	332	332	411	604	604	763
Packed machine weight		kg		306	359	359	443	648	648	815	
Operating weight		kg		282	335	335	415	610	610	771	
OP10	Operation range	Ambient	Min	°CDB refer to "operation range"							
OPZL	Operation range cooling	Ambient	Min	°CDB refer to "operation range"							
		Waterside	Min	°C refer to "operation range"							

ELECTRICAL SPECIFICATIONS OF OPTICAL EQUIPMENT										
			016	021	025	032	040	050	064	
OPSP										
Current	Maximum starting current (cooling/heating)		A	(7)	79.5	80.5	90.5	102.8	104.9	123.7
	Maximum running current		A	24.0	27.1	28.2	37.0	50.4	52.6	70.2
	Recommended fuses		A	25	32	32	40	63	63	80
OPHP										
Current	Maximum starting current (cooling/heating)		A	(7)	79.9	81.7	91.7	103.7	106.3	125.1
	Maximum running current		A	24.4	27.5	29.4	38.2	51.3	54.0	71.6
	Recommended fuses		A	32	32	32	40	63	63	80
OP10										
Cable requirements	Water piping heater output		Quantity of wires		2					
			Maximum running current		1A					
EKRP1AHT*										
Cable requirements	Thermostat ON/OFF signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Thermostat cooling/heating signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Operation ON signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
	Operation OFF signal	Quantity of wires		2						
		Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>						
EKRUAHT*										
Cable requirements	Secondary remote control		Quantity of wires		2					
			Maximum running current		Minimum cable section 0.75 mm <sup>2</sup>					

#### NOTES

1. Additional or different specs compared to standard

3TW60711-1A



### 3 Options

#### 3 - 1 Options

EWA/YQ-BA														
Option availability														
Reference	Description	EW(A/Y)Q*BA							Availability	DIGIT				Numeric optioncodes
		016	021	025	032	040	050	064		11	12	13	14	
-	Standard hydraulic package Filter, shut-off valves, drain/fill valve, automatic air purge Flowswitch	○	○	○	○	○	○	○	Factory mounted	N				-
OPSP	Additional hydraulic components: pump, expansion vessel, safety valve, pressure gauge	○	○	○	○	○	○	○	Factory mounted	P				78
OPHP	= OPSP but pump with higher static pressure	○	○	○	○	○	○	○	Factory mounted	H				79
OP10	Heatertape for freeze prevention during winter standstill	○	○	○	○	○	○	○	Factory mounted			H		57
OPZL	Low leaving water operation down to -10°C	○	○	○	○	○	○	○	Factory mounted		B			08b
EKRP1AHT*	Demand PCB with additional inputs for: Remote ON/OFF Remote cooling/heating Remote thermo ON/OFF	○	○	○	○	○	○	○	KIT					
EKRUAHT*	Additional remote user interface	○	○	○	○	○	○	○	KIT					
BHGP26A1	Digital pressure gauges	○	○	○	○	○	○	○	KIT					
DTA104A62	External control adapter for: Demand control Low noise control	○	○	○	○	○	○	○	KIT					

3TW60719-1A

2

3

# 4 Capacity tables

## 4 - 1 Cooling Capacity Tables

2  
4

EWA/YQ-BA

Cooling - Maximum performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
5	016	20,0	5,82	20,0	6,47	20,0	7,48	20,0	8,69	19,4	9,38
	021	25,0	7,48	25,0	8,22	25,0	9,08	25,0	9,99	25,0	11,8
	025	28,2	9,03	28,0	9,94	28,0	10,8	27,3	11,5	26,1	12,7
	032	37,5	12,8	37,5	14,8	37,0	16,6	35,8	18,2	30,3	16,4
	040	50,0	15,6	50,0	16,8	50,0	18,7	50,0	21,0	50,0	24,9
	050	54,1	17,9	55,0	19,9	54,5	21,6	53,0	23,0	50,3	25,4
7	064	73,9	26,8	72,8	29,8	71,7	33,1	69,0	36,2	58,9	33,2
	016	20,0	5,11	20,0	5,64	20,0	6,42	20,0	7,45	20,0	8,76
	021	25,0	6,92	25,0	7,59	25,0	8,39	25,0	9,25	25,0	10,7
	025	30,0	8,94	30,0	10,3	30,0	11,3	30,0	12,7	28,2	13,6
	032	37,5	11,7	37,5	13,6	37,5	16,0	37,5	18,2	31,1	15,7
	040	50,0	14,3	50,0	15,6	50,0	17,2	50,0	19,3	50,0	22,4
10	050	60,0	18,7	60,0	21,3	60,0	23,5	60,0	27,4	54,7	27,2
	064	75,0	25,5	75,0	29,1	75,0	33,5	75,0	39,4	60,0	31,3
	016	20,0	4,56	20,0	4,97	20,0	5,62	20,0	6,37	20,0	7,18
	021	25,0	6,32	25,0	6,99	25,0	7,72	25,0	8,52	25,0	9,53
	025	30,0	8,14	30,0	9,45	30,0	10,6	30,0	11,5	29,0	12,3
	032	37,5	10,6	37,5	12,2	37,5	14,5	37,5	16,3	32,0	14,5
15	040	50,0	12,7	50,0	14,1	50,0	15,6	50,0	17,4	50,0	19,7
	050	60,0	16,6	60,0	19,2	60,0	21,5	60,0	23,5	57,6	25,7
	064	75,0	23,1	75,0	26,1	75,0	30,7	75,0	35,2	62,5	29,4
	016	20,0	3,66	20,0	4,23	20,0	4,78	20,0	5,38	20,0	6,09
	021	25,0	5,38	25,0	6,03	25,0	6,73	25,0	7,45	25,0	8,20
	025	30,0	6,62	30,0	7,66	30,0	8,80	30,0	9,73	30,0	10,7
18	032	37,5	9,17	37,5	10,5	37,5	12,0	37,5	13,8	33,1	12,6
	040	50,0	10,8	50,0	12,1	50,0	13,5	50,0	15,0	50,0	16,6
	050	60,0	13,8	60,0	15,8	60,0	18,1	60,0	19,8	60,0	22,0
	064	75,0	19,7	75,0	21,9	75,0	25,1	75,0	28,9	65,1	25,6
	016	20,0	3,33	20,0	3,76	20,0	4,29	20,0	4,89	20,0	5,53
	021	25,0	4,91	25,0	5,53	25,0	6,29	25,0	7,01	25,0	7,73
18	025	30,0	6,00	30,0	6,93	30,0	8,02	30,0	8,94	30,0	9,79
	032	37,5	8,25	37,5	9,48	37,5	10,8	37,5	12,5	34,1	11,7
	040	50,0	10,0	50,0	11,3	50,0	12,7	50,0	14,0	50,0	15,6
	050	60,0	12,5	60,0	14,3	60,0	16,6	60,0	18,6	60,0	20,2
	064	75,0	17,8	75,0	19,8	75,0	22,8	75,0	26,5	67,7	24,2

**NOTES**

- Cooling capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range Dt = 3 - 8°C
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

**SYMBOLS**

- CC : Cooling capacity (kW)
- PI : Power input (kW)
- LWE : Leaving Water Evaporator temperature (°C)
- Tamb : Ambient temperature (°C)

3TW60722-1(1)

## 4 Capacity tables

### 4 - 1 Cooling Capacity Tables

EWY/YQ-BA

Cooling OPZL - Maximum performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
-10	016	12,4	6,16	12,4	6,70	12,2	7,35	11,8	7,90	11,2	8,46
	021	17,6	8,21	17,5	8,66	17,0	9,40	16,3	10,1	15,3	11,1
	025	18,0	8,53	17,9	8,97	17,5	9,74	16,7	10,4	15,7	11,5
	032	25,3	12,2	24,5	13,5	22,6	14,9	20,7	16,3	16,7	14,3
	040	34,8	15,9	34,3	17,3	33,3	18,8	31,8	20,1	29,9	22,1
	050	35,2	16,3	34,9	17,9	33,9	19,4	32,5	20,8	30,6	22,8
-5	064	49,1	24,3	47,2	26,9	43,5	29,7	40,1	32,8	31,9	28,1
	016	15,3	6,49	15,2	6,97	14,9	7,63	14,3	8,19	13,5	8,76
	021	21,0	8,71	20,9	8,99	20,4	9,8	19,6	10,4	18,5	11,5
	025	21,4	8,58	21,3	9,30	20,9	10,1	19,9	10,8	18,8	11,8
	032	29,4	12,6	29,1	14,0	27,5	15,5	25,1	17,1	22,6	17,9
	040	41,3	16,4	41,0	18,0	39,8	19,5	38,1	20,8	36,0	22,9
050	41,8	16,9	41,6	18,6	40,5	20,1	38,9	21,5	36,7	23,6	
064	57,2	25,2	56,4	28,0	52,9	30,9	48,9	33,8	39,8	30,9	

#### NOTES

- Cooling capacity (kW)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range  $\Delta t = 3 - 8^\circ\text{C}$
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit
- Usage of glycol and other anti-freeze  
Correction factors for CC and PI are applicable according type and concentration of the used anti-freeze

#### SYMBOLS

- CC : Cooling capacity (kW)  
 PI : Power input (kW)  
 LWE : Leaving Water Evaporator temperature ( $^\circ\text{C}$ )  
 Tamb : Ambient temperature ( $^\circ\text{C}$ )

3TW60722-1(2)

# 4 Capacity tables

## 4 - 1 Cooling Capacity Tables

2  
4

EWA/YQ-BA

Cooling - Nominal performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
5	016	16,8	4,08	16,8	4,64	16,8	5,31	16,8	6,05	16,8	6,82
	021	21,0	5,53	21,0	6,06	21,0	6,79	21,0	7,66	21,0	8,7
	025	25,2	7,22	25,2	8,05	25,2	8,9	25,2	10,0	25,2	11,7
	032	31,5	9,6	31,5	10,9	31,5	12,2	31,4	14,2	30,5	16,3
	040	42,0	11,3	42,0	12,5	42,0	14,1	42,0	16,0	42,0	18,1
	050	50,4	15,1	50,4	16,7	50,4	18,6	50,4	20,9	50,4	24,6
7	064	63,0	19,8	63,0	22,3	63,0	25,4	63,0	29,7	59,3	32,9
	016	16,8	3,81	16,8	4,31	16,8	4,92	16,8	5,58	16,8	6,33
	021	21,0	5,26	21,0	5,83	21,0	6,50	21,0	7,25	21,0	8,1
	025	25,2	6,77	25,2	7,6	25,2	8,4	25,2	9,3	25,2	10,5
	032	31,5	9,1	31,5	10,3	31,5	11,5	31,5	12,9	31,2	15,5
	040	42,0	10,8	42,0	11,8	42,0	13,2	42,0	14,9	42,0	16,7
10	050	50,4	14,0	50,4	15,7	50,4	17,3	50,4	19,0	50,4	22,2
	064	63,0	18,7	63,0	21,1	63,0	23,6	63,0	26,7	63,0	31,5
	016	16,8	3,36	16,8	3,80	16,8	4,31	16,8	5,01	16,8	5,69
	021	21,0	4,91	21,0	5,44	21,0	6,00	21,0	6,73	21,0	7,54
	025	25,2	6,03	25,2	6,99	25,2	7,6	25,2	8,6	25,2	9,6
	032	31,5	8,2	31,5	9,4	31,5	10,5	31,5	11,9	31,5	14,1
15	040	42,0	9,9	42,0	11,0	42,0	12,2	42,0	13,6	42,0	15,2
	050	50,4	12,4	50,4	14,2	50,4	15,7	50,4	17,4	50,4	19,7
	064	63,0	17,0	63,0	19,5	63,0	21,7	63,0	25,0	63,0	29,4
	016	16,8	2,59	16,8	3,06	16,8	3,50	16,8	4,04	16,8	4,63
	021	21,0	4,03	21,0	4,65	21,0	5,17	21,0	5,81	21,0	6,53
	025	25,2	5,26	25,2	5,90	25,2	6,72	25,2	7,51	25,2	8,2
18	032	31,5	6,80	31,5	7,8	31,5	8,9	31,5	10,0	31,5	11,4
	040	42,0	8,2	42,0	9,6	42,0	10,7	42,0	11,9	42,0	13,4
	050	50,4	10,8	50,4	12,1	50,4	13,7	50,4	15,1	50,4	16,7
	064	63,0	14,1	63,0	16,1	63,0	18,4	63,0	20,6	63,0	24,1
	016	16,8	2,31	16,8	2,72	16,8	3,13	16,8	3,63	16,8	4,20
	021	21,0	3,46	21,0	4,09	21,0	4,66	21,0	5,22	21,0	5,88
18	025	25,2	4,96	25,2	5,51	25,2	6,28	25,2	7,00	25,2	7,74
	032	31,5	6,27	31,5	7,15	31,5	8,1	31,5	9,2	31,5	10,4
	040	42,0	7,1	42,0	8,4	42,0	9,5	42,0	10,6	42,0	12,1
	050	50,4	9,9	50,4	11,2	50,4	12,8	50,4	14,2	50,4	15,6
	064	63,0	12,8	63,0	14,6	63,0	16,9	63,0	18,9	63,0	21,3

**NOTES**

- Cooling capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range Dt = 3 - 8°C
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

**SYMBOLS**

- CC : Cooling capacity (kW)
- PI : Power input (kW)
- LWE : Leaving Water Evaporator temperature (°C)
- Tamb : Ambient temperature (°C)

3TW60722-4(1)

## 4 Capacity tables

### 4 - 1 Cooling Capacity Tables

EWY/YQ-BA

Cooling OPZL - Nominal performance table

Tamb (°C)		20		25		30		35		40	
LWE	Size	CC	PI	CC	PI	CC	PI	CC	PI	CC	PI
-10	016	12,5	6,18	12,5	6,72	12,3	7,36	11,9	7,91	11,3	8,48
	021	18,0	7,98	17,8	8,68	17,2	9,42	16,5	10,1	15,5	11,1
	025	18,1	8,24	18,0	8,98	17,5	9,75	16,8	10,4	15,8	11,4
	032	25,6	12,2	24,8	13,6	22,9	15,0	20,9	16,4	16,8	14,3
	040	35,2	15,9	34,8	17,3	33,7	18,8	32,2	20,1	30,3	22,2
	050	37,6	16,6	37,3	18,1	36,4	19,7	35,1	21,1	30,6	22,8
-5	064	49,6	24,4	47,8	26,9	44,0	29,8	40,6	32,6	32,3	28,0
	016	15,5	6,51	15,5	6,99	15,1	7,65	14,5	8,21	13,7	8,78
	021	21,0	8,31	21,0	9,02	20,7	9,8	19,8	10,5	18,7	11,5
	025	21,6	8,61	21,5	9,32	21,0	10,1	20,1	10,8	19,0	11,8
	032	29,7	12,7	29,5	14,1	27,8	15,6	25,5	17,1	23,0	18,0
	040	42,0	16,6	41,5	18,0	40,3	19,5	38,6	20,9	36,5	23,0
050	42,3	17,2	42,0	18,6	41,0	20,2	39,3	21,5	37,1	23,6	
064	57,8	25,2	57,0	28,0	53,6	31,0	48,9	34,0	41,0	31,1	

#### NOTES

- Cooling capacity (kW)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for chilled water range  $\Delta t = 3 - 8^\circ\text{C}$
- Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit
- Usage of glycol and other anti-freeze  
Correction factors for CC and PI are applicable according type and concentration of the used anti-freeze

#### SYMBOLS

- CC : Cooling capacity (kW)  
 PI : Power input (kW)  
 LWE : Leaving Water Evaporator temperature ( $^\circ\text{C}$ )  
 Tamb : Ambient temperature ( $^\circ\text{C}$ )

3TW60722-4(2)

# 4 Capacity tables

## 4 - 2 Heating Capacity Tables

2  
4


EWA/YQ-BA															
Heating - Maximum performance table															
Tamb (°C)		-15		-10		-7		-2		2		7		15	
LWE	Size	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI
30	016	14,4	6,50	16,6	6,71	18,0	6,83	20,0	6,79	20,0	5,76	20,0	4,76	20,0	3,63
	021	17,9	7,43	20,5	7,60	22,1	7,70	25,0	7,91	25,0	6,99	25,0	6,09	25,0	5,26
	025	20,0	8,56	22,8	8,78	24,6	8,90	27,6	9,09	30,0	9,22	30,0	7,88	30,0	6,38
	032	30,0	12,2	34,1	12,6	36,8	12,8	37,5	11,4	37,5	10,2	37,5	9,15	37,5	7,34
	040	35,8	14,9	41,0	15,2	44,2	15,4	50,0	15,8	50,0	14,0	50,0	12,2	50,0	10,5
	050	40,0	17,1	45,6	17,6	49,1	17,8	55,1	18,2	60,0	18,4	60,0	15,8	60,0	12,8
	064	60,1	24,5	68,3	25,1	73,5	25,5	75,0	22,7	75,0	20,4	75,0	18,3	75,0	14,7
35	016	14,8	7,17	16,8	7,40	18,11	7,52	20,0	7,55	20,0	6,49	20,0	5,42	20,0	4,77
	021	17,9	8,17	20,3	8,35	21,9	8,46	24,6	8,62	25,0	7,90	25,0	6,84	25,0	5,75
	025	20,1	9,43	22,8	9,66	24,4	9,78	27,3	9,98	29,6	10,1	30,0	8,93	30,0	7,24
	032	30,3	13,5	34,1	13,8	36,6	14,1	37,5	12,7	37,5	11,4	37,5	10,2	37,5	8,26
	040	35,7	16,3	40,6	16,7	43,7	16,9	49,2	17,2	50,0	15,8	50,0	13,7	50,0	11,5
	050	40,2	18,9	45,5	19,3	48,8	19,6	54,5	20,0	59,1	20,2	60,0	17,9	60,0	14,5
	064	60,6	27,0	68,3	27,7	73,3	28,1	75,0	25,4	75,0	22,8	75,0	20,4	75,0	16,5
40	016	15,0	7,90	16,8	8,13	18,0	8,26	20,0	8,46	20,0	7,37	20,0	6,13	20,0	4,86
	021	17,8	9,1	20,1	9,2	21,6	9,3	24,2	9,5	25,0	8,96	25,0	7,84	25,0	6,45
	025	20,1	10,4	22,5	10,7	24,1	10,8	25,3	10,1	29,0	11,1	30,0	10,2	30,0	8,27
	032	30,4	15,0	34,0	15,3	36,4	15,6	37,5	14,3	37,5	12,9	37,5	11,5	37,5	9,42
	040	35,5	18,1	40,1	18,5	43,1	18,7	48,3	19,0	50,0	17,9	50,0	15,7	50,0	12,9
	050	40,2	20,9	45,0	21,3	48,2	21,6	50,6	20,2	58,0	22,2	60,0	20,3	60,0	16,5
	064	60,8	30,0	68,0	30,7	72,7	31,1	75,0	28,7	75,0	25,8	75,0	23,0	75,0	18,8
45	016	15,0	8,67	16,6	8,91	17,7	9,04	19,6	9,24	20,0	8,43	20,0	7,01	20,0	5,62
	021	17,6	10,1	19,8	10,3	21,2	10,4	23,7	10,5	25,0	10,2	25,0	8,97	25,0	7,40
	025	19,9	11,5	22,2	11,8	23,7	11,9	26,2	12,1	28,3	12,2	30,0	11,7	30,0	9,47
	032	30,3	16,7	33,7	17,0	35,9	17,2	37,5	16,2	37,5	14,6	37,5	13,1	37,5	10,9
	040	35,2	20,1	39,6	20,5	42,4	20,7	47,4	21,1	50,0	20,4	50,0	17,9	50,0	14,8
	050	39,8	23,1	44,3	23,5	47,3	23,8	52,5	24,2	56,7	24,5	60,0	23,4	60,0	18,9
	064	60,6	33,4	67,4	34,1	71,9	34,5	75,0	32,5	75,0	29,3	75,0	26,2	75,0	21,7
50	016	14,8	9,48	16,3	9,73	17,3	9,87	17,6	8,84	18,0	8,04	18,2	7,04	18,6	5,77
	021	17,4	11,2	18,7	10,8	19,0	10,2	19,2	9,25	19,3	8,49	19,1	7,48	19,9	6,40
	025	19,2	12,6	19,6	11,5	19,9	10,7	20,2	9,78	20,4	9,00	20,7	8,10	21,2	7,13
	032	27,9	17,0	28,5	15,7	28,8	14,9	29,0	13,5	29,3	12,2	29,5	10,8	29,7	9,01
	040	34,8	22,4	37,5	21,6	37,9	20,5	38,3	18,5	38,7	17,0	38,2	15,0	39,7	12,8
	050	38,4	25,1	39,1	22,9	39,7	21,5	40,3	19,6	40,8	18,0	41,4	16,2	42,5	14,3
	064	55,8	34,0	56,9	31,3	57,7	29,9	58,0	26,9	58,6	24,5	59,1	21,5	59,4	18,0

Note 1 :  
 HC tabulated does not include capacity drop during frosting period and defrost.  
 The integrated Heating Capacity takes into consideration the capacity drop during frosting period and defrosting operation.  
 (HC Integrated) = (HC) \* (Integrated correction factor during frosting period)

- Integrated heating capacity means the heating capacity during one cycle (between defrosting period and defrosting period), which is integrated and converted to heating capacity per hour.  
 - Integrated correction factor :

Correction factor	Size	Tamb [°C] RH 85%					
		-15	-10	-7	-2	2	7
016	0,90	0,86	0,84	0,82	0,86	1,00	
021	0,87	0,83	0,80	0,83	0,85	1,00	
025	0,87	0,83	0,81	0,81	0,82	0,87	
032	0,88	0,84	0,82	0,85	0,86	1,00	
040	0,87	0,83	0,80	0,83	0,85	1,00	
050	0,87	0,83	0,81	0,81	0,82	0,87	
064	0,88	0,84	0,82	0,85	0,86	1,00	

- Integrated heating capacity graph :

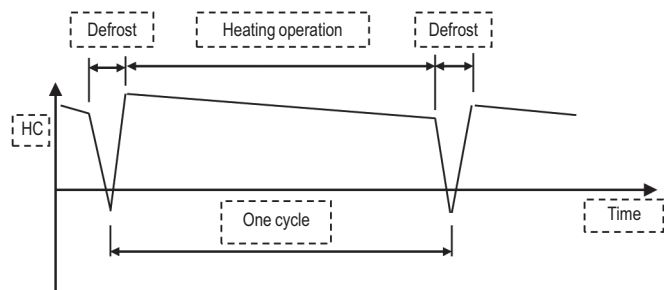

Note 2 :  
 In case the surface of the heat exchanger is covered with snow, heating capacity drops temporarily although it differs with outdoor temperature (°CDB), relative humidity (RH) and frosting volume.

### SYMBOLS

- HC : Heating capacity (kW)
- PI : Power input (kW)
- LWC : Leaving Water Condenser temperature (°C)
- Tamb : Ambient temperature (°C)

### NOTES

1. Heating capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for heated water range Dt = 3 - 8°C
2. Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

3TW60722-1(3)

# 4 Capacity tables

## 4 - 2 Heating Capacity Tables

EWY/YQ-BA

Heating - Nominal performance table

Tamb (°C)		-15		-10		-7		-2		2		7		15	
LWE	Size	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI	HC	PI
30	016	14.4	6.54	16.7	6.76	16.8	6.18	16.8	5.05	16.8	4.48	16.8	3.75	16.8	2.88
	021	17.9	7.48	20.5	7.66	21.0	7.23	21.0	6.30	21.0	5.64	21.0	5.15	21.0	4.01
	025	20.0	8.62	22.9	8.84	24.6	8.97	25.2	8.04	25.2	7.12	25.2	6.17	25.2	5.45
	032	30.2	12.3	31.5	11.4	31.5	10.4	31.5	9.2	31.5	8.4	31.5	7.20	31.5	5.85
	040	35.9	15.0	41.0	15.3	42.0	14.5	42.0	12.6	42.0	11.3	42.0	10.3	42.0	8.0
	050	40.1	17.2	45.7	17.7	49.2	17.9	50.4	16.1	50.4	14.2	50.4	12.3	50.4	10.9
064	60.3	24.6	63.0	22.8	63.0	20.9	63.0	18.4	63.0	16.7	63.0	14.4	63.0	11.7	
35	016	14.9	7.23	16.8	7.46	16.80	6.77	16.8	5.61	16.8	5.03	16.8	4.23	16.8	3.31
	021	17.9	8.23	20.3	8.42	21.0	8.11	21.0	7.03	21.0	6.33	21.0	5.78	21.0	4.53
	025	20.2	9.50	22.8	9.73	24.5	9.86	25.2	8.99	25.2	8.0	25.2	6.96	25.2	5.87
	032	30.4	13.6	31.5	12.7	31.5	11.6	31.5	10.3	31.5	9.4	31.5	8.1	31.5	6.63
	040	35.8	16.5	40.7	16.8	42.0	16.2	42.0	14.1	42.0	12.7	42.0	11.6	42.0	9.1
	050	40.4	19.0	45.6	19.5	48.9	19.7	50.4	18.0	50.4	15.9	50.4	13.9	50.4	11.7
064	60.8	27.2	63.0	25.5	63.0	23.2	63.0	20.6	63.0	18.8	63.0	16.2	63.0	13.3	
40	016	15.1	7.95	16.8	8.19	16.8	7.47	16.8	6.29	16.8	5.63	16.8	4.85	16.8	3.79
	021	17.8	9.1	20.1	9.3	21.0	9.2	21.0	8.0	21.0	7.20	21.0	6.32	21.0	5.32
	025	20.1	10.5	22.6	10.7	24.2	10.9	25.2	10.1	25.2	9.0	25.2	7.9	25.2	6.54
	032	30.5	15.1	31.5	14.1	31.5	12.8	31.5	11.6	31.5	10.6	31.5	9.2	31.5	7.54
	040	35.6	18.2	40.2	18.6	42.0	18.3	42.0	16.1	42.0	14.4	42.0	12.6	42.0	10.6
	050	40.3	21.0	45.2	21.5	48.3	21.7	50.4	20.3	50.4	18.1	50.4	15.8	50.4	13.1
064	61.0	30.3	63.0	28.2	63.0	25.6	63.0	23.2	63.0	21.1	63.0	18.3	63.0	15.1	
45	016	15.0	8.72	16.7	8.97	16.8	8.45	16.8	7.14	16.8	6.37	16.8	5.51	16.8	4.37
	021	17.7	10.1	19.8	10.3	21.0	10.3	21.0	9.0	21.0	8.2	21.0	7.10	21.0	6.06
	025	19.9	11.6	22.2	11.9	23.7	12.0	25.2	11.5	25.2	10.3	25.2	8.9	25.2	7.52
	032	30.4	16.8	31.5	15.8	31.5	14.6	31.5	13.2	31.5	12.3	31.5	10.5	31.5	8.6
	040	35.3	20.3	39.7	20.7	42.0	20.6	42.0	18.1	42.0	16.4	42.0	14.2	42.0	12.1
	050	39.8	23.2	44.4	23.7	47.4	24.0	50.4	23.0	50.4	20.5	50.4	17.8	50.4	15.0
064	60.8	33.7	63.0	31.6	63.0	29.2	63.0	26.4	63.0	24.5	63.0	21.0	63.0	17.2	
50	016	14.8	9.54	16.3	9.80	16.5	9.22	16.7	8.08	16.8	7.37	16.8	6.37	16.8	5.06
	021	17.4	11.3	17.8	10.3	17.9	10.3	18.1	8.71	18.3	8.06	18.6	7.21	18.9	5.96
	025	18.2	11.9	18.8	10.9	19.0	10.3	19.2	9.30	19.4	8.55	19.2	7.61	20.0	6.52
	032	27.0	16.4	27.2	15.1	27.4	14.3	27.8	12.7	27.9	11.5	28.2	10.2	28.3	8.61
	040	34.9	22.6	35.6	20.5	35.8	20.5	36.1	17.4	36.6	16.1	37.1	14.4	37.9	11.9
	050	36.4	23.8	37.5	21.7	37.9	20.6	38.4	18.6	38.7	17.1	38.5	15.2	40.0	13.0
064	54.1	32.7	54.4	30.1	54.8	28.5	55.5	25.4	55.8	23.0	56.3	20.5	56.7	17.2	

Note 1 :

HC tabulated does not include capacity drop during frosting period and defrost.

The integrated Heating Capacity takes into consideration the capacity drop during frosting period and defrosting operation.


(HC Integrated) = (HC) \* (Integrated correction factor during frosting period)

- Integrated heating capacity means the heating capacity during one cycle (between defrosting period and defrosting period), which is integrated and converted to heating capacity per hour.

- Integrated correction factor :

Correction factor	Size	Tamb (°C) RH 85%					
		-15	-10	-7	-2	2	7
	016	0.90	0.86	0.84	0.82	0.86	1.00
	021	0.87	0.83	0.80	0.83	0.85	1.00
	025	0.87	0.83	0.81	0.81	0.82	0.87
	032	0.88	0.84	0.82	0.85	0.86	1.00
	040	0.87	0.83	0.80	0.83	0.85	1.00
	050	0.87	0.83	0.81	0.81	0.82	0.87
	064	0.88	0.84	0.82	0.85	0.86	1.00

- Integrated heating capacity graph :

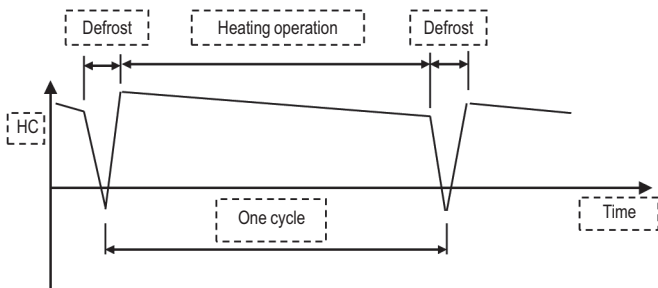

Note 2 :

In case the surface of the heat exchanger is covered with snow, heating capacity drops temporarily although it differs with outdoor temperature (°CDB), relative humidity (RH) and frosting volume.

### SYMBOLS

- HC : Heating capacity (kW)
- PI : Power input (kW)
- LWC : Leaving Water Condenser temperature (°C)
- Tamb : Ambient temperature dry bulb(°C)

### NOTES


1. Heating capacity (CAP)  
Capacity is according to Eurovent rating standard 6/C/003-2006 and valid for heated water range Dt = 3 - 8°C
2. Power input (kW)  
Power input is total input according to Eurovent rating standard 6/C/003-2006: Compressor + fans + control circuit

3TW60722-4(3)

## 4 Capacity tables

### 4 - 3 Capacity Correction Factor

2  
4

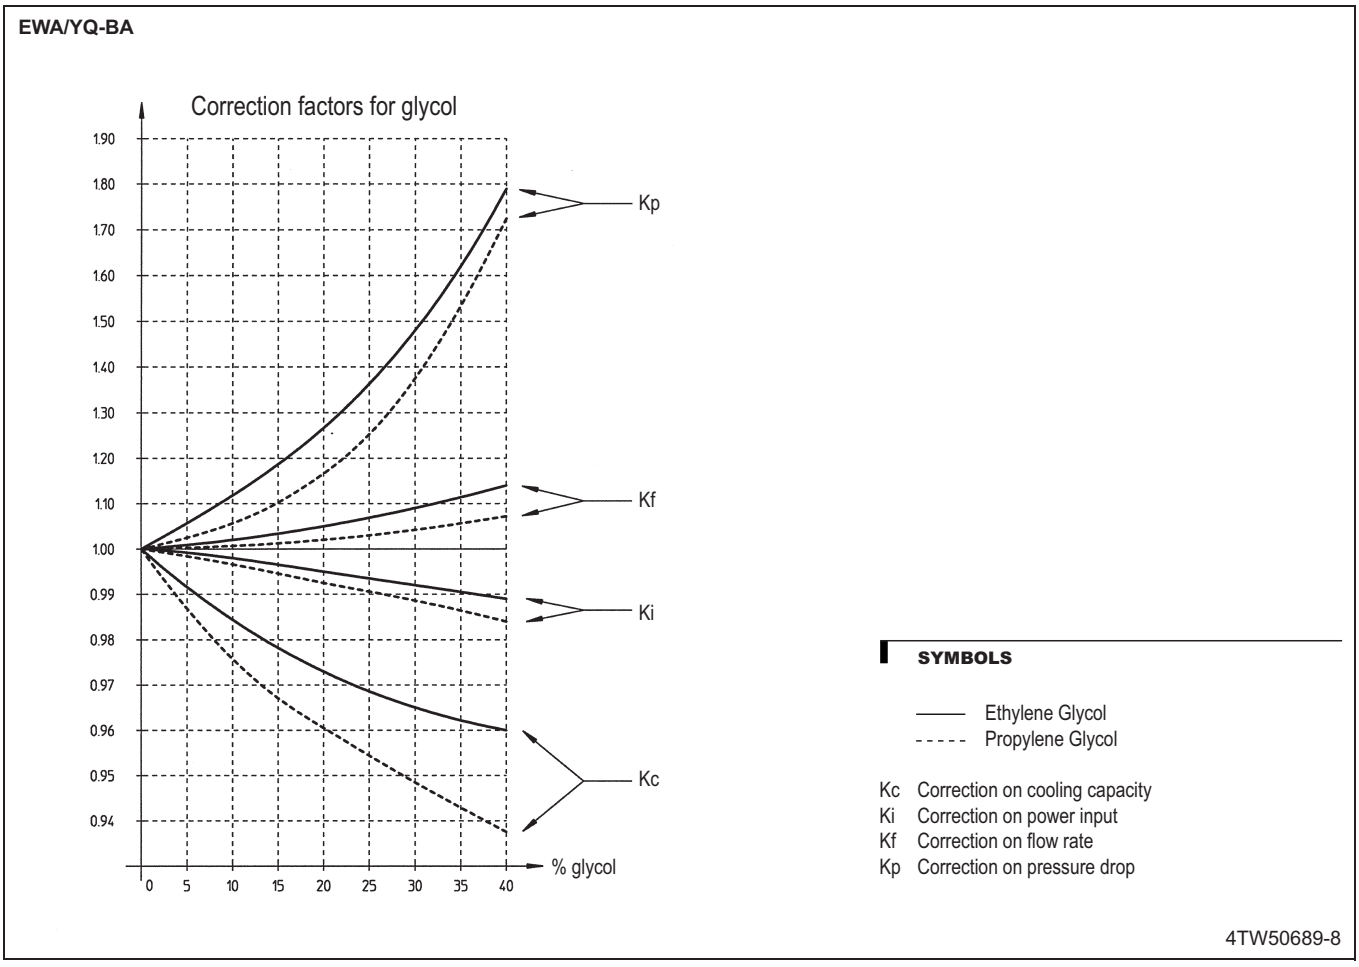



# 5 Dimensional drawings

## 5 - 1 Dimensional Drawings

**EWY/YQ16-25BA**

Models	E	F	G
EWY/YQ16BAWN	736	619	371
EWY/YQ21BAWN	768	613	372
EWY/YQ25BAWN	768	613	372
EWY/YQ16BAWP	711	602	379
EWY/YQ21BAWP	745	599	379
EWY/YQ25BAWP	745	599	379

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

**NOTES**

	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

**3TW60724-1A**

01	Braze plate heat exchanger
02	Coil
03	Compressor
04	Expansion valve
05	Gas stopvalve
06	Liquid stopvalve
07	Switchbox hydromodule
08	Chilled water IN (G1-1/4 female shutoff valve)
09	Chilled water OUT (G1-1/4 female shutoff valve)
10	Water drain
11	Air purge
12	Leaving water temperature sensor
13	Entering water temperature sensor
14	Ambient temperature sensor
15	Refrigerant filter
16	Power supply intake (Ø45)
17	Low voltage supply intake (Ø29)
18	High voltage supply intake (Ø29)
19	Lifting eye for sling
20	Main isolator switch
21	Flowswitch
22	Fan
23	Gas pipe sensor
24	Liquid pipe sensor
25	Water filter
26	Water safety valve (Optional)
27	Water pressure gauge (Optional)
28	Pump (Optional)
29	Expansion vessel (Optional)
30	Accumulator
31	Switchbox outdoor module
32	Main pcb hydro module
33	Demand pcb (Optional)
34	Low voltage terminal
35	High voltage terminal
36	Service panel outdoor module
37	Service panel hydro module
38	Service panel switchbox hydromodule
39	Water pressure port before brazed plate heat exchanger
40	Water pressure port after brazed plate heat exchanger

2  
5

**EWY/YQ32BA**

Models	E	F	G
EWY/YQ32BAWN	870	606	380
EWY/YQ32BAWP	850	595	385

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

**NOTES**

	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

**3TW60734-1A**


01	Braze plate heat exchanger
02	Coil
03	Compressor
04	Expansion valve
05	Gas stopvalve
06	Liquid stopvalve
07	Switchbox hydromodule
08	Chilled water IN (G1-1/4 female shutoff valve)
09	Chilled water OUT (G1-1/4 female shutoff valve)
10	Water drain
11	Air purge
12	Leaving water temperature sensor
13	Entering water temperature sensor
14	Ambient temperature sensor
15	Refrigerant filter
16	Power supply intake (Ø45)
17	Low voltage supply intake (Ø29)
18	High voltage supply intake (Ø29)
19	Lifting eye for sling
20	Main isolator switch
21	Flowswitch
22	Fan
23	Gas pipe sensor
24	Liquid pipe sensor
25	Water filter
26	Water safety valve (Optional)
27	Water pressure gauge (Optional)
28	Pump (Optional)
29	Expansion vessel (Optional)
30	Accumulator
31	Switchbox outdoor module
32	Main pcb hydro module
33	Demand pcb (Optional)
34	Low voltage terminal
35	High voltage terminal
36	Service panel outdoor module
37	Service panel hydro module
38	Service panel switchbox hydromodule
39	Water pressure port before brazed plate heat exchanger
40	Water pressure port after brazed plate heat exchanger

# 5 Dimensional drawings


## 5 - 1 Dimensional Drawings

### EWY/YQ40,50BA

- 01 Braze plate heat exchanger
- 02 Coil
- 03 Compressor
- 04 Expansion valve
- 05 Gas stopvalve
- 06 Liquid stopvalve
- 07 Switchbox hydromodule
- 08 Chilled water IN (G2 female shutoff valve)
- 09 Chilled water OUT (G2 female shutoff valve)
- 10 Water drain
- 11 Air purge
- 12 Leaving water temperature sensor
- 13 Entering water temperature sensor
- 14 Ambient temperature sensor
- 15 Refrigerant filter
- 16 Power supply intake (Ø45)
- 17 Low voltage supply intake (Ø29)
- 18 High voltage supply intake (Ø29)
- 19 Lifting eye for sling
- 20 Main isolator switch
- 21 Flowswitch
- 22 Fan
- 23 Gas pipe sensor
- 24 Liquid pipe sensor
- 25 Water filter
- 26 Water safety valve (Optional)
- 27 Water pressure gauge (Optional)
- 28 Pump (Optional)
- 29 Expansion vessel (Optional)
- 30 Accumulator
- 31 Switchbox outdoor module
- 32 Main pcb hydro module
- 33 Demand pcb (Optional)
- 34 Low voltage terminal
- 35 High voltage terminal
- 36 Service panel outdoor module
- 37 Service panel hydro module
- 38 Service panel switchbox hydromodule
- 39 Water pressure port before brazed plate heat exchanger
- 40 Water pressure port after brazed plate heat exchanger

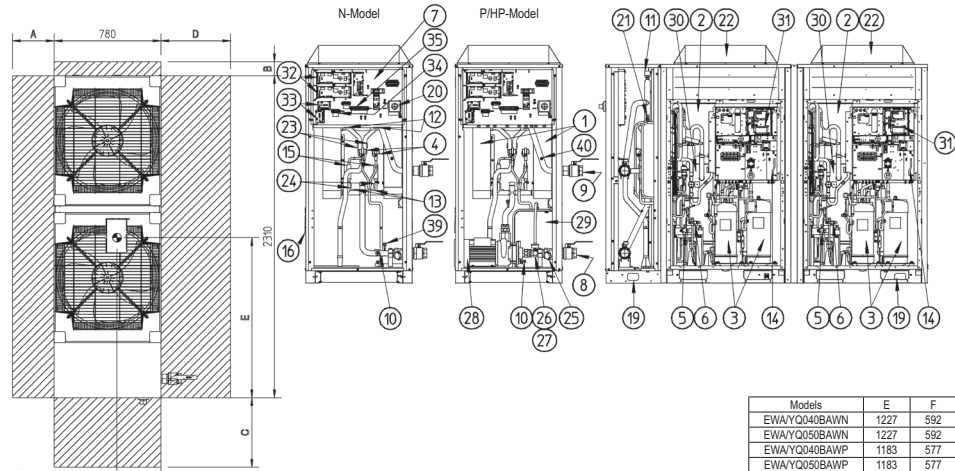

Models	E	F	G
EWY/YQ040BAWN	1227	592	380
EWY/YQ050BAWN	1227	592	380
EWY/YQ040BAWP	1183	577	387
EWY/YQ050BAWP	1183	577	387

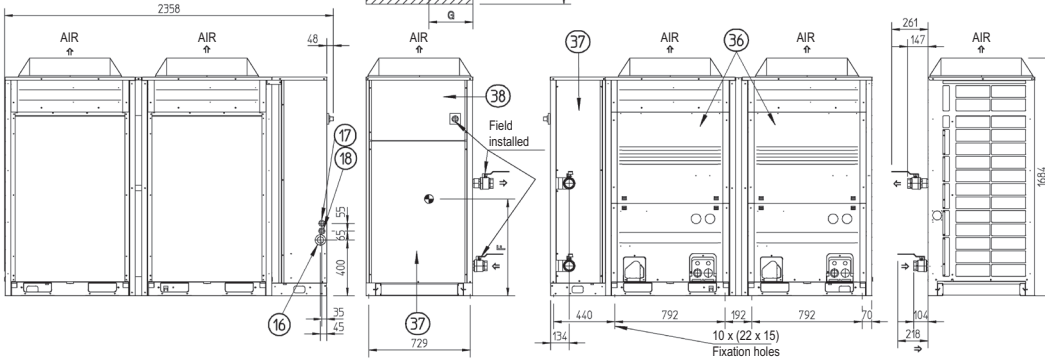

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES


	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.


3TW60754-1A

### EWY/YQ64BA

- 01 Braze plate heat exchanger
- 02 Coil
- 03 Compressor
- 04 Expansion valve
- 05 Gas stopvalve
- 06 Liquid stopvalve
- 07 Switchbox hydromodule
- 08 Chilled water IN (G2 female shutoff valve)
- 09 Chilled water OUT (G2 female shutoff valve)
- 10 Water drain
- 11 Air purge
- 12 Leaving water temperature sensor
- 13 Entering water temperature sensor
- 14 Ambient temperature sensor
- 15 Refrigerant filter
- 16 Power supply intake (Ø45)
- 17 Low voltage supply intake (Ø29)
- 18 High voltage supply intake (Ø29)
- 19 Lifting eye for sling
- 20 Main isolator switch
- 21 Flowswitch
- 22 Fan
- 23 Gas pipe sensor
- 24 Liquid pipe sensor
- 25 Water filter
- 26 Water safety valve (Optional)
- 27 Water pressure gauge (Optional)
- 28 Pump (Optional)
- 29 Expansion vessel (Optional)
- 30 Accumulator
- 31 Switchbox outdoor module
- 32 Main pcb hydro module
- 33 Demand pcb (Optional)
- 34 Low voltage terminal
- 35 High voltage terminal
- 36 Service panel outdoor module
- 37 Service panel hydro module
- 38 Service panel switchbox hydromodule
- 39 Water pressure port before brazed plate heat exchanger
- 40 Water pressure port after brazed plate heat exchanger

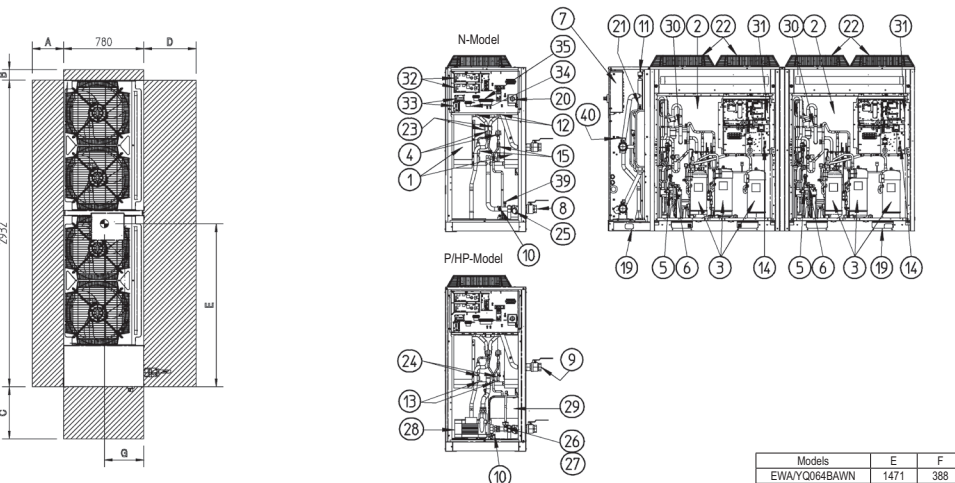

Models	E	F	G
EWY/YQ064BAWN	1471	388	590
EWY/YQ064BAWP	1430	394	578

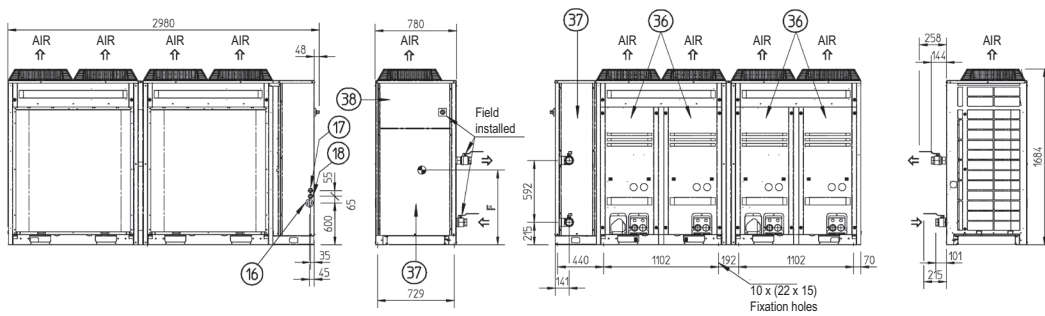

Legend:  
 Required space around the unit for service and air intake  
 Centre of gravity

#### NOTES


	1	2
A	300	500
B	100	500
C	500	500
D	500	500

1= Distance from wall (or other unit) for regions without heavy snowfall.  
 2= Distance from wall (or other unit) for regions with heavy snowfall.

3TW60774-1A

## 6 Piping diagrams


### 6 - 1 Piping Diagrams

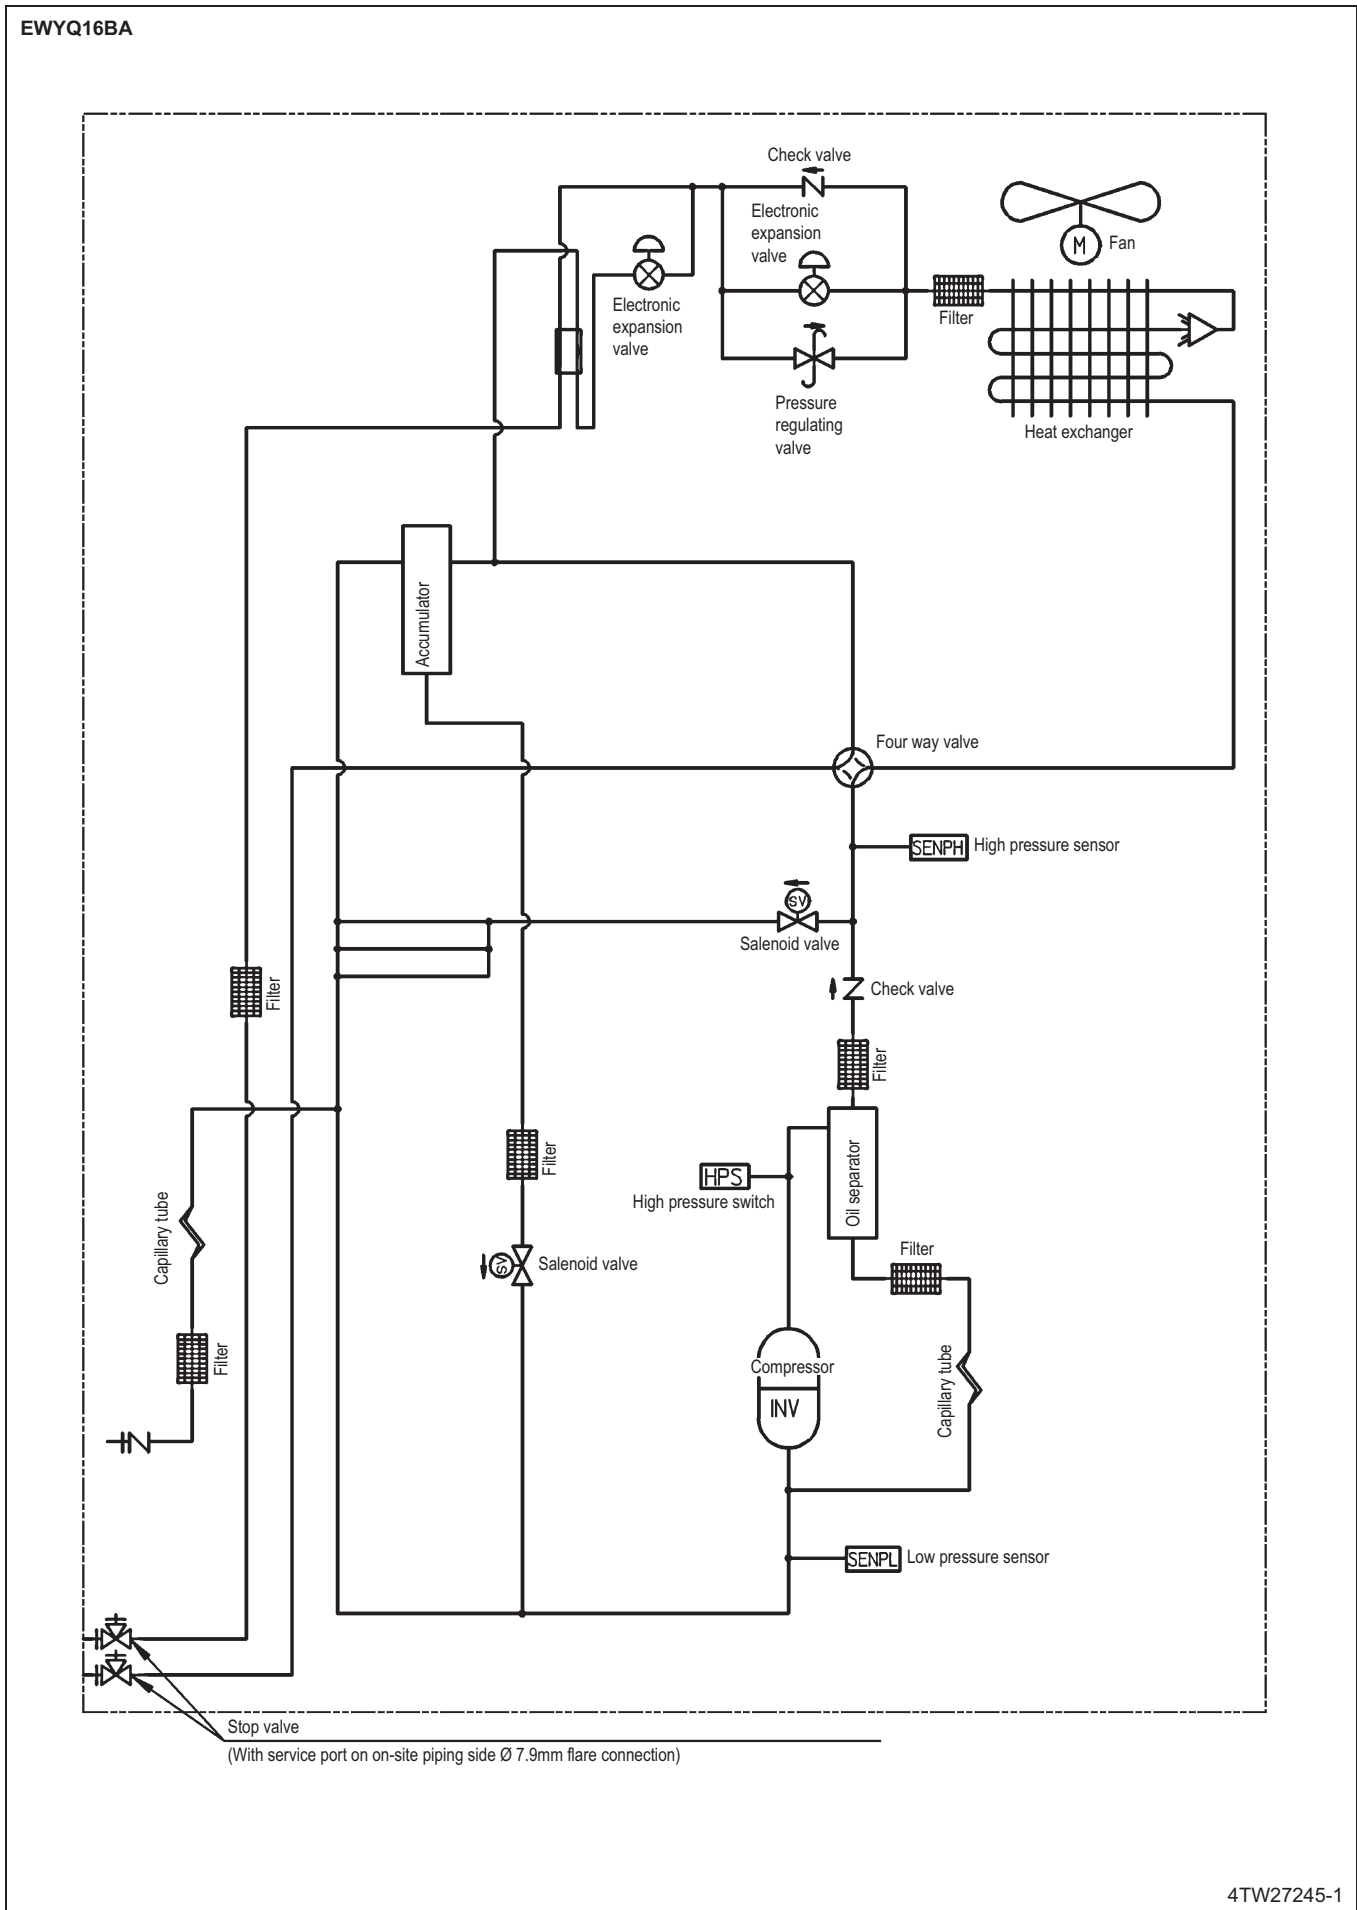

## 6 Piping diagrams

### 6 - 1 Piping Diagrams

EWAQ25,50BA  
EWYQ21,25,40,50BA

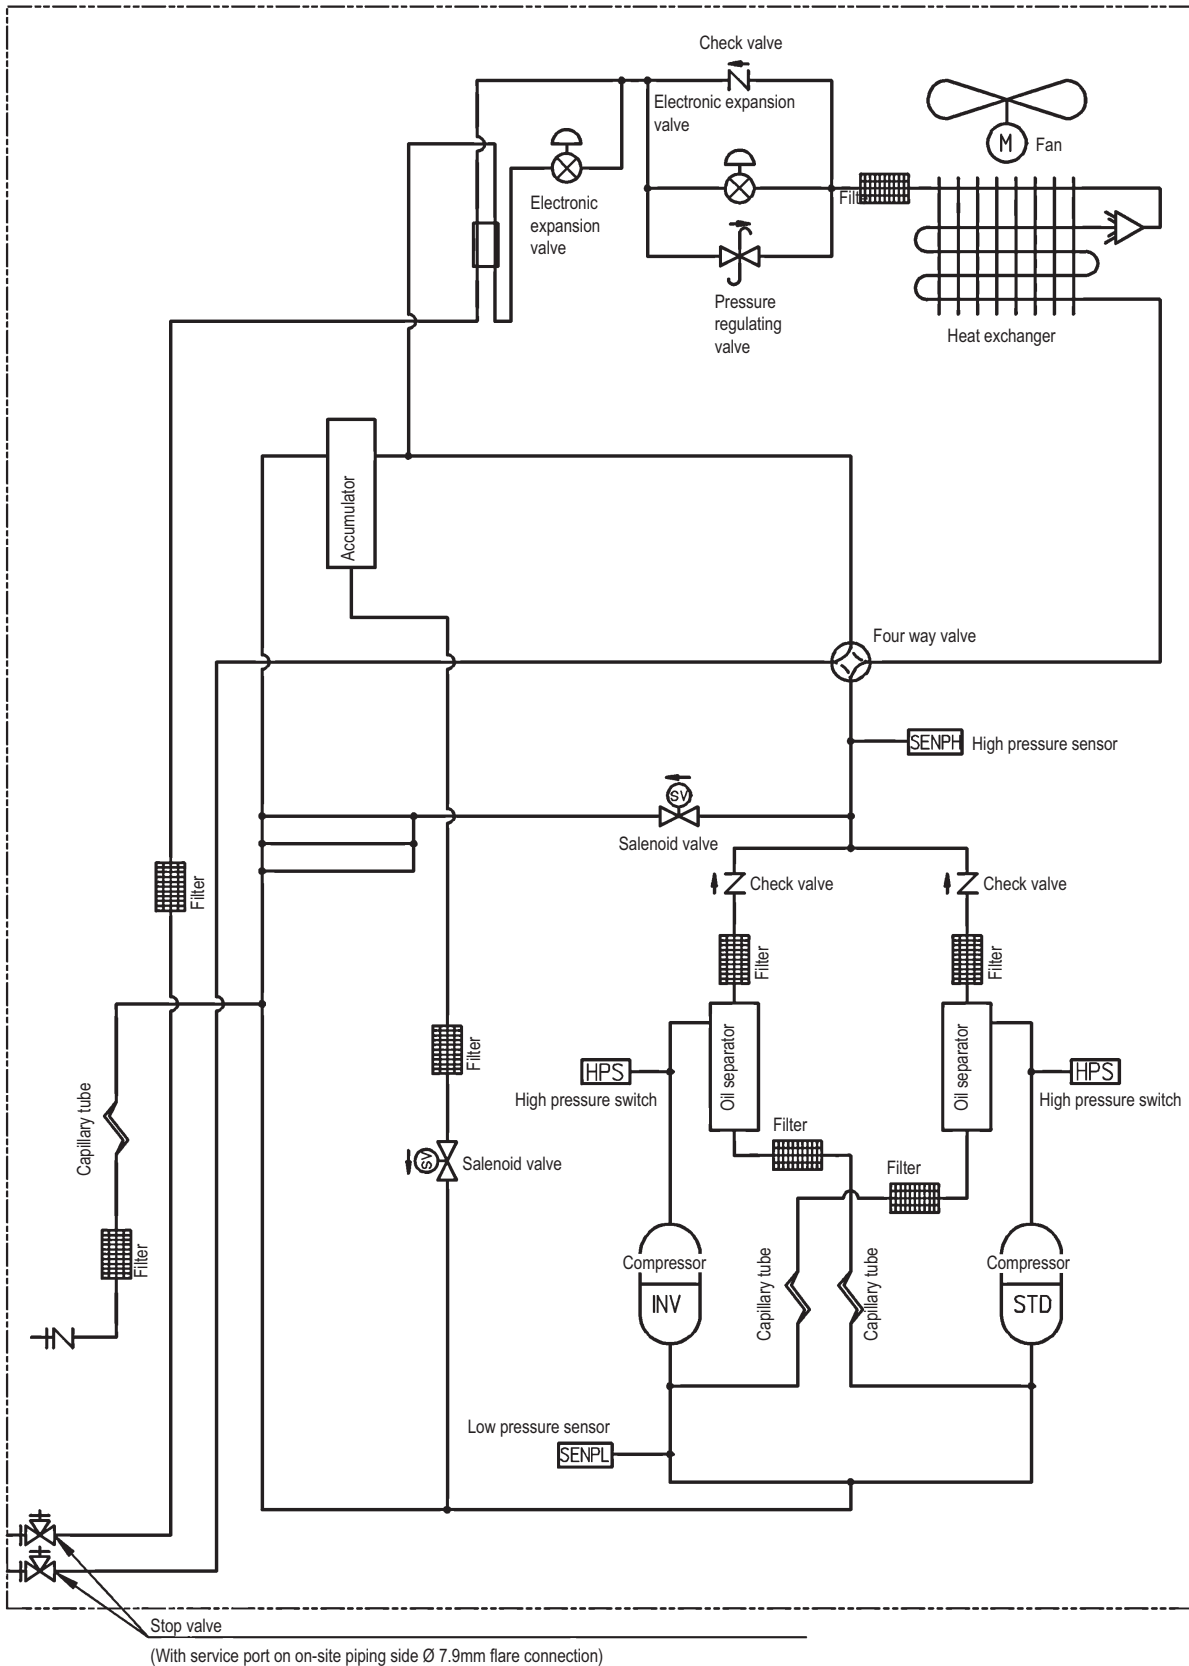


4TW27255-1

# 6 Piping diagrams

## 6 - 1 Piping Diagrams

EWYQ32,64BA

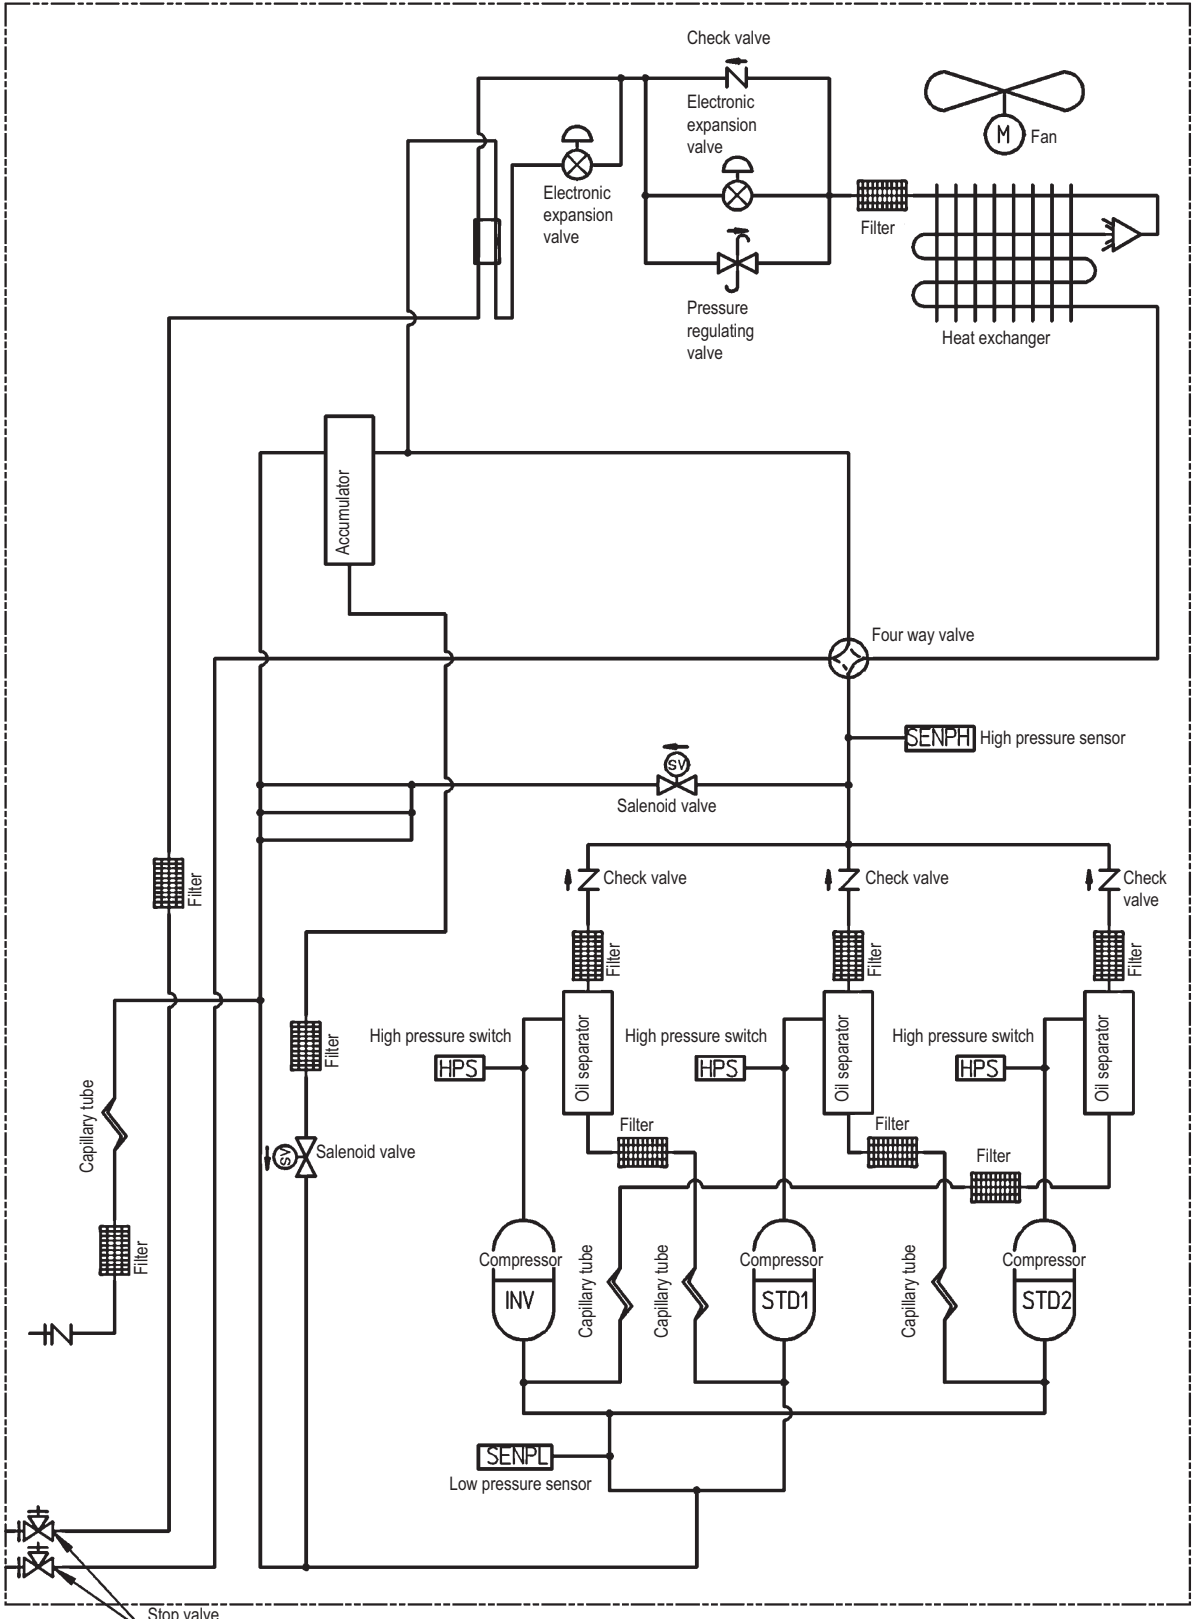

Stop valve  
(With service port on on-site piping side Ø 7.9mm flare connection)

4TW27275-1


# 6 Piping diagrams

## 6 - 1 Piping Diagrams

2  
6


**EWA/YQ-BA Piping diagram - Hydromodule**

Overview		Small inverter chiller - Outdoor module combination						
		Single circuit			Double circuit			
Outdoor module piping diagram		16kW	21kW	25kW	32kW	40kW	50kW	64kW
C/O	4TW27315-1	•						
	4TW27325-1		•			•		
	4TW27255-1			•			•	
	4TW27345-1				•			•
H/P	4TW27245-1	•						
	4TW27255-1		•	•		•	•	
	4TW27275-1				•			•

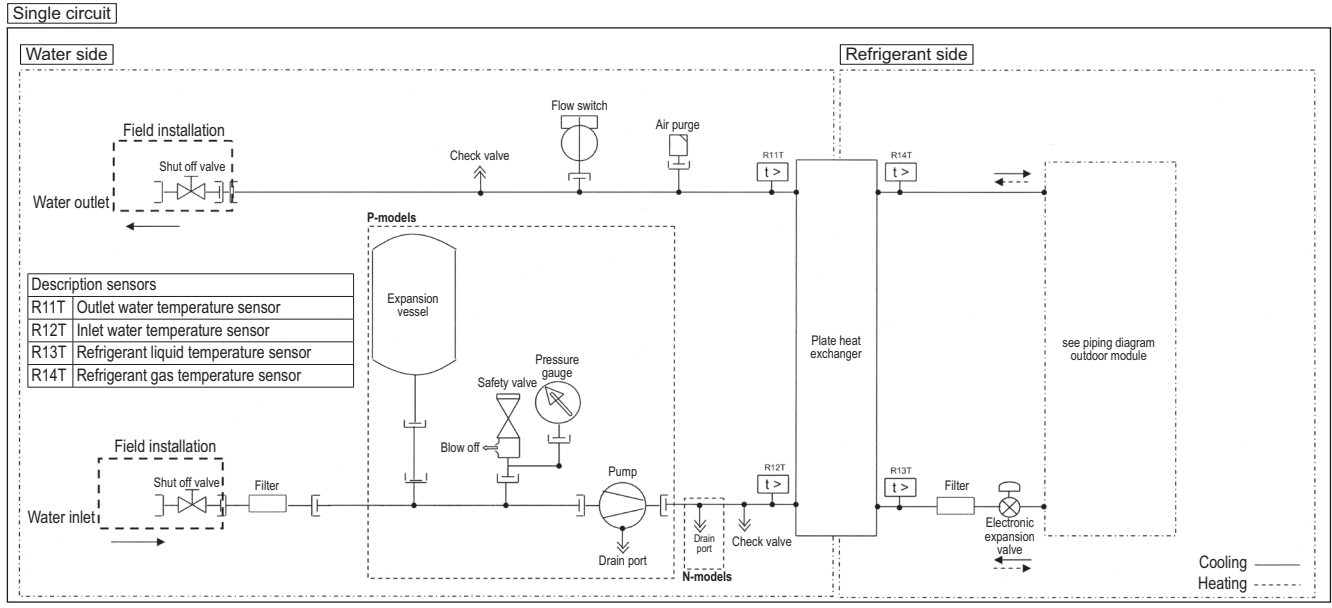

3TW60715-1(1)

**EWA/YQ-BA Piping diagram - Hydromodule**

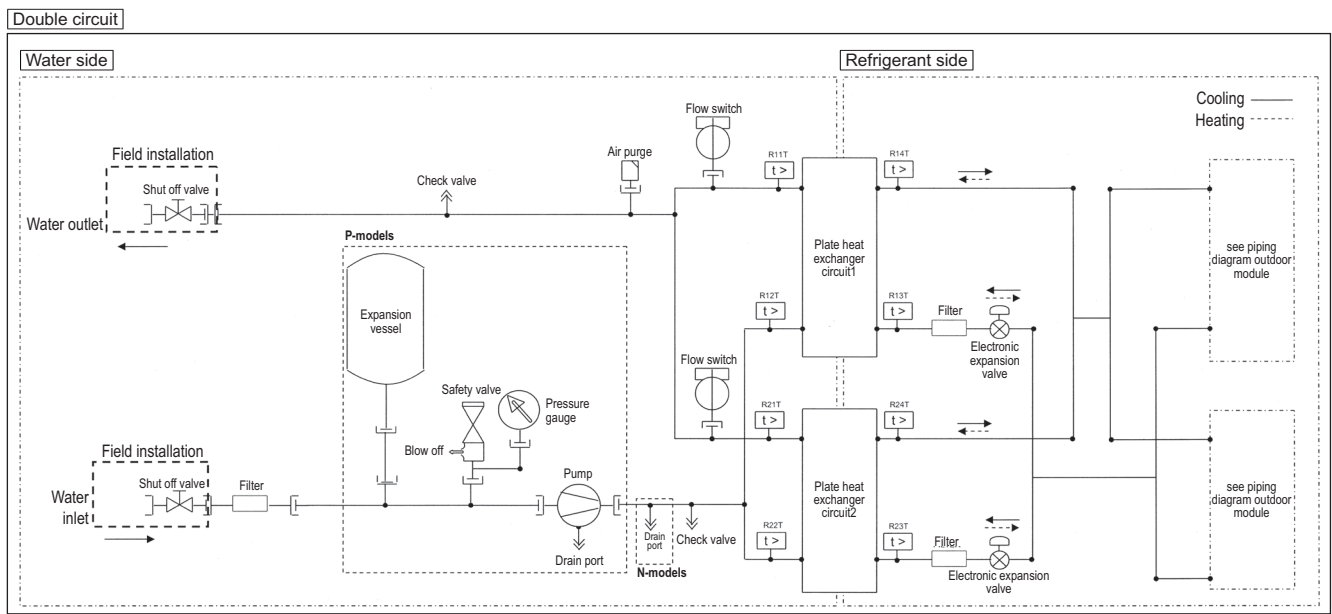

Description sensors circuit 1		Description sensors circuit 1	
R11T	Outlet water temperature sensor	R21T	Outlet water temperature sensor
R12T	Inlet water temperature sensor	R22T	Inlet water temperature sensor
R13T	Refrigerant liquid temperature sensor	R23T	Refrigerant liquid temperature sensor
R14T	Refrigerant gas temperature sensor	R24T	Refrigerant gas temperature sensor


Check valve, Flare conn., Screw conn., Flange conn., Pinched pipe, Spinned pipe

3TW60715-1(2)



# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

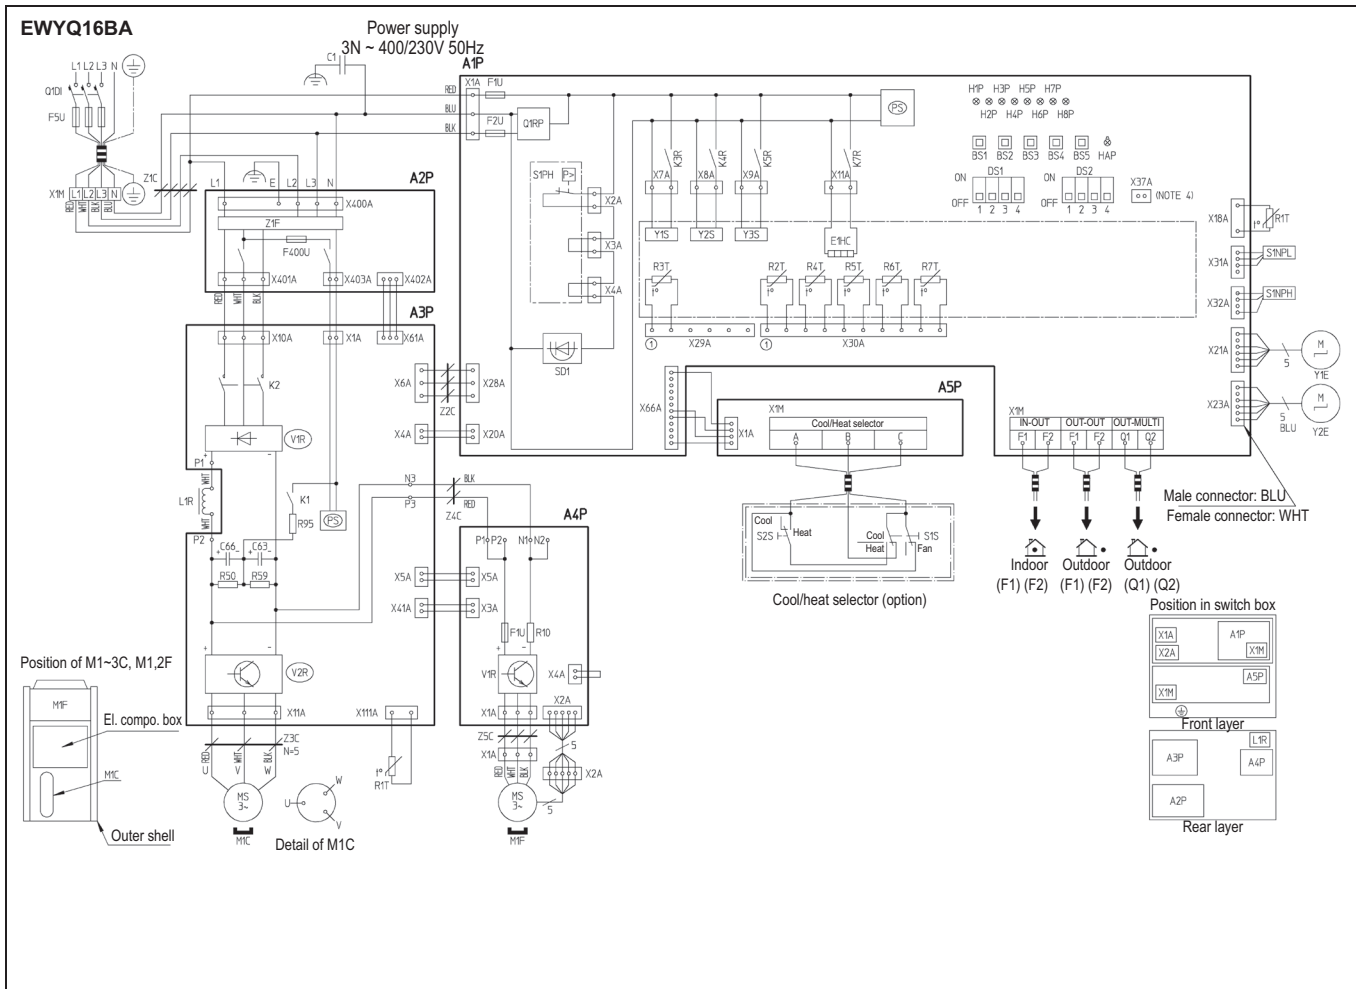

2  
7

A1P-A5P	Printed circuit board		R1T-R7T	Thermistor	
	A1P: Main	A4P: Fan		R1T: AIR (A1P)	R4T: Heat exch. deicer
	A2P: Noise filter	A5P: ABC I/P		R1T: FIN (A3P)	R5T: Heat exch. outlet
BS1-BS5	Push button switch (Mode, set, return, test, reset)		R50, R59	Resistor	
				R50, R59	Resistor (current limiting)
C1	Capacitor		S1NPH	Pressure sensor (high)	
C63, C66	Capacitor		S1NPL	Pressure sensor (low)	
DS1, DS2	Dip switch		S1PH	Pressure switch (high)	
E1HC	Crankcase heater		SD1	Safety devices input	
F1U	Fuse (250V, 8A (B)) (A4P)		V1R	Power module (A4P)	
F1U, F2U	Fuse (250V, 3.15A (D)) (A1P)		V1R, V2R	Power module (A3P)	
F5U	Field fuse		X1A-X2A	Connector (M1F)	
F400U	Fuse (250V, 6.3A (D)) (A2P)		X1M	Terminal strip (power supply)	
H1P-H8P	Pilotlamp (service monitor - orange)		X1M	Terminal strip (control) (A1P)	
	[H2P] Prepare, Test ----- Flickering		X1M	Terminal strip (A5P)	
	Malfunction detection ----- Light up		Y1E	Electronic expansion valve (main)	
HAP	Pilotlamp (service monitor - green)		Y2E	Electronic expansion valve (subcool)	
K1	Magnetic relay		Y1S-Y3S	Solenoid valve	
K2	Magnetic contactor (M1C)			Y1S: Hot gas	Y3S: 4 way valve
K3R-K7R	K3R: Y1S	K5R: Y3S	Y2S: Oil return		
	K4R: Y2S	K7R: E1HC	Z1C-5C	Noise filter (ferrite core)	
L1R	Reactor		Z1F	Noise filter (With surge absorber)	
M1C	Motor (Compressor)		Cool/Heat Selector		
M1F	Motor (Fan)		S1S	Selector switch (fan/cool - heat)	
PS	Switching power supply (A1P, A3P)		S2S	Selector switch (cool - heat)	
Q1RP	Phase reversal detect circuit				
Q1DI	Earth leakage breaker				
R10	Resistor (current sensor) (A4P)				

2TW27246-1A

**NOTES**


- This wiring diagram only applies to the outdoor unit
- Field wiring
- terminal strip, connector, terminal, Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = Brown, GRY = Grey, GRN = Green, ORG = Orange

# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

2  
7

EWYQ21,40BA

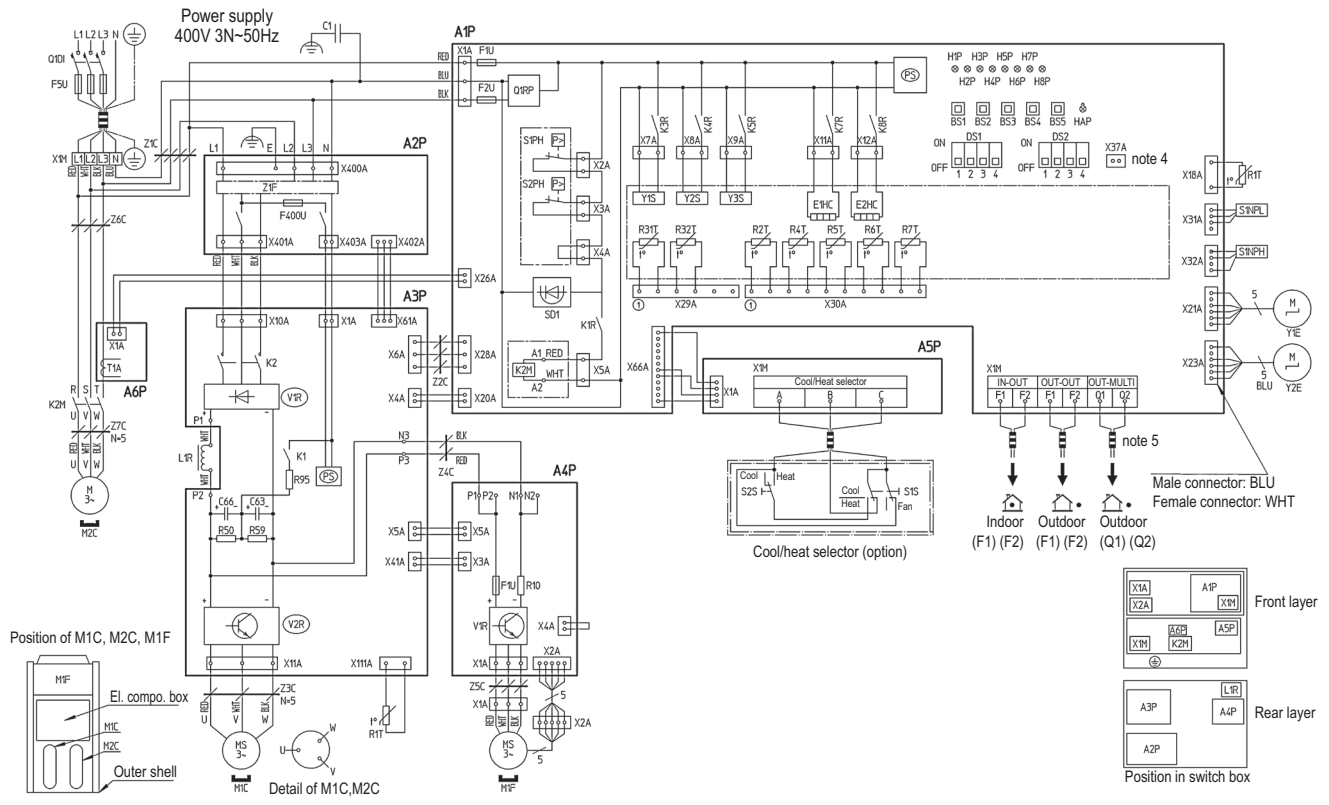

A1P-A6 P	Printed circuit board	Q1D1	Earth leakage breaker	
	A1P: Main	R10	Resistor (current sensor) (A4P)	
BS1-BS5	Push button switch (Mode, set, return, test, reset)	R1T-R7T	Thermistor	
		R31T,R32T	R1T: AIR (A1P)	
C1	Capacitor	R4T	Heat exch. deicer	
C63,C66	Capacitor	R5T	Heat exch. outlet	
DS1, DS2	Dip switch	R6T	Liquid pipe	
E1HC,E2HC	Crankcase heater	R7T	Accumulator	
F1U	Fuse (250V, 8A ⊕) (A4P)	S1NPH	Pressure sensor (high)	
F1U, F2U	Fuse (250V, 3.15A ⊕) (A1P)	S1NPL	Pressure sensor (low)	
F5U	Field fuse	S1PH,S2PH	Pressure switch (high)	
F400U	Fuse (250V, 6.3A ⊕) (A2P)	T1A	Current sensor (A6P)	
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test..... Flickering Malfunction detection..... Light up	SD1	Safety devices input	
HAP	Pilotlamp (service monitor - green)	V1R	Power module (A4P)	
K1	Magnetic relay	V1R, V2R	Power module (A3P)	
K2	Magnetic contactor (M1C)	X1A,X2A	Connector (M1F)	
K2M	Magnetic contactor (M2C)	X1M	Terminal strip (power supply)	
K1R	Magnetic relays (K2M)	X1M	Terminal strip (control) (A1P)	
K3R-K8R	K3R: Y1S	X1M	Terminal strip (A5P)	
	K4R: Y2S	Y1E	Electronic expansion valve (main)	
	K5R: Y3S	Y2E	Electronic expansion valve (subcool)	
L1R	K7R: E1HC	Y1S-Y3S	Solenoid valve	
	K8R: E2HC	Y1S: Hot gas	Y3S: 4 way valve	
M1C,M2C	Motor (Compressor)	Y2S: Oil return		
M1F	Motor (Fan)	Z1C-Z7C	Noise filter (ferrite core)	
PS	Switching power supply (A1P, A3P)	Z1F	Noise filter (With surge absorber)	
Q1RP	Phase reversal detect circuit			
			Cool/Heat Selector	
			S1S	Selector switch (fan/cool - heat)
			S2S	Selector switch (cool - heat)

2TW27256-1A

**NOTES**


- This wiring diagram only applies to the outdoor unit
- ⊕: field wiring,
- : terminal strip, ⊠: connector, ○: terminal, ⊕: Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange



# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

EWA-YQ25,50BA

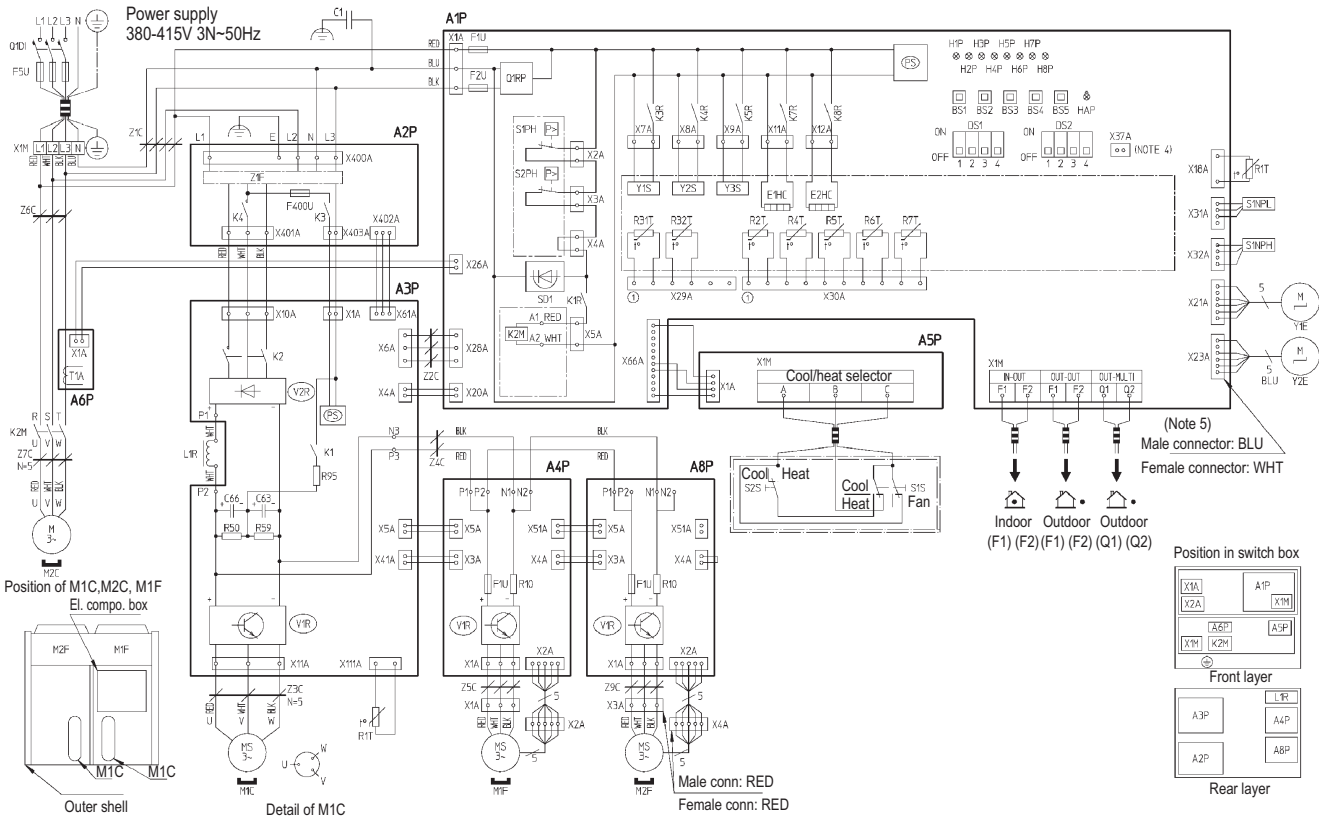

A1P-A6P	Printed circuit board	K1R	Magnetic relays (K2M)	S1PH, S2PH	Pressure switch (high)	
	A1P: Main	A4P, A8P: Fan	K3R: Y1S	K7R: E1HC	T1A	Current sensor (A6P)
	A2P: Noise filter	A5P: ABC I/P	K4R: Y2S	K8R: E2HC	SD1	Safety devices input
BS1-BS5	Push button switch (Mode, set, return, test, reset)	L1R	Reactor	V2R	Diode bridge (A3P)	
		M1C, M2C	Motor (Compressor)	X1A-X4A	Connector (M1F, M2F)	
C1	Capacitor	M1F, M2F	Motor (Fan)	X1M	Terminal strip (power supply)	
C63, C66	Capacitor	PS	Switching power supply (A1P, A3P)	X1M	Terminal strip (Control) (A1P)	
DS1, DS2	Dip switch	Q1RP	Phase reversal detect circuit	X1M	Terminal strip (A5P)	
E1HC	Crankcase heater	Q1DI	Earth leakage breaker	Y1E	Electronic expansion valve (main)	
F1U	Fuse (DC 650V, 8A Ⓢ) (A4P, A8P)	R1T-R7T R31T-R32T	Thermistor	Y2E	Electronic expansion valve (subcool)	
F1U, F2U	Fuse (250V, 3.15A Ⓢ) (A1P)		R1T: AIR (A1P)	R4T: Heat exch. deicer	Y1S-Y3S	Solenoid valve
F5U	Field fuse		R1T: FIN (A3P)	R5T: Heat exch. outlet		Y1S: Hot gas
F400U	Fuse (250V, 6.3A Ⓢ) (A2P)		R2T: Suction	R6T: Liquid pipe	Y2S: Oil return	
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test ----- Flickering Malfunction detection --- Light up	R10	Resistor (current sensor) (A4P)	Z1C-Z9C	Noise filter (ferrite core)	
		HAP	Pilotlamp (service monitor - green)	R50, R59	Resistor	Z1F
K1, K3	Magnetic relay	R95	Resistor (current limiting)	Cool/heat selector		
K2, K4	Magnetic contactor (M1C)	S1NPH	Pressure sensor (high)	S1S	Selector switch (fan/cool-heat)	
K2M	Magnetic contactor (M2C)	S1NPL	Pressure sensor (low)	S2S	Selector switch (cool-heat)	

2TW31476-1

### NOTES


- This wiring diagram only applies to the outdoor unit
- |—: field wiring
- : terminal strip, □□□: connector, ○: terminal, ⊕: Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange

2  
7

# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase

2  
7

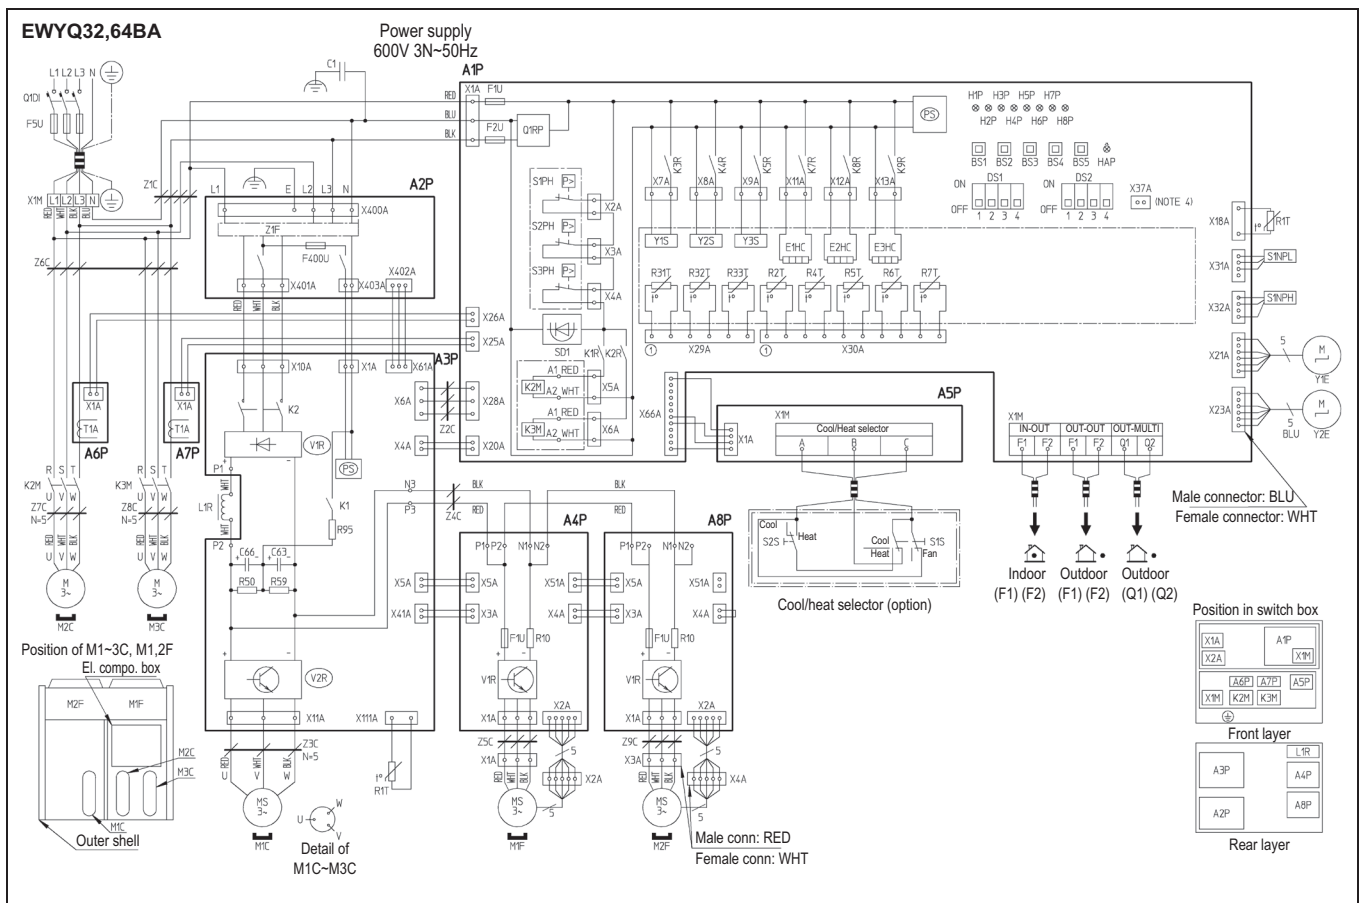

A1P-A7P	Printed circuit board	R1T-R7T R31T-R33T	Thermistor	R33T: M3C discharge R4T: Heat exch. deicer R5T: Heat exch. outlet R6T: Liquid pipe R7T: Accumulator	
	A1P: Main		A4P, A8P: Fan		R1T: AIR (A1P)
	A2P: Noise filter		A5P: ABC I/P		R1T: FIN (A3P)
BS1-BS5	Push button switch (Mode, set, return, test, reset)	R50, R59	Resistor		
C1	Capacitor	R95	Resistor (current limiting)		
DS1, DS2	Dip switch	S1NPH	Pressure sensor (high)		
E1HC-E3HC	Crankcase heater	S1NPL	Pressure sensor (low)		
F1U	Fuse (250V, 8A Ⓞ) (A4P)	S1PH-S3PH	Pressure switch (high)		
F1U, F2U	Fuse (250V, 3.15A ⓘ) (A1P)	T1A	Current sensor (A6P, A7P)		
F5U	Field fuse	SD1	Safety devices input		
F400U	Fuse (250V, 6.3A ⓘ) (A2P)	V1R	Power module (A4P, A8P)		
H1P-H8P	Pilotlamp (service monitor - orange) [H2P] Prepare, Test..... Flickering Malfunction detection..... Light up	V1R, V2R	Power module (A3P)		
HAP	Pilotlamp (service monitor - green)	X1A-X4A	Connector (M1F)		
K1	Magnetic relay	X1M	Terminal strip (power supply)		
K2	Magnetic contactor (M1C)	X1M	Terminal strip (control) (A1P)		
K2M, K3M	Magnetic contactor (M2C, M3C)	X1M	Terminal strip (A5P)		
K1R, K2R	Magnetic relays (K2M, K3M)	Y1E	Electronic expansion valve (main)		
K3R-K9R	K3R: Y1S	Y2E	Electronic expansion valve (subcool)		
	K4R: Y2S		Solenoid valve		
	K5R: Y3S	Y1S: Hot gas	Y1S: Hot gas	Y3S: 4 way valve	
K7R-K9R	K7R: E1HC	Y2S: Oil return			
	K8R: E2HC				
	K9R: E3HC	Z1C-Z9C	Noise filter (ferrite core)		
L1R	Reactor	Z1F	Noise filter (With surge absorber)		
M1C-M2C	Motor (Compressor)				
M1F, M2F	Motor (Fan)				
PS	Switching power supply (A1P, A3P)				
Q1RP	Phase reversal detect circuit				
Q1DI	Earth leakage breaker				
R10	Resistor (current sensor) (A4P, A8P)				
			<b>Cool/Heat Selector</b>		
			S1S	Selector switch (fan/cool - heat)	
			S2S	Selector switch (cool - heat)	

2TW27276-1A

**NOTES**

- This wiring diagram only applies to the outdoor unit
- ▬▬▬: field wiring,
- : terminal strip, □○□: connector, ○-: terminal, ⊕: Protective earth (screw)
- When using the option adapter, refer to the installation manual
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2 and on how to use BS1-BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH
- BLK = Black, RED = Red, BLU = Blue, WHT = White, PNK = Pink, YLW = Yellow, BRN = brown, GRY = Grey, GRN = Green, ORG = Orange

# 7 Wiring diagrams


## 7 - 1 Wiring Diagrams - Three Phase

EWYQ-BA


Wiring diagram - Hydromodule

Part number	Description
A1P	Main PCB (master)
A2P	User interface PCB
A3P	Control PCB
A4P	* Demand PCB
A5P	Main PCB (slave)
A6P	* Demand PCB
A7P	* Remote user Interface PCB
C1 - C3	Filter capacitor
E1H	Switch box heater
E2H	Plate heat exchanger heater (circuit 1)
E3H	Plate heat exchanger heater (circuit 2)
E4H	Water piping heater
E5H	Expansion vessel heater
F1 - F2	Fuse (F, 1A, 250V)
F1U (A*P)	Fuse (T, 3.15A, 250V)
HAP (A*P)	PCB LED
K11E	Electronic expansion valve (circuit 1)
K21E	Electronic expansion valve (circuit 2)
K1P	Pump contactor
K1S	Pump overcurrent relay
K*R (A3P)	PCB relay
M1P	Pump
PS (A*P)	Switching power supply
Q1DI	# Earth leakage circuit breaker
Q1T	Thermostat for expansion vessel heater
R11T	Leaving water thermistor (Circuit 1)
R12T	Returning water thermistor (Circuit 1)
R13T	Refrigerant liquid thermistor (Circuit 1)
R14T	Refrigerant gas thermistor (Circuit 1)
R21T	Leaving water thermistor (Circuit 2)
R22T	Returning water thermistor (Circuit 2)
R23T	Refrigerant liquid thermistor (Circuit 2)
R24T	Refrigerant gas thermistor (Circuit 2)
S1L	Flow switch (Circuit 1)
S2L	Flow switch (Circuit 2)
S1M	Main switch
S1S	# Thermostat Input 1
S2S	# Thermostat input 2
S3S	# Operation ON input
S4S	# Operation OFF input
SS1 (A1P, A5P)	Selector switch (emergency)
SS1 (A2P)	Selector switch (main / sub)
SS1 (A7P)	* Selector switch (main / sub)
V1C - V2C	Ferrite core noise filter
X1M - X4M	Terminal strip
X801M (A*P)	* PCB terminal strip
Z1F - Z2F (A*P)	Noisefilter

\*: field installed option #: field supplied

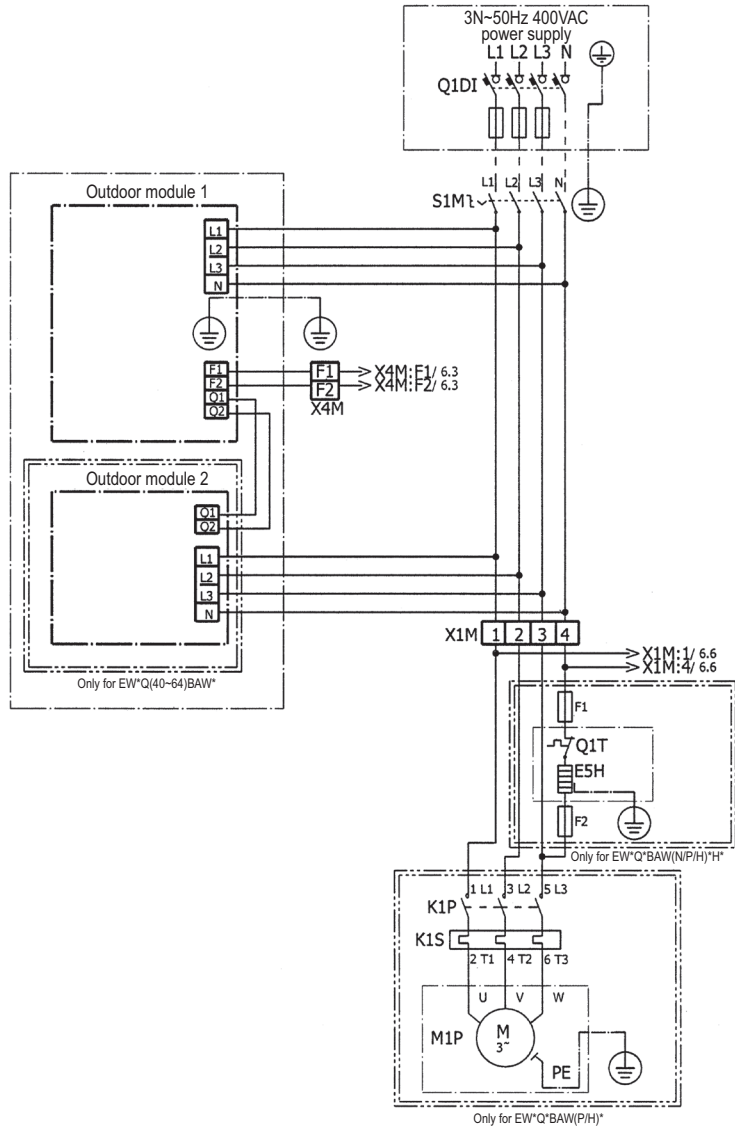

Switchbox layout

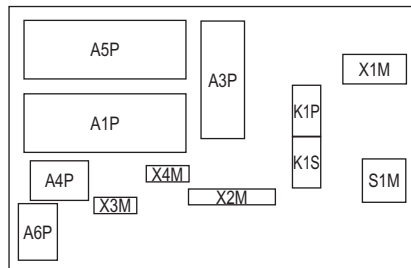

4TW60726-1 (1)

### NOTES


- X1M: Terminal; X2M: Field wiring terminal for high voltage; X3M: Field wiring terminal for low voltage; X4M: Factory wiring terminal for low voltage
- : Earth wiring; - - - - -: Field supply; [ ]: Option; [ ]: Wiring depending on model; [ ]: Not mounted in switch box; [ ]: PCB; 1: Several wiring possibilities
- User installed options:

- EKRUAHT\* = Remote user interface
- 1x EKRP1AHT\* = Demand PCB (only for EW\*Q(16-32)BAW\*)
- 2x EKRP1AHT\* = Demand PCB's (only for EW\*Q(40-64)BAW\*)

# 7 Wiring diagrams

## 7 - 1 Wiring Diagrams - Three Phase


2  
7

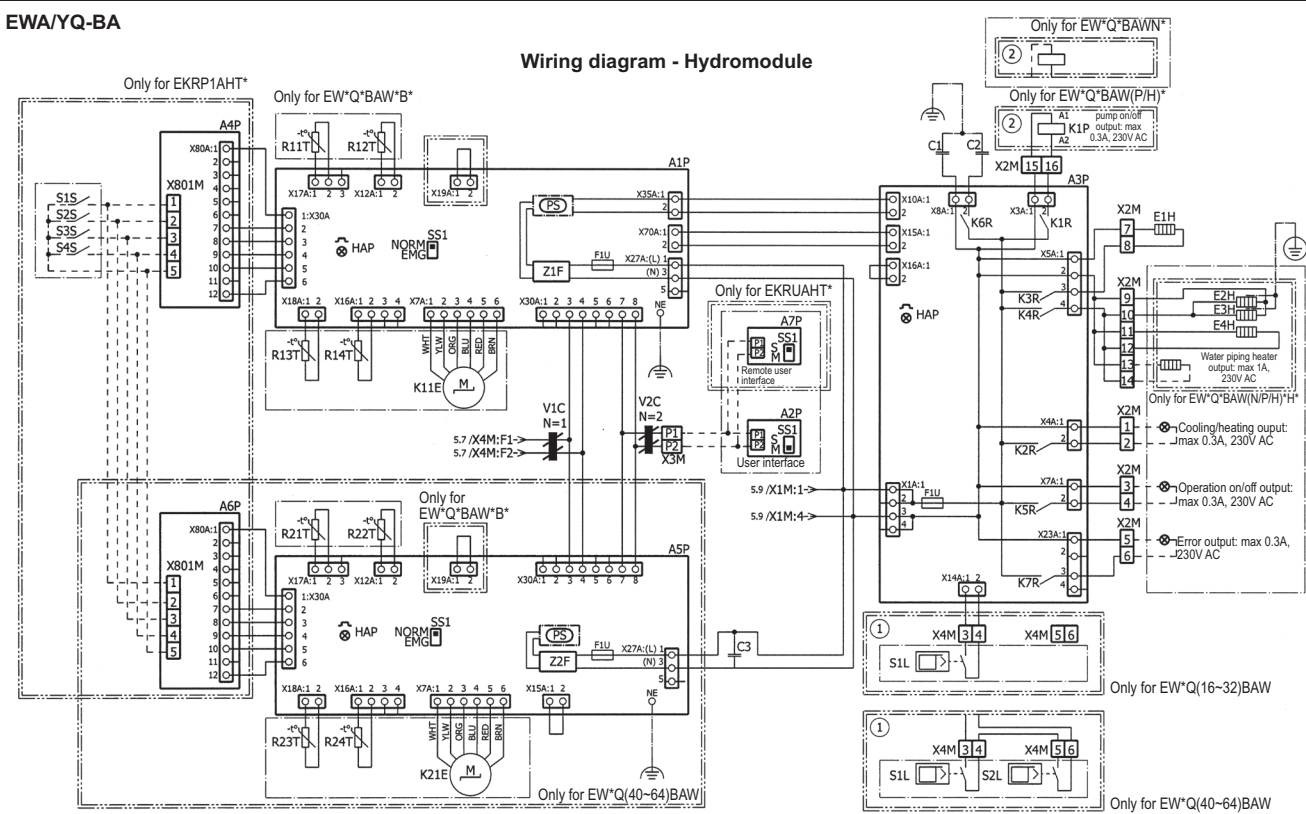

Part number	Description
A1P	Main PCB (master)
A2P	User interface PCB
A3P	Control PCB
A4P	* Demand PCB
A5P	Main PCB (slave)
A6P	* Demand PCB
A7P	* Remote user interface PCB
C1 - C3	Filter capacitor
E1H	Switch box heater
E2H	Plate heat exchanger heater (circuit 1)
E3H	Plate heat exchanger heater (circuit 2)
E4H	Water piping heater
E5H	Expansion vessel heater
F1 - F2	Fuse (F, 1A, 250V)
F1U (A*P)	Fuse (T, 3.15A, 250V)
HAP (A*P)	PCB LED
K11E	Electronic expansion valve (circuit 1)
K21E	Electronic expansion valve (circuit 2)
K1P	Pump contactor
K1S	Pump overcurrent relay
K*R (A3P)	PCB relay
M1P	Pump
PS (A*P)	Switching power supply
Q1DI	# Earth leakage circuit breaker
Q1T	Thermostat for expansion vessel heater
R11T	Leaving water thermistor (Circuit 1)
R12T	Returning water thermistor (Circuit 1)
R13T	Refrigerant liquid thermistor (Circuit 1)

R14T	Refrigerant gas thermistor (Circuit 1)
R21T	Leaving water thermistor (Circuit 2)
R22T	Returning water thermistor (Circuit 2)
R23T	Refrigerant liquid thermistor (Circuit 2)
R24T	Refrigerant gas thermistor (Circuit 2)
S1L	Flow switch (Circuit 1)
S2L	Flow switch (Circuit 2)
S1M	Main switch
S1S	# Thermostat Input 1
S2S	# Thermostat input 2
S3S	# Operation ON input
S4S	# Operation OFF input
SS1 (A1P, A5P)	Selector switch (emergency)
SS1 (A2P)	Selector switch (main / sub)
SS1 (A7P)	* Selector switch (main / sub)
V1C - V2C	Ferrite core noise filter
X1M - X4M	Terminal strip
X801M (A*P)	* PCB terminal strip
Z1F - Z2F (A*P)	Noisefilter

\*: field installed option #: field supplied

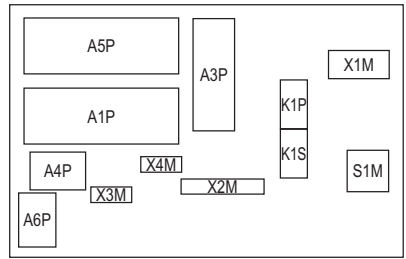

Switchbox layout

4TW60726-1 (2)


### NOTES

- X1M: Terminal; X2M: Field wiring terminal for high voltage; X3M: Field wiring terminal for low voltage; X4M: Factory wiring terminal for low voltage
- : Earth wiring; - - - - -: Field supply; [ ]: Option; [ ]: Wiring depending on model; [ ]: Not mounted in switch box; [ ]: PCB; 1: Several wiring possibilities
- User installed options:

- EKRUHT\* = Remote user interface
- 1x EKRP1AHT\* = Demand PCB (only for EW\*Q(16-32)BAW\*)
- 2x EKRP1AHT\* = Demand PCB's (only for EW\*Q(40-64)BAW\*)

# 8 External connection diagrams

## 8 - 1 External Connection Diagrams

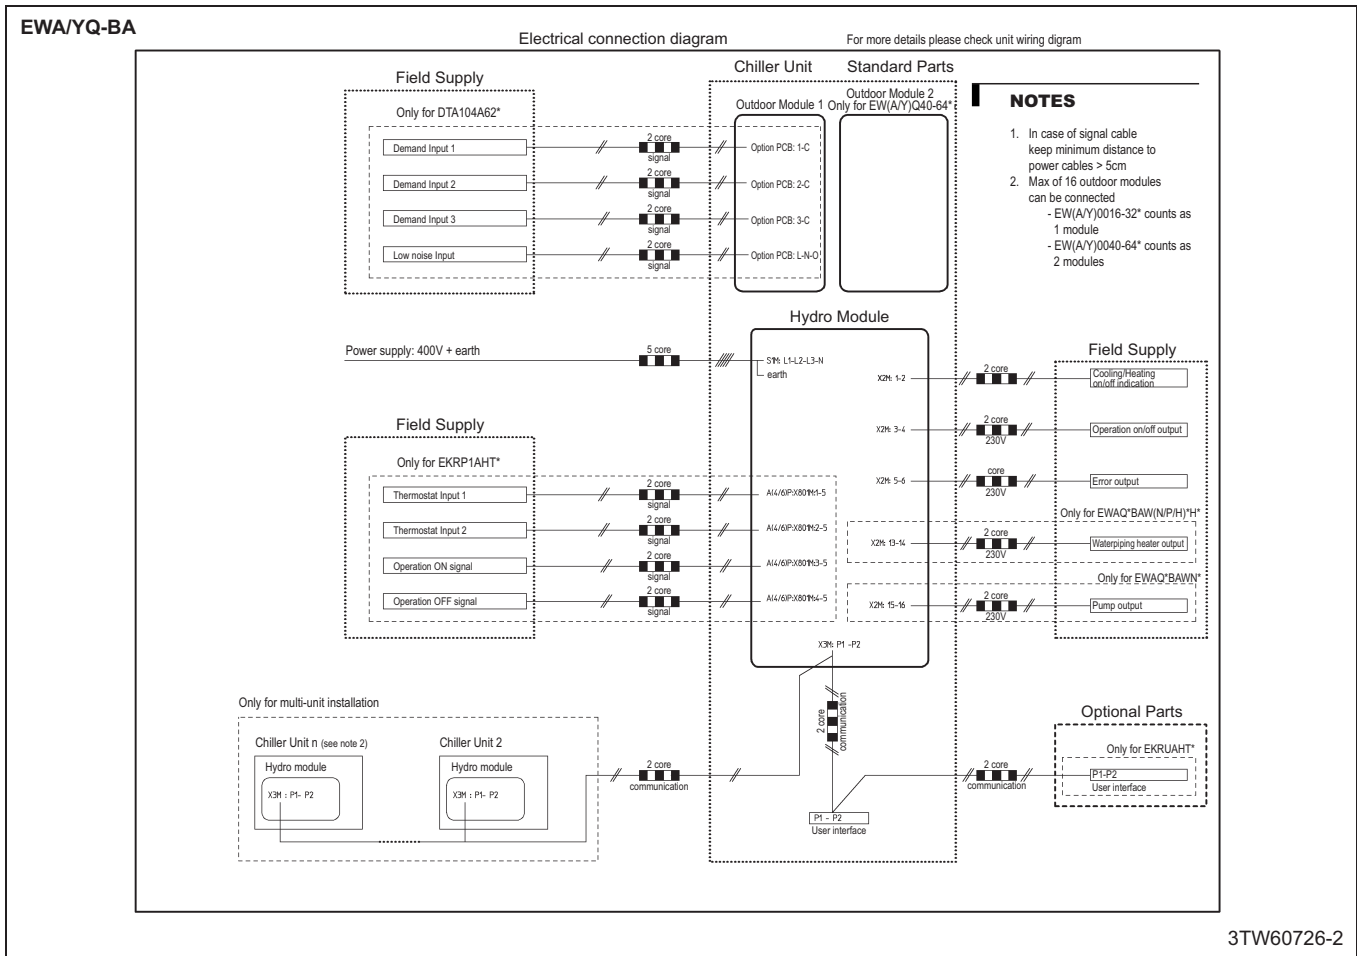

2  
8

## 9 Sound data

### 9 - 1 Sound Power Spectrum

#### EWA/YQ-BA

Models LWE=7°C / Tamb=35°C								Total (dBA)
	125	250	500	1000	2000	4000	8000	LwA
EW(A/Y)Q016BAW*	84	79	76	73	67	65	61	78
EW(A/Y)Q021BAW*	84	80	77	73	66	60	53	78
EW(A/Y)Q025BAW*	84	80	77	73	66	60	53	78
EW(A/Y)Q032BAW*	84	80	80	75	68	63	62	80
EW(A/Y)Q040BAW*	87	83	80	76	69	63	56	81
EW(A/Y)Q050BAW*	87	83	80	76	69	63	56	81
EW(A/Y)Q064BAW*	87	83	83	78	71	66	65	83

#### NOTES

1. Values of Sound power according to ISO3744
2. LWE = Leaving water evaporator temperature  
Tamb = Ambient temperature

4TW60717-1A

# 10 Installation

## 10 - 1 Water Charge, Flow and Quality

### EWAY/Q-BA

This table is from JRA GL-02-1994

JRA: Japanese Refrigerant Association

ITEMS (1) (5)	Cooling water (3)			Cooled water		Heated water (2)				Tendency if out of criteria	
	Circulating system		Once flow	Circulating water [below 20°C]	Supply water (4)	Low temperature		High temperature			
	Circulating water	Supply water (4)	Flowing water			Circulating water [20°C-60°C]	Supply water (4)	Circulating water [60°C-80°C]	Supply water (4)		
ITEMS TO BE CONTROLLED	pH at 25°C	6.5~8.2	6.0~8.0	6.8~8.0	6.8~8.0	7.0~8.0	7.0~8.0	7.0~8.0	7.0~8.0	corrosion + scale	
	Electrical conductivity	[mS/m] at 25°C	below 80	below 30	below 40	below 40	below 30	below 30	below 30	below 30	corrosion + scale
		[µS/cm] At 25°C(1)	(below 800)	(below 300)	(below 400)	(below 400)	(below 300)	(below 300)	(below 300)	(below 300)	corrosion + scale
	Chloride ion [mgCl <sup>-</sup> /l]	below 200	below 50	below 50	below 50	below 50	below 50	below 50	below 30	below 30	corrosion
	Sulfate ion [mgSO <sub>4</sub> <sup>2-</sup> /l]	below 200	below 50	below 50	below 50	below 50	below 50	below 50	below 30	below 30	corrosion
	M-alkalinity (pH4.8) [mgCaCO <sub>3</sub> /l]	below 100	below 50	below 50	below 50	below 50	below 50	below 50	below 50	below 50	scale
	Total hardness [mgCaCO <sub>3</sub> /l]	below 200	below 70	below 70	below 70	below 70	below 70	below 70	below 70	below 70	scale
	Calcium hardness [mgCaCO <sub>3</sub> /l]	below 150	below 50	below 50	below 50	below 50	below 50	below 50	below 50	below 50	scale
Silica ion [mgSiO <sub>2</sub> /l]	below 50	below 30	below 30	below 30	below 30	below 30	below 30	below 30	below 30	scale	
ITEMS TO BE REFERRED TO	Iron [mgFe/l]	below 1.0	below 0.3	below 1.0	below 1.0	below 0.3	below 1.0	below 0.3	below 1.0	below 0.3	corrosion + scale
	Copper [mgCu/l]	below 0.3	below 0.1	below 1.0	below 1.0	below 0.1	below 1.0	below 0.1	below 1.0	below 0.1	corrosion
	Sulfide ion [mgS <sup>2-</sup> /l]	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	not detectable	corrosion
	Ammonium ion [mgNH <sub>4</sub> <sup>+</sup> /l]	below 1.0	below 0.1	below 1.0	below 1.0	below 0.1	below 0.3	below 0.1	below 0.1	below 0.1	corrosion
	Remaining chloride [mgCl/l]	below 0.3	below 0.3	below 0.3	below 0.3	below 0.3	below 0.25	below 0.3	below 0.1	below 0.3	corrosion
	Free carbide [mgCo <sub>2</sub> /l]	below 4.0	below 4.0	below 4.0	below 4.0	below 4.0	below 0.4	below 4.0	below 0.4	below 4.0	corrosion
	Stability index	6.0~7.0	---	---	---	---	---	---	---	---	corrosion + scale

#### NOTES

- Names, definitions and units are according to JIS K 0101. Units and figures between brackets are old units published as reference only.
- In case of using heated water (more than 40°C), corrosion is generally noticeable. Especially when the iron material is in direct contact with water without any protection shields, it is desirable to give the valid measures for corrosion. e.g. chemical measure,...
- In the cooling water using hermetic cooling tower, closed circuit water is according to heated water standard, and scattered water is according to cooling water standard.
- Supply water is considered drink water, industrial water and ground water except for genuine water, neutral water and soft water.
- The above mentioned items are representable items in corrosion and scale cases.



3TW50179-1



# 11 Operation range

## 11 - 1 Operation Range

2  
11

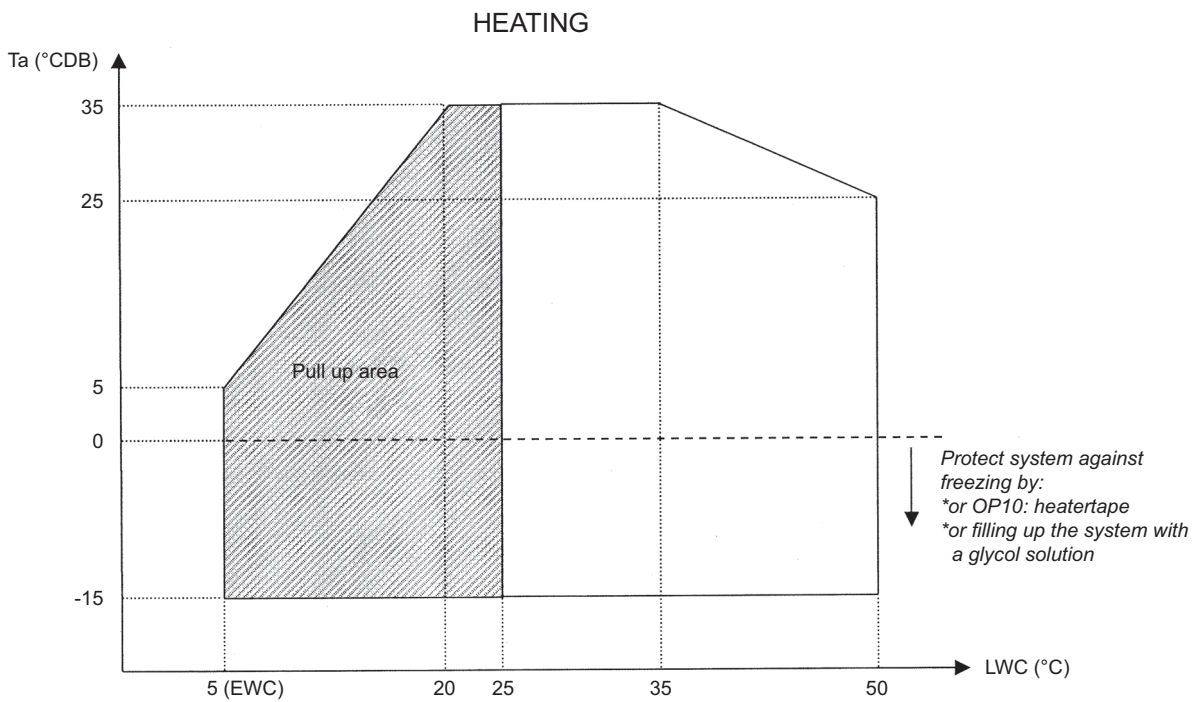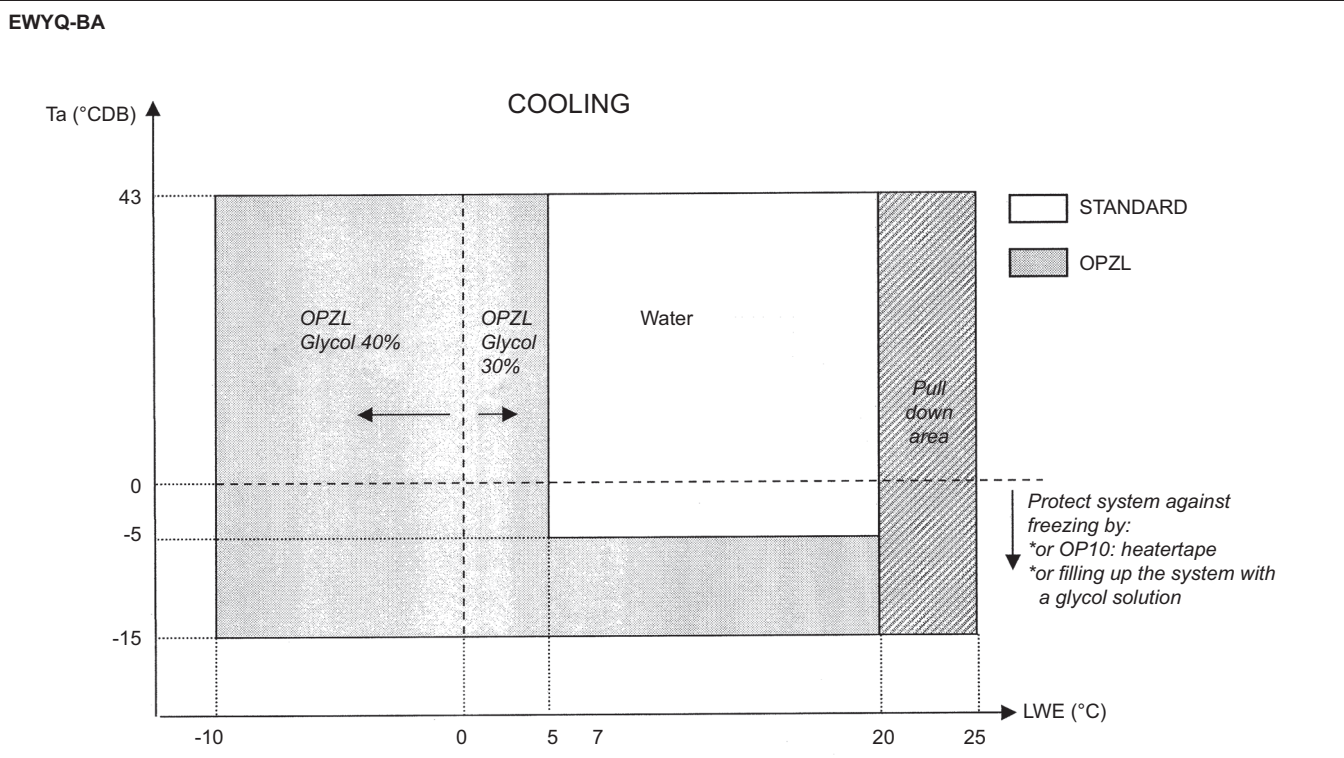




**SYMBOLS**

- Ta : Ambient temperature dry bulb (°C)
- LWE : Leaving water evaporator temperature (°C)
- LWC : Leaving water condenser temperature (°C)
- EWC : Entering water



# 12 Hydraulic performance

## 12 - 1 Static Pressure Drop Unit

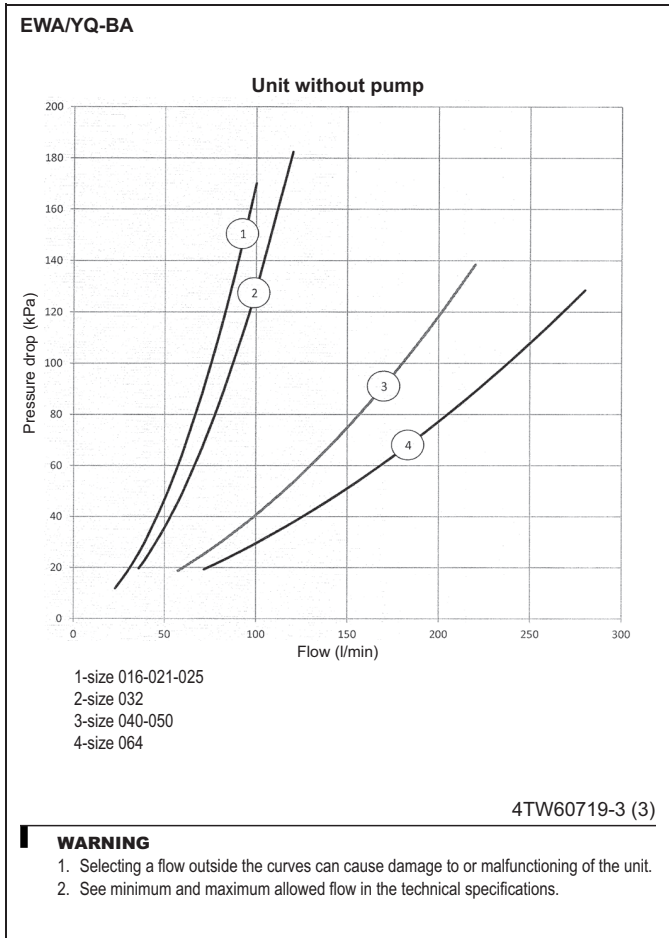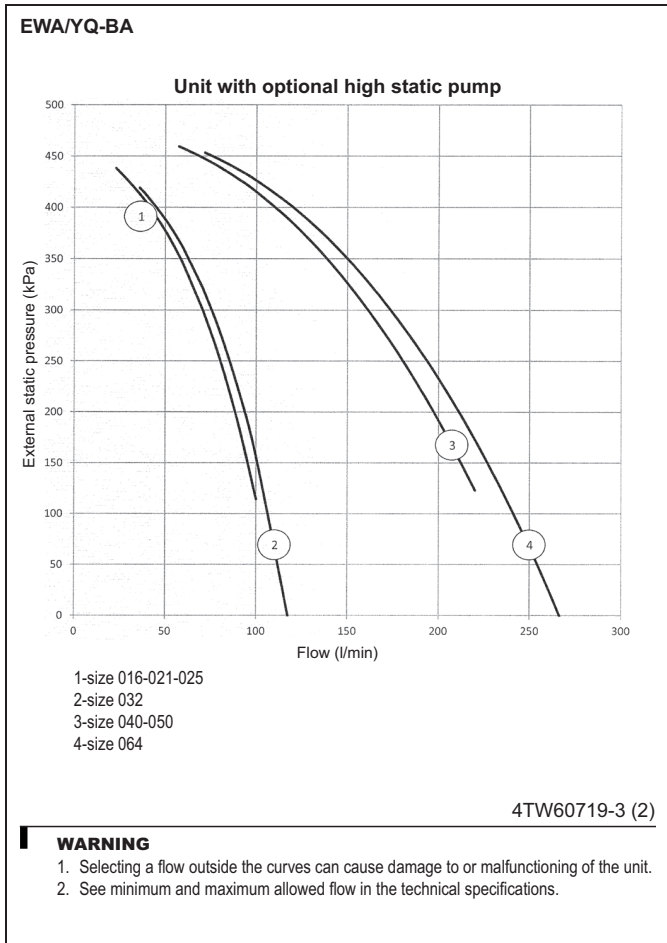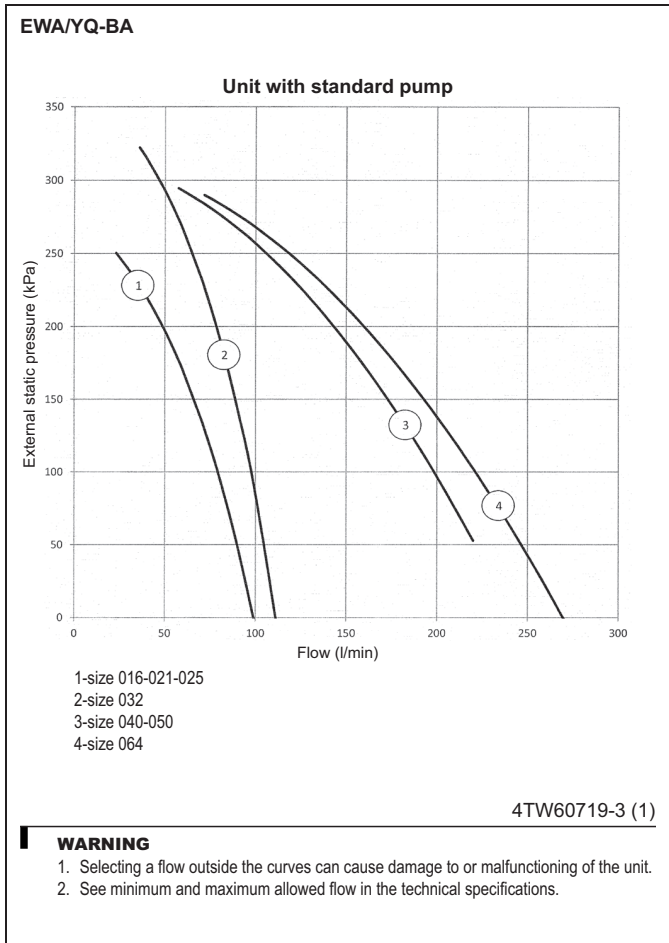





Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



Daikin Europe N.V. participates in the Eurovent Certification programme for Air conditioners (AC), Liquid Chilling Packages (LCP) and Fan coil units (FCU). Check ongoing validity of certificate online: [www.eurovent-certification.com](http://www.eurovent-certification.com) or using: [www.certiflash.com](http://www.certiflash.com)

The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V..



Daikin products are distributed by: