

TABLE OF CONTENTS

FWE-CF

1	Features	2
2	Specifications	3
	Technical Specifications	3
	Electrical Specifications	4
3	Nomenclature	5
	Nomenclature	5
4	Options	6
	Options	6
5	Dimensional drawings	13
	Dimensional Drawings	13
6	Wiring diagrams	14
	Wiring Diagrams - Single Phase	14
7	Installation	15
	Installation Method	15
8	Operation range	19
	Operation Range	19

1 Features

- 4-speed fan motor
- High power air flow
- Wired electronic controllers range
- Available static pressure up to 50Pa
- Wide operating range
- Standard left and right side water connection
- Extended drain pan as standard
- Factory mounted valve (both left and right side)
- Nylon filter G2 class
- Polyethylene insulation



1
1

2 Specifications

2-1 Technical Specifications				FWE02CF	FWE03CF	FWE04CF	FWE06CF	FWE07CF	FWE08CF	FWE10CF
Cooling capacity	Total capacity	Super high	kW	2.10	3.16	3.98	6.05	6.78	7.79	9.91
		High	kW	1.76	2.69	3.22	5.20	5.61	6.79	8.61
		Low	kW	0.85	1.40	1.63	2.72	3.10	3.88	4.88
		Nom.	kW	1.56	2.36	2.70	4.47	4.91	5.98	7.49
	Sensible capacity	Super high	kW	1.55	2.37	3.19	4.49	5.16	5.91	7.45
		High	kW	1.28	1.99	2.53	3.81	4.20	5.09	6.39
		Low	kW	0.66	1.18	1.35	2.02	2.47	3.05	3.65
		Nom.	kW	1.13	1.73	2.10	3.23	3.64	4.44	5.49
Heating capacity	4-Pipe	Super high	kW	2.3	3.53	4.56	6.17	7.6	8.52	10.4
		High	kW	1.94	3.06	3.76	5.37	6.42	7.52	9.16
		Medium	kW	1.75	2.74	3.22	4.69	5.72	6.72	8.07
		Low	kW	1.02	1.72	2.03	2.88	3.92	4.59	5.42
Power input	Super high		W	46	69	83	119	163	181	230
	High		W	39	54	59	93	128	145	180
	Low		W	29	40	42	60	89	102	121
	Nom.		W	34	47	50	73	105	117	145
Casing	Colour			Metal						
	Material			Galvanised metal						
Dimensions	Unit	Height	mm	253						
		Width	mm	590						
		Depth	mm	705	875	1,005	1,205	1,455	1,555	1,815
	Packed unit	Height	mm	260						
		Width	mm	605						
		Depth	mm	720	890	1,020	1,220	1,470	1,570	1,830
Weight	Unit		kg	18	22	25	30	40	41	49
	Operation weight		kg	18	22	25	30	40	41	49
	Packed unit		kg	20	24	28	33	43	45	53
Heat exchanger	Rows	Quantity		3						
	Stages	Quantity		2	3			6		
	Fin pitch		mm	2.1						
	Face area		m ²	6.0	8.4	10.1	12.8	16.2	17.3	21.0
	Water volume		l	0.74	1.02	1.24	1.56	1.97	2.14	2.56
Additional heat exchanger	Rows	Quantity		1						
	Stages	Quantity		1						
	Fin pitch		mm	2.1						
	Face area		m ²	2.01	2.79	3.38	4.27	5.39	5.76	7.01
	Water volume		l	0.25	0.34	0.41	0.52	0.66	0.71	0.85
Water flow	Cooling		l/h	360	540	720	1,044	1,188	1,332	1,728
	Heating		l/h	-						
	Additional heat exchanger		l/h	108	180	216	324	432	468	576
Water pressure drop	Cooling		kPa	14.5	11.4	21.6	46.3	14.6	19.1	32.7
	Heating		kPa	-						
	Additional heat exchanger		kPa	3.6	8.8	15.6	31.8	58.6	74.6	123
Fan	Type			Centrifugal (Blade: forward - curve)						
	Quantity			1		2		3		4
	Air flowrate	Super high	m ³ /h	416.13	626.11	834.52	1,193.03	1,547.59	1,741.82	2,166.07
		High	m ³ /h	302.41	501.23	571.11	905.11	1,173.36	1,386.46	1,728.98
		Medium	m ³ /h	232.05	370.86	376.72	617.57	845.83	1,000.94	1,198.80
		Low	m ³ /h	142	256	257.48	414.34	569	684.16	804.37
Available pressure		High	Pa	-						
Fan motor		Speed	Steps	4						
Sound power level	Super high		dBA	51	61	58	62		64	65
	High		dBA	49	56	48	55	57	58	60
	Nom.		dBA	37	49	38	46	47	50	
	Low		dBA	31	38	32	39	38	41	40

2 Specifications

1
2

2-1 Technical Specifications			FWE02CF	FWE03CF	FWE04CF	FWE06CF	FWE07CF	FWE08CF	FWE10CF
Sound pressure level	Super high	dBA	41	51	48	52		54	55
	High	dBA	39	46	38	45	47	48	49
	Medium	dBA	26	39	28	36	37	40	39
	Low	dBA	21	28	22	29	27	31	29
Piping connections	Drain	OD	mm	19.05					
Insulation material			Physical PE						
Water connections	Std. heat exchanger		inch	3/4					
	Add. heat exchanger		inch	3/4					


2-2 Electrical Specifications			FWE02CF	FWE03CF	FWE04CF	FWE06CF	FWE07CF	FWE08CF	FWE10CF
Current input	Super high	A	0.206	0.309	0.372	0.533	0.731	0.811	1.031
	High	A	0.174	0.243	0.265	0.430	0.575	0.648	0.780
	Medium	A	0.150	0.208	0.217	0.325	0.472	0.523	0.648
	Low	A	0.128	0.177	0.188	0.271	0.400	0.456	0.540
Power supply	Type	AC							
	Phase	1~							
	Frequency	Hz	50						
	Voltage	V	220-240						
Required wire section		mm ²	1						
Required fuses		A	4						

Notes

- (1) All declared values are for ESP "0 Pa"
- (2) Optional products (factory mounted kit) power consumption value is 2,5W (for each valves)
- (3) Fan power output = power delivered to air by fan

3 Nomenclature

3 - 1 Nomenclature

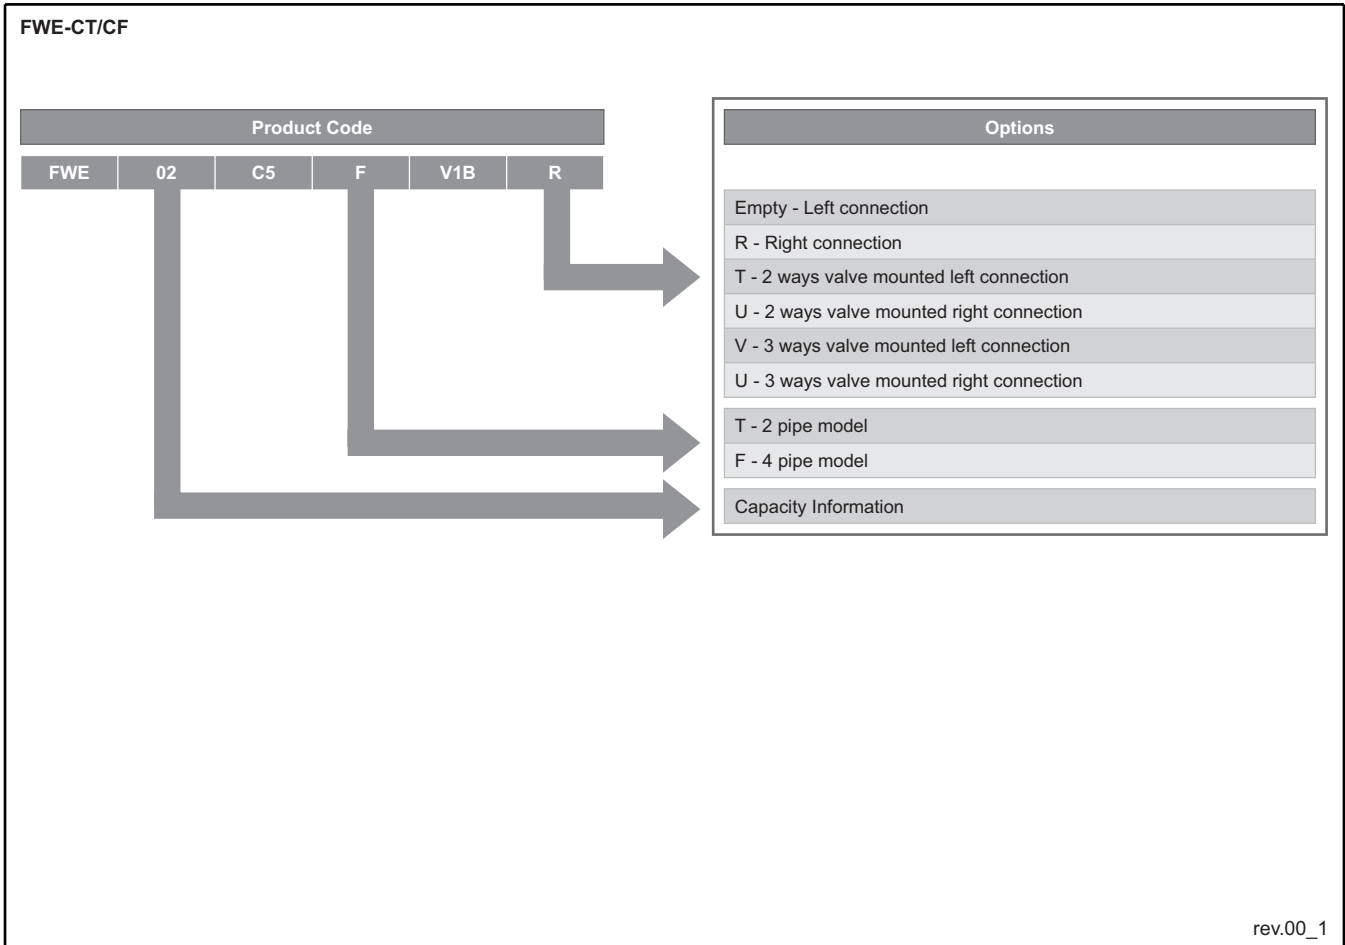

4 Options

4 - 1 Options

FWE-CT/CF

1
4

1 VALVE KIT MODELS

Model Name	Description
EK2MV2B10C5	2 Pipes 2 Way Valve Kit
EK2MV3B10C5	2 Pipes 3 Way Valve Kit
EK4MV2B10C5	4 Pipes 2 Way Valve Kit
EK4MV3B10C5	4 Pipes 3 Way Valve Kit

2 ON/OFF VALVE KITS SPECIFICATIONS

The 2-way or 3-way ON/OFF valve kits, connected to the Daikin controllers, help to set the room temperature by interrupting the water flow to the heat exchanger. The kits are available with various fittings for all FWE units, both for 2-pipe and for 4-pipe systems.

The position of water input, connections to heat exchanger and water returning to the circuit is shown in figure 1 (2 way type) and figure 2 (3 way type) according to the indications on the valve body.

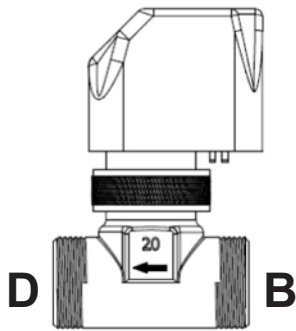


Figure 1

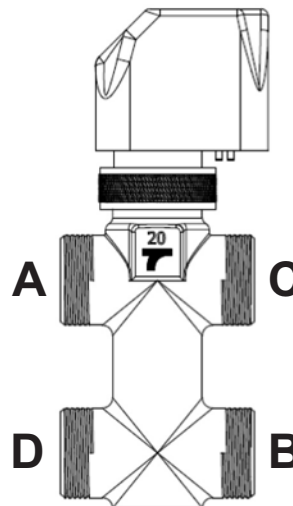


Figure 2

- A = Heat exchanger
- B = Water inlet from circuit
- C = Water returning to circuit
- D = Heat exchanger water inlet

The connection must be made by using "Piping Connection Diagrams" and "Pipe Description Schemas" inside the kit box for each models. All fittings are specified in "Pipe Description Schema" with 1:1 scale to facilitate finding the correct fitting part.

4 Options

4 - 1 Options

FWE-CT/CF

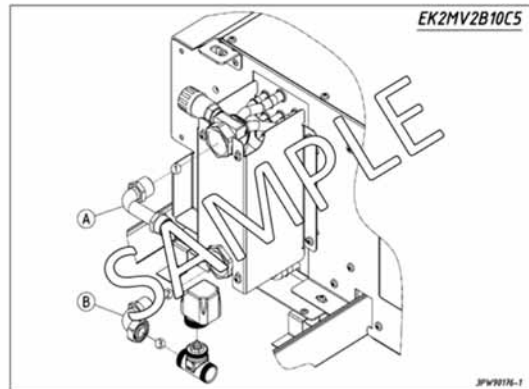


Figure for
4 pipe / 2 way valve model piping connection diagram

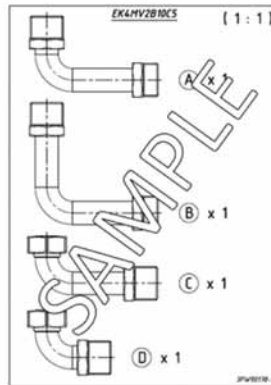


Figure for
4 pipe / 2 way valve model pipe description schema

Piping Connection Diagram

In these files, the letters indicate the corresponding fittings in "pipe description schema". The numbers indicated the assembly sequence that has to be followed.

Pipe Description Schema

In these files, part drawings are scaled 1:1 and the numbers at the right of the part drawings indicate quantity.

! WARNING:

- For electrical connection to the controller, refer to the wiring diagram of the controller.
- Each unit requires a switch (IL) on the feeder line with a distance of at least 3 mm between the opening contacts, and a suitable safety fuse (F).

3 THE KIT CONSISTS OF

- 2-way valve body with 2 connections and 3-way valve body with 4 connections with built-in by-pass made of brass, maximum working pressure 16 bar.
- Electro-thermal actuator having the following specifications:
- Power supply; 230 VAC, activation; NC (Normal Close) and ON/OFF,
- Total opening time: 3 minutes.
- Cable length: 1 meter
- Protection class: IP44 to EN 60529
- Power consumption (normal operation): 2.5 W

! Caution: During mounting of the hydraulic kit to unit, the required amount of extra sealing material should be used to seal between fitting connection points for unmounted units.

! Caution: After mounting the hydraulic kit, the installer must ensure that there is no leakage on any connection point.

Hydraulic kit for the installation of the valve on the heat exchanger.

The flow resistance of the valve is obtained from the following formula:

$$P_w = (Q_w/K_v)^2$$

Valve	K_v direct passage	K_v by-pass
2 Way 3/4"	2.8	-
3 Way 3/4"	2.8	1.8

Where:

P_w is the flow resistance expressed in kg/cm².

Q_w is the water flow rate expressed in m³/h.

K_v is the flow rate identified in the table.


4 Options

4 - 1 Options

1
4


FWE-CT/CF

EK2MV2B10C5

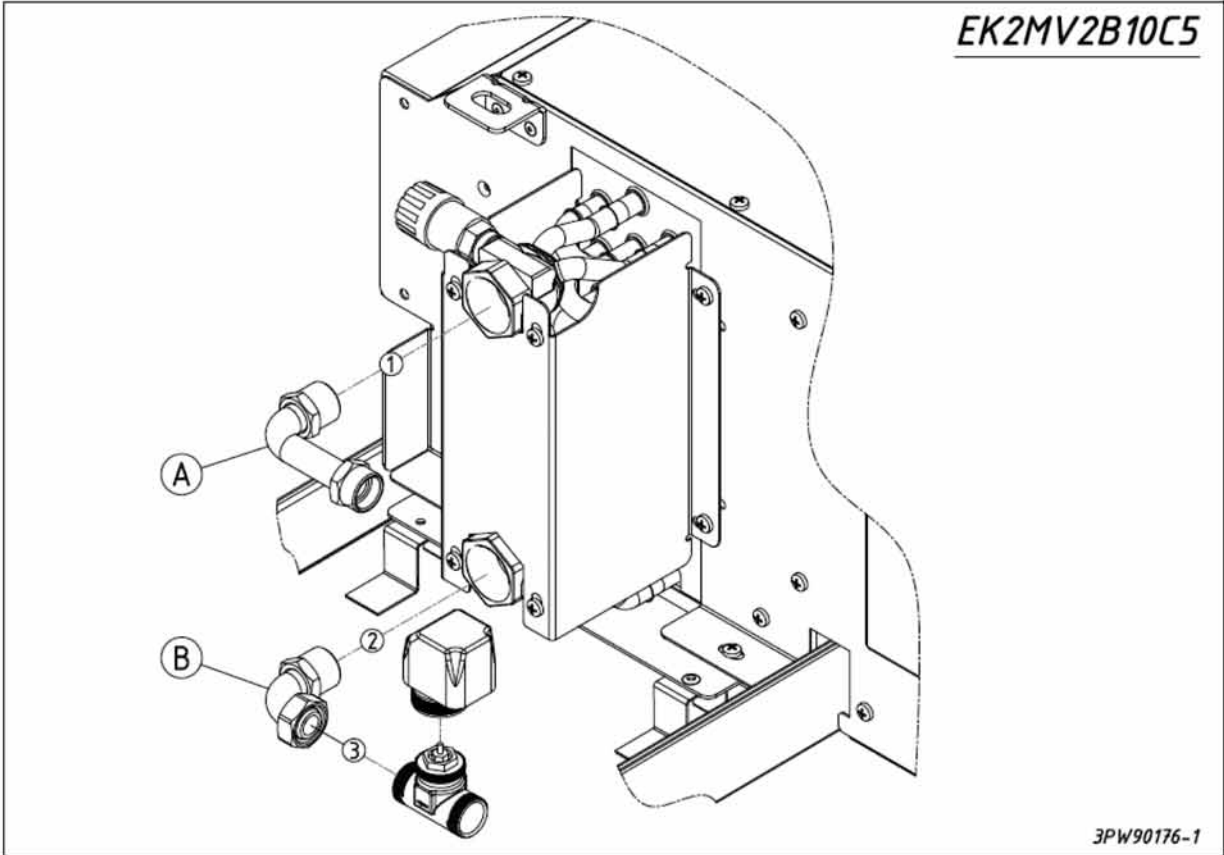

3PW90176-1

EK2MV2B10C5

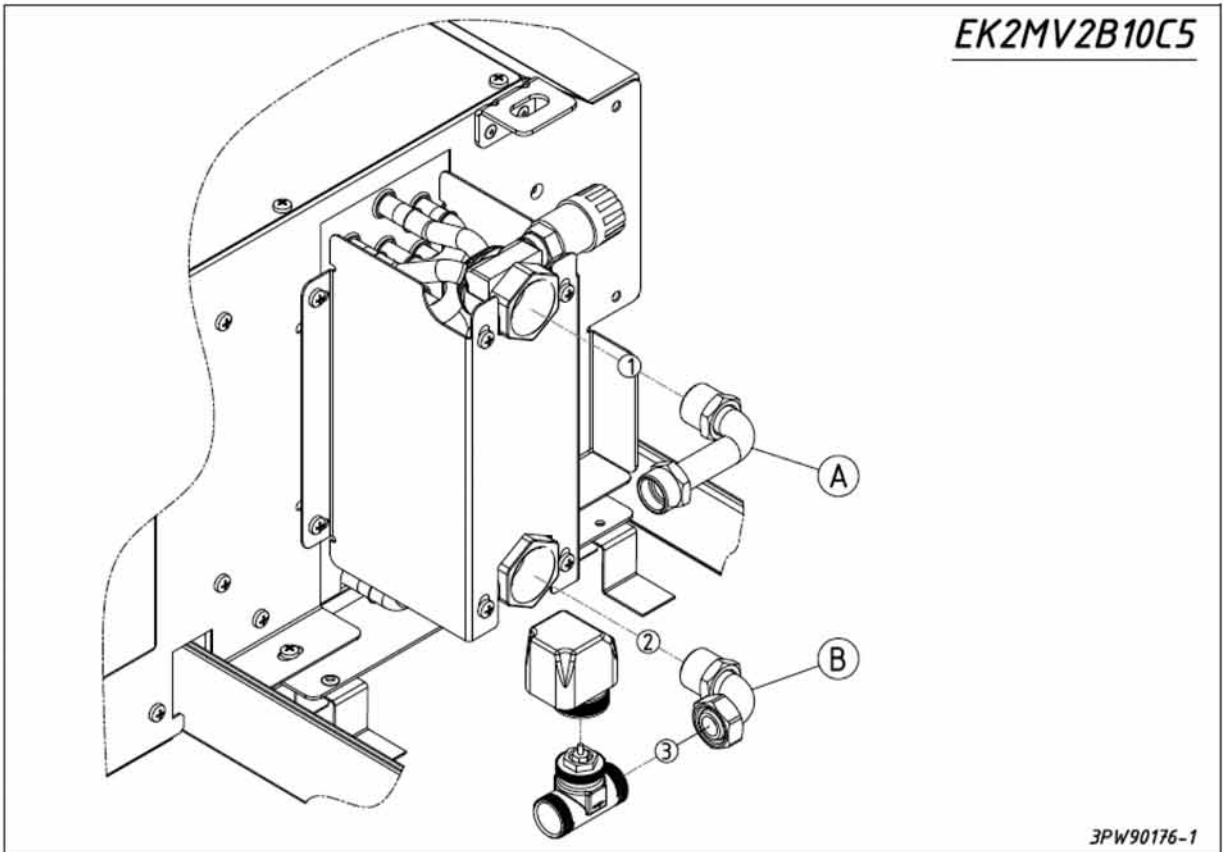

3PW90176-1


rev.00_3

4 Options

4 - 1 Options


FWE-CT/CF

EK2MV3B10C5

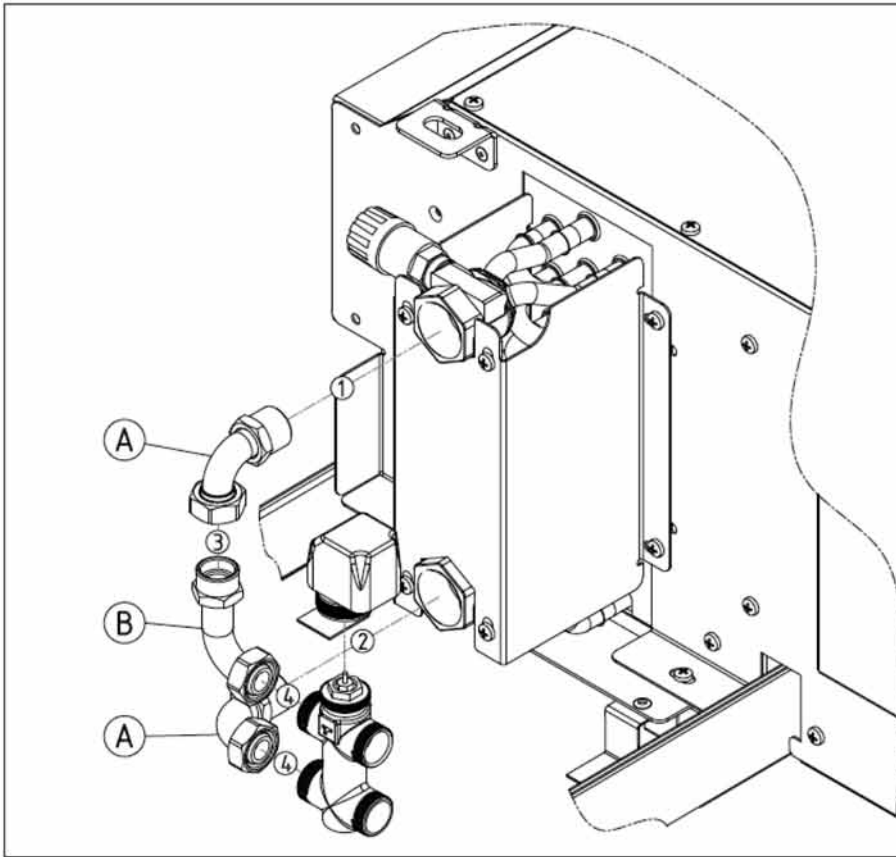

3PW90175-1

EK2MV3B10C5

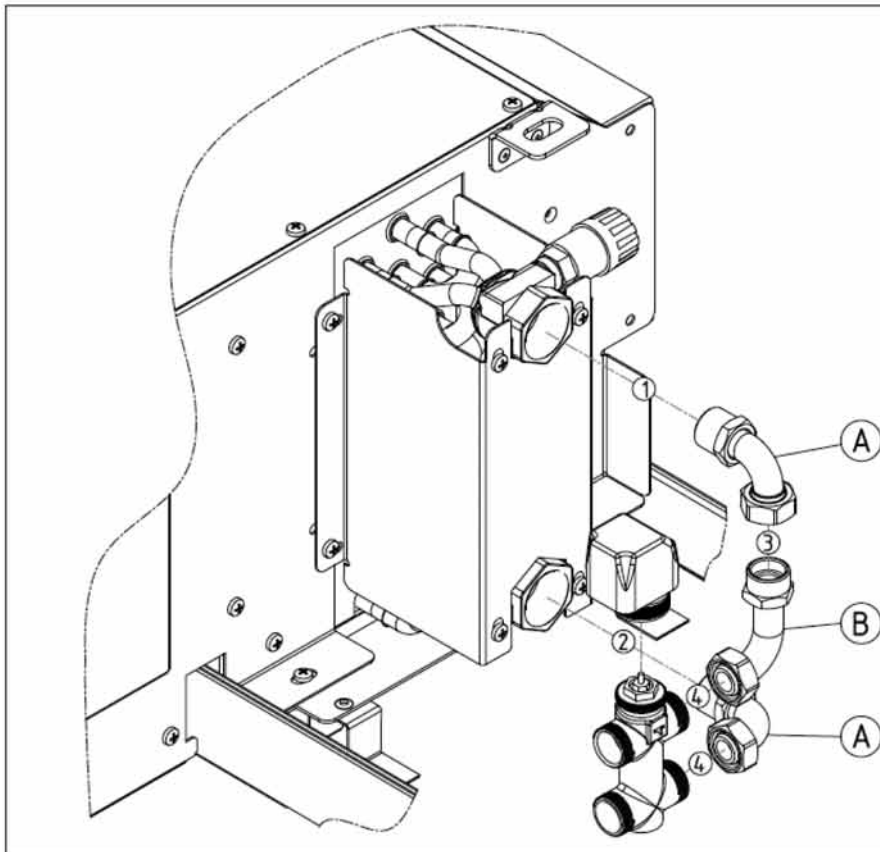

3PW90175-1

rev.00_4


4 Options

4 - 1 Options

1
4


FWE-CT/CF

EK4MV2B10C5

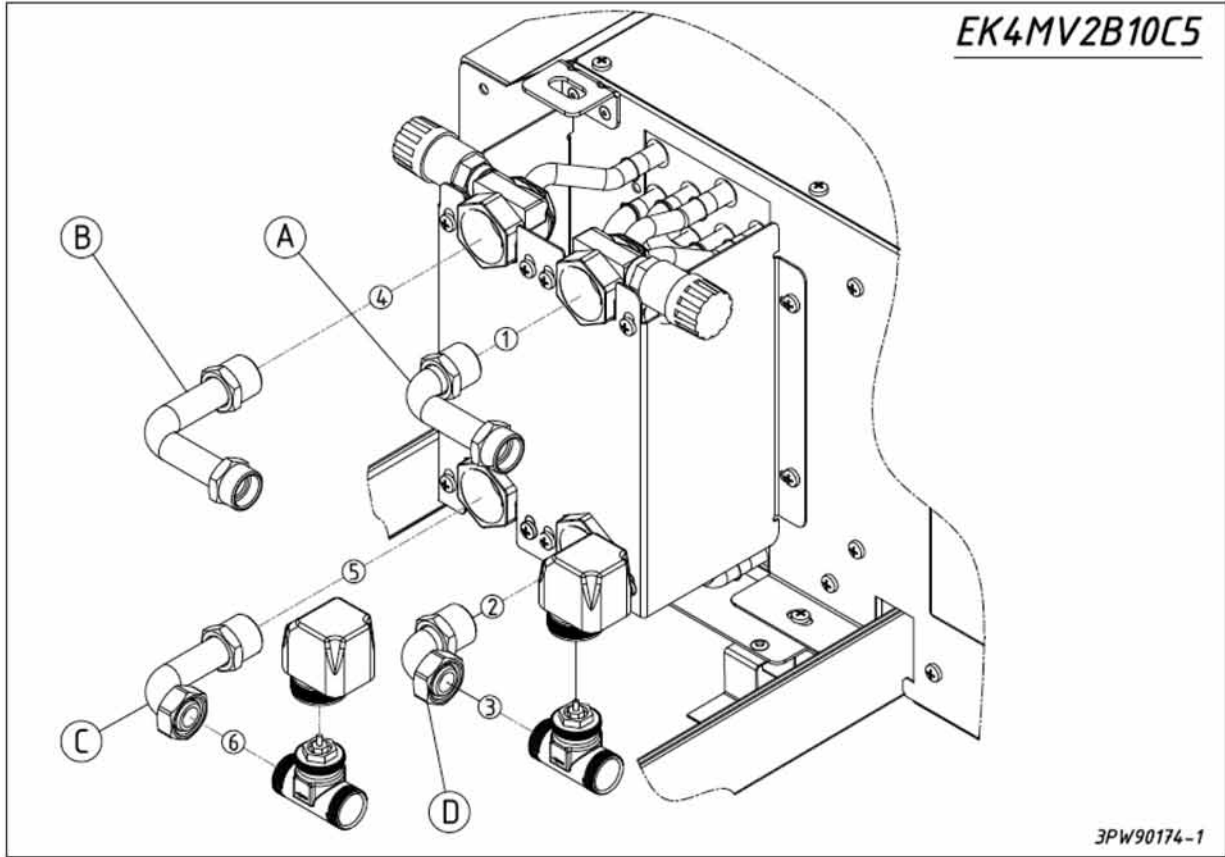

3PW90174-1

EK4MV2B10C5

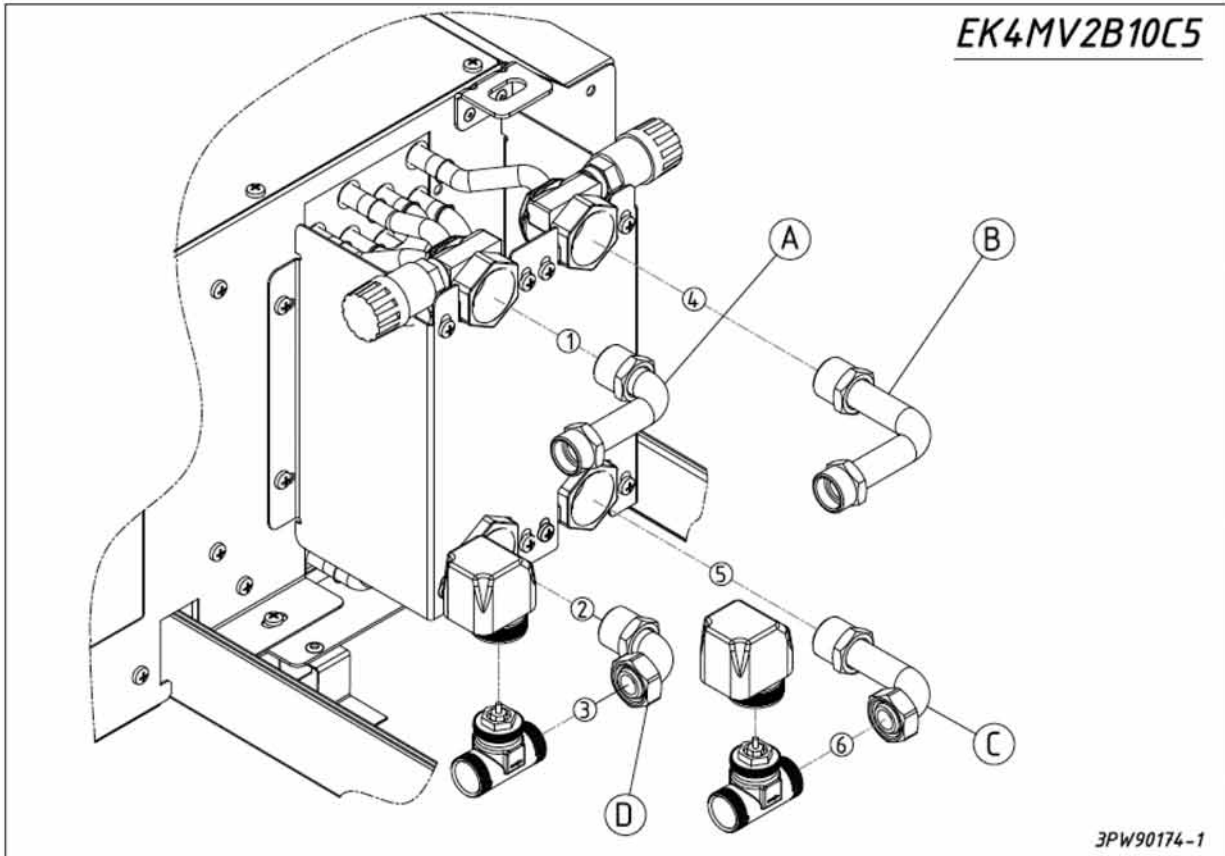



3PW90174-1

rev.00_5

4 Options

4 - 1 Options

FWE-CT/CF

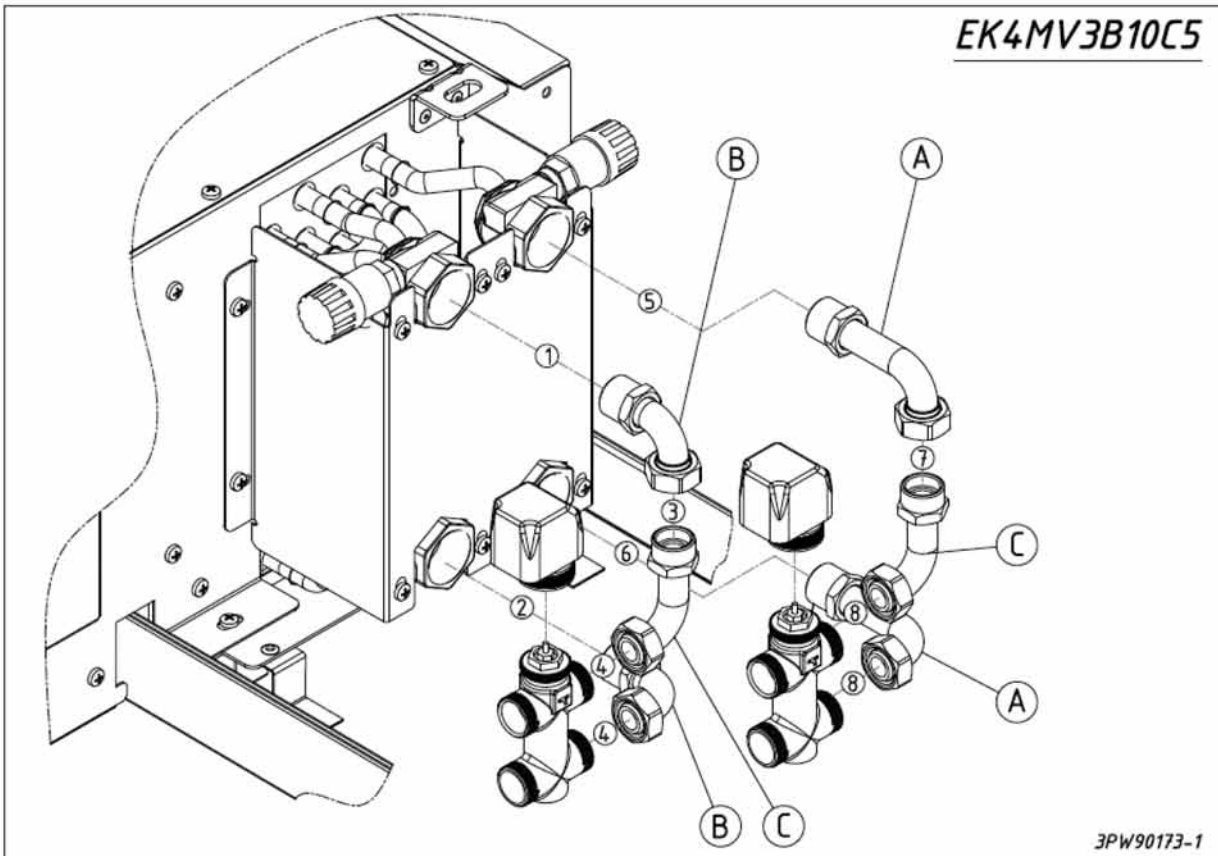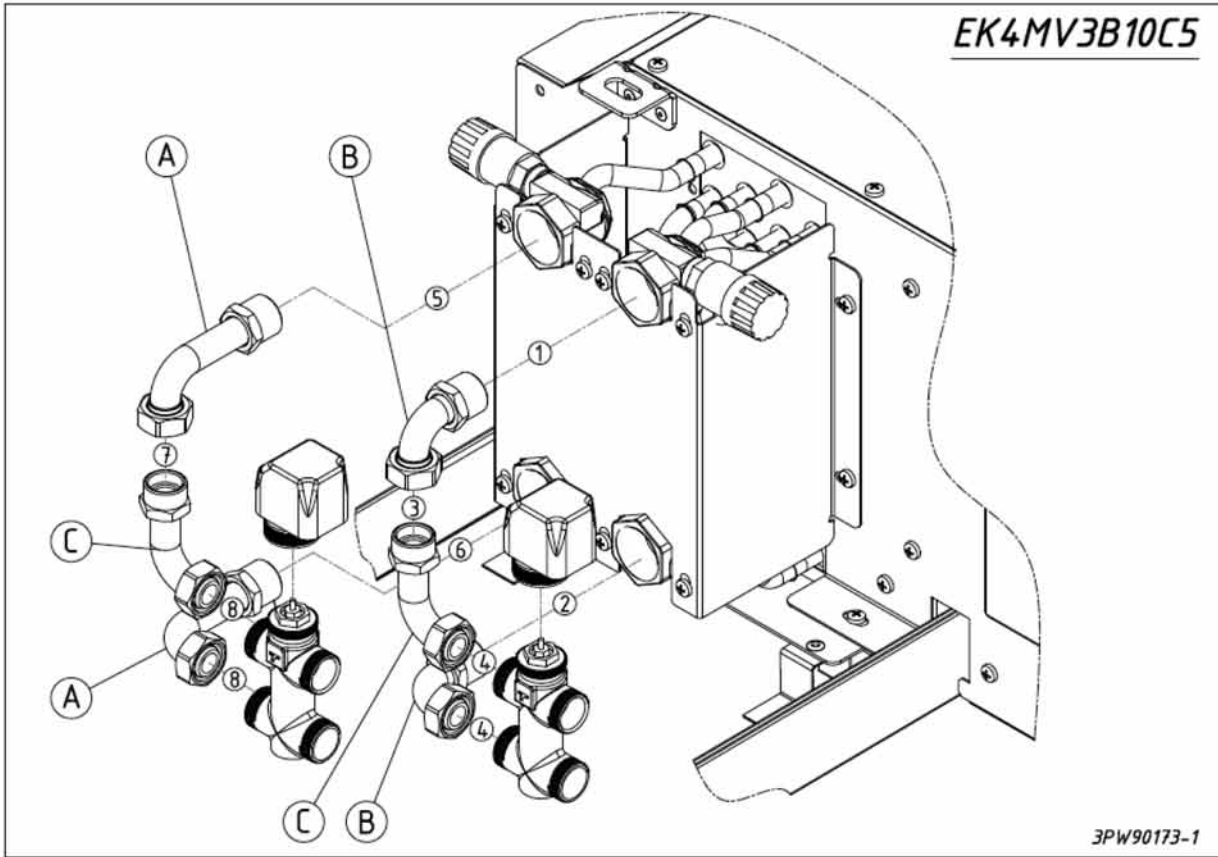

rev.00_6



4 Options

4 - 1 Options

1
4



FWE-CT/CF

EK2MV2B10C5 (1 : 1)

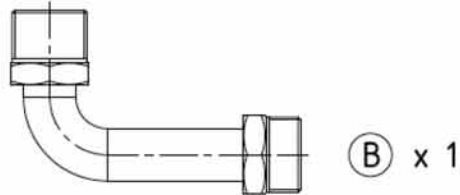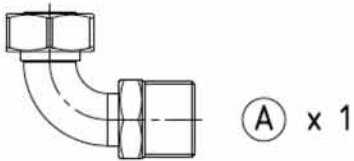





3PW90180-1

EK2MV3B10C5 (1 : 1)

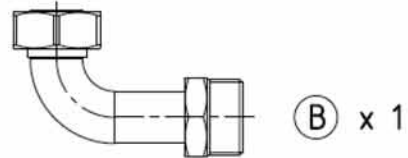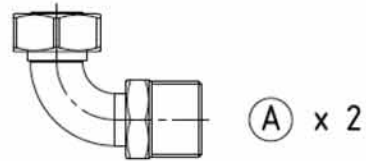




3PW90179-1

EK4MV2B10C5 (1 : 1)

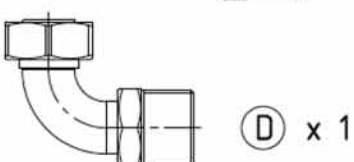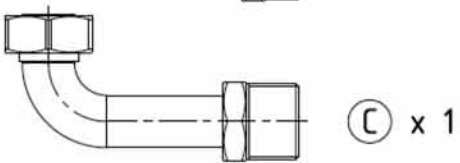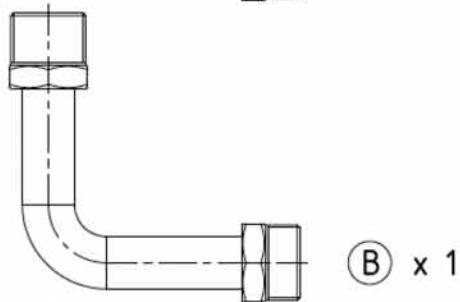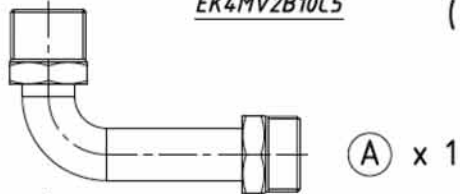

3PW90178-1

EK4MV3B10C5 (1 : 1)

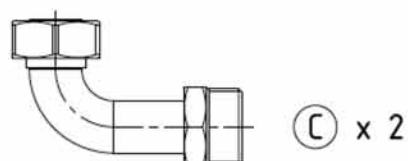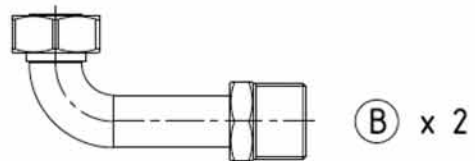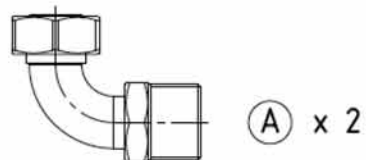


3PW90177-1

rev.00_7

5 Dimensional drawings

5 - 1 Dimensional Drawings

FWE-CT/CF

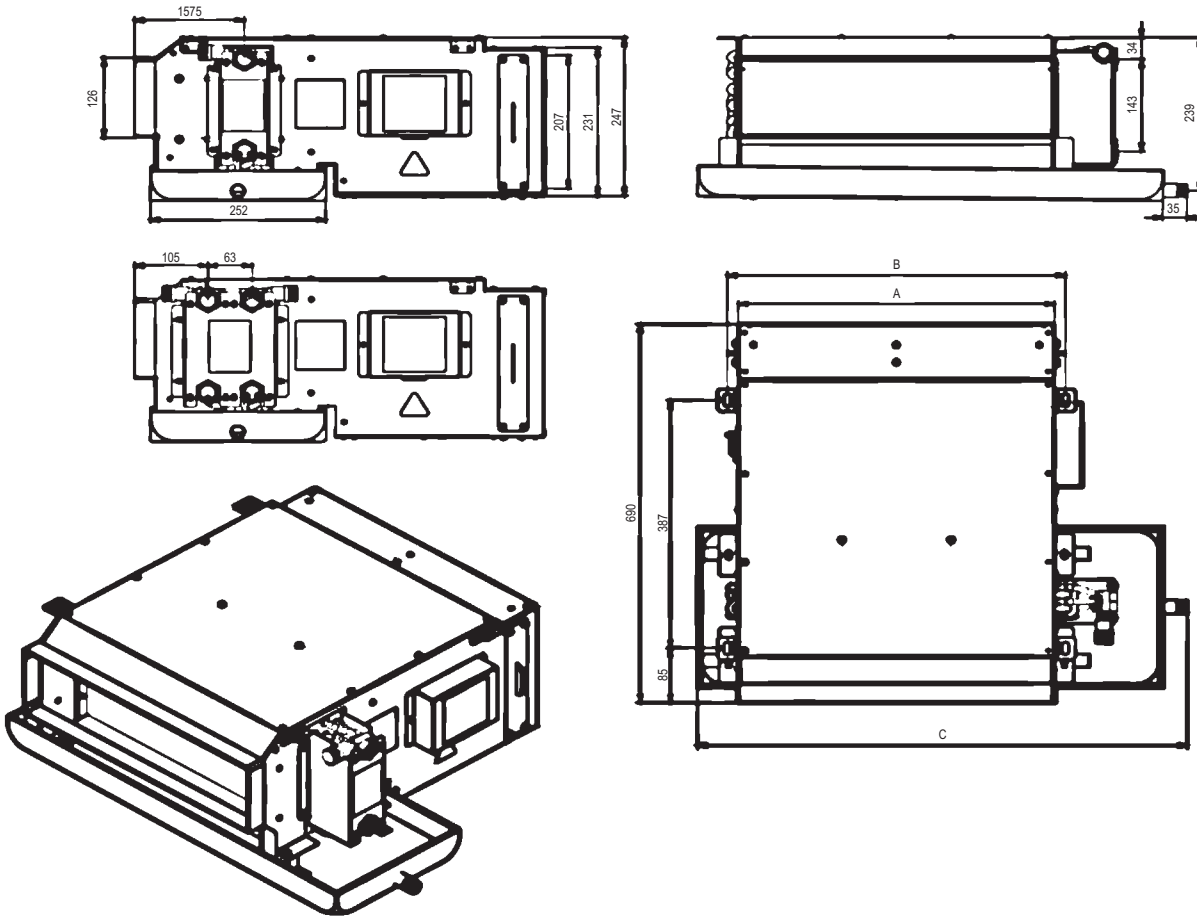

Unit dimensions

Model	A (mm)	B (mm)	C (mm)	Water Inlet (Inch)	Water Outlet (Inch)	Drain (Inch)
FWE02C5(T/F)V1B	454	486	705	R3/4"	R3/4"	R3/4"
FWE03C5(T/F)V1B	629	661	875	R3/4"	R3/4"	R3/4"
FWE04C5(T/F)V1B	759	791	1005	R3/4"	R3/4"	R3/4"
FWE06C5(T/F)V1B	959	991	1205	R3/4"	R3/4"	R3/4"
FWE07C5(T/F)V1B	1209	1241	1455	R3/4"	R3/4"	R3/4"
FWE08C5(T/F)V1B	1309	1341	1555	R3/4"	R3/4"	R3/4"
FWE10C5(T/F)V1B	1569	1601	1815	R3/4"	R3/4"	R3/4"

rev.00_1


6 Wiring diagrams

6 - 1 Wiring Diagrams - Single Phase

1
6

FWE02,03,04,06CT/CF

FWE (02-03-04-06)C5(T/F)V1
Electrical circuit diagram

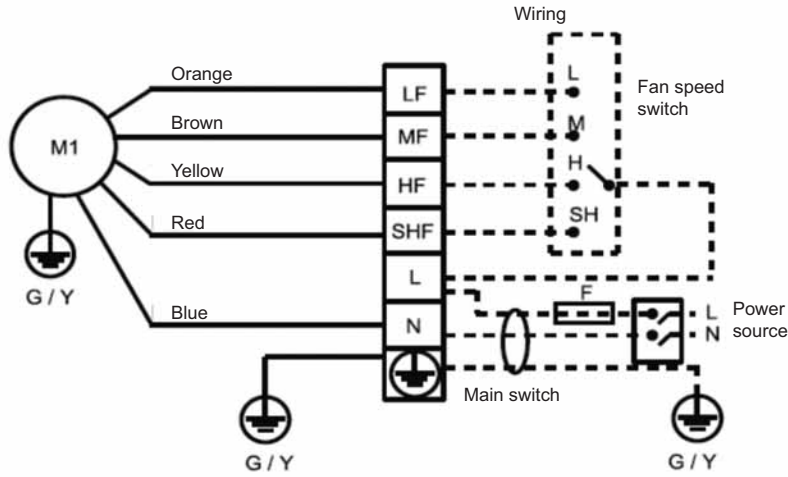


NOTES

- = Field wiring
- M1, M2 = Fan motor
- G/Y = Green/Yellow
- F = Fuse
- LF = Low speed
- MF = Medium speed
- HF = High speed
- SHF = Super high speed

rev.00_1

FWE07,08,10CT/CF

FWE (07-08-10)C5(T/F)V1
Electrical circuit diagram

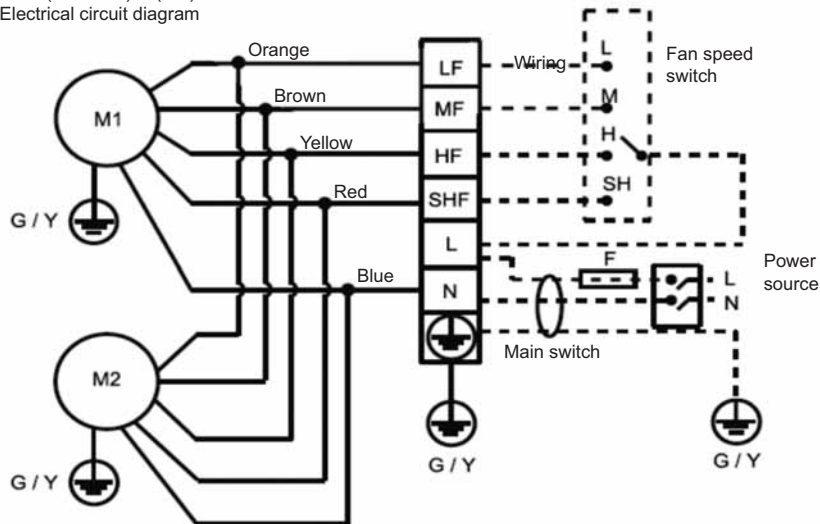

NOTES

- = Field wiring
- M1, M2 = Fan motor
- G/Y = Green/Yellow
- F = Fuse
- LF = Low speed
- MF = Medium speed
- HF = High speed
- SHF = Super high speed

rev.00_2

7 Installation

7 - 1 Installation Method

FWE-CT/CF

1 Caution Before Installation Of Unit

- Do the following checks before installation and operation.
- Have adequate space for installation and maintenance. Please refer to the unit size (figure 1) and the correction diagram. (Figure 2: Gaps around the unit show the required minimum space.)
- Make sure you have adequate space for piping and electrical connections.
- Make sure that the carrier rods can withstand the weight of the unit.
- For proper operation of the unit and the condensed water discharge, installation of the unit should be done horizontally.
- Channel external static pressure is designed to be within the range of static pressure.
- The installer must supply service valves and insulation for water piping in accordance with the local code and regulation.
- Before installation and service transactions are done, main switch of the unit should be verified in switch off position.

1
7

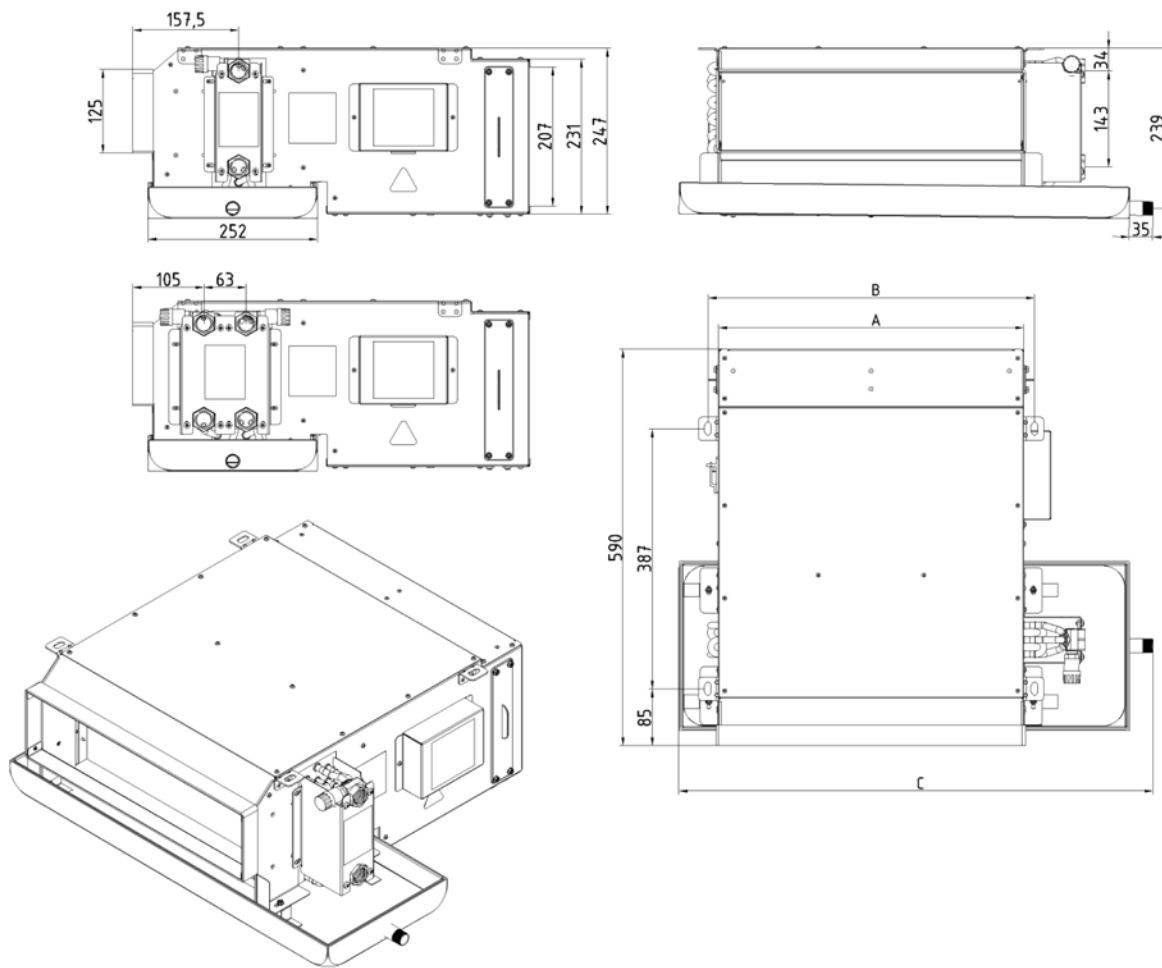


Figure 1

Model	Unit dimensions			Water Inlet (Inch)	Water Outlet (Inch)	Drain (Inch)
	A (mm)	B (mm)	C (mm)			
FWE02C5(T/F)V1B	454	486	705	R3/4"	R3/4"	R3/4"
FWE03C5(T/F)V1B	629	661	875	R3/4"	R3/4"	R3/4"
FWE04C5(T/F)V1B	759	791	1005	R3/4"	R3/4"	R3/4"
FWE06C5(T/F)V1B	959	991	1205	R3/4"	R3/4"	R3/4"
FWE07C5(T/F)V1B	1209	1241	1455	R3/4"	R3/4"	R3/4"
FWE08C5(T/F)V1B	1309	1341	1555	R3/4"	R3/4"	R3/4"
FWE10C5(T/F)V1B	1569	1601	1815	R3/4"	R3/4"	R3/4"

7 Installation

7 - 1 Installation Method

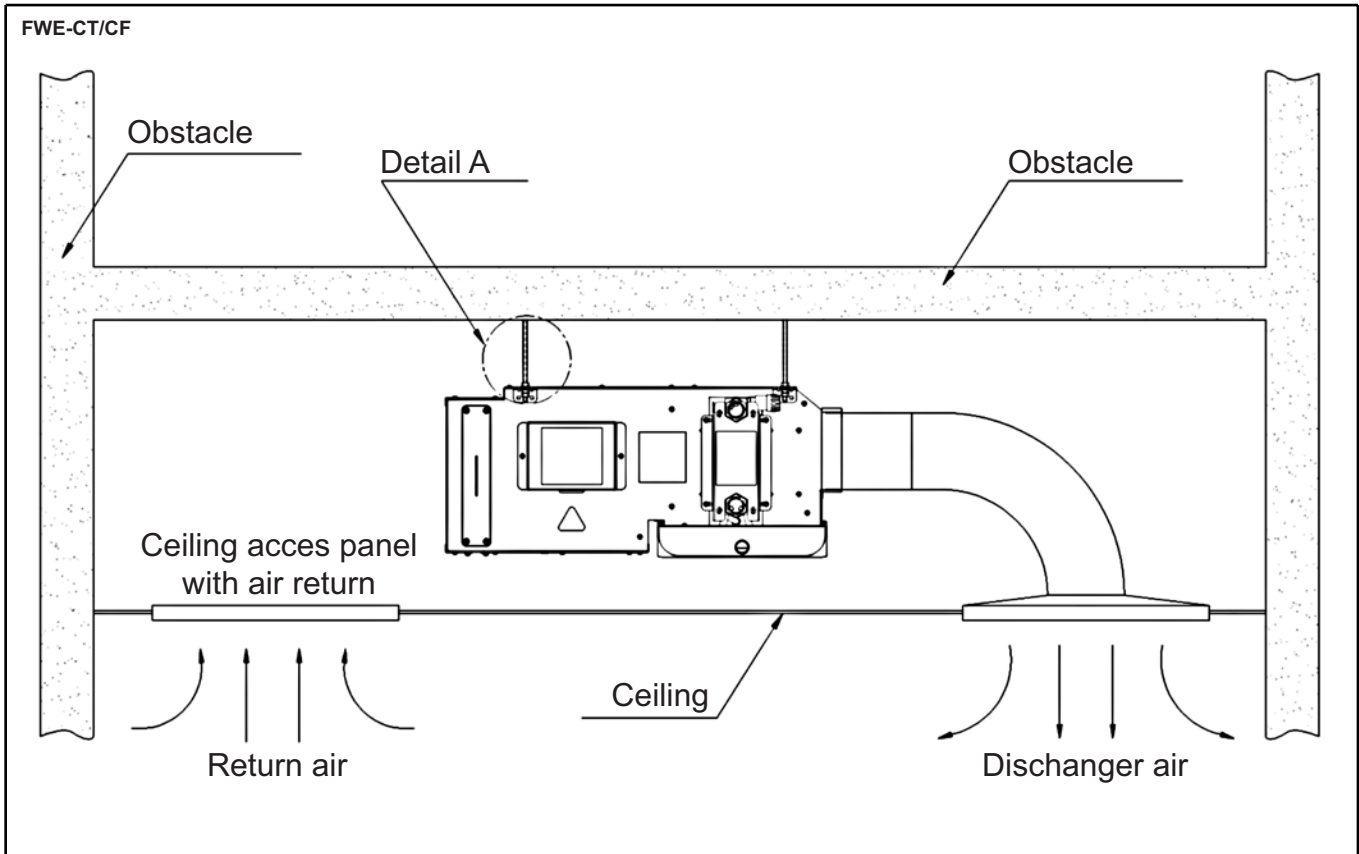


Figure 3

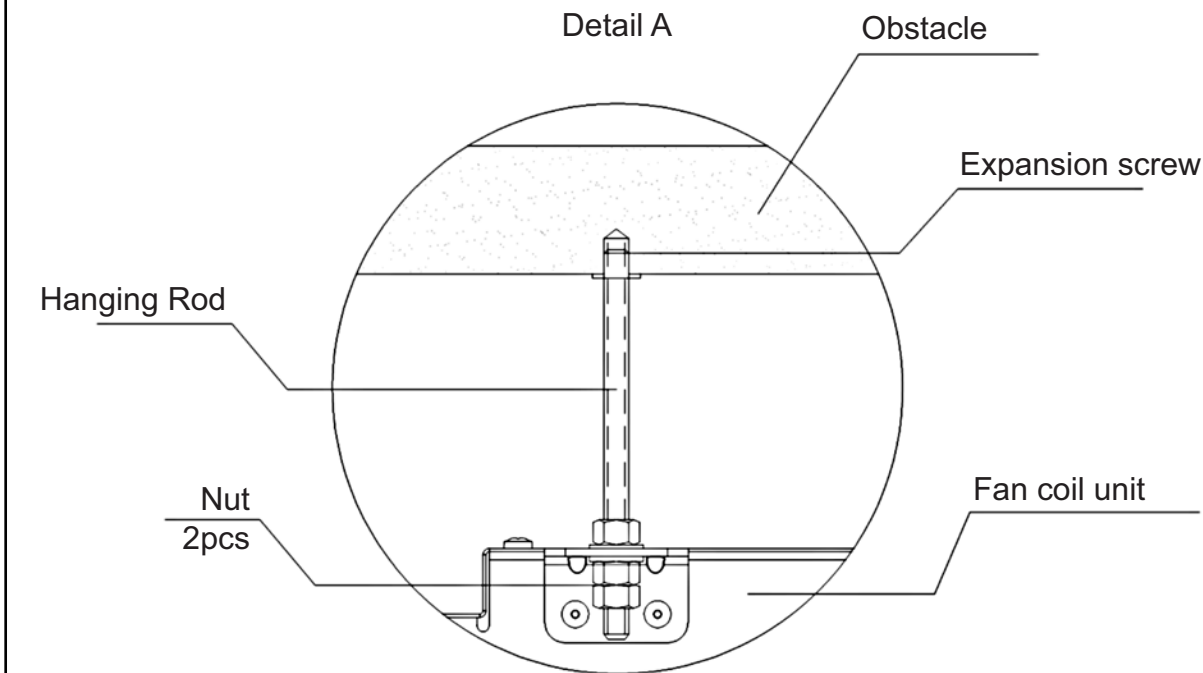


Figure 4

rev.00_3

7 Installation

7 - 1 Installation Method

FWE-CT/CF

1
7

3 Air Duct Connection

- Circulatory air pressure drop should be within External Static Pressure.
- Galvanized steel air ducts are suitable.
- Make sure there is no leak of air.
- Air duct should be fire-proof, refer to national and local regulations of the country where the unit is installed.

4 Pipe Connections

- When the water inlet and outlet connections are made, make sure that there is no hot or cold water on the system and the valves.
- In case of contact with the hot water, burns may occur on contact area.
- Use appropriate fittings for water connections. Refer to the specifications.
- The lower connection is the water inlet while the upper is the outlet.
- Seal must be used in water connections against leakage.
- Drain pipe can be PVC or steel.
- The suggested slope of the drain pipe is minimum 1:50.

5 Wiring

- All wiring connection must be done according to the wiring diagram on the units and inside the manual.
- The units must be grounded well.
- All field wiring must be installed in accordance with the national regulations that apply.
- Power supply cable must be equivalent to H05RN-F (2451EC57) as minimum requirement.
- Ensure that appropriate voltage value and cables are supplied to the units.
- While making this unit's electrical connections, there must not be any energy on the main supply cable and main switch has to be switched off.
- During the installation of electrical connections, make sure the cables are connected firmly.
- An appropriate strain relief unit must be used to attach the power wires to the terminal box.

rev.00_4

8 Operation range

8 - 1 Operation Range

FWE-CT/CF

Water Side	
Max. Pressure	16.4 kg/cm ²
Max. Water Inlet Temp.	70°C (Heating Mode)
Min. Water Inlet Temp.	3°C (Cooling Mode)

Ambient Side	
Max. Temp.	36°C (Cooling Mode), 30°C (Heating Mode)
Min. Temp.	16°C (Cooling Mode), 10°C (Heating Mode)

Power Supply	
Nominal Voltage	220 – 240 V / 50 Hz / ~1
Voltage Limits	± 10 % V / ± 2 Hz

rev.00_1

