



# Applied Systems Technical Data

Air cooled chiller, standard efficiency, standard sound



EEEDEN13-417

EWAD-C-SS



# TABLE OF CONTENTS

## EWAD-C-SS

1	Features .....	2
2	Specifications .....	3
	Technical Specifications .....	3
	Technical Specifications .....	4
	Electrical Specifications .....	5
	Electrical Specifications .....	5
3	Features and advantages .....	7
	Features and Advantages .....	7
4	General Characteristics .....	9
	General characteristics .....	9
5	Nomenclature .....	13
	Nomenclature .....	13
6	Options .....	14
	Water Pump Kit - Technical Information .....	14
	Water Pump Kit - Combination Matrix .....	16
7	Capacity tables .....	17
	Cooling Capacity Tables .....	17
8	Dimensional drawings .....	19
	Dimensional Drawings .....	19
9	Sound data .....	21
	Sound Power Spectrum .....	21
10	Installation .....	23
	Installation Method .....	23
11	Operation range .....	24
	Operation Range .....	24
12	Hydraulic performance .....	26
	Water Pressure Drop Curve Evaporator .....	26
13	Specification text .....	27
	Specification Text .....	27

# 1 Features

- Standard efficiency, standard sound levels
- Stepless single-screw compressor
- Large operation range (ambient temperature down to -18°C and up to 46°C)
- All models are PED pressure vessel approved
- Optimised for use with R-134a
- 2-3 truly independent refrigerant circuits
- Standard electronic expansion valve
- DX shell and tube evaporator – one pass refrigerant side to minimize pressure drops
- Partial and total heat recovery option available
- MicroTech III controller

1



## 2 Specifications

2-1 Technical Specifications				EWAD650C-SS	EWAD740C-SS	EWAD830C-SS	EWAD910C-SS	EWAD970C-SS	EWADC11C-SS	EWADC12C-SS	EWADC13C-SS		
Cooling capacity	Nom.	kW		645 (1)	741 (1)	829 (1)	908 (1)	962 (1)	1,059 (1)	1,146 (1)	1,315 (1)		
Capacity control	Method			Stepless									
	Minimum capacity			13									
Power input	Cooling	Nom.	kW		223 (1)	265 (1)	302 (1)	322 (1)	355 (1)	382 (1)	408 (1)	446 (1)	
EER				2.89 (1)	2.80 (1)	2.74 (1)	2.82 (1)	2.71 (1)	2.77 (1)	2.81 (1)	2.95 (1)		
ESEER				3.79	3.69	3.72	3.65	3.60	3.69	3.63	3.88		
IPLV				4.30	4.17	4.16	4.23	4.14	4.17	4.19	4.42		
Casing	Colour			Ivory white									
	Material			Galvanized and painted steel sheet									
Dimensions	Unit	Height	mm		2,540								
		Width	mm		2,285								
		Depth	mm		6,185				7,085	7,985	8,885		
Weight	Unit		kg		5,630	5,740	5,760	6,280	6,560	7,010	7,280	7,900	
	Operation weight		kg		5,910	5,990	6,010	6,530	6,810	7,250	7,520	8,280	
Water heat exchanger	Type			Single pass shell & tube									
	Water volume			l		266		251		243		386	
	Nominal water flow	Cooling		l/s		30.9	35.5	39.7	43.5	46.1	50.8	55.0	62.9
	Nominal water pressure drop	Cooling	Heat exchanger	kPa		47	54	53	62	69	64	74	54
	Insulation material			Closed cell									
Air heat exchanger	Type			High efficiency fin and tube type with integral subcooler									
Fan	Quantity			10		12		14	16	18			
	Type			Direct propeller									
	Diameter			mm		800							
	Air flow rate	Nom.		l/s		53,442		64,131		74,819	85,508	96,196	
	Speed			rpm		900							
Fan motor	Drive			Direct on line									
	Input	Cooling	W		17,500		21,000		24,500	28,000	31,500		
Sound power level	Cooling	Nom.		dBA		100		101		102			
Sound pressure level	Cooling	Nom.		dBA		79	80		81				
Compressor	Type			asymmetric single screw compressor									
	Quantity			2									
	Oil	Charged volume		l		38		44	50				
Operation range	Water side	Cooling	Min.	°CDB		-8							
			Max.	°CDB		15							
	Air side	Cooling	Min.	°CDB		-18							
			Max.	°CDB		52							
Refrigerant	Type			R-134a									
	Circuits	Quantity		2									
Refrigerant circuit	Charge		kg		128		146	144	162	178	196		
Piping connections	Evaporator water inlet/outlet (OD)			168.3mm							219.1mm		
Safety devices	Item	01		High discharge pressure (pressure switch)									
		02		High discharge pressure (pressure transducer)									
		03		Low suction pressure (pressure transducer)									
		04		Compressor motor protection									
		05		High discharge temperature									
		06		Low oil pressure									
		07		Low pressure ratio									
		08		High oil filter pressure drop							High oil pressure drop		
		09		Phase monitor									
		10		Emergency stop							Emergency stop button		
		11		Water freeze protection controller									

## 2 Specifications

2-2 Technical Specifications				EWADH14 C-SS	EWADC140 C-SS	EWADC15 C-SS	EWADC16 C-SS	EWADC17 C-SS	EWADC18 C-SS	EWADC19 C-SS	EWADC20 C-SS	
Cooling capacity	Nom.	kW		1,412 (1)	1,419 (1)	1,532 (1)	1,615 (1)	1,706 (1)	1,797 (1)	1,870 (1)	1,917 (1)	
Capacity control	Method			Stepless								
	Minimum capacity		%	13	7							
Power input	Cooling	Nom.	kW		479 (1)	500 (1)	557 (1)	586 (1)	627 (1)	669 (1)	687 (1)	721 (1)
EER				2.95 (1)	2.84 (1)	2.75 (1)		2.72 (1)	2.69 (1)	2.72 (1)	2.66 (1)	
ESEER				3.86	3.88	3.72	3.68	3.58	3.67	3.68	3.64	
IPLV				4.42	4.19	4.22	4.18	4.13	4.18		4.15	
Casing	Colour			Ivory white								
	Material			Galvanized and painted steel sheet								
Dimensions	Unit	Height	mm	2,540								
		Width	mm	2,285								
		Depth	mm	8,885	10,185		11,085			11,985		
Weight	Unit		kg	7,900	10,310	10,320	10,710	10,770	11,240	11,600		
	Operation weight		kg	8,280	10,730		11,110	11,260	12,110	12,480		
Water heat exchanger	Type			Single pass shell & tube								
	Water volume		l	386	421	408		474	850			
	Nominal water flow	Cooling	l/s	67.6	67.78	73.4	77.4	81.8	86.0	89.5	91.7	
	Nominal water pressure drop	Cooling	Heat exchanger	kPa	58	47	62	68	75	36	39	40
	Insulation material			Closed cell								
Air heat exchanger	Type			High efficiency fin and tube type with integral subcooler								
Fan	Quantity			18	20		22		24			
	Type			Direct propeller								
	Diameter		mm	800								
	Air flow rate	Nom.	l/s	96,196	106,888	106,885	117,573			128,262		
	Speed		rpm	900	920	900						
Fan motor	Drive			Direct on line	DOL	Direct on line						
	Input	Cooling	W	31,500	1,750	35,000	38,500		42,000			
Sound power level	Cooling	Nom.	dBA	102	102.9	103			104			
Sound pressure level	Cooling	Nom.	dBA	81					82			
Compressor	Type			asymmetric single screw compressor or	Semi-hermetic single screw compressor or	asymmetric single screw compressor						
	Quantity			2	3							
	Oil	Charged volume	l	50	75							
Operation range	Water side	Cooling	Min.	°CDB	-8							
			Max.	°CDB	15							
	Air side	Cooling	Min.	°CDB	-18							
			Max.	°CDB	52	46	52					
Refrigerant	Type			R-134a								
	Circuits	Quantity		2	3							
Refrigerant circuit	Charge		kg	196	-	260	261	275	305			
Piping connections	Evaporator water inlet/outlet (OD)			219.1mm					273mm			

## 2 Specifications

2-2 Technical Specifications			EWADH14 C-SS	EWADC140 C-SS	EWADC15 C-SS	EWADC16 C-SS	EWADC17 C-SS	EWADC18 C-SS	EWADC19 C-SS	EWADC20 C-SS		
Safety devices	Item	01	High discharge pressure (pressure switch)									
		02	High discharge pressure (pressure transducer)									
		03	Low suction pressure (pressure transducer)									
		04	Compressor motor protection									
		05	High discharge temperature									
		06	Low oil pressure									
		07	Low pressure ratio									
		08	High oil pressure drop	High oil filter pressure drop					High oil pressure drop			
		09	Phase monitor									
		10	Emergency stop button	Emergency stop					Emergency stop button			
		11	Water freeze protection controller									

2

2-3 Electrical Specifications				EWAD650C -SS	EWAD740C -SS	EWAD830C -SS	EWAD910C -SS	EWAD970C -SS	EWADC11 C-SS	EWADC12 C-SS	EWADC13 C-SS	
Compressor	Phase			3~								
	Voltage		V	400								
	Voltage range	Min.	%	-10								
		Max.	%	10								
	Maximum running current		A	218	231	274	333	398				
	Starting method			Wye-delta								
Compressor 2	Maximum running current		A	218	274	333	398	451				
Power supply	Phase			3~								
	Frequency		Hz	50								
	Voltage		V	400								
	Voltage range	Min.	%	-10								
		Max.	%	10								
Unit	Maximum starting current		A	604	649	915	962	1,017	1,021	1,068		
	Nominal running current (RLA)	Cooling	A	366	432	492	524	577	624	667	726	
			A	476	545	589	656	715	787	859	921	
	Max unit current for wires sizing		A	520	596	644	717	781	860	939	1,005	
Fans	Nominal running current (RLA)		A	40			48		56	64	72	

### Notes

- (1) Cooling: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C; full load operation.
- (2) Sound pressure levels are measured at entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C; full load operation; Standard: ISO3744
- (3) Allowed voltage tolerance  $\pm 10\%$ . Voltage unbalance between phases must be within  $\pm 3\%$ .
- (4) Maximum starting current: starting current of biggest compressor + 75 % of maximum current of the other compressor + fans current for the circuit at 75 %
- (5) Nominal current in cooling mode: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C. Compressor + fans current.
- (6) Maximum running current is based on max compressor absorbed current in its envelope and max fans absorbed current
- (7) Maximum unit current for wires sizing is based on minimum allowed voltage.
- (8) Maximum current for wires sizing: (compressors full load ampere + fans current) x 1.1
- (9) Cooling: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C. Compressor + fans current.

## 2 Specifications

2-4 Electrical Specifications				EWADH14 C-SS	EWADC140 C-SS	EWADC15 C-SS	EWADC16 C-SS	EWADC17 C-SS	EWADC18 C-SS	EWADC19 C-SS	EWADC20 C-SS
Compressor	Phase			3~							
	Voltage		V	400							
	Voltage range	Min.	%	-10							
		Max.	%	10							
	Maximum running current		A	451	326	398			451		
Starting method			Wye-delta								
Compressor 2	Maximum running current		A	451	326	333	398			451	
Power supply	Phase			3~							
	Frequency		Hz	50							
	Voltage		V	400							
	Voltage range	Min.	%	-10							
		Max.	%	10							
Unit	Maximum starting current		A	1,081	1,242.6	1,312	1,363	1,367	1,410	1,456	1,470
	Nominal running current (RLA)	Cooling	A	773	823 (5)	909	959.0	1,023	1,092	1,116	1,164
		Maximum running current		A	974	1,058	1,144	1,217	1,281	1,334	1,395
	Max unit current for wires sizing		A	1,064	1,164	1,251	1,330	1,400	1,459	1,525	1,584
Fans	Nominal running current (RLA)		A	72	80		88			96	

### Notes

- (1) Cooling: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C; full load operation.
- (2) Sound pressure levels are measured at entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C; full load operation; Standard: ISO3744
- (3) Allowed voltage tolerance ± 10%. Voltage unbalance between phases must be within ± 3%.
- (4) Maximum starting current: starting current of biggest compressor + 75 % of maximum current of the other compressor + fans current for the circuit at 75 %
- (5) Nominal current in cooling mode: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C. Compressor + fans current.
- (6) Maximum running current is based on max compressor absorbed current in its envelope and max fans absorbed current
- (7) Maximum unit current for wires sizing is based on minimum allowed voltage.
- (8) Maximum current for wires sizing: (compressors full load ampere + fans current) x 1.1
- (9) Cooling: entering evaporator water temp. 12°C; leaving evaporator water temp. 7°C; ambient air temp. 35°C. Compressor + fans current.



### 3 Features and advantages

#### 3 - 1 Features and Advantages

##### Low operating cost

This unit is the result of careful design, aimed to optimizing the energy efficiency of the chillers, with the objective of bringing down operating costs and improving installation profitability, effectiveness and economical management.

A very high efficiency single rotor screw compressor design are used in this application, together with large condenser coil surface area for maximum heat transfer and low discharge pressure, advanced technology condenser fans, a single-pass pure counter-flow shell&tube direct-expansion evaporator with low refrigerant pressure drops.

##### Low operating sound levels


Very low noise levels both at full load and part load conditions are achieved by the latest compressor design that use a single main rotor with two adjacent rotating composite gaterotors making gas flow velocities and subsequent noise levels among the lowest available. By a unique new fan that moves large volume of air at exceptionally low sound levels and by the virtually vibration-free operation.

##### Outstanding reliability

The chillers have two or three truly independent refrigerant circuits depending on the size, in order to assure maximum safety for any maintenance, whether planned or not. They are equipped with a rugged compressor design with advanced composite compressor gaterotors material, a proactive control logic and are full factory-run-tested to optimized trouble-free operation.


##### Infinite capacity control

Cooling capacity control is infinitely variable by means of a single screw asymmetric compressor controlled by microprocessor system. Each unit has infinitely variable capacity control from 100% down to 12.5% (two compressor unit), down to 7% (three compressors units). This modulation allows the compressor capacity to exactly match the building cooling load without any leaving evaporator water temperature fluctuation. This chilled water temperature fluctuation is avoided only with a stepless control.

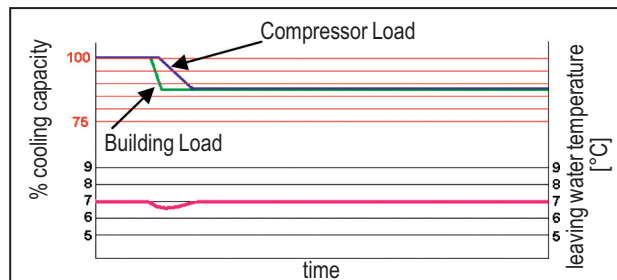

ELWT fluctuation with stepless capacity control

With a compressor load step control in fact, the compressor capacity, at partial loads, will be too high or too low compared to the building cooling load. The result is an increase in chiller energy costs, particularly at the part-load conditions at which the chiller operates most of the time.

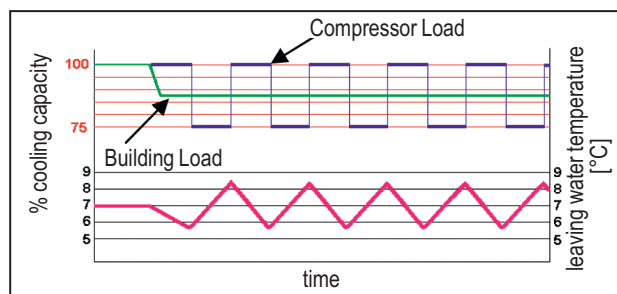

ELWT fluctuation with steps capacity control (4 steps)

Units with stepless regulation offer benefits that the units with step regulation are unable to match. The ability to follow the system energy demand at any time and the possibility to provide steady outlet water temperature without deviations from the set-point, are the two points that allow you to understand how the optimum operating conditions of a system can be met only through the use of a unit with step-less regulation.

##### Superior control logic

The new MicroTech III controller provides an easy to use control environmental. The control logic is designed to provide maximum efficiency, to continue operation in unusual operating conditions and to provide a history of unit operation. One of the greatest benefits is the easy interface with LonWorks, Bacnet, Ethernet TCP/IP or Modbus communications.

### 3 Features and advantages

#### 3 - 1 Features and Advantages

3

##### Code requirements – Safety and observant of laws/directives

Units are designed and manufactured in accordance with applicable selections of the following:

Construction of pressure vessel	97/23/EC (PED)
Machinery Directive	2006/42/EC
Low Voltage	2006/95/EC
Electromagnetic Compatibility	2004/108/EC
Electrical & Safety codes	EN 60204–1 / EN 60335-2-40
Manufacturing Quality Stds	UNI – EN ISO 9001:2004

##### Certifications

Units are CE marked, complying with European directives in force, concerning manufacturing and safety. On request units can be produced complying with laws in force in non European countries (ASME, GOST, etc.), and with other applications, such as naval (RINA, etc.).

##### Versions

Three different Efficiency Versions available:

**S:** Standard Efficiency

15 sizes to cover a range from 647 up to 1922 kW with an EER up to 2.99 and an ESEER up to 4.08 (data referred to Standard Noise)

**X:** High Efficiency

17 sizes to cover a range from 756 up to 2008 kW with an EER up to 3.29 and an ESEER up to 4.33 (data referred to Standard Noise)

**P:** Premium Efficiency

9 sizes to cover a range from 821 up to 1562 kW with an EER up to 3.64 and an ESEER up to 4.53 (data referred to Standard Noise)

The EER (Energy Efficiency Ratio) is the ratio of the Cooling Capacity to the Power Input of the unit. The Power Input includes: the power input for operation of the compressor, the power input of all control and safety devices, the power input for fans.

The ESEER (European Seasonal Energy Efficiency Ratio) is a weighed formula enabling to take into account the variation of EER with the load rate and the variation of air inlet condenser temperature.

$$ESEER = A \times EER_{100\%} + B \times EER_{75\%} + C \times EER_{50\%} + D \times EER_{25\%}$$

	A	B	C	D
Coefficient	0.03 (3%)	0.33 (33%)	0.41 (41%)	0.23 (23%)
Air inlet condenser temperature	35°C	30°C	25°C	20°C

##### Sound Configuration

Standard, low and reduced sound configurations available as follows:

**SS:** Standard Noise

Condenser fan rotating at 900 rpm, rubber antivibration under compressor

**SL:** Low Noise

Condenser fan rotating at 900 rpm, rubber antivibration under compressor, compressor sound enclosure.

**SR:** Reduced Noise

Condenser fan rotating at 700 rpm, rubber antivibration under compressor, compressor sound enclosure.

## 4 General Characteristics

### 4 - 1 General characteristics

**Cabinet and structure** The cabinet is made of galvanized steel sheet and painted to provide a high resistance to corrosion. Colour Ivory White (Munsell code 5Y7.5/1) ( $\pm$ RAL7044). The base frame has an eye-hook to lift the unit with ropes for an easy installation. The weight is uniformly distributed along the profiles of the base and this facilitates the arrangement of the unit.

**Compressor (Asymmetric Single Screw)** The compressor is semi-hermetic, single-screw type with gate-rotor made with the latest high-strength fibre reinforced star material. The compressor has an asymmetric slide regulation managed by the unit controller for infinitely modulating capacity from 100% to 25%. An integrated high efficiency oil separator maximizes the oil separation and standard start is Wye-Delta (Y- $\Delta$ ) type.

**Refrigerant** The compressors have been designed to operate with R-134a, ecological refrigerant with zero ODP (Ozone Depletion Potential) and very low GWP (Global Warming Potential), resulting in low TEWI (Total Equivalent Warming Impact).

**Evaporator (Shell&Tube)** The unit is equipped with a direct expansion shell&tube evaporator with refrigerant evaporating inside the tubes and water flowing outside. The tubes are enhanced for maximum heat transfer and rolled into steel tube sheet and sealed.

The evaporators are single-pass on both the refrigerant and water sides for pure counter-flow heat exchange and low refrigerant pressure drops. Both attributes contribute to the heat exchanger effectiveness and total unit's outstanding efficiency. The water side is designed for 10 bar of maximum operating pressure and is provided with vents and drain.

The external shell is covered with a 20mm closed cell insulation material and the evaporator water connections are provided with victaulic kit (as standard). Each evaporator has 2 or 3 circuits, one for each compressor and is manufactured in accordance to 97/23/EC directive (PED).

**Condenser** The condenser is manufactured with internally enhanced seamless copper tubes arranged in a staggered row pattern and mechanically expanded into lanced and rippled aluminum condenser fins with full fin collars. An integral sub-cooler circuit provides sub-cooling to effectively eliminate liquid flashing and increase cooling capacity without increasing the power input.

**Heat Recovery Exchanger** The unit is equipped with a plate to plate type heat exchanger for each circuit made of stainless steel brazed plates and manufactured in accordance to PED approval.

**Condenser fans ( $\varnothing$  800)** The condenser fans are propeller type with high efficiency design blades to maximize performances. The material of the blades is glass reinforced resin and each fan is protected by a guard. Fan motors are protected by circuit breakers (installed inside the electrical panel as a standard) and are IP54.

**Electronic expansion valve** The unit is equipped with the most advanced electronic expansion valves to achieve precise control of refrigerant mass flow. As today's system requires improved energy efficiency, tighter temperature control, wider range of operating conditions and incorporate features like remote monitoring and diagnostics, the application of electronic expansion valves becomes mandatory.

Electronic expansion valves possess unique features: short opening and closing time, high resolution, positive shut-off function to eliminate use of additional solenoid valve, continuous modulation of mass flow without stress in the refrigerant circuit and corrosion resistance stainless steel body.

Electronic expansion valves are typically working with lower  $\Delta$ P between high and low pressure side, than a thermostatic expansion valve. The electronic expansion valve allows the system to work with low condenser pressure (winter time) without any refrigerant flow problems and with a perfect chilled water leaving temperature control.

Refrigerant circuit Each unit has 2 or 3 independent refrigerant circuits and each one includes:

- Compressor with integrated oil separator
- Refrigerant
- Evaporator
- Air Cooled Condenser
- Electronic expansion valve
- Discharge line shut off valve
- Liquid line shut off valve
- Sight glass with moisture indicator
- Filter drier
- Charging valves
- High pressure switch
- High pressure transducers
- Low pressure transducers
- Oil pressure transducer

## 4 General Characteristics

### 4 - 1 General characteristics

4

**Electrical control panel** Power and control are located in the main panel that is manufactured to ensure protection against all weather conditions. The electrical panel is IP54 and (when opening the doors) internally protected with plexiglas panel against possible accidental contact with electrical components (IP20). The main panel is fitted with a main switch interlocked door. Power Section The power section includes compressors and fans protection devices, compressors and fans starters and control circuit power supply.

**MicroTech III controller** MicroTech III controller is installed as standard; it can be used to modify unit set-points and check control parameters. A built-in display shows chiller operating status plus temperatures and pressures of water, refrigerant and air, programmable values, set-points. A sophisticated software with predictive logic, selects the most energy efficient combination of compressors, EEXV and condenser fans to keep stable operating conditions to maximise chiller energy efficiency and reliability.

MicroTech III is able to protect critical components based on external signs from its system (such as motor temperatures, refrigerant gas and oil pressures, correct phase sequence, pressure switches and evaporator). The input coming from the high pressure switch cuts all digital output from the controller in less than 50ms, this is an additional security for the equipment. Fast program cycle (200ms) for a precise monitoring of the system. Floating point calculations supported for increased accuracy in Pressure / Temperature conversions.

#### Control section - main features

- Management of the compressor stepless capacity and fans modulation.
- Chiller enabled to work in partial failure condition.
- Full routine operation at condition of:
  - high ambient temperature value
  - high thermal load
  - high evaporator entering water temperature (start-up)
- Display of evaporator entering/leaving water temperature.
- Display of Outdoor Ambient Temperature.
- Display of condensing-evaporating temperature and pressure, suction and discharge superheat for each circuit.
- Leaving water evaporator temperature regulation (temperature tolerance = 0,1°C).
- Compressor and evaporator pumps hours counter.
- Display of Status Safety Devices.
- Number of starts and compressor working hours.
- Optimized management of compressor load.
- Fan management according to condensing pressure.
- Re-start in case of power failure (automatic / manual).
- Soft Load (optimized management of the compressor load during the start-up).
- Start at high evaporator water temperature.
- Return Reset (Set Point Reset based on return water temperature).
- OAT (Outside Ambient temperature) Reset.
- Set point Reset (optional).
- Application and system upgrade with commercial SD cards.
- Ethernet port for remote or local servicing using standard web browsers.
- Two different sets of default parameters could be stored for easy restore.

#### Safety device / logic for each refrigerant circuit

- High pressure (pressure switch).
- High pressure (transducer).
- Low pressure (transducer).
- Fans circuit breaker.
- High compressor discharge temperature.
- High motor winding temperature.
- Phase Monitor.
- Low pressure ratio.
- High oil pressure drop.
- Low oil pressure.
- No pressure change at start.

#### System security

- Phase monitor.
- Low Ambient temperature lock-out.
- Freeze protection.

**Regulation type** Proportional + integral + derivative regulation on the evaporator leaving water output probe.

GNC\_1a-2a-3a-4a\_Rev.01\_2a

## 4 General Characteristics

### 4 - 1 General characteristics

**MicroTech III** MicroTech III built-in terminal has the following features.

- 164x44 dots liquid crystal display with white back lighting. Supports Unicode fonts for multi-lingual.
  - Key-pad consisting of 3 keys.
  - Push'n'Roll control for an increased usability.
  - Memory to protect the data.
  - General faults alarm relays.
  - Password access to modify the setting.
  - Application security to prevent application tampering or hardware usability with third party applications.
  - Service report displaying all running hours and general conditions.
  - Alarm history memory to allow an easy fault analysis.
- Supervising systems (on request)

**MicroTech III remote control** MicroTech III is able to communicate to BMS (Building Management System) based on the most common protocols as:

- ModbusRTU
- LonWorks, now also based on the international 8040 Standard Chiller Profile and LonMark Technology.
- BacNet BTP certified over IP and MS/TP (class 4) (Native).
- Ethernet TCP/IP.

#### Standard Options (supplied on basic unit)

**Wye-Delta compressor starter (Y-D)** - For low inrush current and reduced starting torque

**Double setpoint** - Dual leaving water temperature setpoints.

**Phase monitor** - The phase monitor controls that phases sequence is correct and controls phase loss.

**Evaporator victaulic kit** - Hydraulic joint with gasket for an easy and quick water connection.

**20mm evaporator insulation** - The external shell is covered with a 20mm closed cell insulation material.

**Evaporator electric heater** - Electric heater (controlled by a thermostat) to protect the evaporator from freezing down to -28°C ambient temperature, providing the power supply is on.

**Electronic expansion valve**

**Discharge line shut-off valve** - Installed on the discharge port of the compressor to facilitate maintenance operation.

**Ambient outside temperature sensor and setpoint reset**

**Hour run meter**

**General fault contactor**

**Setpoint reset, Demand limit and Alarm from external device - (Set-point reset):** The leaving water temperature set-point can be overwritten with the following options: 4-20mA from external source (by user); outside ambient temperature; evaporator water temperature  $\Delta t$ . - (Demand limit): User can limit the load of the unit by 4-20mA signal or by network system. - (Alarm from external device): Microprocessor is able to receive an alarm signal from an external device (eg. pump, etc...). User can decide if this alarm signal will stop or not the unit.

**Fans circuit breakers** - Safety device against motor overloading and short circuit

**Main switch interlock door**

**Emergency stop**

#### Options (on request)

#### MECHANICAL

**Total heat recovery** - Produced with plate to plate or Shell&Tube heat exchangers to produce hot water.

**Partial heat recovery** - Produced with plate to plate heat exchangers to produce hot water.

**Brine version** - Allows the unit to operate down to -8°C leaving liquid temperature (antifreeze required).

**Evaporator flange kit**

**Condenser coil guards**

**Evaporator area guards**

**Cu-Cu condenser coil** - To give better protection against corrosion by aggressive environments.

**Cu-Cu-Sn condenser coil** - To give better protection against corrosion in aggressive environments and by salty air.

**Alucoat fins coil** - Fins are protected by a special acrylic paint with a high resistance to corrosion.

**Suction line shut-off valve** - Installed on the suction port of the compressor to facilitate maintenance operation.

**High pressure side manometers**

**Low pressure side manometers**

**One centrifugal pump (low lift)** - Hydronic kit consists of: single direct driven centrifugal pump, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pump are protected from freezing with an additional electrical heater.

## 4 General Characteristics

### 4 - 1 General characteristics

4

**One centrifugal pump (high lift)** Hydronic kit consists of: single direct driven centrifugal pump, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pump are protected from freezing with an additional electrical heater.

**Two centrifugal pump (low lift)** - Hydronic kit consists of: twin direct driven centrifugal pumps, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pumps are protected from freezing with an additional electrical heater.

**Two centrifugal pump (high lift)** Hydronic kit consists of: twin direct driven centrifugal pumps, water filling system with pressure gauge, safety valve, drain valve. The motor pump is protected by a circuit breaker installed in control panel. The kit is assembled and wired to the control panel. The pipe and pumps are protected from freezing with an additional electrical heater.

**Double pressure relief valve with diverter**

**Evaporator right water connections**

#### ELECTRICAL / CONTROL

**Soft starter** - Electronic starting device to reduce the mechanical stress during compressor start-up

**Compressor thermal overload relays** - Safety devices against compressor motor overloading. This device together with internal motor protection (standard) guarantee the best safety system for compressor motor.

**Under / Over voltage control** - This device control the voltage value of power supply and stop the chiller if the value exceeds the allowed operating limits.

**Energy meter** - Device installed inside the control box showing ampere and volt values

**Capacitors for power factor correction** - To increase the operating power factor of the unit at nominal operating conditions. The capacitors are "dry" self-regenerating type with over pressure disconnecting safety device insulated with a no toxic dielectric mix with no PCB or PCT.

**Current limit** - To limit maximum absorbed current of the unit whenever is required

**Speedtrol (fan speed control device - ON/OFF - up to -18°C)** - Continuous fan speed modulation on the first fan of each circuit. It allows the unit working with air temperature down to -18°C.

**Evaporator flow switch** - Supplied separately to be wired and installed on the evaporator water piping (by the customer).  
Compressors circuit breakers

**Fans speed regulation (+ fan silent mode)** - To control the fan speed revolution for smooth operating control of the unit. This option improves the sound level of the unit during low ambient temperature operation.

**Ground fault relay** - To shut down the entire unit if a ground fault condition is detected.

**Rapid restart** - It allows the unit to start as fast as 30 seconds after power is restored (in case of power failure).

#### INSTALLATION

**Rubber anti vibration mounts** - Supplied separately, these are positioned under the base of the unit during installation. Ideal to reduce the vibrations when the unit is floor mounted.

**Spring anti vibration mounts** - Supplied separately, these are positioned under the base of the unit during installation. Ideal for dampening vibrations for installation on roofs and metallic structures.

#### OTHER

**Container Kit**

**Witness test**


**Acoustic test**

**Refrigerant recovery unit** - This option allows to stock refrigerant charge of 1 circuit for maintenance operation. Liquid receiver includes in/out shut-off valve and relief valve.

**Transport kit**

# 5 Nomenclature

## 5 - 1 Nomenclature

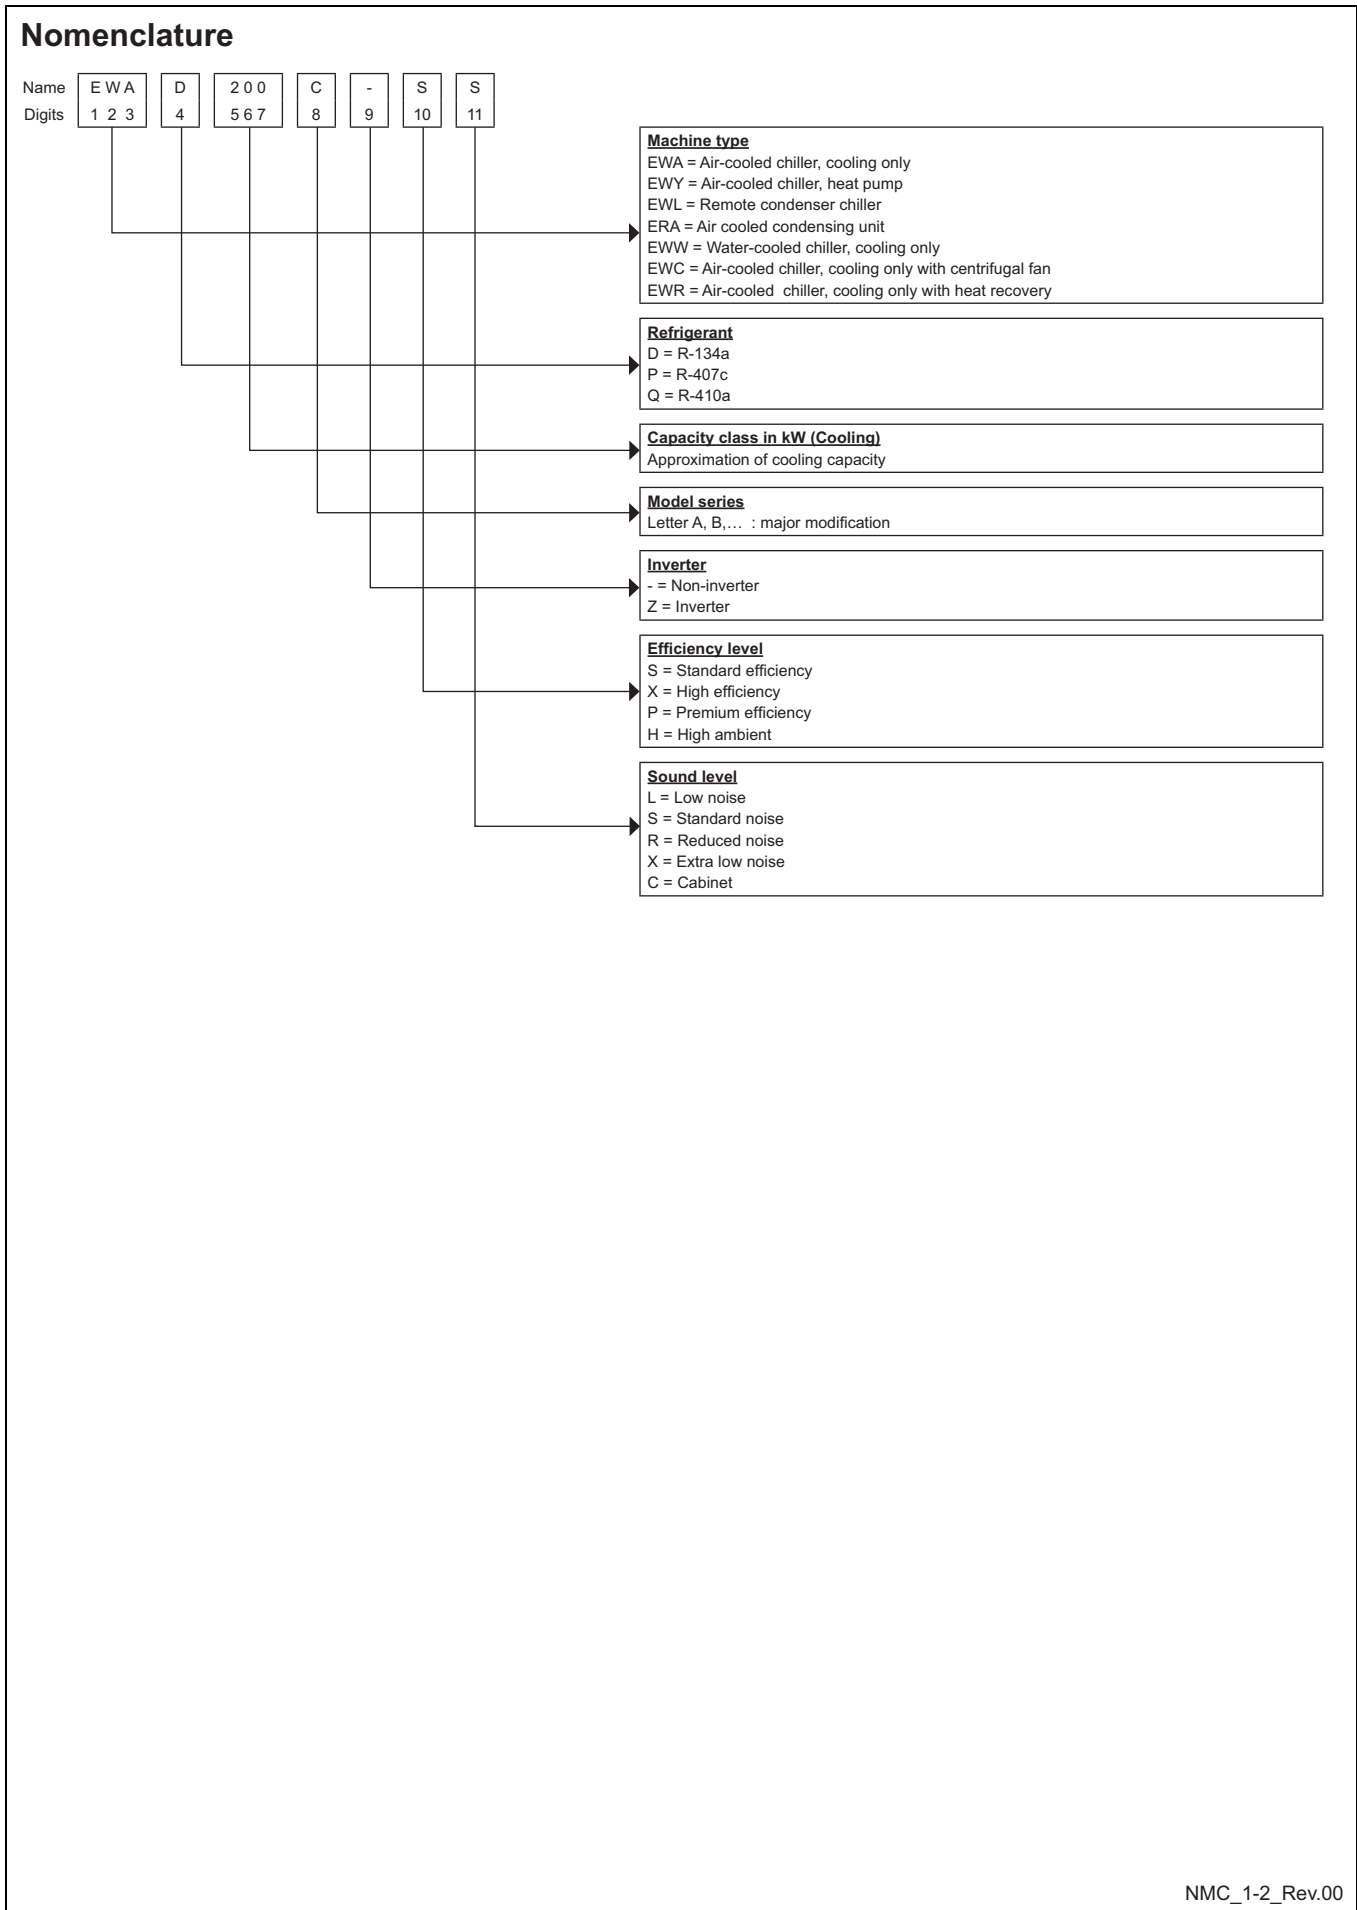


## 6 Options

### 6 - 1 Water Pump Kit - Technical Information

6

#### Water Pump Kit - Discharge Head


##### Single Pump (2 poles) - Discharge Head

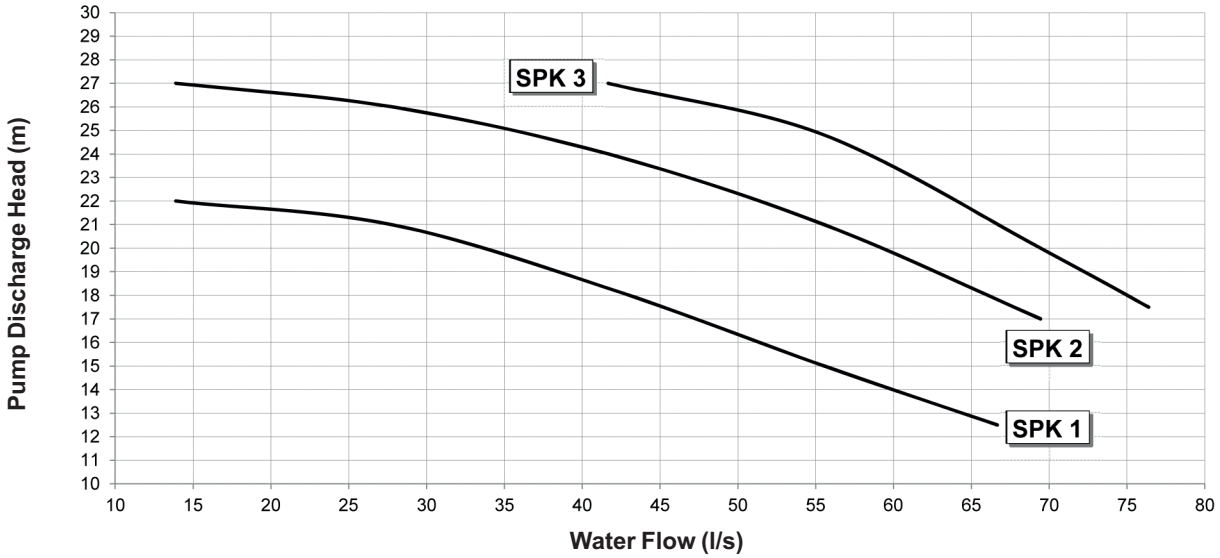

#### Note

- the above curves are referred to the discharge head of the pump only
- when selecting the pump you have to consider the installation and evaporator pressure drops
- when using mixture of water and glycol please contact the factory as above specification can change

##### Twin Pump (2 poles) - Discharge Head

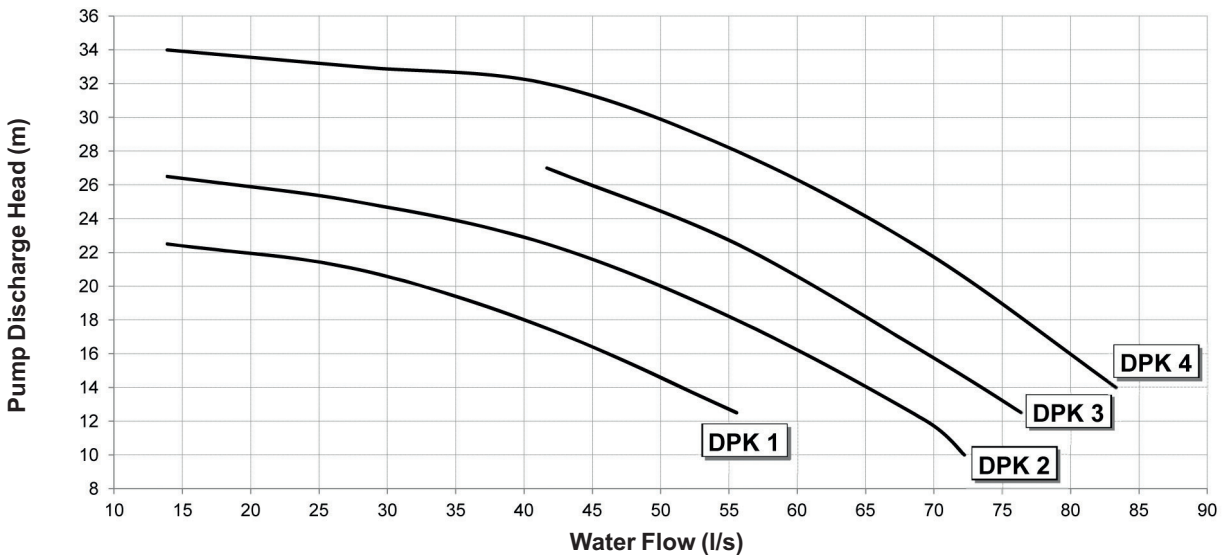

#### NOTES

- the above curves are referred to the discharge head of the pump only
- when selecting the pump you have to consider the installation and evaporator pressure drops
- when using mixture of water and glycol please contact the factory as above specification can change



## 6 Options

### 6 - 1 Water Pump Kit - Technical Information

		Pump Motor Power (kW)	Pump Motor Current (A)	Power supply (V-ph-Hz)	PN	Motor Protection	Insulation (Class)	Working Temp. (°C)
Single Pump	SPK 1	11,0	20,0	400V-3ph-50hz	16	IP55	class F	-20 +140
	SPK 2	15,0	26,5	400V-3ph-50hz	16	IP55	class F	-20 +140
	SPK 3	18,5	32,5	400V-3ph-50hz	16	IP55	class F	-20 +140
Double Pump	DPK 1	11,0	20,0	400V-3ph-50hz	16	IP55	class F	-20 +140
	DPK 2	15,0	26,5	400V-3ph-50hz	16	IP55	class F	-20 +140
	DPK 3	18,5	32,5	400V-3ph-50hz	16	IP55	class F	-20 +140
	DPK 4	22,0	39,0	400V-3ph-50hz	16	IP55	class F	-20 +140

**NOTE**

- When using mixture of water and glycol please contact the factory as above specification can change

WPKTI\_1a-2a-3a\_Rev.03\_3a

## 6 Options

### 6 - 2 Water Pump Kit - Combination Matrix

6

Version	Size	Version	Size	Single Pump			Double Pump			
				SPK 1	SPK 2	SPK 3	DPK 1	DPK 2	DPK 3	DPK 4
EWAD-C-SS EWAD-C-SL	650	EWAD-C-SR	620	X	X		X	X		
	740		720	X	X		X	X		
	830		790	X	X		X	X		
	910		880	X	X		X	X		
	970		920	X	X	X	X	X		
	C11		C10	X	X	X	X	X		
	C12		C11	X	X	X	X	X	X	X
	C13		C12		X	X			X	X
	H14		H14			X				X
EWAD-C-XS EWAD-C-XL	760	EWAD-C-XR	740	X	X		X	X		
	830		810	X	X		X	X		
	890		870	X	X		X	X		
	990		970	X	X	X	X	X	X	X
	C10		C10	X	X	X	X	X	X	X
	C11		C11	X	X	X		X	X	X
	C12		C12	X	X	X		X	X	X
	C13		C13	X	X	X		X	X	X
	H14		H14			X				X
	H15		H15			X				X
EWAD-C-PS EWAD-C-PL	820	EWAD-C-PR	810	X	X		X	X		
	890		880	X	X		X	X		
	980		960	X	X	X	X	X		
	C11		C10	X	X	X	X	X	X	X
	C12		C11	X	X	X		X	X	X
	C13		C13	X	X	X		X	X	X
	C14		C14		X	X		X	X	X
	C15		C15			X				X
	C16		C16							

WPKCM\_1a-2a-3a\_Rev.03\_2a

# 7 Capacity tables

## 7 - 1 Cooling Capacity Tables

EWAD650-C13C-SS/SL

Ta: Condenser inlet air temperature; Twout: Evaporator leaving water temperature ( $\Delta t 5^{\circ}\text{C}$ );  
CC: Cooling capacity; PI: Power input; qw: Fluid flow rate; dpw: Fluid pressure drop

Size	Condenser inlet air temperature Ta	Twout																							
		5				7				9				11				13				15			
		CC	PI	qw	dpw	CC	PI	qw	dpw	CC	PI	qw	dpw	CC	PI	qw	dpw	CC	PI	qw	dpw	CC	PI	qw	dpw
650	25	671	187	32.1	50	710	194	34.0	55	750	200	36.0	61	791	206	38.0	68	832	213	40.0	74	874	220	42.1	81
	30	641	201	30.6	46	679	208	32.5	51	718	215	34.4	57	757	222	36.4	62	797	229	38.3	69	838	236	40.3	75
	35	608	216	29.1	42	645	223	30.9	47	683	230	32.7	52	721	238	34.6	57	759	245	36.5	63	798	253	38.4	69
	40	571	232	27.3	37	606	240	29.0	42	642	247	30.8	46	679	255	32.6	51	716	263	34.4	56	753	272	36.2	62
	43	546	242	26.1	34	581	250	27.8	39	615	258	29.5	43	651	266	31.2	47	687	275	33.0	52	723	284	34.8	58
	46	518	252	24.8	31	552	261	26.4	35	586	269	28.1	39	620	278	29.7	44	655	287	31.4	48	675	287	32.4	51
740	25	749	218	35.8	55	788	225	37.8	61	829	232	39.8	66	870	240	41.8	73	912	247	43.9	79	955	256	46.0	86
	30	729	237	34.9	52	767	244	36.8	58	806	252	38.7	63	846	260	40.6	69	887	268	42.7	75	928	277	44.7	82
	35	704	257	33.7	49	741	265	35.5	54	779	273	37.3	59	817	282	39.2	65	855	291	41.1	71	895	300	43.1	77
	40	672	279	32.1	45	707	288	33.9	50	743	297	35.6	54	779	306	37.4	59	815	315	39.2	65	852	325	41.0	70
	43	648	294	31.0	42	682	303	32.7	47	716	312	34.3	51	740	315	35.5	54	761	315	36.5	57	783	316	37.6	60
46	609	303	29.1	38	629	303	30.1	40	648	302	31.1	43	658	296	31.6	44	661	298	31.7	44	667	289	32.0	45	
830	25	844	249	40.4	54	888	257	42.6	60	933	266	44.8	65	979	275	47.0	71	1026	285	49.3	78	1073	295	51.7	85
	30	819	270	39.2	52	862	279	41.3	57	905	288	43.4	62	949	298	45.6	68	994	308	47.8	73	1039	319	50.0	80
	35	788	293	37.7	48	829	302	39.7	53	870	313	41.7	58	911	323	43.8	63	953	334	45.8	68	996	345	47.9	74
	40	746	318	35.7	44	785	328	37.6	48	824	339	39.5	52	863	350	41.4	57	897	359	43.1	61	905	352	43.5	62
	43	716	334	34.2	40	753	345	36.1	44	768	343	36.8	46	775	334	37.2	47	779	324	37.4	47	793	319	38.1	49
46	634	321	30.3	32	645	315	30.9	34	655	307	31.3	34	647	314	31.0	34	652	302	31.3	34	664	295	31.9	35	
910	25	918	265	43.9	63	966	273	46.3	70	1015	282	48.7	76	1065	291	51.2	83	1116	301	53.7	91	1167	310	56.2	99
	30	894	288	42.8	60	940	297	45.1	66	988	306	47.4	73	1036	316	49.8	79	1085	326	52.2	86	1134	336	54.6	94
	35	863	312	41.3	57	908	322	43.5	62	953	332	45.7	68	999	342	48.0	74	1046	353	50.3	81	1093	364	52.6	88
	40	824	339	39.4	52	866	349	41.5	57	909	360	43.6	62	953	371	45.7	68	997	383	47.9	74	1035	391	49.8	79
	43	794	357	38.0	49	835	368	40.0	54	872	376	41.8	58	897	377	43.1	61	925	378	44.4	65	951	379	45.7	68
46	741	363	35.4	43	765	363	36.6	46	785	361	37.6	48	797	354	38.2	49	796	353	38.2	49	804	343	38.7	50	
970	25	978	292	46.8	71	1028	301	49.3	78	1079	311	51.8	85	1131	321	54.4	93	1184	332	57.0	101	1237	343	59.6	110
	30	951	317	45.5	67	999	327	47.9	74	1048	338	50.3	81	1098	349	52.8	88	1149	360	55.3	96	1200	372	57.8	104
	35	916	344	43.9	63	962	355	46.1	69	1009	366	48.4	75	1057	378	50.8	82	1105	390	53.1	89	1153	403	55.5	96
	40	871	374	41.7	58	915	386	43.8	63	959	398	46.0	69	1003	411	48.2	75	1048	424	50.4	81	1082	431	52.1	86
	43	838	394	40.1	54	880	406	42.1	59	912	414	43.7	63	922	405	44.2	64	934	397	44.9	66	945	388	45.4	67
46	762	391	36.4	45	771	381	36.9	46	776	368	37.2	47	791	361	37.9	49	782	368	37.6	48	791	356	38.0	49	
C11	25	1072	314	51.3	65	1127	324	54.0	72	1184	334	56.9	79	1242	345	59.7	86	1302	356	62.6	94	1362	368	65.6	102
	30	1043	341	49.9	62	1097	352	52.6	68	1152	363	55.3	75	1208	374	58.1	82	1265	386	60.9	89	1323	399	63.7	97
	35	1008	370	48.2	59	1059	382	50.8	64	1112	394	53.4	70	1165	406	56.0	77	1220	419	58.7	83	1274	432	61.4	90
	40	961	403	46.0	54	1010	415	48.4	59	1060	428	50.8	64	1110	441	53.3	70	1161	455	55.8	76	1203	463	57.9	81
	43	926	424	44.3	50	974	437	46.6	55	1016	447	48.7	60	1042	446	50.0	63	1074	447	51.6	66	1104	448	53.1	70
46	860	429	41.1	44	890	430	42.6	47	910	426	43.6	49	924	417	44.3	50	925	418	44.4	50	931	404	44.8	51	
C12	25	1154	336	55.3	75	1214	346	58.2	82	1275	357	61.3	90	1337	368	64.3	98	1401	380	67.5	107	1465	391	70.7	116
	30	1126	365	53.9	72	1184	376	56.8	79	1243	388	59.7	86	1304	400	62.7	94	1365	412	65.7	102	1427	424	68.8	111
	35	1090	397	52.2	68	1146	408	55.0	74	1203	421	57.8	81	1261	433	60.6	88	1320	446	63.5	96	1380	460	66.5	104
	40	1044	431	50.0	62	1097	444	52.6	68	1151	457	55.3	75	1206	470	58.0	81	1262	484	60.7	89	1319	499	63.5	96
	43	1009	454	48.3	59	1061	467	50.8	64	1113	481	53.4	70	1166	495	56.0	77	1220	509	58.7	83	1261	517	60.7	88
46	968	479	46.3	54	1018	492	48.8	60	1044	493	50.1	63	1055	481	50.7	64	1062	467	51.1	65	1073	455	51.6	66	
C13	25	1325	366	63.4	55	1398	377	66.9	60	1471	389	70.5	66	1545	401	74.2	73	1621	414	77.9	79	1699	427	81.8	86
	30	1289	398	61.7	52	1360	410	65.1	57	1432	423	68.7	63	1504	436	72.2	69	1577	450	75.8	75	1652	464	79.5	82
	35	1246	432	59.6	49	1315	446	62.9	54	1384	460	66.4	59	1454	474	69.8	65	1524	488	73.2	71	1595	503	76.7	77
	40	1190	470	56.9	45	1256	484	60.1	50	1322	499	63.4	55	1389	514	66.7	60	1456	530	69.9	65	1523	546	73.3	71
	43	1149	494	54.9	42	1212	509	58.0	47	1276	525	61.2	51	1341	541	64.4	56	1385	545	66.5	60	1427	548	68.6	63
46	1100	521	52.6	39	1143	526	54.7	42	1180	526	56.5	44	1207	521	57.9	46	1219	508	58.5	47	1219	504	58.6	47	

**NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания**

- 1 Fluid: Water  
Fluid: Wasser  
Υγρό: Νερό  
Líquido: agua  
Liquide: Eau  
Fluido: Acqua  
Vloeistof: Water  
Жидкость: Вода
- 2 For working conditions where dpw values are in italic, please contact factory.  
Für Arbeitsbedingungen mit kursiv gedruckten dpw-Werten, wenden Sie sich bitte an den Hersteller.  
Για τις συνθήκες εργασίας όπου οι τιμές dpw είναι σε πλάγια γραφή, παρακαλούμε επικοινωνήστε με το εργοστάσιο.  
Para las condiciones de funcionamiento en las que los valores dpw están en cursiva, póngase en contacto con la fábrica.  
Pour les conditions de travail lorsque les valeurs dpw sont en italique, veuillez contacter l'usine.  
Per le condizioni d'esercizio in cui i valori dpw sono riportati in corsivo, contattare il produttore.  
Voor bedrijfsomstandigheden met schuingedrukte dpw-waarden, gelieve contact op te nemen met de fabriek.  
Если условия работы соответствуют значениям dpw, указанным курсивом, обратитесь на завод-изготовитель.

SRC\_1-2-3-4-5-6-7-8-9\_Rev.02\_1-2\_(1-2)

# 7 Capacity tables

## 7 - 1 Cooling Capacity Tables

EWADH14-C20C-SS/SL

Ta: Condenser inlet air temperature; Twout: Evaporator leaving water temperature ( $\Delta t 5^{\circ}\text{C}$ );  
CC: Cooling capacity; PI: Power input; qw: Fluid flow rate; dpw: Fluid pressure drop

Size	Condenser inlet air temperature Ta	Twout																							
		5				7				9				11				13				15			
		CC kW	PI kW	qw l/s	dpw kPa	CC kW	PI kW	qw l/s	dpw kPa	CC kW	PI kW	qw l/s	dpw kPa	CC kW	PI kW	qw l/s	dpw kPa	CC kW	PI kW	qw l/s	dpw kPa	CC kW	PI kW	qw l/s	dpw kPa
H14	25	1427	392	68.3	59	1502	404	72.0	65	1580	416	75.8	72	1659	429	79.7	78	1739	443	83.6	85	1821	457	87.7	93
	30	1388	427	66.4	56	1462	440	70.0	62	1537	454	73.7	68	1613	468	77.5	74	1690	483	81.3	81	1769	498	85.2	88
	35	1339	465	64.1	53	1412	479	67.6	58	1484	494	71.1	64	1556	509	74.7	70	1630	525	78.3	76	1705	541	82.0	82
	40	1275	506	61.0	48	1345	522	64.4	53	1415	538	67.8	59	1484	555	71.2	64	1553	571	74.6	70	1624	589	78.1	75
	43	1229	534	58.7	45	1295	550	62.0	50	1363	567	65.4	55	1431	584	68.7	60	1454	578	69.8	62	1474	567	70.9	63
	46	1175	564	56.2	42	1200	559	57.4	43	1214	544	58.1	44	1231	532	59.1	46	1245	517	59.8	47	1239	524	59.5	46
C15	25	1552	458	74.3	63	1635	473	78.3	70	1720	489	82.5	77	1806	505	86.8	84	1895	522	91.1	92	1984	540	95.6	100
	30	1509	498	72.2	60	1589	514	76.1	66	1671	530	80.2	73	1754	548	84.3	80	1839	566	88.4	87	1925	585	92.7	94
	35	1455	540	69.6	56	1532	557	73.4	62	1610	575	77.2	68	1689	594	81.1	74	1769	613	85.1	81	1851	633	90.1	88
	40	1385	587	66.2	52	1457	606	69.8	57	1531	625	73.4	62	1605	645	77.1	68	1681	665	80.8	74	1737	675	83.6	78
	43	1333	618	63.7	48	1402	637	67.1	53	1467	655	70.3	57	1497	648	71.8	60	1536	646	73.8	63	1573	642	75.6	65
	46	1233	625	58.9	42	1268	622	60.7	44	1301	616	62.3	46	1313	599	63.0	47	1312	605	63.0	47	1331	590	63.9	48
C16	25	1633	482	78.2	70	1720	497	82.5	77	1809	513	86.9	84	1900	530	91.3	92	1993	548	95.9	100	2087	566	100.5	109
	30	1589	524	76.1	66	1674	540	80.2	73	1759	558	84.4	80	1847	575	88.8	87	1936	594	93.1	95	2026	613	97.6	104
	35	1534	568	73.4	62	1615	586	77.4	68	1697	605	81.4	75	1780	624	85.5	82	1865	644	89.7	89	1951	665	94.0	97
	40	1463	618	70.0	57	1539	637	73.7	63	1616	657	77.5	68	1695	677	81.4	75	1775	698	85.3	81	1835	709	88.3	87
	43	1410	651	67.4	53	1483	671	71.0	59	1552	689	74.4	64	1583	680	76.0	66	1625	677	78.1	69	1665	672	80.1	72
	46	1306	657	62.4	46	1340	651	64.2	49	1379	646	66.1	51	1414	639	67.8	54	1426	651	68.5	55	1466	647	70.4	58
C17	25	1729	515	82.8	76	1818	531	87.2	84	1909	549	91.7	92	2002	567	96.3	100	2097	585	101.0	109	2193	605	105.7	118
	30	1682	559	80.5	73	1769	577	84.8	80	1857	596	89.1	87	1946	615	93.6	95	2037	635	98.1	103	2129	655	102.6	112
	35	1623	608	77.7	68	1706	627	81.8	75	1790	647	85.9	82	1875	667	90.1	89	1961	688	94.4	97	2049	710	98.7	105
	40	1546	661	74.0	62	1624	682	77.8	68	1703	703	81.7	75	1783	725	85.7	81	1865	747	89.7	88	1926	759	92.7	94
	43	1488	697	71.2	58	1563	718	74.9	64	1628	734	78.1	69	1667	730	80.0	72	1703	724	81.8	75	1736	716	83.5	77
	46	1374	702	65.7	50	1410	696	67.5	53	1436	686	68.8	55	1452	667	69.7	56	1454	675	69.8	56	1470	654	70.7	57
C18	25	1829	547	87.4	37	1920	564	91.9	41	2013	581	96.4	44	2107	600	101.0	48	2204	619	105.8	52	2301	638	110.5	56
	30	1778	596	85.0	35	1866	614	89.3	38	1956	633	93.7	42	2046	653	98.1	46	2138	673	102.6	49	2231	694	107.2	53
	35	1713	649	81.8	33	1797	669	86.0	36	1882	690	90.1	39	1968	711	94.4	42	2055	733	98.6	46	2143	755	102.9	50
	40	1625	708	77.6	30	1706	730	81.6	33	1787	752	85.6	36	1868	775	89.5	39	1943	796	93.2	42	1976	789	94.8	43
	43	1560	747	74.5	28	1638	770	78.3	30	1673	767	80.1	32	1690	747	81.0	32	1708	728	81.9	33	1725	708	82.8	34
	46	1385	720	66.1	22	1403	700	67.1	23	1419	678	67.9	24	1425	687	68.2	24	1435	679	68.8	24	1451	656	69.6	25
C19	25	1895	560	90.6	40	1990	577	95.2	43	2087	594	100.0	47	2185	612	104.8	51	2285	630	109.7	56	2386	650	114.7	60
	30	1846	611	88.2	38	1938	629	92.7	41	2031	648	97.3	45	2125	667	101.9	49	2221	687	106.6	53	2319	708	111.4	57
	35	1783	667	85.2	35	1870	687	89.5	39	1959	707	93.8	42	2050	728	98.3	46	2141	749	102.8	50	2234	772	107.3	54
	40	1698	730	81.1	32	1782	751	85.2	35	1867	773	89.4	39	1952	795	93.6	42	2038	818	97.8	45	2110	834	101.3	48
	43	1635	771	78.1	30	1716	793	82.1	33	1785	808	85.5	36	1826	802	87.5	37	1863	792	89.3	38	1881	773	90.3	39
	46	1499	771	71.6	26	1541	765	73.7	27	1552	739	74.3	28	1579	724	75.6	29	1576	725	75.6	28	1598	705	76.7	29
C20	25	1947	586	93.0	41	2043	604	97.8	45	2141	622	102.6	49	2241	640	107.5	54	2343	660	112.5	58	2446	680	117.5	63
	30	1895	640	90.5	39	1988	659	95.1	43	2082	679	99.8	47	2178	699	104.5	51	2276	720	109.2	55	2374	742	114.1	60
	35	1828	700	87.3	37	1917	721	91.7	40	2007	742	96.1	44	2098	764	100.6	48	2190	787	105.1	52	2284	810	109.7	56
	40	1738	768	83.0	34	1823	790	87.2	37	1908	812	91.4	40	1994	836	95.6	43	2081	861	99.8	47	2146	873	103.1	50
	43	1671	812	79.8	31	1753	835	83.8	34	1816	848	86.9	37	1836	828	88.0	37	1850	802	88.7	38	1870	781	89.8	39
	46	1500	794	71.6	26	1529	777	73.1	27	1540	747	73.7	27	1569	731	75.2	28	1560	745	74.8	28	1580	721	75.8	29

### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания

1 Fluid: Water  
Fluid: Wasser  
Υγρό: Νερό  
Líquido: agua  
Liquide: Eau  
Fluido: Acqua  
Vloeistof: Water  
Жидкость: Вода


2 For working conditions where dpw values are in italic, please contact factory.  
Für Arbeitsbedingungen mit kursiv gedruckten dpw-Werten, wenden Sie sich bitte an den Hersteller.  
Για τις συνθήκες εργασίας όπου οι τιμές dpw είναι σε πλάγια γραφή, παρακαλούμε επικοινωνήστε με το εργοστάσιο.  
Para las condiciones de funcionamiento en las que los valores dpw están en cursiva, póngase en contacto con la fábrica.  
Pour les conditions de travail lorsque les valeurs dpw sont en italique, veuillez contacter l'usine.  
Per le condizioni d'esercizio in cui i valori dpw sono riportati in corsivo, contattare il produttore.  
Voor bedrijfsomstandigheden met schuingedrukte dpw-waarden, gelieve contact op te nemen met de fabriek.  
Если условия работы соответствуют значениям dpw, указанным курсивом, обратитесь на завод-изготовитель.

SRC\_1-2-3-4-5-6-7-8-9\_Rev.02\_1-2\_(2-2)

## 8 Dimensional drawings

### 8 - 1 Dimensional Drawings

EWAD-C- (2 circuits)

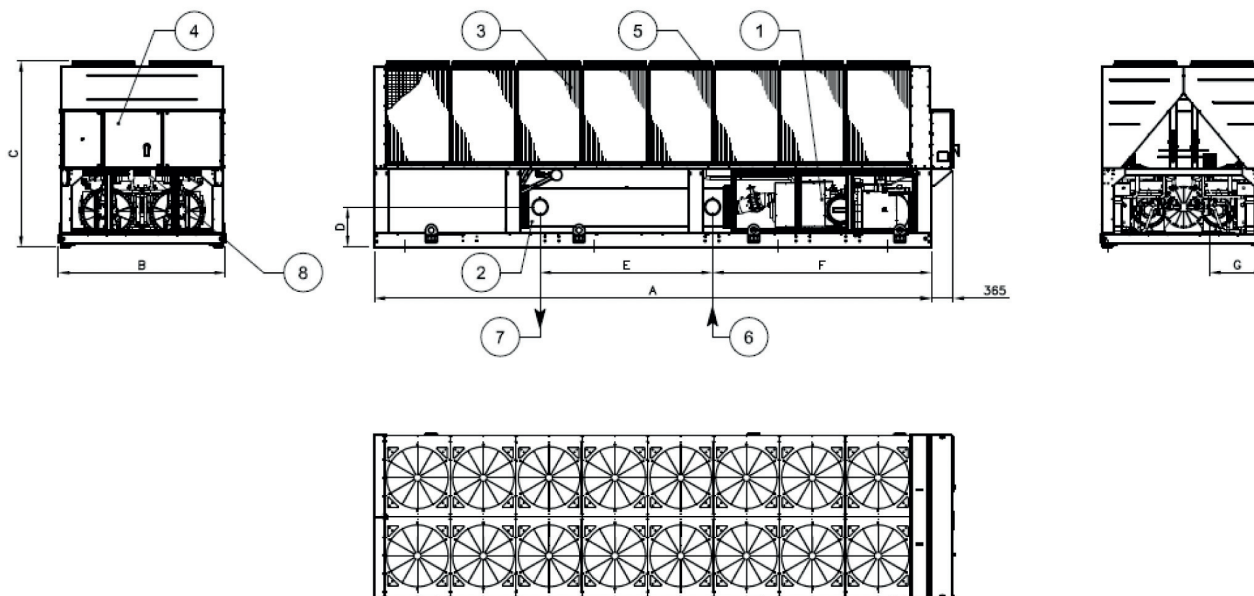

Drawing is for illustration only. Please refer to the table below for unit dimensions.

EWAD~C-	Dimensions (mm)								Fans
Size	Size	A	B	C	D	E	F	G	
EWAD650+830C-SS/SL	EWAD620+720C-SR	6185	2285	2540	450	2412	435	810	Nr 10
EWAD910+970C-SS/SL	EWAD880+920C-SR	6185	2285	2540	450	2412	435	810	Nr 12
EWADC11C-SS/SL	EWADC10C-SR	7085	2285	2540	1350	2412	435	810	Nr 14
EWADC12C-SS/SL	EWADC11C-SR	7985	2285	2540	2250	2412	435	810	Nr 16
EWADC13+H14C-SS/SL	EWADC12+H14C-SR	8885	2285	2540	3170	2360	540	760	Nr 18
EWAD760C-XS/XL	EWAD740C-XR	6185	2285	2540	470	2412	435	810	Nr 12
EWAD830+890C-XS/XL	EWAD810+870C-XR	7085	2285	2540	1370	2412	435	810	Nr 14
EWAD990+C10C-XS/XL	EWAD970+C10C-XR	7985	2285	2540	2270	2360	540	760	Nr 16
EWADC11+C13C-XS/XL	EWADC11+C13C-XR	9785	2285	2540	4070	2360	540	760	Nr 20
EWADH14+H15C-XS/XL/XR		9785	2285	2285	2920	3440	540	685	Nr 20
EWAD820+890C-PS/PL	EWAD810+880C-PR	8885	2285	2540	2020	3510	540	760	Nr 18
EWAD980C-PS/PL	EWAD960C-PR	8885	2285	2540	2020	3440	540	685	Nr 18
EWADC11+C12C-PS/PL	EWADC10+C11C-PR	9785	2285	2540	2920	3440	540	685	Nr 20
EWADC13C-PS/PL	EWADC13C-PR	11085	2285	2540	4205	3440	540	685	Nr 22
EWADC14C-PS/PL	EWADC14C-PR	11985	2285	2540	5105	3440	540	685	Nr 24
EWADC15+C16C-PS/PL/PR		11985	2285	2285	5130	3440	540	685	Nr 24

#### LEGEND


1. Compressor
2. Evaporator
3. Condenser coil
4. Electrical panel
5. Fan
6. Evaporator Water inlet
7. Evaporator Water outlet
8. Slot for power and control connection

DMN\_1c-2b\_Rev.03\_1c

## 8 Dimensional drawings

### 8 - 1 Dimensional Drawings

EWAD-C- (3 circuits)

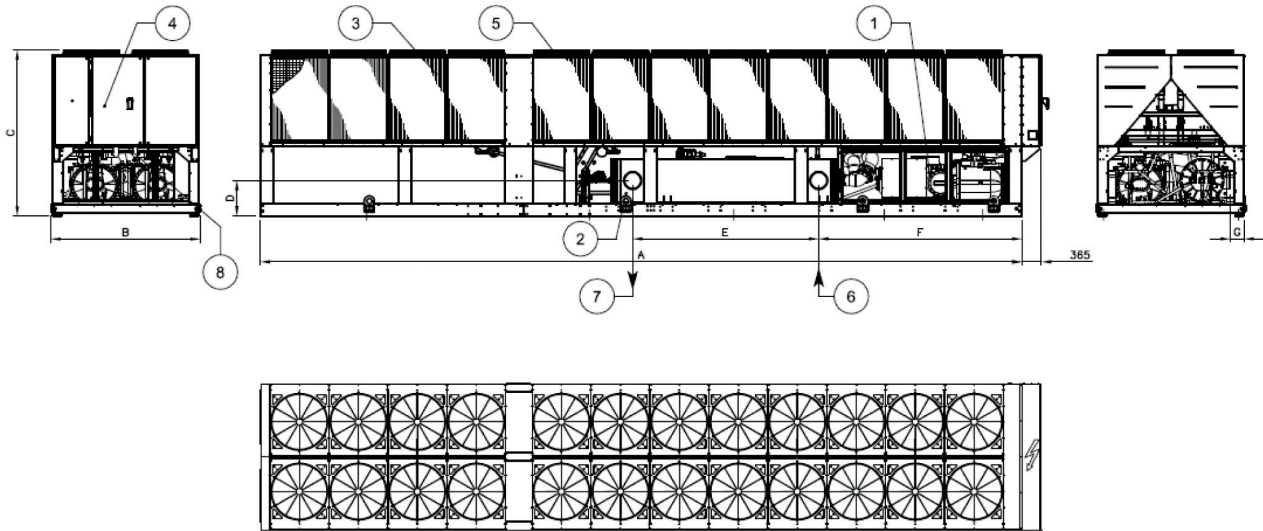

Drawing is for illustration only. Please refer to the table below for unit dimensions.

EWAD~C-		Dimensions (mm)							Fans
Size	Size	A	B	C	D	E	F	G	
EWADC14+C15C-SS/SL	EWADC13+C14C-SR	10185	2285	2540	4440	2360	540	285	Nr 20
EWADC16+C17C-SS/SL	EWADC15+C16C-SR	11085	2285	2540	5340	2360	540	285	Nr 22
EWADC18C-SS/SL	EWADC17C-SR	11085	2285	2540	4780	2840	540	210	Nr 22
EWADC19+C20C-SS/SL	EWADC18+C19C-SR	11985	2285	2540	5680	2840	540	210	Nr 24
EWADC14C-XS/XL	EWADC14C-XR	11985	2285	2540	5680	2910	540	285	Nr 24
EWADC15+C16C-XS/XL	EWADC15+C16C-XR	11985	2285	2540	5680	2840	540	210	Nr 24
EWADC17C-XS/XL	EWADC17C-XR	12885	2285	2540	6580	2840	540	210	Nr 26
EWADC18C-XS/XL	EWADC18C-XR	13785	2285	2540	7480	2840	540	210	Nr 28
EWADC19C- XS/XL	EWADC19C-XR	14685	2285	2540	8380	2840	540	210	Nr 30
EWADH14+H15C-XS/XL/XR		14685	2285	2285	8380	2840	540	210	Nr 30

#### LEGEND

1. Compressor
2. Evaporator
3. Condenser coil
4. Electrical panel
5. Fan
6. Evaporator Water inlet
7. Evaporator Water outlet
8. Slot for power and control connection

## 9 Sound data

### 9 - 1 Sound Power Spectrum

#### SOUND LEVELS EWAD~C-SS

MODEL	Sound pressure level at 1 m from the unit (rif. 2 x 10 <sup>-5</sup> Pa)									Power
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB(A)	dB(A)
650	73,9	76,0	78,8	78,0	73,9	69,4	59,8	50,7	79,0	99,5
740	74,4	76,5	79,3	78,5	74,4	69,9	60,3	51,2	79,5	100,0
830	74,4	76,5	79,3	78,5	74,4	69,9	60,3	51,2	79,5	100,0
910	75,3	77,4	80,2	79,4	75,3	70,8	61,2	52,1	80,4	100,9
970	75,5	77,6	80,4	79,6	75,5	71,0	61,4	52,3	80,6	101,1
C11	75,5	77,6	80,4	79,6	75,5	71,0	61,4	52,3	80,6	101,5
C12	75,5	77,6	80,4	79,6	75,5	71,0	61,4	52,3	80,6	101,7
C13	75,6	77,7	80,5	79,7	75,6	71,1	61,5	52,4	80,7	101,9
H14	75,6	77,7	80,5	79,7	75,6	71,1	61,5	52,4	80,7	101,9
C15	76,0	78,1	80,9	80,1	76,0	71,5	61,9	52,8	81,1	103,0
C16	76,0	78,1	80,9	80,1	76,0	71,5	61,9	52,8	81,1	103,2
C17	76,1	78,2	81,0	80,2	76,1	71,6	62,0	52,9	81,2	103,3
C18	76,4	78,5	81,3	80,5	76,4	71,9	62,3	53,2	81,5	103,5
C19	76,8	78,9	81,7	80,9	76,8	72,3	62,7	53,6	81,9	103,7
C20	76,8	78,9	81,7	80,9	76,8	72,3	62,7	53,6	81,9	103,7

#### EWAD~C-SL

MODEL	Sound pressure level at 1 m from the unit (rif. 2 x 10 <sup>-5</sup> Pa)									Power
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB(A)	dB(A)
650	70,4	72,5	75,3	74,5	70,4	65,9	56,3	47,2	75,5	96,0
740	70,5	72,6	75,4	74,6	70,5	66,0	56,4	47,3	75,6	96,1
830	70,5	72,6	75,4	74,6	70,5	66,0	56,4	47,3	75,6	96,1
910	71,4	73,5	76,3	75,5	71,4	66,9	57,3	48,2	76,5	97,5
970	71,5	73,6	76,4	75,6	71,5	67,0	57,4	48,3	76,6	97,1
C11	71,7	73,8	76,6	75,8	71,7	67,2	57,6	48,5	76,8	97,6
C12	71,8	73,9	76,7	75,9	71,8	67,3	57,7	48,6	76,9	98,1
C13	71,9	74,0	76,8	76,0	71,9	67,4	57,8	48,7	77,0	98,2
H14	71,9	74,0	76,8	76,0	71,9	67,4	57,8	48,7	77,0	98,2
C15	72,1	74,2	77,0	76,2	72,1	67,6	58,0	48,9	77,2	99,1
C16	72,2	74,3	77,1	76,3	72,2	67,7	58,1	49,0	77,3	99,5
C17	72,3	74,4	77,2	76,4	72,3	67,8	58,2	49,1	77,4	99,5
C18	72,8	74,9	77,7	76,9	72,8	68,3	58,7	49,6	77,9	99,9
C19	72,9	75,0	77,8	77,0	72,9	68,4	58,8	49,7	78,0	101,0
C20	72,9	75,0	77,8	77,0	72,9	68,4	58,8	49,7	78,0	101,0

#### EWAD~C-SR

MODEL	Sound pressure level at 1 m from the unit (rif. 2 x 10 <sup>-5</sup> Pa)									Power
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	dB(A)	dB(A)
620	67,6	60,8	67,9	73,1	60,5	56,9	48,6	36,0	71,0	91,5
720	68,1	61,3	68,4	73,6	61,0	57,4	49,1	36,5	71,5	92,0
790	68,1	61,3	68,4	73,6	61,0	57,4	49,1	36,5	71,5	92,0
880	68,6	61,8	68,9	74,1	61,5	57,9	49,6	37,0	72,0	92,5
920	69,1	62,3	69,4	74,6	62,0	58,4	50,1	37,5	72,5	93,0
C10	69,2	62,4	69,5	74,7	62,1	58,5	50,2	37,6	72,6	93,5
C11	69,3	62,5	69,6	74,8	62,2	58,6	50,3	37,7	72,7	93,8
C12	69,4	62,6	69,7	74,9	62,3	58,7	50,4	37,8	72,9	94,0
H14	69,4	62,6	69,7	74,9	62,3	58,7	50,4	37,8	72,9	94,0
C13	69,5	62,7	69,8	75,0	62,4	58,8	50,5	37,9	72,9	94,8
C14	69,6	62,8	69,9	75,1	62,5	58,9	50,6	38,0	73,0	94,9
C15	69,6	62,8	69,9	75,1	62,5	58,9	50,6	38,0	73,0	95,1
C16	69,7	62,9	70,0	75,2	62,6	59,0	50,7	38,1	73,1	95,2
C17	70,2	63,4	70,5	75,7	63,1	59,5	51,2	38,6	73,6	95,7
C18	70,3	63,5	70,6	75,8	63,2	59,6	51,3	38,7	73,7	95,8
C19	70,3	63,5	70,6	75,8	63,2	59,6	51,3	38,7	73,7	95,8

#### NOTE

Reduction to be applied to standard, low and reduced sound configuration.

NSL\_1a-2b-3b-4a\_Rev.03\_1a

## 9 Sound data

### 9 - 1 Sound Power Spectrum

#### Sound pressure level correction factor for different distances

##### EWAD~C-SS / EWAD~C-SL / EWAD~C-SR

Unit size			Distance						
EWAD~C-SS	EWAD~C-SL	EWAD~C-SR	1m	5m	10m	15m	20m	25m	50m
650	650	620	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
740	740	720	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
830	830	790	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
910	910	880	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
970	970	920	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
C11	C11	C10	0,0	-6,9	-11,4	-14,3	-16,5	-18,3	-23,9
C12	C12	C11	0,0	-6,7	-11,2	-14,1	-16,3	-18,0	-23,6
C13	C13	C12	0,0	-6,6	-11,0	-13,9	-16,0	-17,8	-23,4
H14	H14	H14	0,0	-6,6	-11,0	-13,9	-16,0	-17,8	-23,4
C15	C15	C14	0,0	-6,4	-10,7	-13,6	-15,7	-17,4	-17,4
C16	C16	C15	0,0	-6,3	-10,5	-13,4	-15,5	-17,2	-17,2
C17	C17	C16	0,0	-6,3	-10,5	-13,4	-15,5	-17,2	-17,2
C18	C18	C17	0,0	-6,3	-10,5	-13,4	-15,5	-17,2	-22,8
C19	C19	C18	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5
C20	C20	C19	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5

##### EWAD~C-XS / EWAD~C-XL / EWAD~C-XR

Unit size			Distance						
EWAD~C-XS	EWAD~C-XL	EWAD~C-XR	1m	5m	10m	15m	20m	25m	50m
760	760	740	0,0	-7,1	-11,6	-14,6	-16,8	-18,6	-24,2
830	830	810	0,0	-6,9	-11,4	-14,3	-16,5	-18,3	-23,9
890	890	870	0,0	-6,9	-11,4	-14,3	-16,5	-18,3	-23,9
990	990	970	0,0	-6,7	-11,2	-14,1	-16,3	-18,0	-23,6
C10	C10	C10	0,0	-6,7	-11,2	-14,1	-16,3	-18,0	-23,6
C11	C11	C11	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
C12	C12	C12	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
C13	C13	C13	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
H14	H14	H14	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
H15	H15	H15	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
C16	C16	C16	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5
C17	C17	C17	0,0	-6,1	-10,3	-13,0	-15,1	-16,8	-22,3
C18	C18	C18	0,0	-6,0	-10,1	-12,9	-15,0	-16,7	-22,1
C19	C19	C19	0,0	-5,9	-10	-12,7	-14,8	-16,5	-22,0
C20	C20	C20	0,0	-5,9	-10,0	-12,7	-14,8	-16,5	-22,0
C21	C21	C21	0,0	-5,9	-10	-12,7	-14,8	-16,5	-22,0
C22	C22	C22	0,0	-5,9	-10	-12,7	-14,8	-16,5	-22,0

##### EWAD~C-PS / EWAD~C-PL / EWAD~C-PR

Unit size			Distance						
EWAD~C-PS	EWAD~C-PL	EWAD~C-PR	1m	5m	10m	15m	20m	25m	50m
820	820	810	0,0	-6,6	-11,0	-13,9	-16,0	-17,8	-23,4
890	890	880	0,0	-6,6	-11,0	-13,9	-16,0	-17,8	-23,4
980	980	960	0,0	-6,6	-11,0	-13,9	-16,0	-17,8	-23,4
C11	C11	C10	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
C12	C12	C11	0,0	-6,5	-10,8	-13,7	-15,8	-17,5	-23,1
C13	C13	C13	0,0	-6,3	-10,5	-13,4	-15,5	-17,2	-22,8
C14	C14	C14	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5
C15	C15	C15	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5
C16	C16	C16	0,0	-6,2	-10,4	-13,2	-15,3	-17,0	-22,5

#### NOTE

Reduction to be applied to standard, low and reduced sound configuration.



# 10 Installation

## 10 - 1 Installation Method

**Warning** Installation and maintenance of the unit must to be performed only by qualified personnel who have knowledge with local codes and regulations, and experience with this type of equipment. Must be avoided the unit installation in places that could be considered dangerous for all the maintenance operations.

**Handling** Care should be taken to avoid rough handling or shock due to dropping the unit. Do not push or pull the unit from anything other than the base frame. Never allow the unit to fall during unloading or moving as this may result in serious damage. To lift the unit, rings are provided in the base frame of the unit. Spreader bar and cables should be arranged to prevent damage to the condenser coil or unit cabinet.

**Location** The units are produced for outside installation on roofs, floors or below ground level on condition that the area is free from obstacles for the passage of the condenser air. The unit should be positioned on solid foundations and perfectly level; in the case of installation on roofs or floors, it may be advisable to arrange the use of suitable weight distribution beams. When the units are installed on the ground, a concrete base at least 250 mm wider and longer than the unit's footprint should be laid. Furthermore, this base should withstand the unit weight mentioned in the technical data table.

**Space requirements** The units are air-cooled, then it is important to respect the minimum distances which guarantee the best ventilation of the condenser coils. Limitations of space reducing the air flow could cause significant reductions in cooling capacity and an increase in electricity consumption.

To determinate unit placement, careful consideration must be given to assure a sufficient air flow across the condenser heat transfer surface. Two conditions must be avoided to achieve the best performance: warm air recirculation and coil starvation. Both these conditions cause an increase of condensing pressures that results in reductions in unit efficiency and capacity.

Moreover the unique microprocessor has the ability to calculate the operating environment of the air cooled chiller and the capacity to optimize its performance staying on-line during abnormal conditions.


Each side of the unit must be accessible after installation for periodic service. Fig.1 shows you minimum recommended clearance requirements. Vertical condenser air discharge must be unobstructed because the unit would have its capacity and efficiency significantly reduced.

If the units are positioned in places surrounded by walls or obstacles of the same height as the units, the units should be at least 2500 mm from obstacles (Fig.2). In the event the obstacles are higher than the units, the units should be at least 3000 mm from the obstacle (Fig.3). Units installed closer than the minimum recommended distance to a wall or other vertical riser may experience a combination of coil starvation and warm air recirculation, thus causing reduction in unit capacity and efficiency reductions. The microprocessor control is proactive in response "of design condition". In the case of single or compounded influences restricting airflow to the unit, the microprocessor will act to keep the compressor(s) running (at reduced capacity) rather than allowing a shut-off on high discharge pressure.

When two or more units are positioned side by side it is recommended that the condenser coils are at least 3600 mm distance from one another (Fig.4); strong wind could be the cause of air warm recirculation.

For other installation solutions, consult our technicians.

The above recommended information are representative of general installation. A specific evaluation should be done by contractor depending on the case.

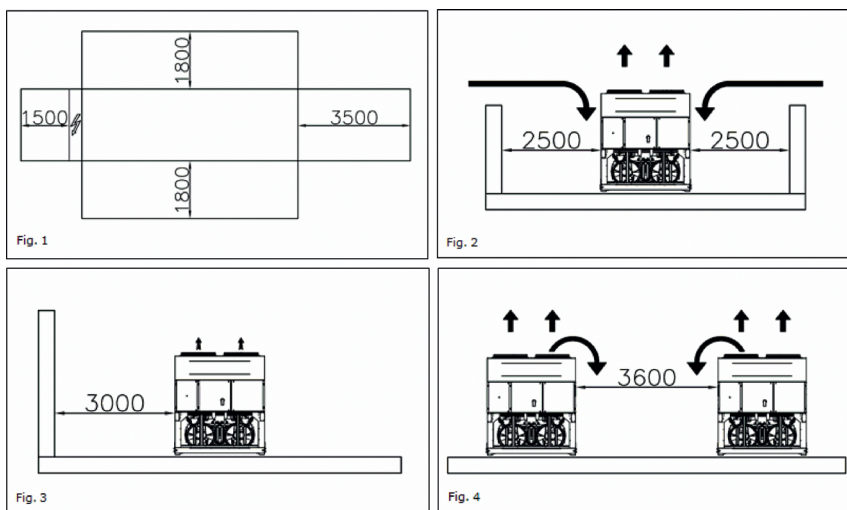

**Acoustic protection** When noise level must meet special requirements, it is necessary to pay the maximum attention to ensure the perfect insulation of the unit from the support base by applying appropriate vibration-dampening devices on the unit, on the water pipes and on the electrical connections.


**Storage** The environment conditions have to be in the following limits:

- Minimum ambient temperature: -20°C
- Maximum ambient temperature: +57°C
- Maximum R.H.: 95% not condensing

# 11 Operation range

## 11 - 1 Operation Range

11

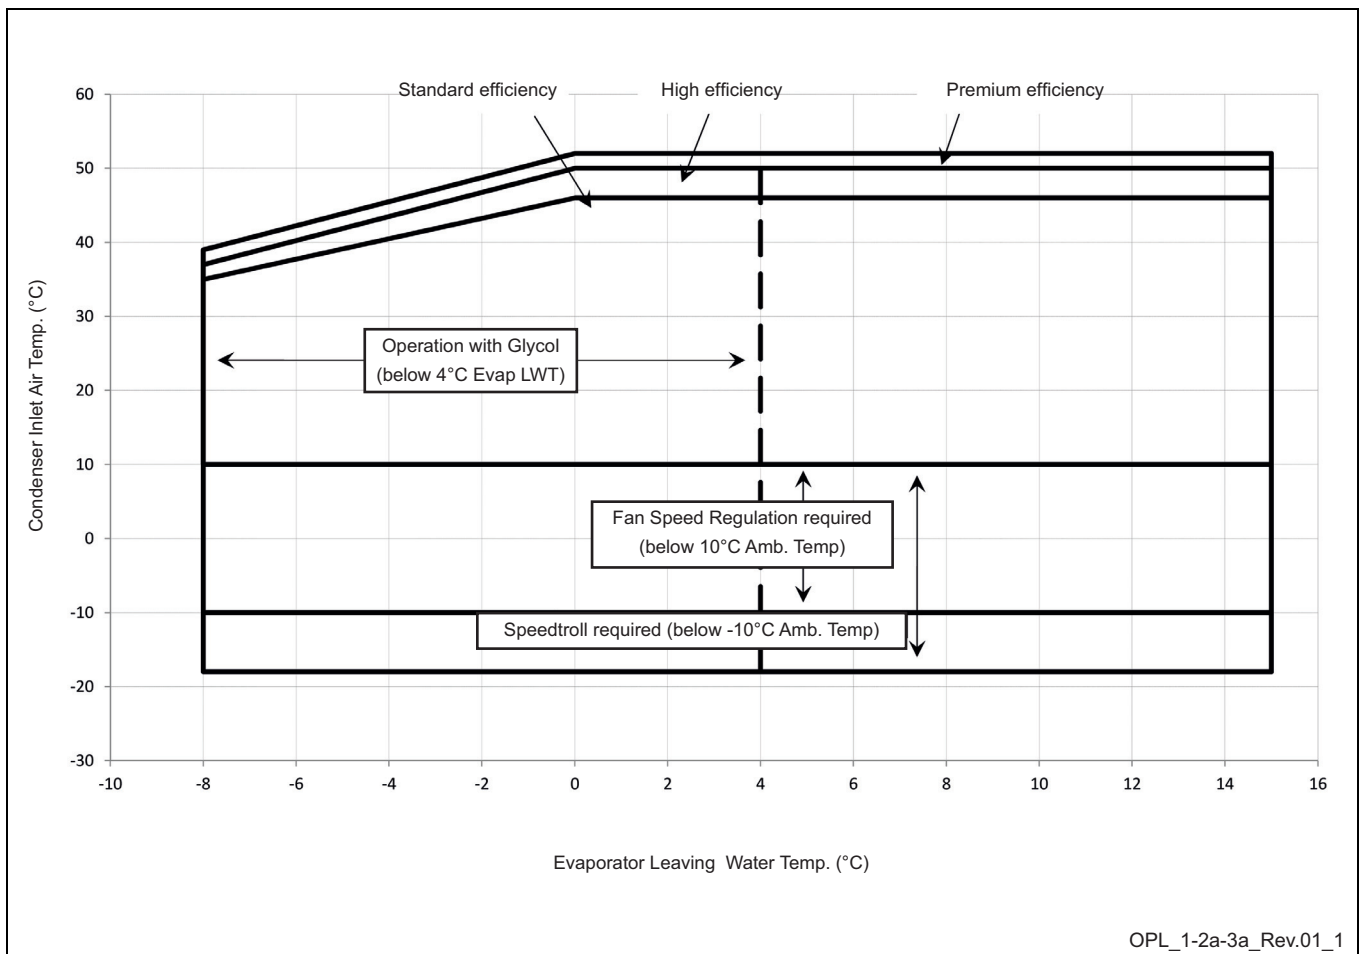

OPL\_1-2a-3a\_Rev.01\_1

### Water charge, flow and quality

Items <sup>(1) (6)</sup>		Cooling Water			Cooled Water		Heated water <sup>(2)</sup>				Tendency if out of criteria		
		Circulating System		Once Flow	Circulating water [Below 20°C]	Supply water <sup>(4)</sup>	Low temperature [20°C ~ 60°C]		High temperature [60°C ~ 80°C]				
		Circulating water	Supply water <sup>(4)</sup>	Flowing water			Circulating water	Supply water <sup>(4)</sup>	Circulating water	Supply water <sup>(4)</sup>			
Items to be controlled	pH	at 25°C		6.5 ~ 8.2	6.0 ~ 8.0	6.0 ~ 8.0	6.8 ~ 8.0	6.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	7.0 ~ 8.0	Corrosion + Scale
	Electrical conductivity	[mS/m] at 25°C		Below 80	Below 30	Below 40	Below 80	Below 80	Below 30	Below 30	Below 30	Below 30	Corrosion + Scale
		[µS/cm] at 25°C		(Below 800)	(Below 300)	(Below 400)	(Below 800)	(Below 800)	(Below 300)	(Below 300)	(Below 300)	(Below 300)	Corrosion + Scale
	Chloride ion	[mgCl <sup>-</sup> /l]		Below 200	Below 50	Below 50	Below 200	Below 50	Below 50	Below 50	Below 30	Below 30	Corrosion
	Sulfate ion	[mgSO <sub>4</sub> <sup>-2</sup> /l]		Below 200	Below 50	Below 50	Below 200	Below 50	Below 50	Below 50	Below 30	Below 30	Corrosion
	M-alkalinity (pH4.8)	[mgCaCO <sub>3</sub> /l]		Below 100	Below 50	Below 50	Below 100	Below 50	Below 50	Below 50	Below 50	Below 50	Scale
	Total hardness	[mgCaCO <sub>3</sub> /l]		Below 200	Below 70	Below 70	Below 200	Below 70	Below 70	Below 70	Below 70	Below 70	Scale
	Calcium hardness	[mgCaCO <sub>3</sub> /l]		Below 150	Below 50	Below 50	Below 50	Below 50	Below 50	Below 50	Below 50	Below 50	Scale
	Silica ion	[mgSiO <sub>2</sub> /l]		Below 50	Below 30	Below 30	Below 30	Below 30	Below 30	Below 30	Below 30	Below 30	Scale
	Oxygen	(mg O <sub>2</sub> /l)		Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Corrosion
	Particulate size	(mm)		Below 0.5	Below 0.5	Below 0.5	Below 0.5	Below 0.6	Below 0.5	Below 0.6	Below 0.5	Below 0.6	Erosion
	Total dissolved solids	(mg / l)		Below 1000	Below 1000	Below 1000	Below 1000	Below 1001	Below 1000	Below 1001	Below 1000	Below 1001	Erosion
Items to be referred to	Ethylene, Propylene Glycol (weight conc.)	Below 60%		Below 60%	---	Below 60%	Below 60%	Below 60%	Below 60%	Below 60%	Below 60%	---	
	Nitrate ion	(mg NO <sub>3</sub> <sup>-</sup> /l)		Below 100	Below 100	Below 100	Below 100	Below 101	Below 100	Below 100	Below 100	Below 101	Corrosion
	TOC Total organic carbon	(mg /l)		Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Scale
	Iron	[mgFe/l]		Below 1.0	Below 0.3	Below 1.0	Below 1.0	Below 0.3	Below 1.0	Below 0.3	Below 1.0	Below 0.3	Corrosion + Scale
	Copper	[mgCu/l]		Below 0.3	Below 0.1	Below 1.0	Below 1.0	Below 1.0	Below 1.0	Below 0.1	Below 1.0	Below 0.1	Corrosion
	Sulfite ion	[mgS <sub>2</sub> <sup>-2</sup> /l]		Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Not detectable	Corrosion
	Ammonium ion	[mgNH <sub>4</sub> <sup>+</sup> /l]		Below 1.0	Below 0.1	Below 1.0	Below 1.0	Below 0.1	Below 0.3	Below 0.1	Below 0.1	Below 0.1	Corrosion
	Remaining chloride	[mgCl/l]		Below 0.3	Below 0.3	Below 0.3	Below 0.3	Below 0.3	Below 0.25	Below 0.3	Below 0.1	Below 0.3	Corrosion
	Free carbide	[mgCO <sub>2</sub> /l]		Below 4.0	Below 4.0	Below 4.0	Below 4.0	Below 4.0	Below 0.4	Below 4.0	Below 0.4	Below 4.0	Corrosion
	Stability index			6.0 ~ 7.0	---	---	---	---	---	---	---	---	Corrosion + Scale

### NOTES

- Names, definitions and units are according to JIS K 0101. Units and figures between brackets are old units published as reference only.
- In case of using heated water (more than 40°C), corrosion is generally noticeable. Especially when the iron materials is in direct contact with water without any protection shields, it is desirable to give the valid measure for corrosion. E.g. chemical measure.
- In the cooling water using hermetic cooling tower, close circuit water is according to heated water standard, and scattered water is according to cooling water standard.
- Supply water is considered drink water, industrial water and ground water except for genuine water, neutral water and soft water.
- The above mentioned items are representable items in corrosion and scale cases.
- The limits above have to be considered as a general prescription and can not totally assure the absence of corrosion and erosion. Some particular combinations of elements or the presence of components not listed in the table or factors not considered may trigger corrosion phenomena.

OPL\_1-2a-3a\_Rev.01\_2a

# 11 Operation range

## 11 - 1 Operation Range

### Water content in cooling circuits

The cooled water distribution circuits should have minimum water content to avoid excessive compressors start and stop. In fact, each time the compressor starts up, an excessive quantity of oil goes from the compressor sump and simultaneously there is a rise in the temperature of the compressor motor's stator due to the inrush current during the start-up. To prevent damage to the compressors, it has been envisaged the application of a device to limit frequent stops and restarts.

During the span of one hour there will be no more than 6 starts of the compressor. The plant side should therefore ensure that the overall water content allows a more constant functioning of the unit and consequently greater environmental comfort. The minimum water content per unit should be calculated using this simplified formula:

For 2 compressors unit

$$M \text{ (liters)} = (0.1595 \times \Delta T(^{\circ}\text{C}) + 3.0825) \times P(\text{kW})$$

For 3 compressors unit

$$M \text{ (liters)} = (0.0443 \times \Delta T(^{\circ}\text{C}) + 1.6202) \times P(\text{kW})$$

where:

- M minimum water content per unit expressed in litres
- P Cooling Capacity of the unit expressed in kW
- $\Delta T$  evaporator entering / leaving water temperature difference expressed in  $^{\circ}\text{C}$

This formula is valid for:

- standard microprocessor parameters

For more accurate determination of quantity of water, it is advisable to contact the designer of the plant.

# 12 Hydraulic performance

## 12 - 1 Water Pressure Drop Curve Evaporator

12

### Evaporating Pressure Drops

EWAD~C-SS EWAD~C-SL	650	740	830	910	970	C11	C12	C14	C15	C16	C17
Cooling Capacity (kW)	647	744	832	912	967	1064	1152	1419	1538	1622	1714
Water Flow (l/s)	30.90	35.56	39.74	43.60	46.21	50.85	55.04	67.78	73.5	77.51	81.89
Pressure Drops (kPa)	73	59	52	61	68	63	72	47	59	65	73

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

EWAD~C-SR	650	740	830	910	970	C11	C12	C14	C15	C16	C17
Cooling Capacity (kW)	619	715	789	876	922	1020	1112	1367	1471	1556	1623
Water Flow (l/s)	29.57	34.15	37.71	41.83	44.05	48.75	53.11	65.32	70.28	74.32	77.57
Pressure Drops (kPa)	67	55	47	57	62	58	68	44	54	60	66

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

EWAD~C-XS EWAD~C-XL	760	830	890	990	C10	C11	C12	C13	C14	C15	C16	C17	C18	C19
Cooling Capacity (kW)	756	830	889	1001	1074	1196	1280	1349	1409	1526	1596	1685	1768	1858
Water Flow (l/s)	36.10	39.67	42.49	47.82	51.32	57.13	61.18	64.45	67.34	72.90	76.24	80.48	84.47	88.79
Pressure Drops (kPa)	80	56	64	61	69	45	51	71	77	57	62	68	64	37

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

EWAD~C-XR	760	830	890	990	C10	C11	C12	C13	C14	C15	C16	C17	C18	C19
Cooling Capacity (kW)	736	811	866	974	1041	1168	1247	1302	1378	1486	1550	1639	1722	1813
Water Flow (l/s)	35.17	38.74	41.36	46.54	49.76	55.78	59.56	62.21	65.85	70.98	74.07	78.32	82.3	86.61
Pressure Drops (kPa)	76	54	61	58	65	43	49	67	74	54	59	65	61	35

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

EWAD~C-PS EWAD~C-PL	820	890	980	C11	C12	C13	C14
Cooling Capacity (kW)	821	890	975	1074	1158	1279	1390
Water Flow (l/s)	39.22	42.53	46.6	51.30	55.31	61.12	66.41
Pressure Drops (kPa)	57	65	30	61	69	60	73

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

EWAD~C-PR	820	890	980	C11	C12	C13	C14
Cooling Capacity (kW)	809	875	956	1053	1132	1251	1359
Water Flow (l/s)	38.65	41.81	45.69	50.30	54.11	59.76	64.95
Pressure Drops (kPa)	56	63	29	59	66	58	70

Water flow and pressure drop referred to nominal condition: evaporator water in/out: 12/7°C – condenser air inlet: 35°C

### Evaporating Pressure Drops

To determine the pressure drop for different versions or at different working conditions, please refer to the following formula:

$$PD_2 \text{ (kPa)} = PD_1 \text{ (kPa)} \times \left( \frac{Q_2 \text{ (l/s)}}{Q_1 \text{ (l/s)}} \right)^{1.8}$$

where:

- PD<sub>2</sub> Pressure drop to be determinate (kPa)
- PD<sub>1</sub> Pressure drop at nominal condition (kPa)
- Q<sub>2</sub> water flow at new working condition (l/s)
- Q<sub>1</sub> water flow at nominal condition (l/s)

### How to use the formula: Example

The unit EWAD650C-SS has been selected for working at the following conditions:

- evaporator water in/out : 11/6°C

- condenser air inlet: 46°C

The cooling capacity at these working conditions is: 536 kW

The water flow at these working conditions is: 25.61 l/s

The unit EWAD650C-SS at nominal working conditions has the following data:

- evaporator water in/out : 12/7°C

- condenser air inlet: 35°C

The cooling capacity at these working conditions is: 647 kW

The water flow at these working conditions is: 30.90 l/s

The pressure drop at these working conditions is: 73 kPa

The pressure drop at the selected working condition will be:

$$PD_2 \text{ (kPa)} = 73 \text{ (kPa)} \times \left( \frac{25.61 \text{ (l/s)}}{30.90 \text{ (l/s)}} \right)^{1.8}$$

$$PD_2 \text{ (kPa)} = 52 \text{ (kPa)}$$

### NOTES

If the calculated evaporator water pressure drop is below 10 kPa or above 100 kPa please contact the factory for dedicated evaporator.

## 13 Specification text

### 13 - 1 Specification Text

**General** The chiller will be designed and manufactured in accordance with the following European directives:

- Construction of pressure vessel 97/23/EC (PED)
- Machinery Directive 2006/42/EC
- Low Voltage 2006/95/EC
- Electromagnetic Compatibility 2004/108/EC
- Electrical & Safety codes EN 60204-1 / EN 60335-2-40
- Manufacturing Quality Standards UNI – EN ISO 9001:2004

To avoid any losses, the unit will be tested at full load in the factory (at the nominal working conditions and water temperatures). The chiller will be delivered to the job site completely assembled and charged with refrigerant and oil. The installation of the chiller must comply with the manufacturer's instructions for rigging and handling equipment.

The unit will be able to start up and operate (as standard) at full load with:

- outside air temperature from ..... °C to ..... °C
- evaporator leaving fluid temperature between ..... °C and ..... °C

**Refrigerant** Only R-134a can be used.

**Performance** Chiller shall supply the following performances:

- Number of chiller(s) : ..... unit(s)
- Cooling capacity for single chiller : ..... kW
- Power input for single chiller in cooling mode : ..... kW
- Heat exchanger entering water temperature in cooling mode : ..... °C
- Heat exchanger leaving water temperature in cooling mode : ..... °C
- Heat exchanger water flow : ..... l/s
- Nominal outside working ambient temperature in cooling mode : ..... °C

Operating voltage range should be 400V ±10%, 3ph, 50Hz, voltage unbalance maximum 3%, without neutral conductor and shall only have one power connection point.

**Unit description** Chiller shall include as standard not less than: two or three independent refrigerant circuits (depending on the size), semi-hermetic asymmetric type rotary single screw compressors, electronic expansion device (EEXV), refrigerant direct expansion 'shell&tube' heat exchanger, air-cooled condenser section, R-134a refrigerant, lubrication system, motor starting components, discharge line shut-off valve, control system and all components necessary for a safe and stable unit operation. The chiller will be factory assembled on a robust base frame made of galvanized steel, protected by an epoxy paint.

**Sound level and vibrations** Sound pressure level at 1 meter distance in free field, semispheric conditions, shall not exceed .....dB(A). The sound pressure levels must be rated in accordance to ISO 3744 (other types of rating can not be used). Vibration on the base frame should not exceed 2 mm/s.

**Dimensions** Unit dimensions shall not exceed following indications:

- Unit length ..... mm
- Unit width ..... mm
- Unit height ..... mm

**Compressors (Asymmetric)** The unit shall be equipped with:

- Semi-hermetic, single-screw asymmetric type with one main helical rotor meshing with two diametrical opposed gaterotors. The gaterotors' contact elements shall be constructed of composite material designed for extended life. Electrical motor shall be 2-pole, semi-hermetic, squirrel-cage induction type and cooled by suction gas.
- The oil injection shall be used in order to get high EER (Energy Efficiency Ratio) also at high condensing pressure and low sound pressure levels in each load condition.
- The compressor shall be provided with a built in, high efficiency, mesh type oil separator and oil filter.
- Refrigerant system differential pressure shall provide oil injection on all moving compressor parts to correctly lubricate them. Electrical oil pump lubricating system is not allowed.
- Compressor cooling must be done by refrigerant liquid injection. An external dedicated heat exchanger and additional piping to carry the oil from compressor to heat exchanger and viceversa is not allowed.
- The compressor shall be direct electrical driven, without gear transmission between the screw and the electrical motor.
- The compressor casing shall be provided with ports to realize economized refrigerant cycles.
- The compressor must be protected by a temperature sensor for high discharge temperature and an electrical motor thermistor for high winding temperature.
- The compressor shall be equipped with an electric oil heater.
- The compressor shall be fully field serviceable. Compressor that must be removed and returned to the factory for service shall be unacceptable.

SPC\_1b-2a-3\_Rev.02\_1b

## 13 Specification text

### 13 - 1 Specification Text

13

**Evaporator** The units shall be equipped with a direct expansion shell&tube evaporator with copper tubes rolled into steel tubesheets. The evaporator shall be single-pass on both the refrigerant and water sides for pure counter-flow heat exchange and low refrigerant pressure drops.

- The external shell shall be linked with an electrical heater to prevent freezing down to -28°C ambient temperature, controlled by a thermostat and shall be insulated with flexible, closed cell polyurethane insulation material (20-mm thick).
- The evaporator will have 2 or 3 circuits, one for each compressor and shall be single refrigerant pass.
- The water connections shall be VICTAULIC type connections as standard to ensure quick mechanical disconnection between the unit and the hydronic network.
- The evaporator will be manufactured in accordance to PED approval.

**Condenser coil** The unit shall be equipped with condenser coils constructed with internally finned seamless copper tubes and arranged in a staggered row pattern and mechanically expanded into lanced and rippled aluminium fins with full fin collars for higher efficiencies. The space between the fins is given by a collar that will increase the surface area in connection with the tubes, protecting them from ambient corrosion.

- The condenser coils will have an integral subcooler circuit that provides sufficient subcooling to effectively eliminate the possibility of liquid flashing and increase the unit's efficiency with 5% to 7% without increasing in energy consumption.
- The condenser coils shall be leak-tested and submitted to a pressure test with dry air.

**Condenser fans** The condenser fans used in conjunction with the condenser coils, shall be propeller type with glass reinforced resin blades for higher efficiencies and lower sound. Each fan shall be protected by a fan guard.

- The air discharge shall be vertical and each fan must be coupled to the electrical motor, supplied as standard to IP54 and capable to work to ambient temperatures of - 20°C to + 65°C.
- The condenser fans shall have as a standard a thermally protection by internal thermal motor protection and protected by circuit breaker installed inside the electrical panel as a standard.

**Refrigerant circuit** The unit shall have two or three refrigerant circuits (depending on the size).

- The circuit shall include as standard: electronic expansion device piloted by unit's microprocessor control, compressor discharge shut-off valve, liquid line shut-off valve, sight glass with moisture indicator, replaceable filter drier, charging valves, high pressure switch, high and low pressure transducers, oil pressure transducer and insulated suction line.

**Low sound unit configurations (on request)** The unit compressor shall be connected with unit's metal base frame by rubber antivibration supports to prevent the transmission of vibrations to all metal unit structure, in order to control the unit sound.

- The chiller shall be provided with an acoustical compressor enclosure. This enclosure shall be realized with a light, corrosion resisting aluminium structure and metal panels. The compressor sound-proof enclosure shall be internally fitted with flexible, multi-layer, high density materials.

**Hydronic kit options (on request)** The hydronic module shall be integrated in the chiller chassis without increasing its dimensions and includes the following elements: centrifugal pump with motor protected by a circuit breaker installed in control panel, water filling system with pressure gauge, safety valve, drain valve.

- The hydronic module shall be assembled and wired to the control panel.
- The water piping shall be protected against corrosion and freezing and insulated to prevent condensation.
- A choice of two pump types shall be available:
  - in-line single pump
  - in-line twin pumps.

## 13 Specification text

### 13 - 1 Specification Text

**Electrical control panel** Power and control shall be located in the main panel that will be manufactured to ensure protection against all weather conditions.

- The electrical panel shall be IP54 and (when opening the doors) internally protected with plexiglas panel against possible accidental contact with electrical components (IP20).
- The main panel shall be fitted with a main switch interlocked door.
- The power section will include compressors and fans protection devices, compressors and fans starters and control circuit power supply.

**Controller** The controller will be installed as standard and it will be used to modify unit set-points and check control parameters.

- A built-in display will show chiller operating status plus temperatures and pressures of water, refrigerant and air, programmable values, set-points.
- A sophisticated software with predictive logic, will select the most energy efficient combination of compressors, EEXV and condenser fans to keep stable operating conditions to maximise chiller energy efficiency and reliability.
- The controller will be able to protect critical components based on external signs from its system (such as motor temperatures, refrigerant gas and oil pressures, correct phase sequence, pressure switches and evaporator). The input coming from the high pressure switch cuts all digital output from the controller in less than 50ms, this will be an additional security for the equipment.
- Fast program cycle (200ms) for a precise monitoring of the system.
- Floating point calculations supported for increased accuracy in P/T conversions.

#### Controller main features

- Management of the compressor stepless capacity and fans modulation.
- Chiller enabled to work in partial failure condition.
- Full routine operation at condition of:
  - high ambient temperature value
  - high thermal load
  - high evaporator entering water temperature (start-up)
- Display of evaporator entering/leaving water temperature.
- Display of Outdoor Ambient Temperature.
- Display of condensing-evaporating temperature and pressure, suction and discharge superheat for each circuit.
- Leaving water evaporator temperature regulation (temperature tolerance = 0,1°C).
- Compressor and evaporator pumps hours counter.
- Display of Status Safety Devices.
- Number of starts and compressor working hours.
- Optimized management of compressor load.
- Fan management according to condensing pressure.
- Re-start in case of power failure (automatic / manual).
- Soft Load (optimized management of the compressor load during the start-up).
- Start at high evaporator water temperature.
- Return Reset (Set Point Reset based on return water temperature).
- OAT (Outside Ambient temperature) Reset.
- Set point Reset (optional).
- Application and system upgrade with commercial SD cards.
- Ethernet port for remote or local servicing using standard web browsers.
- Two different sets of default parameters could be stored for easy restore.

**High Level Communications Interface (on request)** The chiller shall be able to communicate to BMS (Building Management System) based on the most common protocols as:

- ModbusRTU
- LonWorks, now also based on the international 8040 Standard Chiller Profile and LonMark Technology
- BacNet BTP certified over IP and MS/TP (class 4) (Native)
- Ethernet TCP/IP.

SPC\_1b-2a-3\_Rev.02\_3







Daikin's unique position as a manufacturer of air conditioning equipment, compressors and refrigerants has led to its close involvement in environmental issues. For several years Daikin has had the intention to become a leader in the provision of products that have limited impact on the environment. This challenge demands the eco design and development of a wide range of products and an energy management system, resulting in energy conservation and a reduction of waste.



Daikin Europe N.V. participates in the Eurovent Certification programme for Air conditioners (AC), Liquid Chilling Packages (LCP) and Fan coil units (FCU). Check on-going validity of certificate online: [www.eurovent-certification.com](http://www.eurovent-certification.com) or using: [www.certiflash.com](http://www.certiflash.com)

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by: