

Service Manual

Inverter Pair Wall Mounted Type G-Series



[Applied Models]

- Inverter Pair : Cooling Only
- Inverter Pair : Heat Pump

Inverter Pair Wall Mounted Type G-Series

●Cooling Only

Indoor Unit

FTXS20G2V1B
FTXS25G2V1B
FTXS35G2V1B
FTXS42G2V1B
FTXS50G2V1B

Outdoor Unit

RKS20G2V1B	RKS20G2V1B9
RKS25G2V1B	RKS25G2V1B9
RKS35G2V1B	RKS35G2V1B9
RKS42G2V1B	
RKS50G2V1B	

●Heat Pump

Indoor Unit

FTXS20G2V1B	ATXS20G2V1B
FTXS25G2V1B	ATXS25G2V1B
FTXS35G2V1B	ATXS35G2V1B
FTXS42G2V1B	ATXS42G2V1B
FTXS50G2V1B	ATXS50G2V1B

Outdoor Unit

RXS20G2V1B	RXS20G2V1B9	ARXS20G2V1B	ARXS20G3V1B
RXS25G2V1B	RXS25G2V1B9	ARXS25G2V1B	ARXS25G3V1B
RXS35G2V1B	RXS35G2V1B9	ARXS35G2V1B	ARXS35G3V1B
RXS42G2V1B		ARXS42G2V1B	ARXS42G3V1B
RXS50G2V1B		ARXS50G2V1B	ARXS50G3V1B

ARXS20G4V1B
ARXS25G4V1B
ARXS35G4V1B



The removal procedure for each model is separately bound. Refer to page 167 for the booklet number of applicable model.

1. Introduction	V
1.1 Safety Cautions	v
1.2 Used Icons	ix
Part 1 List of Functions	1
1. Functions.....	2
1.1 Cooling Only.....	2
1.2 Heat Pump	3
Part 2 Specifications	6
1. Specifications	7
1.1 Cooling Only.....	7
1.2 Heat Pump	10
Part 3 Printed Circuit Board Connector Wiring Diagram	21
1. Indoor Unit.....	22
2. Outdoor Unit.....	24
2.1 RK(X)S20-35G2V1B, ARXS20-35G2V1B.....	24
2.2 RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B	26
2.3 RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B.....	28
2.4 RK(X)S50G2V1B, ARXS50G2V1B	29
2.5 ARXS50G3V1B	30
Part 4 Function and Control.....	32
1. Main Functions.....	33
1.1 Temperature Control	33
1.2 Frequency Principle.....	33
1.3 Airflow Direction Control.....	35
1.4 Fan Speed Control for Indoor Unit	36
1.5 Program Dry Operation	37
1.6 Automatic Operation.....	38
1.7 Thermostat Control.....	39
1.8 NIGHT SET Mode	40
1.9 ECONO Operation	41
1.10 2-Area INTELLIGENT EYE Operation	42
1.11 INTELLIGENT EYE Operation	44
1.12 Inverter POWERFUL Operation	45
1.13 Clock Setting	46
1.14 WEEKLY TIMER Operation	47
1.15 Other Functions.....	55
2. Function of Thermistor	56
3. Control Specification	57
3.1 Mode Hierarchy	57
3.2 Frequency Control.....	58
3.3 Controls at Mode Changing / Start-up.....	60
3.4 Discharge Pipe Temperature Control.....	62
3.5 Input Current Control.....	63
3.6 Freeze-up Protection Control	65
3.7 Heating Peak-cut Control	65

3.8 Outdoor Fan Control.....	66
3.9 Liquid Compression Protection Function.....	66
3.10 Defrost Control	67
3.11 Electronic Expansion Valve Control	68
3.12 Malfunctions	71

Part 5 Remote Controller 72

1. FTXS20/25/35/42/50G2V1B	73
2. ATXS20/25/35/42/50G2V1B	75

Part 6 Service Diagnosis..... 77





1. Troubleshooting with LED	79
1.1 Indoor Unit.....	79
1.2 Outdoor Unit.....	79
2. Problem Symptoms and Measures	80
3. Service Check Function	81
3.1 ARC452 Series.....	81
3.2 ARC433 Series.....	84
4. Troubleshooting	87
4.1 Error Codes and Description	87
4.2 Indoor Unit PCB Abnormality	88
4.3 Freeze-up Protection Control or Heating Peak-cut Control	89
4.4 Fan Motor (DC Motor) or Related Abnormality.....	90
4.5 Thermistor or Related Abnormality (Indoor Unit).....	92
4.6 Refrigerant Shortage	93
4.7 Low-voltage Detection or Over-voltage Detection	96
4.8 Signal Transmission Error (between Indoor Unit and Outdoor Unit)	98
4.9 Signal Transmission Error on Outdoor Unit PCB (RK(X)S50G2V1B, ARXS50G2V1B Only)	100
4.10 Unspecified Voltage (between Indoor Unit and Outdoor Unit)	101
4.11 Outdoor Unit PCB Abnormality.....	102
4.12 OL Activation (Compressor Overload)	105
4.13 Compressor Lock	107
4.14 DC Fan Lock	108
4.15 Input Overcurrent Detection	109
4.16 Four Way Valve Abnormality	110
4.17 Discharge Pipe Temperature Control.....	112
4.18 High Pressure Control in Cooling	113
4.19 Compressor System Sensor Abnormality	114
4.20 Position Sensor Abnormality	116
4.21 DC Voltage / Current Sensor Abnormality (20/25/35/42 Class Only) ...	119
4.22 CT or Related Abnormality (RK(X)S50G2V1B, ARXS50G2V1B Only)	120
4.23 Thermistor or Related Abnormality (Outdoor Unit).....	122
4.24 Electrical Box Temperature Rise	124
4.25 Radiation Fin Temperature Rise	126
4.26 Output Overcurrent Detection	128
5. Check	130
5.1 Thermistor Resistance Check	130
5.2 Fan Motor Connector Output Check	131

5.3	Power Supply Waveforms Check.....	131
5.4	Electronic Expansion Valve Check.....	132
5.5	Four Way Valve Performance Check.....	133
5.6	Inverter Units Refrigerant System Check.....	133
5.7	Inverter Analyzer Check.....	134
5.8	Rotation Pulse Check on the Outdoor Unit PCB.....	136
5.9	Installation Condition Check.....	137
5.10	Discharge Pressure Check.....	137
5.11	Outdoor Fan System Check.....	138
5.12	Main Circuit Short Check.....	138
5.13	Capacitor Voltage Check.....	140
5.14	Power Module Check.....	141
Part 7 Trial Operation and Field Settings.....		144
1.	Pump Down Operation.....	145
2.	Forced Cooling Operation.....	146
3.	Trial Operation.....	148
4.	Field Settings.....	150
4.1	Model Type Setting.....	150
4.2	When 2 Units are Installed in 1 Room.....	150
4.3	Standby Electricity Saving.....	151
4.4	Facility Setting Jumper and Switch (cooling at low outdoor temperature).....	152
4.5	Jumper and Switch Settings.....	154
5.	Silicon Grease on Power Transistor / Diode Bridge.....	155
Part 8 Appendix.....		156
1.	Piping Diagrams.....	157
1.1	Indoor Unit.....	157
1.2	Outdoor Unit.....	158
2.	Wiring Diagrams.....	163
2.1	Indoor Unit.....	163
2.2	Outdoor Unit.....	163
3.	Removal Procedure (Booklet No.).....	167








1. Introduction




1.1 Safety Cautions









Cautions and Warnings

- Be sure to read the following safety cautions before conducting repair work.
- The caution items are classified into “ **Warning**” and “ **Caution**”. The “ **Warning**” items are especially important since they can lead to death or serious injury if they are not followed closely. The “ **Caution**” items can also lead to serious accidents under some conditions if they are not followed. Therefore, be sure to observe all the safety caution items described below.
- About the pictograms
 - △ This symbol indicates the item for which caution must be exercised.
The pictogram shows the item to which attention must be paid.
 - This symbol indicates the prohibited action.
The prohibited item or action is shown in the illustration or near the symbol.
 - This symbol indicates the action that must be taken, or the instruction.
The instruction is shown in the illustration or near the symbol.
- After the repair work is complete, be sure to conduct a test operation to ensure that the equipment operates normally, and explain the cautions for operating the product to the customer.












1.1.1 Cautions Regarding Safety of Workers






 Warning	
Be sure to disconnect the power cable plug from the plug socket before disassembling the equipment for repair. Working on the equipment that is connected to the power supply may cause an electrical shock. If it is necessary to supply power to the equipment to conduct the repair or inspecting the circuits, do not touch any electrically charged sections of the equipment.	
If the refrigerant gas is discharged during the repair work, do not touch the discharged refrigerant gas. The refrigerant gas may cause frostbite.	
When disconnecting the suction or discharge pipe of the compressor at the welded section, evacuate the refrigerant gas completely at a well-ventilated place first. If there is gas remaining inside the compressor, the refrigerant gas or refrigerating machine oil discharges when the pipe is disconnected, and it may cause injury.	
If the refrigerant gas leaks during the repair work, ventilate the area. The refrigerant gas may generate toxic gases when it contacts flames.	
The step-up capacitor supplies high-voltage electricity to the electrical components of the outdoor unit. Be sure to discharge the capacitor completely before conducting repair work. A charged capacitor may cause an electrical shock.	
Do not start or stop the air conditioner operation by plugging or unplugging the power cable plug. Plugging or unplugging the power cable plug to operate the equipment may cause an electrical shock or fire.	







 Warning	
Be sure to wear a safety helmet, gloves, and a safety belt when working at a high place (more than 2 m). Insufficient safety measures may cause a fall accident.	
In case of R-410A refrigerant models, be sure to use pipes, flare nuts and tools for the exclusive use of the R-410A refrigerant. The use of materials for R-22 refrigerant models may cause a serious accident such as a damage of refrigerant cycle as well as an equipment failure.	






 Caution	
Do not repair the electrical components with wet hands. Working on the equipment with wet hands may cause an electrical shock.	
Do not clean the air conditioner by splashing water. Washing the unit with water may cause an electrical shock.	
Be sure to provide the grounding when repairing the equipment in a humid or wet place, to avoid electrical shocks.	
Be sure to turn off the power switch and unplug the power cable when cleaning the equipment. The internal fan rotates at a high speed, and may cause injury.	
Be sure to conduct repair work with appropriate tools. The use of inappropriate tools may cause injury.	
Be sure to check that the refrigerating cycle section has cooled down enough before conducting repair work. Working on the unit when the refrigerating cycle section is hot may cause burns.	
Use the welder in a well-ventilated place. Using the welder in an enclosed room may cause oxygen deficiency.	

1.1.2 Cautions Regarding Safety of Users

 Warning	
<p>Be sure to use parts listed in the service parts list of the applicable model and appropriate tools to conduct repair work. Never attempt to modify the equipment. The use of inappropriate parts or tools may cause an electrical shock, excessive heat generation or fire.</p>	
<p>If the power cable and lead wires have scratches or deteriorated, be sure to replace them. Damaged cable and wires may cause an electrical shock, excessive heat generation or fire.</p>	
<p>Do not use a joined power cable or extension cable, or share the same power outlet with other electrical appliances, since it may cause an electrical shock, excessive heat generation or fire.</p>	
<p>Be sure to use an exclusive power circuit for the equipment, and follow the local technical standards related to the electrical equipment, the internal wiring regulations, and the instruction manual for installation when conducting electrical work. Insufficient power circuit capacity and improper electrical work may cause an electrical shock or fire.</p>	
<p>Be sure to use the specified cable for wiring between the indoor and outdoor units. Make the connections securely and route the cable properly so that there is no force pulling the cable at the connection terminals. Improper connections may cause excessive heat generation or fire.</p>	
<p>When wiring between the indoor and outdoor units, make sure that the terminal cover does not lift off or dismount because of the cable. If the cover is not mounted properly, the terminal connection section may cause an electrical shock, excessive heat generation or fire.</p>	
<p>Do not damage or modify the power cable. Damaged or modified power cable may cause an electrical shock or fire. Placing heavy items on the power cable, and heating or pulling the power cable may damage the cable.</p>	
<p>Do not mix air or gas other than the specified refrigerant (R-410A / R-22) in the refrigerant system. If air enters the refrigerating system, an excessively high pressure results, causing equipment damage and injury.</p>	
<p>If the refrigerant gas leaks, be sure to locate the leaking point and repair it before charging the refrigerant. After charging refrigerant, make sure that there is no refrigerant leak. If the leaking point cannot be located and the repair work must be stopped, be sure to perform pump-down and close the service valve, to prevent the refrigerant gas from leaking into the room. The refrigerant gas itself is harmless, but it may generate toxic gases when it contacts flames, such as fan and other heaters, stoves and ranges.</p>	
<p>When relocating the equipment, make sure that the new installation site has sufficient strength to withstand the weight of the equipment. If the installation site does not have sufficient strength and if the installation work is not conducted securely, the equipment may fall and cause injury.</p>	





 Warning	
Check to make sure that the power cable plug is not dirty or loose, then insert the plug into a power outlet securely. If the plug has dust or loose connection, it may cause an electrical shock or fire.	
Be sure to install the product correctly by using the provided standard installation frame. Incorrect use of the installation frame and improper installation may cause the equipment to fall, resulting in injury.	For unitary type only 
Be sure to install the product securely in the installation frame mounted on the window frame. If the unit is not securely mounted, it may fall and cause injury.	For unitary type only 
When replacing the coin battery in the remote controller, be sure to dispose of the old battery to prevent children from swallowing it. If a child swallows the coin battery, see a doctor immediately.	

 Caution	
Installation of a leakage breaker is necessary in some cases depending on the conditions of the installation site, to prevent electrical shocks.	
Do not install the equipment in a place where there is a possibility of combustible gas leaks. If the combustible gas leaks and remains around the unit, it may cause a fire.	
Check to see if the parts and wires are mounted and connected properly, and if the connections at the soldered or crimped terminals are secure. Improper installation and connections may cause excessive heat generation, fire or an electrical shock.	
If the installation platform or frame has corroded, replace it. Corroded installation platform or frame may cause the unit to fall, resulting in injury.	
Check the grounding, and repair it if the equipment is not properly grounded. Improper grounding may cause an electrical shock.	

 Caution	
Be sure to measure the insulation resistance after the repair, and make sure that the resistance is 1 MΩ or higher. Faulty insulation may cause an electrical shock.	
Be sure to check the drainage of the indoor unit after the repair. Faulty drainage may cause the water to enter the room and wet the furniture and floor.	
Do not tilt the unit when removing it. The water inside the unit may spill and wet the furniture and floor.	
Be sure to install the packing and seal on the installation frame properly. If the packing and seal are not installed properly, water may enter the room and wet the furniture and floor.	For unitary type only 

1.2 Used Icons

Icons are used to attract the attention of the reader to specific information. The meaning of each icon is described in the table below:

Icon	Type of Information	Description
 Note:	Note	A “note” provides information that is not indispensable, but may nevertheless be valuable to the reader, such as tips and tricks.
 Caution	Caution	A “caution” is used when there is danger that the reader, through incorrect manipulation, may damage equipment, lose data, get an unexpected result or has to restart (part of) a procedure.
 Warning	Warning	A “warning” is used when there is danger of personal injury.
	Reference	A “reference” guides the reader to other places in this binder or in this manual, where he/she will find additional information on a specific topic.

Part 1

List of Functions

1. Functions.....	2
1.1 Cooling Only.....	2
1.2 Heat Pump	3

1. Functions

1.1 Cooling Only

Category	Functions	FTXS20/25/35/42G2V1B RKS20/25/35/42G2V1B RKS20/25/35G2V1B9	FTXS50G2V1B RKS50G2V1B	Category	Functions	FTXS20/25/35/42G2V1B RKS20/25/35/42G2V1B RKS20/25/35G2V1B9	FTXS50G2V1B RKS50G2V1B
Basic Function	Inverter (with inverter power control)	●	●	Health & Clean	Air-purifying filter	—	—
	Operation limit for cooling (°CDB)	-10 ~46★	-10 ~46★		Photocatalytic deodorizing filter	—	—
	Operation limit for heating (°CWB)	—	—		Air-purifying filter with photocatalytic deodorizing function	—	—
	PAM control	●	●		Titanium apatite photocatalytic air-purifying filter	●	●
	Standby electricity saving	●	—		Air filter (prefilter)	●	●
Compressor	Oval scroll compressor	—	—	Wipe-clean flat panel	●	●	
	Swing compressor	●	●	Washable grille	—	—	
	Rotary compressor	—	—	MOLD PROOF operation	—	—	
	Reluctance DC motor	●	●	Good-sleep cooling operation	—	—	
Comfortable Airflow	Power-airflow flap	—	—	Timer	WEEKLY TIMER operation	●	●
	Power-airflow dual flaps	●	●		24-hour ON/OFF TIMER	●	●
	Power-airflow diffuser	—	—		NIGHT SET mode	●	●
	Wide-angle louvers	●	●	Worry Free "Reliability & Durability"	Auto-restart (after power failure)	●	●
	Vertical auto-swing (up and down)	●	●		Self-diagnosis (digital, LED) display	●	●
	Horizontal auto-swing (right and left)	●	●		Wiring error check function	—	—
	3-D airflow	●	●		Anti-corrosion treatment of outdoor heat exchanger	●	●
COMFORT AIRFLOW operation	●	●	Flexibility	Multi-split / split type compatible indoor unit	●	●	
Comfort Control	Auto fan speed	●		●	H/P, C/O compatible indoor unit	●	●
	Indoor unit quiet operation	●		●	Flexible power supply correspondence	—	—
	NIGHT QUIET mode (automatic)	—		—	High ceiling application	—	—
	OUTDOOR UNIT QUIET operation (manual)	●		●	Chargeless	10 m	10 m
	2-area INTELLIGENT EYE operation	●		●	Either side drain (right or left)	●	●
	INTELLIGENT EYE operation	—		—	Power selection	—	—
	Quick warming function (preheating operation)	—		—	Remote Control	5-room centralized controller (option)	●
	Hot-start function	—	—	Remote control adaptor (normal open pulse contact) (option)		●	●
Automatic defrosting	—	—	Remote control adaptor (normal open contact) (option)	●		●	
Operation	Automatic operation	—	—	Remote Controller	DIII-NET compatible (adaptor) (option)	●	●
	Program dry operation	●	●		Wireless	●	●
	Fan only	●	●	Wired (option)	●	●	
Lifestyle Convenience	New POWERFUL operation (non-inverter)	—	—				
	Inverter POWERFUL operation	●	●				
	Priority-room setting	—	—				
	COOL / HEAT mode lock	—	—				
	HOME LEAVE operation	—	—				
	ECONO operation	●	●				
	Indoor unit [ON/OFF] button	●	●				
	Signal receiving sign	●	●				
Temperature display	—	—					

Note: ● : Holding Functions
— : No Functions

★ : Lower limit can be extended by cutting jumper or turning on the switch. (facility use only)
Refer to page 152 for detail.

1.2 Heat Pump

Category	Functions	FTXS20/25/35/42G2V1B RXS20/25/35/42G2V1B RXS20/25/35G2V1B9	FTXS50G2V1B RXS50G2V1B	Category	Functions	FTXS20/25/35/42G2V1B RXS20/25/35/42G2V1B RXS20/25/35G2V1B9	FTXS50G2V1B RXS50G2V1B
Basic Function	Inverter (with inverter power control)	●	●	Health & Clean	Air-purifying filter	—	—
	Operation limit for cooling (°CDB)	-10 ~46★	-10 ~46★		Photocatalytic deodorizing filter	—	—
	Operation limit for heating (°CWB)	-15 ~18	-15 ~18		Air-purifying filter with photocatalytic deodorizing function	—	—
	PAM control	●	●		Titanium apatite photocatalytic air-purifying filter	●	●
	Standby electricity saving	●	—		Air filter (prefilter)	●	●
Compressor	Oval scroll compressor	—	—	Wipe-clean flat panel	●	●	
	Swing compressor	●	●	Washable grille	—	—	
	Rotary compressor	—	—	MOLD PROOF operation	—	—	
	Reluctance DC motor	●	●	Good-sleep cooling operation	—	—	
Comfortable Airflow	Power-airflow flap	—	—	Timer	WEEKLY TIMER operation	●	●
	Power-airflow dual flaps	●	●		24-hour ON/OFF TIMER	●	●
	Power-airflow diffuser	—	—		NIGHT SET mode	●	●
	Wide-angle louvers	●	●	Worry Free "Reliability & Durability"	Auto-restart (after power failure)	●	●
	Vertical auto-swing (up and down)	●	●		Self-diagnosis (digital, LED) display	●	●
	Horizontal auto-swing (right and left)	●	●		Wiring error check function	—	—
	3-D airflow	●	●		Anti-corrosion treatment of outdoor heat exchanger	●	●
COMFORT AIRFLOW operation	●	●	Flexibility	Multi-split / split type compatible indoor unit	●	●	
Comfort Control	Auto fan speed	●		●	H/P, C/O compatible indoor unit	●	●
	Indoor unit quiet operation	●		●	Flexible power supply correspondence	—	—
	NIGHT QUIET mode (automatic)	—		—	High ceiling application	—	—
	OUTDOOR UNIT QUIET operation (manual)	●		●	Chargeless	10 m	10 m
	2-area INTELLIGENT EYE operation	●		●	Either side drain (right or left)	●	●
	INTELLIGENT EYE operation	—		—	Power selection	—	—
	Quick warming function (preheating operation)	●		●	Remote Control	5-room centralized controller (option)	●
	Hot-start function	●	●	Remote control adaptor (normal open pulse contact) (option)		●	●
Automatic defrosting	●	●	Remote control adaptor (normal open contact) (option)	●		●	
Operation	Automatic operation	●	●	DIII-NET compatible (adaptor) (option)	●	●	
	Program dry operation	●	●	Remote Controller	Wireless	●	●
	Fan only	●	●		Wired (option)	●	●
Lifestyle Convenience	New POWERFUL operation (non-inverter)	—	—				
	Inverter POWERFUL operation	●	●				
	Priority-room setting	—	—				
	COOL / HEAT mode lock	—	—				
	HOME LEAVE operation	—	—				
	ECONO operation	●	●				
	Indoor unit [ON/OFF] button	●	●				
	Signal receiving sign	●	●				
Temperature display	—	—					

Note: ● : Holding Functions
— : No Functions

★ : Lower limit can be extended by cutting jumper or turning on the switch. (facility use only)
Refer to page 152 for detail.

Category	Functions	ATXS20/25/35/42G2V1B APXS20/25/35/42G2V1B APXS20/25/35/42G3V1B	ATXS50G2V1B APXS50G2V1B APXS50G3V1B	Category	Functions	ATXS20/25/35/42G2V1B APXS20/25/35/42G2V1B APXS20/25/35/42G3V1B	ATXS50G2V1B APXS50G2V1B APXS50G3V1B
Basic Function	Inverter (with inverter power control)	●	●	Health & Clean	Air-purifying filter	—	—
	Operation limit for cooling (°CDB)	-10 ~46★	-10 ~46★		Photocatalytic deodorizing filter	—	—
	Operation limit for heating (°CWB)	-15 ~18	-15 ~18		Air-purifying filter with photocatalytic deodorizing function	—	—
	PAM control	●	●		Titanium apatite photocatalytic air-purifying filter	●	●
	Standby electricity saving	●	—		Air filter (prefilter)	●	●
Compressor	Oval scroll compressor	—	—	Wipe-clean flat panel	●	●	
	Swing compressor	●	●	Washable grille	—	—	
	Rotary compressor	—	—	MOLD PROOF operation	—	—	
	Reluctance DC motor	●	●	Good-sleep cooling operation	—	—	
Comfortable Airflow	Power-airflow flap	—	—	Timer	WEEKLY TIMER operation	—	—
	Power-airflow dual flaps	●	●		24-hour ON/OFF TIMER	●	●
	Power-airflow diffuser	—	—		NIGHT SET mode	●	●
	Wide-angle louvers	●	●	Worry Free "Reliability & Durability"	Auto-restart (after power failure)	●	●
	Vertical auto-swing (up and down)	●	●		Self-diagnosis (digital, LED) display	●	●
	Horizontal auto-swing (right and left)	●	●		Wiring error check function	—	—
	3-D airflow	●	●		Anti-corrosion treatment of outdoor heat exchanger	●	●
COMFORT AIRFLOW operation	●	●	Flexibility	Multi-split / split type compatible indoor unit	●	●	
Comfort Control	Auto fan speed	●		●	H/P, C/O compatible indoor unit	—	—
	Indoor unit quiet operation	●		●	Flexible power supply correspondence	—	—
	NIGHT QUIET mode (automatic)	—		—	High ceiling application	—	—
	OUTDOOR UNIT QUIET operation (manual)	●		●	Chargeless	10 m	10 m
	2-area INTELLIGENT EYE operation	—		—	Either side drain (right or left)	●	●
	INTELLIGENT EYE operation	●		●	Power selection	—	—
	Quick warming function (preheating operation)	●		●	Remote Control	5-room centralized controller (option)	●
	Hot-start function	●	●	Remote control adaptor (normal open pulse contact) (option)		●	●
Automatic defrosting	●	●	Remote control adaptor (normal open contact) (option)	●		●	
Operation	Automatic operation	●	●	Remote Controller	DIII-NET compatible (adaptor) (option)	●	●
	Program dry operation	●	●		Wireless	●	●
	Fan only	●	●		Wired (option)	●	●
Lifestyle Convenience	New POWERFUL operation (non-inverter)	—	—	Remote Controller			
	Inverter POWERFUL operation	●	●				
	Priority-room setting	—	—				
	COOL / HEAT mode lock	—	—				
	HOME LEAVE operation	—	—				
	ECONO operation	●	●				
	Indoor unit [ON/OFF] button	●	●				
	Signal receiving sign	●	●				
Temperature display	—	—					

Note: ● : Holding Functions
— : No Functions

★ : Lower limit can be extended by cutting jumper or turning on the switch. (facility use only)
Refer to page 152 for detail.

Category	Functions	ATXS20/25/35G2V1B ARXS20/25/35G4V1B	Category	Functions	ATXS20/25/35G2V1B ARXS20/25/35G4V1B
Basic Function	Inverter (with inverter power control)	●	Health & Clean	Air-purifying filter	—
	Operation limit for cooling (°CDB)	-10 ~46★		Photocatalytic deodorizing filter	—
	Operation limit for heating (°CWB)	-15 ~18		Air-purifying filter with photocatalytic deodorizing function	—
	PAM control	●		Titanium apatite photocatalytic air-purifying filter	●
	Standby electricity saving	●		Air filter (prefilter)	●
Compressor	Oval scroll compressor	—	Timer	Wipe-clean flat panel	●
	Swing compressor	●		Washable grille	—
	Rotary compressor	—		MOLD PROOF operation	—
	Reluctance DC motor	●		Good-sleep cooling operation	—
Comfortable Airflow	Power-airflow flap	—	WEEKLY TIMER operation	WEEKLY TIMER operation	—
	Power-airflow dual flaps	●		24-hour ON/OFF TIMER	●
	Power-airflow diffuser	—		NIGHT SET mode	●
	Wide-angle louvers	●	Worry Free “Reliability & Durability”	Auto-restart (after power failure)	●
	Vertical auto-swing (up and down)	●		Self-diagnosis (digital, LED) display	●
	Horizontal auto-swing (right and left)	●		Wiring error check function	—
	3-D airflow	●		Anti-corrosion treatment of outdoor heat exchanger	●
COMFORT AIRFLOW operation	●	Flexibility	Multi-split / split type compatible indoor unit	●	
Comfort Control	Auto fan speed		●	H/P, C/O compatible indoor unit	—
	Indoor unit quiet operation		●	Flexible power supply correspondence	—
	NIGHT QUIET mode (automatic)		—	High ceiling application	—
	OUTDOOR UNIT QUIET operation (manual)		●	Chargeless	10 m
	2-area INTELLIGENT EYE operation		—	Either side drain (right or left)	●
	INTELLIGENT EYE operation		●	Power selection	—
	Quick warming function (preheating operation)		●	Remote Control	5-room centralized controller (option)
	Hot-start function	●	Remote control adaptor (normal open pulse contact) (option)		●
Automatic defrosting	●	Remote control adaptor (normal open contact) (option)	●		
Operation	Automatic operation	●	Remote Controller	DIII-NET compatible (adaptor) (option)	●
	Program dry operation	●		Wireless	●
	Fan only	●		Wired (option)	●
Lifestyle Convenience	New POWERFUL operation (non-inverter)	—			
	Inverter POWERFUL operation	●			
	Priority-room setting	—			
	COOL / HEAT mode lock	—			
	HOME LEAVE operation	—			
	ECONO operation	●			
	Indoor unit [ON/OFF] button	●			
	Signal receiving sign	●			
Temperature display	—				

Note: ● : Holding Functions
— : No Functions

★ : Lower limit can be extended by cutting jumper.
(facility use only)
Refer to page 152 for detail.

Part 2

Specifications

1. Specifications	7
1.1 Cooling Only	7
1.2 Heat Pump	10

1. Specifications

1.1 Cooling Only

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS20G2V1B		FTXS25G2V1B		FTXS35G2V1B		
	Outdoor Unit		RKS20G2V1B		RKS25G2V1B		RKS35G2V1B		
Capacity Rated (Min. ~ Max.)			kW	2.0 (1.3 ~ 2.8)		2.5 (1.3 ~ 3.2)		3.5 (1.4 ~ 4.0)	
			Btu/h	6,800 (4,400 ~ 9,600)		8,500 (4,400 ~ 10,900)		11,900 (4,800 ~ 13,600)	
			kcal/h	1,720 (1,120 ~ 2,410)		2,150 (1,120 ~ 2,750)		3,010 (1,200 ~ 3,440)	
Moisture Removal			L/h	0.9		1.2		1.9	
Running Current (Rated)			A	2.8 - 2.7 - 2.5		3.2 - 3.0 - 2.9		4.4 - 4.2 - 4.0	
Power Consumption Rated (Min. ~ Max.)			W	470 (320 ~ 910)		550 (320 ~ 810)		870 (350 ~ 1,190)	
Power Factor			%	76.3 - 75.7 - 78.3		78.1 - 79.7 - 79.0		89.9 - 90.1 - 90.6	
COP (Rated)			W/W	4.26 (4.06 ~ 3.08)		4.55 (4.06 ~ 3.95)		4.02 (4.00 ~ 3.36)	
Piping Connections	Liquid	mm	φ 6.4		φ 6.4		φ 6.4		
	Gas	mm	φ 9.5		φ 9.5		φ 9.5		
	Drain	mm	φ 18.0		φ 18.0		φ 18.0		
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes		Both Liquid and Gas Pipes		
Max. Interunit Piping Length			m	20		20		20	
Max. Interunit Height Difference			m	15		15		15	
Chargeless			m	10		10		10	
Amount of Additional Charge of Refrigerant			g/m	20		20		20	
Indoor Unit			FTXS20G2V1B		FTXS25G2V1B		FTXS35G2V1B		
Front Panel Color			White		White		White		
Airflow Rate	H	m ³ /min (cfm)	9.4 (332)		9.1 (321)		10.4 (367)		
	M		7.4 (262)		7.1 (252)		7.7 (270)		
	L		5.5 (193)		5.2 (182)		4.8 (170)		
	SL		4.0 (141)		3.7 (130)		3.5 (125)		
Fan	Type		Cross Flow Fan		Cross Flow Fan		Cross Flow Fan		
	Motor Output		W		23		23		
	Speed		Steps		5 Steps, Quiet, Auto		5 Steps, Quiet, Auto		
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward		
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof		
Running Current (Rated)			A	0.09 - 0.08 - 0.08		0.09 - 0.08 - 0.08		0.12 - 0.12 - 0.11	
Power Consumption (Rated)			W	18 - 18 - 18		18 - 18 - 18		26 - 26 - 26	
Power Factor			%	90.9 - 97.8 - 93.8		90.9 - 97.8 - 93.8		98.5 - 94.2 - 98.5	
Temperature Control			Microcomputer Control		Microcomputer Control		Microcomputer Control		
Dimensions (H x W x D)			mm	295 x 800 x 215		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)			mm	274 x 870 x 366		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)			kg	9		9		10	
Gross Weight (Gross Mass)			kg	13		13		13	
Sound Pressure Level	H / M / L / SL		dB(A)	38 / 32 / 25 / 22		38 / 32 / 25 / 22		42 / 34 / 26 / 23	
Sound Power Level			dB	54		54		58	
Outdoor Unit			RKS20G2V1B		RKS25G2V1B		RKS35G2V1B		
Casing Color			Ivory White		Ivory White		Ivory White		
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type		
	Model		1YC23AFXD		1YC23AFXD		1YC23AFXD		
	Motor Output		W		600		600		
Refrigerant Oil	Type		FVC50K		FVC50K		FVC50K		
	Charge		L		0.375		0.375		
Refrigerant	Type		R-410A		R-410A		R-410A		
	Charge		kg		0.80		1.00		
Airflow Rate	H	m ³ /min (cfm)	36.2 (1,278)		33.5 (1,183)		36.0 (1,272)		
	SL		34.0 (1,201)		31.4 (1,109)		31.4 (1,109)		
Fan	Type		Propeller		Propeller		Propeller		
	Motor Output		W		50		50		
Running Current (Rated)			A	2.67 - 2.55 - 2.45		3.06 - 2.93 - 2.81		4.26 - 4.08 - 3.91	
Power Consumption (Rated)			W	452 - 452 - 452		532 - 532 - 532		844 - 844 - 844	
Power Factor			%	76.9 - 77.1 - 76.9		79.0 - 78.9 - 78.9		90.1 - 89.9 - 89.9	
Starting Current			A	2.8		3.2		4.4	
Dimensions (H x W x D)			mm	550 x 765 x 285		550 x 765 x 285		550 x 765 x 285	
Packaged Dimensions (H x W x D)			mm	612 x 906 x 364		612 x 906 x 364		612 x 906 x 364	
Weight (Mass)			kg	32		34		34	
Gross Weight (Gross Mass)			kg	37		40		40	
Sound Pressure Level	H / SL		dB(A)	46 / 43		46 / 43		48 / 44	
Sound Power Level			dB	61		61		63	
Drawing No.			3D059727		3D059728		3D059729		

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS20G2V1B	FTXS25G2V1B	FTXS35G2V1B
	Outdoor Unit		RKS20G2V1B9	RKS25G2V1B9	RKS35G2V1B9
Capacity Rated (Min. ~ Max.)		kW	2.0 (1.3 ~ 2.8)	2.5 (1.3 ~ 3.2)	3.5 (1.4 ~ 4.0)
		Btu/h	6,800 (4,400 ~ 9,600)	8,500 (4,400 ~ 10,900)	11,900 (4,800 ~ 13,600)
		kcal/h	1,720 (1,120 ~ 2,410)	2,150 (1,120 ~ 2,750)	3,010 (1,200 ~ 3,440)
Moisture Removal		L/h	0.9	1.2	1.9
Running Current (Rated)		A	2.8 - 2.7 - 2.5	3.2 - 3.0 - 2.9	4.4 - 4.2 - 4.0
Power Consumption Rated (Min. ~ Max.)		W	470 (320 ~ 910)	550 (320 ~ 810)	870 (350 ~ 1,190)
Power Factor		%	76.3 - 75.7 - 78.3	78.1 - 79.7 - 79.0	89.9 - 90.1 - 90.6
COP (Rated)		W/W	4.26 (4.06 ~ 3.08)	4.55 (4.06 ~ 3.95)	4.02 (4.00 ~ 3.36)
Piping Connections	Liquid	mm	φ 6.4	φ 6.4	φ 6.4
	Gas	mm	φ 9.5	φ 9.5	φ 9.5
	Drain	mm	φ 18.0	φ 18.0	φ 18.0
Heat Insulation			Both Liquid and Gas Pipes	Both Liquid and Gas Pipes	Both Liquid and Gas Pipes
Max. Interunit Piping Length		m	20	20	20
Max. Interunit Height Difference		m	15	15	15
Chargeless		m	10	10	10
Amount of Additional Charge of Refrigerant		g/m	20	20	20
Indoor Unit			FTXS20G2V1B	FTXS25G2V1B	FTXS35G2V1B
Front Panel Color			White	White	White
Airflow Rate	H	m ³ /min (cfm)	9.4 (332)	9.1 (321)	10.4 (367)
	M		7.4 (262)	7.1 (252)	7.7 (270)
	L		5.5 (193)	5.2 (182)	4.8 (170)
	SL		4.0 (141)	3.7 (130)	3.5 (125)
Fan	Type		Cross Flow Fan	Cross Flow Fan	Cross Flow Fan
	Motor Output	W	23	23	23
	Speed	Steps	5 Steps, Quiet, Auto	5 Steps, Quiet, Auto	5 Steps, Quiet, Auto
Air Direction Control			Right, Left, Horizontal, Downward	Right, Left, Horizontal, Downward	Right, Left, Horizontal, Downward
Air Filter			Removable / Washable / Mildew Proof	Removable / Washable / Mildew Proof	Removable / Washable / Mildew Proof
Running Current (Rated)		A	0.09 - 0.08 - 0.08	0.09 - 0.08 - 0.08	0.12 - 0.12 - 0.11
Power Consumption (Rated)		W	18 - 18 - 18	18 - 18 - 18	26 - 26 - 26
Power Factor		%	90.9 - 97.8 - 93.8	90.9 - 97.8 - 93.8	98.5 - 94.2 - 98.5
Temperature Control			Microcomputer Control	Microcomputer Control	Microcomputer Control
Dimensions (H x W x D)		mm	295 x 800 x 215	295 x 800 x 215	295 x 800 x 215
Packaged Dimensions (H x W x D)		mm	274 x 870 x 366	274 x 870 x 366	274 x 870 x 366
Weight (Mass)		kg	9	9	10
Gross Weight (Gross Mass)		kg	13	13	13
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	38 / 32 / 25 / 22	42 / 34 / 26 / 23
Sound Power Level		dB	54	54	58
Outdoor Unit			RKS20G2V1B9	RKS25G2V1B9	RKS35G2V1B9
Casing Color			Ivory White	Ivory White	Ivory White
Compressor	Type		Hermetically Sealed Swing Type	Hermetically Sealed Swing Type	Hermetically Sealed Swing Type
	Model		1YC23AEXD	1YC23AEXD	1YC23AEXD
	Motor Output	W	600	600	600
Refrigerant Oil	Type		FVC50K	FVC50K	FVC50K
	Charge	L	0.375	0.375	0.375
Refrigerant	Type		R-410A	R-410A	R-410A
	Charge	kg	0.80	1.00	1.20
Airflow Rate	H	m ³ /min (cfm)	36.2 (1,278)	33.5 (1,183)	36.0 (1,272)
	SL		32.7 (1,153)	30.1 (1,064)	30.1 (1,064)
Fan	Type		Propeller	Propeller	Propeller
	Motor Output	W	23	23	23
Running Current (Rated)		A	2.67 - 2.55 - 2.45	3.06 - 2.93 - 2.81	4.26 - 4.08 - 3.91
Power Consumption (Rated)		W	452 - 452 - 452	532 - 532 - 532	844 - 844 - 844
Power Factor		%	76.9 - 77.1 - 76.9	79.0 - 78.9 - 78.9	90.1 - 89.9 - 89.9
Starting Current		A	2.8	3.2	4.4
Dimensions (H x W x D)		mm	550 x 765 x 285	550 x 765 x 285	550 x 765 x 285
Packaged Dimensions (H x W x D)		mm	612 x 906 x 364	612 x 906 x 364	612 x 906 x 364
Weight (Mass)		kg	32	34	34
Gross Weight (Gross Mass)		kg	35	38	38
Sound Pressure Level	H / SL	dB(A)	46 / 43	46 / 43	48 / 44
Sound Power Level	H	dB	61	61	63
Drawing No.			3D066471	3D066472	3D066474

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS42G2V1B	FTXS50G2V1B
	Outdoor Unit		RKS42G2V1B	RKS50G2V1B
Capacity Rated (Min. ~ Max.)		kW	4.2 (1.7 ~ 5.0)	5.0 (1.7 ~ 5.3)
		Btu/h	14,300 (5,800 ~ 17,100)	17,100 (5,800 ~ 18,100)
		kcal/h	3,610 (1,460 ~ 4,300)	4,300 (1,460 ~ 4,560)
Moisture Removal		L/h	2.3	2.8
Running Current (Rated)		A	6.2 - 5.9 - 5.6	7.1 - 6.7 - 6.5
Power Consumption Rated (Min. ~ Max.)		W	1,220 (440 ~ 2,230)	1,520 (440 ~ 1,810)
Power Factor		%	89.4 - 89.9 - 90.8	97.3 - 98.6 - 97.4
COP (Rated)		W/W	3.44 (3.86 ~ 2.24)	3.29 (3.86 ~ 2.93)
Piping Connections	Liquid	mm	φ 6.4	φ 6.4
	Gas	mm	φ 9.5	φ 12.7
	Drain	mm	φ 18.0	φ 18.0
Heat Insulation			Both Liquid and Gas Pipes	Both Liquid and Gas Pipes
Max. Interunit Piping Length		m	20	30
Max. Interunit Height Difference		m	15	20
Chargeless		m	10	10
Amount of Additional Charge of Refrigerant		g/m	20	20
Indoor Unit			FTXS42G2V1B	FTXS50G2V1B
Front Panel Color			White	White
Airflow Rate	H	m ³ /min (cfm)	9.1 (321)	10.2 (360)
	M		7.7 (273)	8.6 (305)
	L		6.3 (221)	7.0 (246)
	SL		5.4 (190)	6.0 (212)
Fan	Type		Cross Flow Fan	Cross Flow Fan
	Motor Output	W	23	23
	Speed	Steps	5 Steps, Quiet, Auto	5 Steps, Quiet, Auto
Air Direction Control			Right, Left, Horizontal, Downward	Right, Left, Horizontal, Downward
Air Filter			Removable / Washable / Mildew Proof	Removable / Washable / Mildew Proof
Running Current (Rated)		A	0.11 - 0.11 - 0.10	0.12 - 0.12 - 0.11
Power Consumption (Rated)		W	24 - 24 - 24	26 - 26 - 26
Power Factor		%	99.2 - 94.9 - 100.0	98.5 - 94.2 - 98.5
Temperature Control			Microcomputer Control	Microcomputer Control
Dimensions (H x W x D)		mm	295 x 800 x 215	295 x 800 x 215
Packaged Dimensions (H x W x D)		mm	274 x 870 x 366	274 x 870 x 366
Weight (Mass)		kg	10	10
Gross Weight (Gross Mass)		kg	13	13
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 38 / 33 / 30	43 / 39 / 34 / 31
Sound Power Level		dB	58	59
Outdoor Unit			RKS42G2V1B	RKS50G2V1B
Casing Color			Ivory White	Ivory White
Compressor	Type	Hermetically Sealed Swing Type		Hermetically Sealed Swing Type
	Model	2YC36BXD		2YC36BXD
	Motor Output	W	1,100	1,100
Refrigerant Oil	Type	FVC50K		FVC50K
	Charge	L	0.65	0.65
Refrigerant	Type	R-410A		R-410A
	Charge	kg	1.30	1.70
Airflow Rate	H	m ³ /min (cfm)	37.3 (1,317)	50.9 (1,797)
	SL		30.6 (1,079)	48.9 (1,727)
Fan	Type	Propeller		Propeller
	Motor Output	W	50	53
Running Current (Rated)		A	6.04 - 5.78 - 5.54	6.93 - 6.63 - 6.35
Power Consumption (Rated)		W	1,196 - 1,196 - 1,196	1,494 - 1,494 - 1,494
Power Factor		%	90.0 - 90.0 - 90.0	98.0 - 98.0 - 98.0
Starting Current		A	6.2	7.1
Dimensions (H x W x D)		mm	550 x 765 x 285	735 x 825 x 300
Packaged Dimensions (H x W x D)		mm	612 x 906 x 364	797 x 960 x 390
Weight (Mass)		kg	39	47
Gross Weight (Gross Mass)		kg	45	52
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 44
Sound Power Level	H	dB	63	62
Drawing No.			3D059730	3D059731

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

1.2 Heat Pump

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS20G2V1B		FTXS25G2V1B	
	Outdoor Unit		RXS20G2V1B		RXS25G2V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		2.0 (1.3 ~ 2.8)	2.7 (1.3 ~ 4.3)	2.5 (1.3 ~ 3.2)	3.4 (1.3 ~ 4.7)
	Btu/h		6,800 (4,400 ~ 9,600)	9,200 (4,400 ~ 14,700)	8,500 (4,400 ~ 10,900)	11,600 (4,400 ~ 16,000)
	kcal/h		1,720 (1,120 ~ 2,410)	2,320 (1,120 ~ 3,700)	2,150 (1,120 ~ 2,750)	2,920 (1,120 ~ 4,040)
Moisture Removal	L/h		0.9	—	1.2	—
Running Current (Rated)	A		2.8 - 2.7 - 2.5	3.6 - 3.5 - 3.3	3.2 - 3.0 - 2.9	4.3 - 4.1 - 3.9
Power Consumption Rated (Min. ~ Max.)	W		470 (320 ~ 910)	630 (310 ~ 1,360)	550 (320 ~ 810)	750 (310 ~ 1,290)
Power Factor	%		76.3 - 75.7 - 78.3	79.5 - 78.3 - 79.5	78.1 - 79.7 - 79.0	79.3 - 79.5 - 80.1
COP (Rated)	W/W		4.26 (4.06 ~ 3.08)	4.29 (4.19 ~ 3.16)	4.55 (4.06 ~ 3.95)	4.53 (4.19 ~ 3.64)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			FTXS20G2V1B		FTXS25G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.4 (332)	9.9 (350)	9.1 (321)	9.8 (346)
	M		7.4 (262)	8.2 (290)	7.1 (252)	7.9 (280)
	L		5.5 (193)	6.5 (228)	5.2 (182)	6.2 (217)
	SL		4.0 (141)	5.5 (193)	3.7 (130)	5.2 (183)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09	0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09
Power Consumption (Rated)	W		18 - 18 - 18	21 - 21 - 21	18 - 18 - 18	21 - 21 - 21
Power Factor	%		90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2	90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)	kg		9		9	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	38 / 33 / 28 / 25	38 / 32 / 25 / 22	39 / 34 / 28 / 25
Sound Power Level		dB	54	54	54	55
Outdoor Unit			RXS20G2V1B		RXS25G2V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AFXD		1YC23AFXD	
Motor Output	W		600		600	
Refrigerant Oil	Type		FVC50K		FVC50K	
	Charge	L	0.375		0.375	
Refrigerant	Type		R-410A		R-410A	
	Charge	kg	0.80		1.00	
Airflow Rate	H	m³/min (cfm)	36.2 (1,278)	32.6 (1,151)	33.5 (1,183)	30.2 (1,066)
	SL		34.0 (1,201)	24.6 (869)	31.4 (1,109)	22.6 (798)
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		50	
Running Current (Rated)	A		2.67 - 2.55 - 2.45	3.50 - 3.35 - 3.21	3.06 - 2.93 - 2.81	4.14 - 3.96 - 3.80
Power Consumption (Rated)	W		452 - 452 - 452	609 - 609 - 609	532 - 532 - 532	729 - 729 - 729
Power Factor	%		76.9 - 77.1 - 76.9	79.1 - 79.0 - 79.0	79.0 - 78.9 - 78.9	80.0 - 80.0 - 79.9
Starting Current	A		3.6		4.3	
Dimensions (H x W x D)	mm		550 x 765 x 285		550 x 765 x 285	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		612 x 906 x 364	
Weight (Mass)	kg		32		34	
Gross Weight (Gross Mass)	kg		37		40	
Sound Pressure Level	H / SL	dB(A)	46 / 43	47 / 44	46 / 43	47 / 44
Sound Power Level	H	dB	61	62	61	62
Drawing No.			3D059722		3D059723	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m³/min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS35G2V1B		FTXS20G2V1B	
	Outdoor Unit		RXS35G2V1B		RXS20G2V1B9	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		3.5 (1.4 ~ 4.0)	4.0 (1.4 ~ 5.2)	2.0 (1.3 ~ 2.8)	2.7 (1.3 ~ 4.3)
	Btu/h		11,900 (4,800 ~ 13,600)	13,600 (4,800 ~ 17,700)	6,800 (4,400 ~ 9,600)	9,200 (4,400 ~ 14,700)
	kcal/h		3,010 (1,200 ~ 3,440)	3,440 (1,200 ~ 4,470)	1,720 (1,120 ~ 2,410)	2,320 (1,120 ~ 3,700)
Moisture Removal	L/h		1.9	—	0.9	—
Running Current (Rated)	A		4.4 - 4.2 - 4.0	4.8 - 4.6 - 4.4	2.8 - 2.7 - 2.5	3.6 - 3.5 - 3.3
Power Consumption Rated (Min. ~ Max.)	W		870 (350 ~ 1,190)	960 (340 ~ 1,460)	470 (320 ~ 910)	630 (310 ~ 1,360)
Power Factor	%		89.9 - 90.1 - 90.6	90.9 - 90.7 - 90.9	76.3 - 75.7 - 78.3	79.5 - 78.3 - 79.5
COP (Rated)	W/W		4.02 (4.00 ~ 3.96)	4.17 (4.12 ~ 3.56)	4.26 (4.06 ~ 3.08)	4.29 (4.19 ~ 3.16)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			FTXS35G2V1B		FTXS20G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m ³ /min (cfm)	10.4 (367)	10.6 (374)	9.4 (332)	9.9 (350)
	M		7.7 (270)	8.5 (302)	7.4 (262)	8.2 (290)
	L		4.8 (170)	6.4 (226)	5.5 (193)	6.5 (228)
	SL		3.5 (125)	5.4 (191)	4.0 (141)	5.5 (193)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control		Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward		
Air Filter		Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof		
Running Current (Rated)	A		0.12 - 0.12 - 0.11	0.13 - 0.13 - 0.12	0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09
Power Consumption (Rated)	W		26 - 26 - 26	28 - 28 - 28	18 - 18 - 18	21 - 21 - 21
Power Factor	%		98.5 - 94.2 - 98.5	97.9 - 93.6 - 97.2	90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H × W × D)	mm		295 × 800 × 215		295 × 800 × 215	
Packaged Dimensions (H × W × D)	mm		274 × 870 × 366		274 × 870 × 366	
Weight (Mass)	kg		10		9	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 34 / 26 / 23	42 / 36 / 29 / 26	38 / 32 / 25 / 22	38 / 33 / 28 / 25
Sound Power Level		dB	58	58	54	54
Outdoor Unit			RXS35G2V1B		RXS20G2V1B9	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AFXD		1YC23AEXD	
Refrigerant Oil	Motor Output	W	600		600	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.375		0.375	
	Type		R-410A		R-410A	
Airflow Rate	Charge	kg	1.20		0.80	
	H	m ³ /min (cfm)	36.0 (1,272)	30.2 (1,066)	36.2 (1,278)	30.6 (1,080)
SL	31.4 (1,109)		22.6 (798)	32.7 (1,153)	28.5 (1,005)	
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		23	
Running Current (Rated)	A		4.26 - 4.08 - 3.91	4.71 - 4.50 - 4.31	2.67 - 2.55 - 2.45	3.50 - 3.35 - 3.21
Power Consumption (Rated)	W		844 - 844 - 844	932 - 932 - 932	452 - 452 - 452	609 - 609 - 609
Power Factor	%		90.1 - 89.9 - 89.9	89.9 - 90.0 - 90.1	76.9 - 77.1 - 76.9	79.1 - 79.0 - 79.0
Starting Current	A		4.8		3.6	
Dimensions (H × W × D)	mm		550 × 765 × 285		550 × 765 × 285	
Packaged Dimensions (H × W × D)	mm		612 × 906 × 364		612 × 906 × 364	
Weight (Mass)	kg		34		32	
Gross Weight (Gross Mass)	kg		40		35	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45	46 / 43	47 / 44
Sound Power Level	H	dB	63	63	61	62
Drawing No.			3D059724		3D066468	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB	Indoor ; 20°CDB	5 m
Outdoor ; 35°CDB / 24°CWB	Outdoor ; 7°CDB / 6°CWB	

Conversion Formulae
kcal/h = kW × 860
Btu/h = kW × 3412
cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS25G2V1B		FTXS35G2V1B	
	Outdoor Unit		RXS25G2V1B9		RXS35G2V1B9	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		2.5 (1.3 ~ 3.2)	3.4 (1.3 ~ 4.7)	3.5 (1.4 ~ 4.0)	4.0 (1.4 ~ 5.2)
	Btu/h		8,500 (4,400 ~ 10,900)	11,600 (4,400 ~ 16,000)	11,900 (4,800 ~ 13,600)	13,600 (4,800 ~ 17,700)
	kcal/h		2,150 (1,120 ~ 2,750)	2,920 (1,120 ~ 4,040)	3,010 (1,200 ~ 3,440)	3,440 (1,200 ~ 4,470)
Moisture Removal	L/h		1.2	—	1.9	—
Running Current (Rated)	A		3.2 - 3.0 - 2.9	4.3 - 4.1 - 3.9	4.4 - 4.2 - 4.0	4.8 - 4.6 - 4.4
Power Consumption Rated (Min. ~ Max.)	W		550 (320 ~ 810)	750 (310 ~ 1,290)	870 (350 ~ 1,190)	960 (340 ~ 1,460)
Power Factor	%		78.1 - 79.7 - 79.0	79.3 - 79.5 - 80.1	89.9 - 90.1 - 90.6	90.9 - 90.7 - 90.9
COP (Rated)	W/W		4.55 (4.06 ~ 3.95)	4.53 (4.19 ~ 3.64)	4.02 (4.00 ~ 3.96)	4.17 (4.12 ~ 3.56)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			FTXS25G2V1B		FTXS35G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.1 (321)	9.8 (346)	10.4 (367)	10.6 (374)
	M		7.1 (252)	7.9 (280)	7.7 (270)	8.5 (302)
	L		5.2 (182)	6.2 (217)	4.8 (170)	6.4 (226)
	SL		3.7 (130)	5.2 (183)	3.5 (125)	5.4 (191)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09	0.12 - 0.12 - 0.11	0.13 - 0.13 - 0.12
Power Consumption (Rated)	W		18 - 18 - 18	21 - 21 - 21	26 - 26 - 26	28 - 28 - 28
Power Factor	%		90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2	98.5 - 94.2 - 98.5	97.9 - 93.6 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)	kg		9		10	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	39 / 34 / 28 / 25	42 / 34 / 26 / 23	42 / 36 / 29 / 26
Sound Power Level		dB	54	55	58	58
Outdoor Unit			RXS25G2V1B9		RXS35G2V1B9	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AEXD		1YC23AEXD	
Refrigerant Oil	Motor Output	W	600		600	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.375		0.375	
	Type		R-410A		R-410A	
Airflow Rate	Charge	kg	1.00		1.20	
	H	m³/min (cfm)	33.5 (1,183)	28.3 (999)	36.0 (1,272)	28.3 (999)
SL	30.1 (1,064)		25.6 (905)	30.1 (1,064)	25.6 (905)	
Fan	Type		Propeller		Propeller	
	Motor Output	W	23		23	
Running Current (Rated)	A		3.06 - 2.93 - 2.81	4.14 - 3.96 - 3.80	4.26 - 4.08 - 3.91	4.71 - 4.50 - 4.31
Power Consumption (Rated)	W		532 - 532 - 532	729 - 729 - 729	844 - 844 - 844	932 - 932 - 932
Power Factor	%		79.0 - 78.9 - 78.9	80.0 - 80.0 - 79.9	90.1 - 89.9 - 89.9	89.9 - 90.0 - 90.1
Starting Current	A		4.3		4.8	
Dimensions (H x W x D)	mm		550 x 765 x 285		550 x 765 x 285	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		612 x 906 x 364	
Weight (Mass)	kg		34		34	
Gross Weight (Gross Mass)	kg		38		38	
Sound Pressure Level	H / SL	dB(A)	46 / 43	47 / 44	48 / 44	48 / 45
Sound Power Level	H	dB	61	62	63	63
Drawing No.			3D066469		3D066470	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m³/min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		FTXS42G2V1B		FTXS50G2V1B	
	Outdoor Unit		RXS42G2V1B		RXS50G2V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		4.2 (1.7 ~ 5.0)	5.4 (1.7 ~ 6.0)	5.0 (1.7 ~ 5.3)	5.8 (1.7 ~ 6.5)
	Btu/h		14,300 (5,800 ~ 17,100)	18,400 (5,800 ~ 20,500)	17,100 (5,800 ~ 18,100)	19,800 (5,800 ~ 22,200)
	kcal/h		3,610 (1,460 ~ 4,300)	4,640 (1,460 ~ 5,160)	4,300 (1,460 ~ 4,560)	4,990 (1,460 ~ 5,590)
Moisture Removal	L/h		2.3	—	2.8	—
Running Current (Rated)	A		6.2 - 5.9 - 5.6	7.4 - 7.1 - 6.8	7.1 - 6.7 - 6.5	7.3 - 7.0 - 6.7
Power Consumption Rated (Min. ~ Max.)	W		1,220 (440 ~ 2,230)	1,470 (400 ~ 1,980)	1,520 (440 ~ 1,810)	1,570 (400 ~ 2,000)
Power Factor	%		89.4 - 89.9 - 90.8	90.3 - 90.0 - 90.1	97.3 - 98.6 - 97.4	97.8 - 97.5 - 97.6
COP (Rated)	W/W		3.44 (3.86 ~ 2.24)	3.67 (4.25 ~ 3.03)	3.29 (3.86 ~ 2.93)	3.69 (4.25 ~ 3.25)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 12.7	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		30	
Max. Interunit Height Difference	m		15		20	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			FTXS42G2V1B		FTXS50G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m ³ /min (cfm)	9.1 (321)	11.2 (395)	10.2 (360)	11.0 (388)
	M		7.7 (273)	9.4 (333)	8.6 (305)	9.3 (330)
	L		6.3 (221)	7.7 (271)	7.0 (246)	7.6 (267)
	SL		5.4 (190)	6.8 (240)	6.0 (212)	6.7 (236)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.11 - 0.11 - 0.10	0.14 - 0.14 - 0.13	0.12 - 0.12 - 0.11	0.15 - 0.14 - 0.14
Power Consumption (Rated)	W		24 - 24 - 24	30 - 30 - 30	26 - 26 - 26	32 - 32 - 32
Power Factor	%		99.2 - 94.9 - 100.0	97.4 - 93.2 - 96.2	98.5 - 94.2 - 98.5	97.0 - 99.4 - 95.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H × W × D)	mm		295 × 800 × 215		295 × 800 × 215	
Packaged Dimensions (H × W × D)	mm		274 × 870 × 366		274 × 870 × 366	
Weight (Mass)	kg		10		10	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 38 / 33 / 30	42 / 38 / 33 / 30	43 / 39 / 34 / 31	44 / 39 / 34 / 31
Sound Power Level		dB	58	58	59	60
Outdoor Unit			RXS42G2V1B		RXS50G2V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		2YC36BXD		2YC36BXD	
Refrigerant Oil	Motor Output	W	1,100		1,100	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.65		0.65	
	Type		R-410A		R-410A	
Airflow Rate	H	m ³ /min (cfm)	37.3 (1,317)	31.3 (1,107)	50.9 (1,797)	45.0 (1,589)
	SL		30.6 (1,079)	27.2 (959)	48.9 (1,727)	43.1 (1,522)
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		53	
Running Current (Rated)	A		6.04 - 5.78 - 5.54	7.27 - 6.96 - 6.67	6.93 - 6.63 - 6.35	7.13 - 6.82 - 6.54
Power Consumption (Rated)	W		1,196 - 1,196 - 1,196	1,440 - 1,440 - 1,440	1,494 - 1,494 - 1,494	1,538 - 1,538 - 1,538
Power Factor	%		90.0 - 90.0 - 90.0	90.0 - 90.0 - 90.0	98.0 - 98.0 - 98.0	98.0 - 98.0 - 98.0
Starting Current	A		7.4		7.3	
Dimensions (H × W × D)	mm		550 × 765 × 285		735 × 825 × 300	
Packaged Dimensions (H × W × D)	mm		612 × 906 × 364		797 × 960 × 390	
Weight (Mass)	kg		39		48	
Gross Weight (Gross Mass)	kg		45		53	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45	48 / 44	48 / 45
Sound Power Level	H	dB	63	63	62	62
Drawing No.			3D059725		3D059726	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS20G2V1B		ATXS25G2V1B	
	Outdoor Unit		ARXS20G2V1B		ARXS25G2V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		2.0 (1.3 ~ 2.8)	2.7 (1.3 ~ 4.3)	2.5 (1.3 ~ 3.2)	3.4 (1.3 ~ 4.7)
	Btu/h		6,800 (4,400 ~ 9,600)	9,200 (4,400 ~ 14,700)	8,500 (4,400 ~ 10,900)	11,600 (4,400 ~ 16,000)
	kcal/h		1,720 (1,120 ~ 2,410)	2,320 (1,120 ~ 3,700)	2,150 (1,120 ~ 2,750)	2,920 (1,120 ~ 4,040)
Moisture Removal	L/h		0.9	—	1.2	—
Running Current (Rated)	A		2.8 - 2.7 - 2.5	3.6 - 3.5 - 3.3	3.2 - 3.0 - 2.9	4.3 - 4.1 - 3.9
Power Consumption Rated (Min. ~ Max.)	W		470 (320 ~ 910)	630 (310 ~ 1,360)	550 (320 ~ 810)	750 (310 ~ 1,290)
Power Factor	%		76.3 - 75.7 - 78.3	79.5 - 78.3 - 79.5	78.1 - 79.7 - 79.0	79.3 - 79.5 - 80.1
COP (Rated)	W/W		4.26 (4.06 ~ 3.08)	4.29 (4.19 ~ 3.16)	4.55 (4.06 ~ 3.95)	4.53 (4.19 ~ 3.64)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS20G2V1B		ATXS25G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.4 (332)	9.9 (350)	9.1 (321)	9.8 (346)
	M		7.4 (262)	8.2 (290)	7.1 (252)	7.9 (280)
	L		5.5 (193)	6.5 (228)	5.2 (182)	6.2 (217)
	SL		4.0 (141)	5.5 (193)	3.7 (130)	5.2 (183)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09	0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09
Power Consumption (Rated)	W		18 - 18 - 18	21 - 21 - 21	18 - 18 - 18	21 - 21 - 21
Power Factor	%		90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2	90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)	kg		9		9	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	38 / 33 / 28 / 25	38 / 32 / 25 / 22	39 / 34 / 28 / 25
Sound Power Level		dB	54	54	54	55
Outdoor Unit			ARXS20G2V1B		ARXS25G2V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AFXD		1YC23AFXD	
Refrigerant Oil	Motor Output	W	600		600	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.375		0.375	
	Type		R-410A		R-410A	
Refrigerant	Charge	kg	0.80		1.00	
	H	m³/min (cfm)	36.2 (1,278)	32.6 (1,151)	33.5 (1,183)	30.2 (1,066)
SL	34.0 (1,201)		24.6 (869)	31.4 (1,109)	22.6 (798)	
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		50	
Running Current (Rated)	A		2.67 - 2.55 - 2.45	3.50 - 3.35 - 3.21	3.06 - 2.93 - 2.81	4.14 - 3.96 - 3.80
Power Consumption (Rated)	W		452 - 452 - 452	609 - 609 - 609	532 - 532 - 532	729 - 729 - 729
Power Factor	%		76.9 - 77.1 - 76.9	79.1 - 79.0 - 79.0	79.0 - 78.9 - 78.9	80.0 - 80.0 - 79.9
Starting Current	A		3.6		4.3	
Dimensions (H x W x D)	mm		550 x 765 x 285		550 x 765 x 285	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		612 x 906 x 364	
Weight (Mass)	kg		32		34	
Gross Weight (Gross Mass)	kg		37		40	
Sound Pressure Level	H / SL	dB(A)	46 / 43	47 / 44	46 / 43	47 / 44
Sound Power Level	H	dB	61	62	61	62
Drawing No.			3D059732		3D059733	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB	Indoor ; 20°CDB	5 m
Outdoor ; 35°CDB / 24°CWB	Outdoor ; 7°CDB / 6°CWB	

Conversion Formulae
kcal/h = kW × 860
Btu/h = kW × 3412
cfm = m³/min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS35G2V1B		ATXS20G2V1B	
	Outdoor Unit		ARXS35G2V1B		ARXS20G3V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		3.5 (1.4 ~ 4.0)	4.0 (1.4 ~ 5.2)	2.0 (1.3 ~ 2.8)	2.7 (1.3 ~ 4.3)
	Btu/h		11,900 (4,800 ~ 13,600)	13,600 (4,800 ~ 17,700)	6,800 (4,400 ~ 9,600)	9,200 (4,400 ~ 14,700)
	kcal/h		3,010 (1,200 ~ 3,440)	3,440 (1,200 ~ 4,470)	1,720 (1,120 ~ 2,410)	2,320 (1,120 ~ 3,700)
Moisture Removal	L/h		1.9	—	0.9	—
Running Current (Rated)	A		4.4 - 4.2 - 4.0	4.8 - 4.6 - 4.4	2.8 - 2.7 - 2.5	3.6 - 3.5 - 3.3
Power Consumption Rated (Min. ~ Max.)	W		870 (350 ~ 1,190)	960 (340 ~ 1,460)	470 (320 ~ 910)	630 (310 ~ 1,360)
Power Factor	%		89.9 - 90.1 - 90.6	90.9 - 90.7 - 90.9	76.3 - 75.7 - 78.3	79.5 - 78.3 - 79.5
COP (Rated)	W/W		4.02 (4.00 ~ 3.36)	4.17 (4.12 ~ 3.56)	4.26 (4.06 ~ 3.08)	4.29 (4.19 ~ 3.16)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS35G2V1B		ATXS20G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m ³ /min (cfm)	10.4 (367)	10.6 (374)	9.4 (332)	9.9 (350)
	M		7.7 (270)	8.5 (302)	7.4 (262)	8.2 (290)
	L		4.8 (170)	6.4 (226)	5.5 (193)	6.5 (228)
	SL		3.5 (125)	5.4 (191)	4.0 (141)	5.5 (193)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control		Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward		
Air Filter		Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof		
Running Current (Rated)	A		0.12 - 0.12 - 0.11	0.13 - 0.13 - 0.12	0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09
Power Consumption (Rated)	W		26 - 26 - 26	28 - 28 - 28	18 - 18 - 18	21 - 21 - 21
Power Factor	%		98.5 - 94.2 - 98.5	97.9 - 93.6 - 97.2	90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H × W × D)	mm		295 × 800 × 215		295 × 800 × 215	
Packaged Dimensions (H × W × D)	mm		274 × 870 × 366		274 × 870 × 366	
Weight (Mass)	kg		10		9	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 34 / 26 / 23	42 / 36 / 29 / 26	38 / 32 / 25 / 22	38 / 33 / 28 / 25
Sound Power Level		dB	58	58	54	54
Outdoor Unit			ARXS35G2V1B		ARXS20G3V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AFXD		1YC23AEXD	
	Motor Output	W	600		600	
Refrigerant Oil	Type		FVC50K		FVC50K	
	Charge	L	0.375		0.375	
Refrigerant	Type		R-410A		R-410A	
	Charge	kg	1.20		0.80	
Airflow Rate	H	m ³ /min (cfm)	36.0 (1,272)	30.2 (1,066)	36.2 (1,278)	30.6 (1,080)
	SL		31.4 (1,109)	22.6 (798)	32.7 (1,153)	28.5 (1,005)
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		23	
Running Current (Rated)	A		4.26 - 4.08 - 3.91	4.71 - 4.50 - 4.31	2.67 - 2.55 - 2.45	3.50 - 3.35 - 3.21
Power Consumption (Rated)	W		844 - 844 - 844	932 - 932 - 932	452 - 452 - 452	609 - 609 - 609
Power Factor	%		90.1 - 89.9 - 89.9	89.9 - 90.0 - 90.1	76.9 - 77.1 - 76.9	79.1 - 79.0 - 79.0
Starting Current	A		4.8		3.6	
Dimensions (H × W × D)	mm		550 × 765 × 285		550 × 765 × 285	
Packaged Dimensions (H × W × D)	mm		612 × 906 × 364		612 × 906 × 364	
Weight (Mass)	kg		34		32	
Gross Weight (Gross Mass)	kg		40		35	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45	46 / 43	47 / 44
Sound Power Level	H	dB	63	63	61	62
Drawing No.			3D059734		3D066475	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS25G2V1B		ATXS35G2V1B	
	Outdoor Unit		ARXS25G3V1B		ARXS35G3V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		2.5 (1.3 ~ 3.2)	3.4 (1.3 ~ 4.7)	3.5 (1.4 ~ 4.0)	4.0 (1.4 ~ 5.2)
	Btu/h		8,500 (4,400 ~ 10,900)	11,600 (4,400 ~ 16,000)	11,900 (4,800 ~ 13,600)	13,600 (4,800 ~ 17,700)
	kcal/h		2,150 (1,120 ~ 2,750)	2,920 (1,120 ~ 4,040)	3,010 (1,200 ~ 3,440)	3,440 (1,200 ~ 4,470)
Moisture Removal	L/h		1.2	—	1.9	—
Running Current (Rated)	A		3.2 - 3.0 - 2.9	4.3 - 4.1 - 3.9	4.4 - 4.2 - 4.0	4.8 - 4.6 - 4.4
Power Consumption Rated (Min. ~ Max.)	W		550 (320 ~ 810)	750 (310 ~ 1,290)	870 (350 ~ 1,190)	960 (340 ~ 1,460)
Power Factor	%		78.1 - 79.7 - 79.0	79.3 - 79.5 - 80.1	89.9 - 90.1 - 90.6	90.9 - 90.7 - 90.9
COP (Rated)	W/W		4.55 (4.06 ~ 3.95)	4.53 (4.19 ~ 3.64)	4.02 (4.00 ~ 3.36)	4.17 (4.12 ~ 3.56)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation	Both Liquid and Gas Pipes				Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS25G2V1B		ATXS35G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.1 (321)	9.8 (346)	10.4 (367)	10.6 (374)
	M		7.1 (252)	7.9 (280)	7.7 (270)	8.5 (302)
	L		5.2 (182)	6.2 (217)	4.8 (170)	6.4 (226)
	SL		3.7 (130)	5.2 (183)	3.5 (125)	5.4 (191)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09	0.12 - 0.12 - 0.11	0.13 - 0.13 - 0.12
Power Consumption (Rated)	W		18 - 18 - 18	21 - 21 - 21	26 - 26 - 26	28 - 28 - 28
Power Factor	%		90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2	98.5 - 94.2 - 98.5	97.9 - 93.6 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)	kg		9		10	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	39 / 34 / 28 / 25	42 / 34 / 26 / 23	42 / 36 / 29 / 26
Sound Power Level		dB	54	55	58	58
Outdoor Unit			ARXS25G3V1B		ARXS35G3V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AEXD		1YC23AEXD	
Refrigerant Oil	Motor Output	W	600		600	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.375		0.375	
	Type		R-410A		R-410A	
Airflow Rate	Charge	kg	1.00		1.20	
	H	m³/min (cfm)	33.5 (1,183)	28.3 (999)	36.0 (1,272)	28.3 (999)
SL	30.1 (1,064)		25.6 (905)	30.1 (1,064)	25.6 (905)	
Fan	Type		Propeller		Propeller	
	Motor Output	W	23		23	
Running Current (Rated)	A		3.06 - 2.93 - 2.81	4.14 - 3.96 - 3.80	4.26 - 4.08 - 3.91	4.71 - 4.50 - 4.31
Power Consumption (Rated)	W		532 - 532 - 532	729 - 729 - 729	844 - 844 - 844	932 - 932 - 932
Power Factor	%		79.0 - 78.9 - 78.9	80.0 - 80.0 - 79.9	90.1 - 89.9 - 89.9	89.9 - 90.0 - 90.1
Starting Current	A		4.3		4.8	
Dimensions (H x W x D)	mm		550 x 765 x 285		550 x 765 x 285	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		612 x 906 x 364	
Weight (Mass)	kg		34		34	
Gross Weight (Gross Mass)	kg		38		38	
Sound Pressure Level	H / SL	dB(A)	46 / 43	47 / 44	48 / 44	48 / 45
Sound Power Level	H	dB	61	62	63	63
Drawing No.			3D066476		3D066477	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB	Indoor ; 20°CDB	5 m
Outdoor ; 35°CDB / 24°CWB	Outdoor ; 7°CDB / 6°CWB	

Conversion Formulae
kcal/h = kW × 860
Btu/h = kW × 3412
cfm = m³/min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS20G2V1B		ATXS25G2V1B	
	Outdoor Unit		ARXS20G4V1B		ARXS25G4V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		2.0 (1.3 ~ 2.8)	2.7 (1.3 ~ 4.3)	2.5 (1.3 ~ 3.2)	3.4 (1.3 ~ 4.7)
	Btu/h		6,800 (4,400 ~ 9,600)	9,200 (4,400 ~ 14,700)	8,500 (4,400 ~ 10,900)	11,600 (4,400 ~ 16,000)
	kcal/h		1,720 (1,120 ~ 2,410)	2,320 (1,120 ~ 3,700)	2,150 (1,120 ~ 2,750)	2,920 (1,120 ~ 4,040)
Moisture Removal	L/h		0.9	—	1.2	—
Running Current (Rated)	A		2.8 - 2.7 - 2.5	3.6 - 3.5 - 3.3	3.2 - 3.0 - 2.9	4.3 - 4.1 - 3.9
Power Consumption Rated (Min. ~ Max.)	W		470 (320 ~ 910)	630 (310 ~ 1,360)	550 (320 ~ 810)	750 (310 ~ 1,290)
Power Factor	%		76.3 - 75.7 - 78.3	79.5 - 78.3 - 79.5	78.1 - 79.7 - 79.0	79.3 - 79.5 - 80.1
COP (Rated)	W/W		4.26 (4.06 ~ 3.08)	4.29 (4.19 ~ 3.16)	4.55 (4.06 ~ 3.95)	4.53 (4.19 ~ 3.64)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 9.5	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		20	
Max. Interunit Height Difference	m		15		15	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS20G2V1B		ATXS25G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m ³ /min (cfm)	9.4 (332)	9.9 (350)	9.1 (321)	9.8 (346)
	M		7.4 (261)	8.2 (290)	7.1 (252)	7.9 (280)
	L		5.5 (194)	6.5 (230)	5.2 (182)	6.2 (217)
	SL		4.0 (141)	5.5 (194)	3.7 (130)	5.2 (183)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09	0.09 - 0.08 - 0.08	0.10 - 0.10 - 0.09
Power Consumption (Rated)	W		18 - 18 - 18	21 - 21 - 21	18 - 18 - 18	21 - 21 - 21
Power Factor	%		90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2	90.9 - 97.8 - 93.8	95.5 - 91.3 - 97.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H × W × D)	mm		295 × 800 × 215		295 × 800 × 215	
Packaged Dimensions (H × W × D)	mm		289 × 870 × 366		289 × 870 × 366	
Weight (Mass)	kg		9		9	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	38 / 32 / 25 / 22	38 / 33 / 28 / 25	38 / 32 / 25 / 22	39 / 34 / 28 / 25
Sound Power Level		dB	54	54	54	55
Outdoor Unit			ARXS20G4V1B		ARXS25G4V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		1YC23AEXD		1YC23AEXD	
Refrigerant Oil	Motor Output	W	600		600	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.375		0.375	
	Type		R-410A		R-410A	
Refrigerant	Charge	kg	0.80		1.00	
	Type		R-410A		R-410A	
Airflow Rate	H	m ³ /min (cfm)	36.2 (1,278)	30.6 (1,080)	33.5 (1,183)	28.3 (999)
	SL		32.7 (1,153)	28.5 (1,005)	30.1 (1,064)	25.6 (905)
Fan	Type		Propeller		Propeller	
	Motor Output	W	23		23	
Running Current (Rated)	A		2.71 - 2.62 - 2.42	3.50 - 3.40 - 3.21	3.11 - 2.92 - 2.82	4.20 - 4.00 - 3.81
Power Consumption (Rated)	W		452 - 452 - 452	609 - 609 - 609	532 - 532 - 532	729 - 729 - 729
Power Factor	%		75.8 - 75.0 - 77.8	79.1 - 77.9 - 79.0	77.8 - 79.2 - 78.6	78.9 - 79.2 - 79.7
Starting Current	A		3.6		4.3	
Dimensions (H × W × D)	mm		550 × 765 × 285		550 × 765 × 285	
Packaged Dimensions (H × W × D)	mm		612 × 906 × 364		612 × 906 × 364	
Weight (Mass)	kg		32		34	
Gross Weight (Gross Mass)	kg		35		38	
Sound Pressure Level	H / SL	dB(A)	46 / 43	47 / 44	46 / 43	47 / 44
Sound Power Level	H	dB	62	63	62	63
Drawing No.			3D080178		3D080179	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m ³ /min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS35G2V1B	
	Outdoor Unit		ARXS35G4V1B	
			Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		3.5 (1.4 ~ 4.0)	4.0 (1.4 ~ 5.2)
	Btu/h		11,900 (4,800 ~ 13,600)	13,600 (4,800 ~ 17,700)
	kcal/h		3,010 (1,200 ~ 3,440)	3,440 (1,200 ~ 4,470)
Moisture Removal	L/h		1.9	—
Running Current (Rated)	A		4.4 - 4.2 - 4.0	4.8 - 4.6 - 4.4
Power Consumption Rated (Min. ~ Max.)	W		870 (350 ~ 1,190)	960 (340 ~ 1,460)
Power Factor	%		89.9 - 90.1 - 90.6	90.9 - 90.7 - 90.9
COP (Rated)	W/W		4.02 (4.00 ~ 3.36)	4.17 (4.12 ~ 3.56)
Piping Connections	Liquid	mm	φ 6.4	
	Gas	mm	φ 9.5	
	Drain	mm	φ 18.0	
Heat Insulation	Both Liquid and Gas Pipes			
Max. Interunit Piping Length	m		20	
Max. Interunit Height Difference	m		15	
Chargeless	m		10	
Amount of Additional Charge of Refrigerant	g/m		20	
Indoor Unit			ATXS35G2V1B	
Front Panel Color			White	
Airflow Rate	H	m³/min (cfm)	10.4 (367)	10.6 (374)
	M		7.7 (272)	8.5 (302)
	L		4.8 (170)	6.4 (226)
	SL		3.5 (125)	5.4 (191)
Fan	Type		Cross Flow Fan	
	Motor Output	W	23	
	Speed	Steps	5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.12 - 0.12 - 0.11	0.13 - 0.13 - 0.12
Power Consumption (Rated)	W		26 - 26 - 26	28 - 28 - 28
Power Factor	%		98.5 - 94.2 - 98.5	97.9 - 93.6 - 97.2
Temperature Control			Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		289 x 870 x 366	
Weight (Mass)	kg		10	
Gross Weight (Gross Mass)	kg		14	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 34 / 26 / 23	42 / 36 / 29 / 26
Sound Power Level		dB	59	59
Outdoor Unit			ARXS35G4V1B	
Casing Color			Ivory White	
Compressor	Type		Hermetically Sealed Swing Type	
	Model		1YC23AEXD	
	Motor Output	W	600	
Refrigerant Oil	Type		FVC50K	
	Charge	L	0.375	
Refrigerant	Type		R-410A	
	Charge	kg	1.20	
Airflow Rate	H	m³/min (cfm)	36.0 (1,272)	28.3 (999)
	SL		30.1 (1,064)	25.6 (905)
Fan	Type		Propeller	
	Motor Output	W	23	
Running Current (Rated)	A		4.28 - 4.08 - 3.89	4.67 - 4.47 - 4.28
Power Consumption (Rated)	W		844 - 844 - 844	932 - 932 - 932
Power Factor	%		89.6 - 89.9 - 90.4	90.7 - 90.7 - 90.7
Starting Current	A		4.8	
Dimensions (H x W x D)	mm		550 x 765 x 285	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364	
Weight (Mass)	kg		34	
Gross Weight (Gross Mass)	kg		38	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45
Sound Power Level	H	dB	63	63
Drawing No.			3D080180	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB	Indoor ; 20°CDB	5 m
Outdoor ; 35°CDB / 24°CWB	Outdoor ; 7°CDB / 6°CWB	

Conversion Formulae
kcal/h = kW x 860
Btu/h = kW x 3412
cfm = m³/min x 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS42G2V1B		ATXS50G2V1B	
	Outdoor Unit		ARXS42G2V1B		ARXS50G2V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		4.2 (1.7 ~ 5.0)	5.4 (1.7 ~ 6.0)	5.0 (1.7 ~ 5.3)	5.8 (1.7 ~ 6.5)
	Btu/h		14,300 (5,800 ~ 17,100)	18,400 (5,800 ~ 20,500)	17,100 (5,800 ~ 18,100)	19,800 (5,800 ~ 22,200)
	kcal/h		3,610 (1,460 ~ 4,300)	4,640 (1,460 ~ 5,160)	4,300 (1,460 ~ 4,560)	4,990 (1,460 ~ 5,590)
Moisture Removal	L/h		2.3	—	2.8	—
Running Current (Rated)	A		6.2 - 5.9 - 5.6	7.4 - 7.1 - 6.8	7.1 - 6.7 - 6.5	7.3 - 7.0 - 6.7
Power Consumption Rated (Min. ~ Max.)	W		1,220 (440 ~ 2,230)	1,470 (400 ~ 1,980)	1,520 (440 ~ 1,810)	1,570 (400 ~ 2,000)
Power Factor	%		89.4 - 89.9 - 90.8	90.3 - 90.0 - 90.1	97.3 - 98.6 - 97.4	97.8 - 97.5 - 97.6
COP (Rated)	W/W		3.44 (3.86 ~ 2.24)	3.67 (4.25 ~ 3.03)	3.29 (3.86 ~ 2.93)	3.69 (4.25 ~ 3.25)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 12.7	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		30	
Max. Interunit Height Difference	m		15		20	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS42G2V1B		ATXS50G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.1 (321)	11.2 (395)	10.2 (360)	11.0 (388)
	M		7.7 (273)	9.4 (333)	8.6 (305)	9.3 (330)
	L		6.3 (221)	7.7 (271)	7.0 (246)	7.6 (267)
	SL		5.4 (190)	6.8 (240)	6.0 (212)	6.7 (236)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.11 - 0.11 - 0.10	0.14 - 0.14 - 0.13	0.12 - 0.12 - 0.11	0.15 - 0.14 - 0.14
Power Consumption (Rated)	W		24 - 24 - 24	30 - 30 - 30	26 - 26 - 26	32 - 32 - 32
Power Factor	%		99.2 - 94.9 - 100.0	97.4 - 93.2 - 96.2	98.5 - 94.2 - 98.5	97.0 - 99.4 - 95.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		274 x 870 x 366		274 x 870 x 366	
Weight (Mass)	kg		10		10	
Gross Weight (Gross Mass)	kg		13		13	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 38 / 33 / 30	42 / 38 / 33 / 30	43 / 39 / 34 / 31	44 / 39 / 34 / 31
Sound Power Level		dB	58	58	59	60
Outdoor Unit			ARXS42G2V1B		ARXS50G2V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		2YC36BXD		2YC36BXD	
Refrigerant Oil	Motor Output	W	1,100		1,100	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.65		0.65	
	Type		R-410A		R-410A	
Airflow Rate	H	m³/min (cfm)	37.3 (1,317)	31.3 (1,107)	50.9 (1,797)	45.0 (1,589)
	SL		30.6 (1,079)	27.2 (959)	48.9 (1,727)	43.1 (1,522)
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		53	
Running Current (Rated)	A		6.04 - 5.78 - 5.54	7.27 - 6.96 - 6.67	6.93 - 6.63 - 6.35	7.13 - 6.82 - 6.54
Power Consumption (Rated)	W		1,196 - 1,196 - 1,196	1,440 - 1,440 - 1,440	1,494 - 1,494 - 1,494	1,538 - 1,538 - 1,538
Power Factor	%		90.0 - 90.0 - 90.0	90.0 - 90.0 - 90.0	98.0 - 98.0 - 98.0	98.0 - 98.0 - 98.0
Starting Current	A		7.4		7.3	
Dimensions (H x W x D)	mm		550 x 765 x 285		735 x 825 x 300	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		797 x 960 x 390	
Weight (Mass)	kg		39		48	
Gross Weight (Gross Mass)	kg		45		53	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45	48 / 44	48 / 45
Sound Power Level	H	dB	63	63	62	62
Drawing No.			3D059735		3D059736	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW × 860 Btu/h = kW × 3412 cfm = m³/min × 35.3

50 Hz, 220 - 230 - 240 V

Models	Indoor Unit		ATXS42G2V1B		ATXS50G2V1B	
	Outdoor Unit		ARXS42G3V1B		ARXS50G3V1B	
			Cooling	Heating	Cooling	Heating
Capacity Rated (Min. ~ Max.)	kW		4.2 (1.7 ~ 5.0)	5.4 (1.7 ~ 6.0)	5.0 (1.7 ~ 5.3)	5.8 (1.7 ~ 6.5)
	Btu/h		14,300 (5,800 ~ 17,100)	18,400 (5,800 ~ 20,500)	17,100 (5,800 ~ 18,100)	19,800 (5,800 ~ 22,200)
	kcal/h		3,610 (1,460 ~ 4,300)	4,640 (1,460 ~ 5,160)	4,300 (1,460 ~ 4,560)	4,990 (1,460 ~ 5,590)
Moisture Removal	L/h		2.3	—	2.8	—
Running Current (Rated)	A		6.2 - 5.9 - 5.6	7.4 - 7.1 - 6.8	7.1 - 6.7 - 6.5	7.3 - 7.0 - 6.7
Power Consumption Rated (Min. ~ Max.)	W		1,220 (440 ~ 2,230)	1,470 (400 ~ 1,980)	1,520 (440 ~ 1,810)	1,570 (400 ~ 2,000)
Power Factor	%		89.4 - 89.9 - 90.8	90.3 - 90.0 - 90.1	97.3 - 98.6 - 97.4	97.8 - 97.5 - 97.6
COP (Rated)	W/W		3.44 (3.86 ~ 2.24)	3.67 (4.25 ~ 3.03)	3.29 (3.86 ~ 2.93)	3.69 (4.25 ~ 3.25)
Piping Connections	Liquid	mm	φ 6.4		φ 6.4	
	Gas	mm	φ 9.5		φ 12.7	
	Drain	mm	φ 18.0		φ 18.0	
Heat Insulation			Both Liquid and Gas Pipes		Both Liquid and Gas Pipes	
Max. Interunit Piping Length	m		20		30	
Max. Interunit Height Difference	m		15		20	
Chargeless	m		10		10	
Amount of Additional Charge of Refrigerant	g/m		20		20	
Indoor Unit			ATXS42G2V1B		ATXS50G2V1B	
Front Panel Color			White		White	
Airflow Rate	H	m³/min (cfm)	9.1 (321)	11.2 (395)	10.2 (360)	11.0 (388)
	M		7.7 (273)	9.4 (333)	8.6 (305)	9.3 (330)
	L		6.3 (221)	7.7 (271)	7.0 (246)	7.6 (267)
	SL		5.4 (190)	6.8 (240)	6.0 (212)	6.7 (236)
Fan	Type		Cross Flow Fan		Cross Flow Fan	
	Motor Output	W	23		23	
	Speed	Steps	5 Steps, Quiet, Auto		5 Steps, Quiet, Auto	
Air Direction Control			Right, Left, Horizontal, Downward		Right, Left, Horizontal, Downward	
Air Filter			Removable / Washable / Mildew Proof		Removable / Washable / Mildew Proof	
Running Current (Rated)	A		0.11 - 0.11 - 0.10	0.14 - 0.14 - 0.13	0.12 - 0.12 - 0.11	0.15 - 0.14 - 0.14
Power Consumption (Rated)	W		24 - 24 - 24	30 - 30 - 30	26 - 26 - 26	32 - 32 - 32
Power Factor	%		99.2 - 94.9 - 100.0	97.4 - 93.2 - 96.2	98.5 - 94.2 - 98.5	97.0 - 99.4 - 95.2
Temperature Control			Microcomputer Control		Microcomputer Control	
Dimensions (H x W x D)	mm		295 x 800 x 215		295 x 800 x 215	
Packaged Dimensions (H x W x D)	mm		289 x 870 x 366		289 x 870 x 366	
Weight (Mass)	kg		10		10	
Gross Weight (Gross Mass)	kg		14		14	
Sound Pressure Level	H / M / L / SL	dB(A)	42 / 38 / 33 / 30	42 / 38 / 33 / 30	43 / 39 / 34 / 31	44 / 39 / 34 / 31
Sound Power Level		dB	59	59	60	61
Outdoor Unit			ARXS42G3V1B		ARXS50G3V1B	
Casing Color			Ivory White		Ivory White	
Compressor	Type		Hermetically Sealed Swing Type		Hermetically Sealed Swing Type	
	Model		2YC36BXD		2YC36BXD	
Refrigerant Oil	Motor Output	W	1,100		1,100	
	Type		FVC50K		FVC50K	
Refrigerant	Charge	L	0.65		0.65	
	Type		R-410A		R-410A	
Airflow Rate	Charge	kg	1.30		1.70	
	H	m³/min (cfm)	37.3 (1,317)	31.3 (1,107)	50.9 (1,797)	45.0 (1,589)
SL	30.6 (1,079)		27.2 (959)	48.9 (1,727)	43.1 (1,522)	
Fan	Type		Propeller		Propeller	
	Motor Output	W	50		53	
Running Current (Rated)	A		6.09 - 5.79 - 5.50	7.26 - 6.96 - 6.67	6.93 - 6.63 - 6.35	7.13 - 6.82 - 6.54
Power Consumption (Rated)	W		1,196 - 1,196 - 1,196	1,440 - 1,440 - 1,440	1,494 - 1,494 - 1,494	1,538 - 1,538 - 1,538
Power Factor	%		89.3 - 89.8 - 90.6	90.2 - 90.0 - 90.0	98.0 - 98.0 - 98.0	98.0 - 98.0 - 98.0
Starting Current	A		7.4		7.3	
Dimensions (H x W x D)	mm		550 x 765 x 285		735 x 825 x 300	
Packaged Dimensions (H x W x D)	mm		612 x 906 x 364		797 x 992 x 390	
Weight (Mass)	kg		39		47	
Gross Weight (Gross Mass)	kg		45		52	
Sound Pressure Level	H / SL	dB(A)	48 / 44	48 / 45	48 / 44	48 / 45
Sound Power Level	H	dB	63	63	63	63
Drawing No.			3D080181		3D081101	

Note: ■ The data are based on the conditions shown in the table below.

Cooling	Heating	Piping Length
Indoor ; 27°CDB / 19°CWB Outdoor ; 35°CDB / 24°CWB	Indoor ; 20°CDB Outdoor ; 7°CDB / 6°CWB	5 m

Conversion Formulae
kcal/h = kW x 860 Btu/h = kW x 3412 cfm = m³/min x 35.3

Part 3

Printed Circuit Board


Connector Wiring Diagram

1. Indoor Unit.....	22
2. Outdoor Unit.....	24
2.1 RK(X)S20-35G2V1B, ARXS20-35G2V1B.....	24
2.2 RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B	26
2.3 RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B.....	28
2.4 RK(X)S50G2V1B, ARXS50G2V1B	29
2.5 ARXS50G3V1B	30

1. Indoor Unit

Control PCB

- | | |
|----------------|--|
| 1) S1 | Connector for fan motor |
| 2) S21 | Connector for centralized control (HA) |
| 3) S25 | Connector for INTELLIGENT EYE sensor PCB |
| 4) S32 | Connector for indoor heat exchanger thermistor |
| 5) S41 | Connector for swing motors |
| 6) S46 | Connector for display PCB |
| 7) S47 | Connector for signal receiver PCB |
| 8) H1, H2, H3, | Connector for terminal board (indoor - outdoor transmission) |
| 9) FG | Connector for terminal board (frame ground) |
| 10) JA | Address setting jumper |
| | * Refer to page 150 for detail. |
| 11) JB | Fan speed setting when compressor stops for thermostat OFF |
| JC | Power failure recovery function (auto-restart) |
| | * Refer to page 154 for detail. |
| 12) LED A | LED for service monitor (green) |
| 13) FU1 (F1U) | Fuse (3.15 A, 250 V) |
| 14) V1 | Varistor |

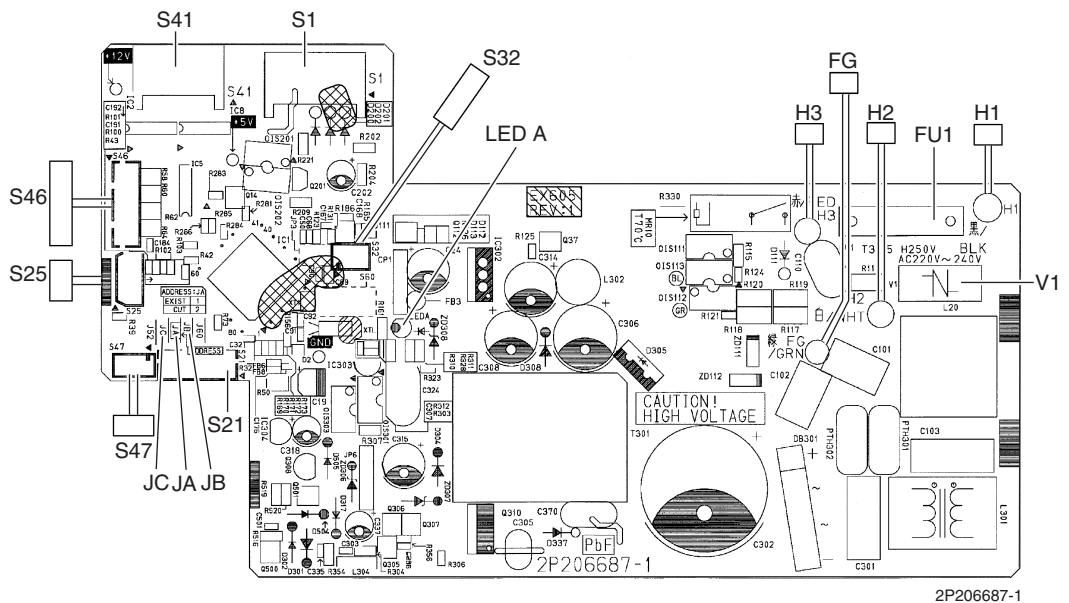


Caution

Replace the PCB if you accidentally cut the jumpers other than JA, JB, and JC.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.


Signal Receiver PCB

- 1) S48 Connector for control PCB

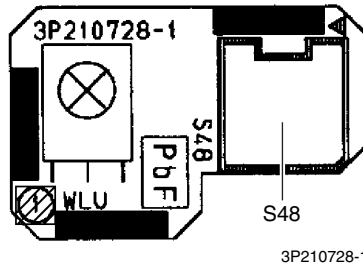


Display PCB

- 1) S49 Connector for control PCB
- 2) SW1 (S1W) Forced cooling operation [ON/OFF] button
* Refer to page 146 for detail.
- 3) LED1 (H1P) LED for operation (green)
- 4) LED2 (H2P) LED for timer (yellow)
- 5) LED3 (H3P) LED for INTELLIGENT EYE (green)
- 6) RTH1 (R1T) Room temperature thermistor

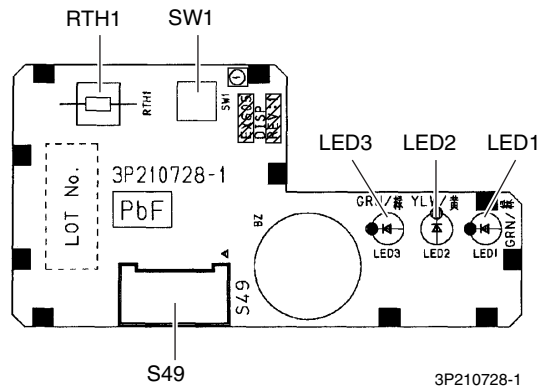

INTELLIGENT EYE Sensor PCB

- 1) S26 Connector for control PCB

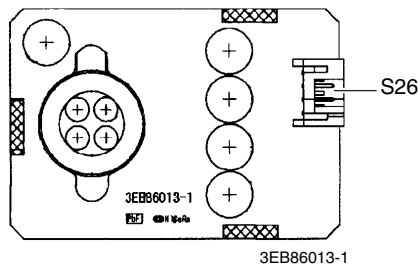


2. Outdoor Unit

2.1 RK(X)S20-35G2V1B, ARXS20-35G2V1B

Main PCB

- | | |
|--------------|--|
| 1) S10 | Connector for filter PCB |
| 2) S20 | Connector for electronic expansion valve coil |
| 3) S30 | Connector for compressor |
| 4) S40 | Connector for overload protector |
| 5) S50 | Connector for magnetic relay |
| 6) S70 | Connector for fan motor |
| 7) S80 | Connector for four way valve coil |
| 8) S90 | Connector for thermistors
(outdoor temperature, outdoor heat exchanger, discharge pipe) |
| 9) HL3, HN3 | Connector for filter PCB |
| 10) HR2 | Connector for reactor |
| 11) FU1, FU2 | Fuse (3.15 A, 250 V) |
| 12) LED A | LED for service monitor (green) |
| 13) V1 | Varistor |
| 14) J5 | Jumper for improvement of defrost performance
* Refer to page 154 for detail. |
| 15) J8 | Jumper for facility setting
* Refer to page 152 for detail. |
| 16) SW1 | Forced cooling operation [ON/OFF] button
* Refer to page 146 for detail. |

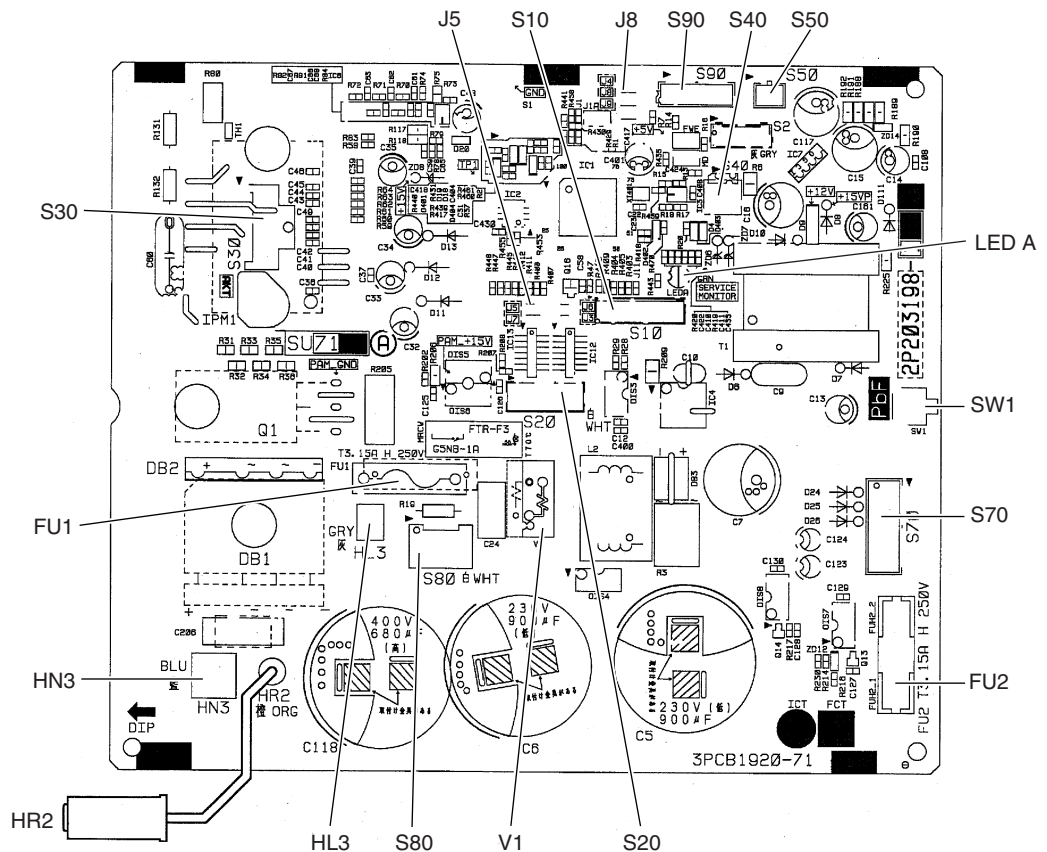

2P203198-1




Caution

Replace the PCB if you accidentally cut the jumpers other than J5 and J8.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

Filter PCB


- | | |
|----------------|---|
| 1) S11 | Connector for main PCB |
| 2) HL1, HN1, S | Connector for terminal board |
| 3) E1 | Terminal for earth wire |
| 4) E2 | Connector for terminal board (earth wire) |
| 5) HL2, HN2 | Connector for main PCB |
| 6) HR1 | Connector for reactor |
| 7) FU3 | Fuse (20 A, 250 V) |
| 8) V2, V3 | Varistor |

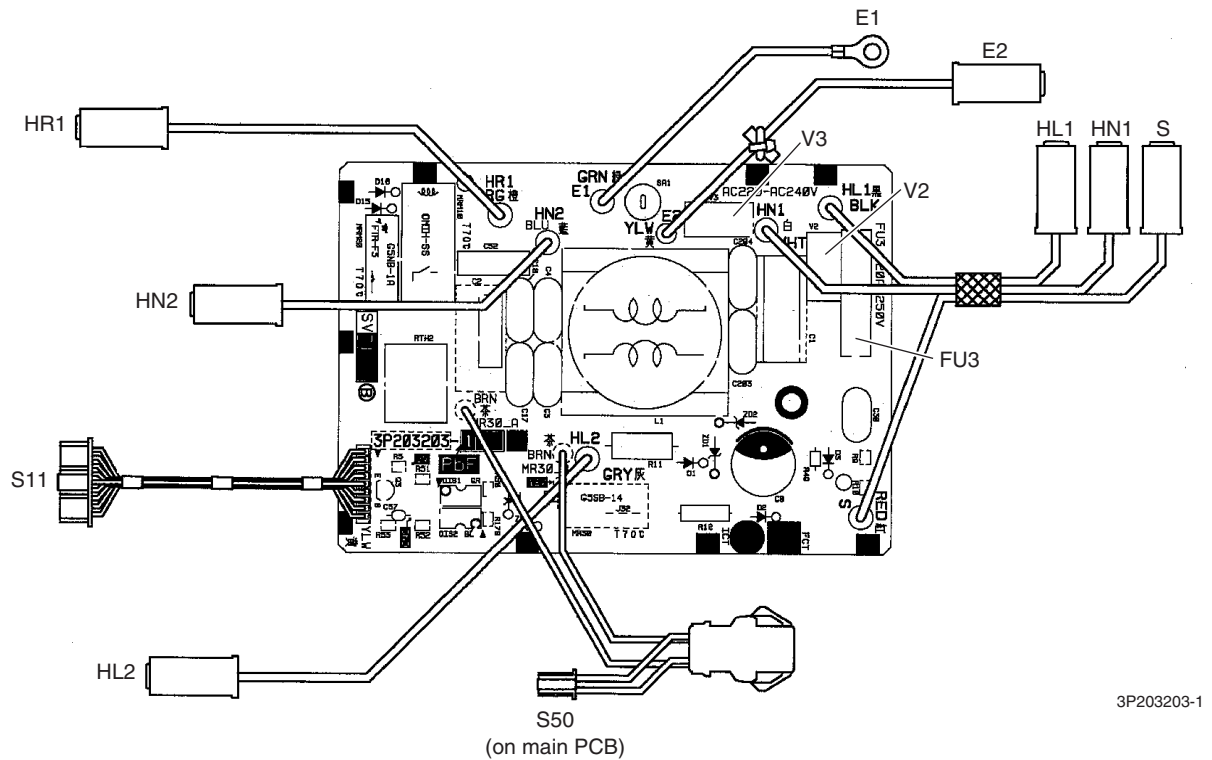

2.2 RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B

Main PCB

- | | |
|-------------|--|
| 1) S10 | Connector for filter PCB |
| 2) S20 | Connector for electronic expansion valve coil |
| 3) S40 | Connector for overload protector |
| 4) S50 | Connector for magnetic relay |
| 5) S70 | Connector for fan motor |
| 6) S80 | Connector for four way valve coil |
| 7) S90 | Connector for thermistors
(outdoor temperature, outdoor heat exchanger, discharge pipe) |
| 8) S100 | Connector for forced operation button PCB |
| 9) HL3, HN3 | Connector for filter PCB |
| 10)HR2 | Connector for reactor |
| 11)U, V, W | Connector for compressor |
| 12)FU2 | Fuse (3.15 A, 250 V) |
| 13)LED A | LED for service monitor (green) |
| 14)V1 | Varistor |
| 15)J4 | Jumper for facility setting
* Refer to page 152 for detail. |
| 16)J5 | Jumper for improvement of defrost performance
* Refer to page 154 for detail. |

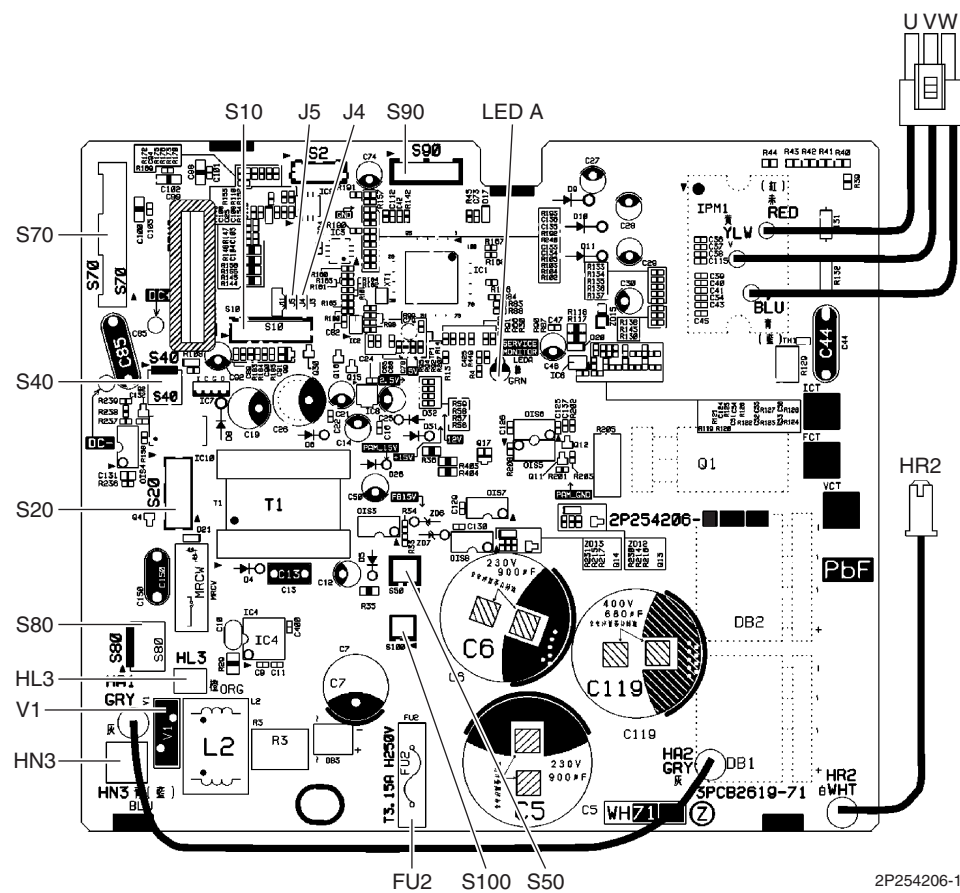

2P254206-1
2P254206-11




Caution

Replace the PCB if you accidentally cut the jumpers other than J4 and J5.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.


Filter PCB

- 1) S11 Connector for main PCB
- 2) AC1, AC2, S Connector for terminal board
- 3) E1, E2 Terminal for earth wire
- 4) HL2, HN2 Connector for main PCB
- 5) HR1 Connector for reactor
- 6) FU1 Fuse (3.15 A, 250 V)
- 7) FU3 Fuse (20 A, 250 V)
- 8) V2, V3 Varistor

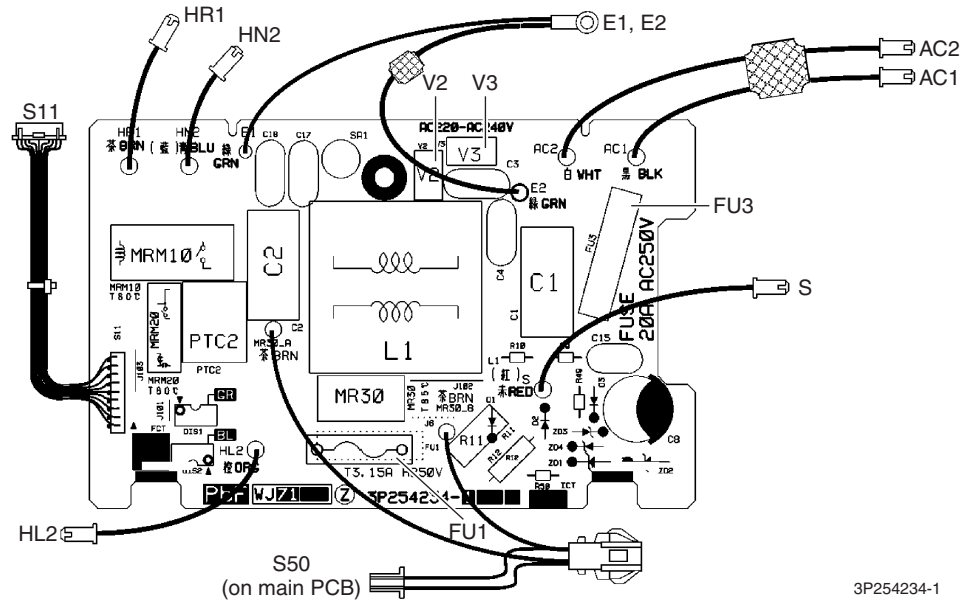

Forced Operation Button PCB


- 1) S110 Connector for main PCB
- 2) SW1 Forced cooling operation [ON/OFF] button
* Refer to page 146 for detail.



2.3 RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B

Main PCB

- | | |
|----------------|--|
| 1) S20 | Connector for electronic expansion valve coil |
| 2) S40 | Connector for overload protector |
| 3) S70 | Connector for fan motor |
| 4) S80 | Connector for four way valve coil |
| 5) S90 | Connector for thermistors
(outdoor temperature, outdoor heat exchanger, discharge pipe) |
| 6) U, V, W | Connector for compressor |
| 7) HL1, HN1, S | Connector for terminal board |
| 8) E (E2) | Connector for earth wire |
| 9) HR1, HR2 | Connector for reactor |
| 10) LED A | LED for service monitor (green) |
| 11) FU1, FU2 | Fuse (3.15 A, 250 V) |
| 12) FU3 | Fuse (30 A, 250 V) |
| 13) J4 | Jumper for facility setting
* Refer to page 152 for detail. |
| 14) J5 | Jumper for improvement of defrost performance
* Refer to page 154 for detail. |
| 15) V1, V3, V4 | Varistor |

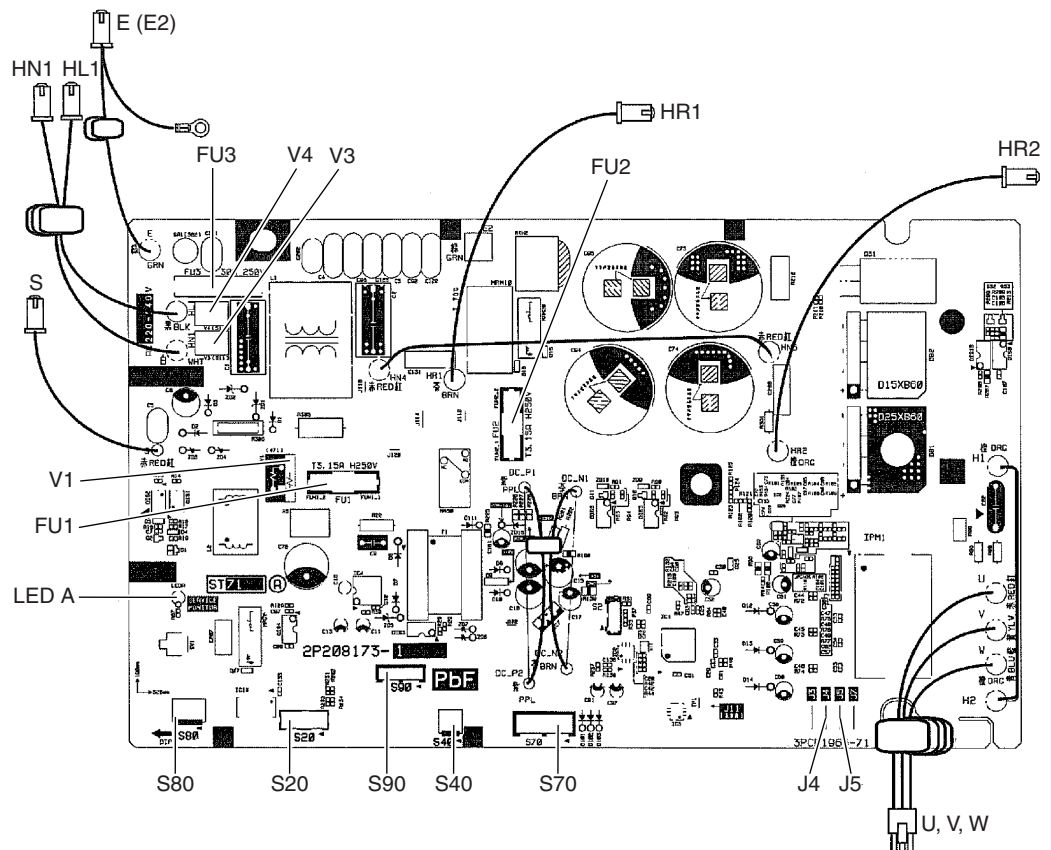

2P208173-1
2P208173-2



Caution


Replace the PCB if you accidentally cut the jumpers other than J4 and J5.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

2.4 RK(X)S50G2V1B, ARXS50G2V1B


Main PCB

- | | |
|---------------------------|--|
| 1) S10 | Connector for terminal board (indoor - outdoor transmission) |
| 2) S20 | Connector for electronic expansion valve coil |
| 3) S40 | Connector for overload protector |
| 4) S51, S101 | Connector for service monitor PCB |
| 5) S70 | Connector for fan motor |
| 6) S80 | Connector for four way valve coil |
| 7) S90 | Connector for thermistors
(outdoor temperature, outdoor heat exchanger, discharge pipe) |
| 8) AC1, AC2 | Connector for terminal board (power supply) |
| 9) E1, E2 | Connector for earth wire |
| 10) HR1, HR2 | Connector for reactor |
| 11) U, V, W | Connector for compressor |
| 12) FU1 | Fuse (30 A, 250 V) |
| 13) FU2, FU3 | Fuse (3.15 A, 250 V) |
| 14) V2, V3, V5
V6, V11 | Varistor |

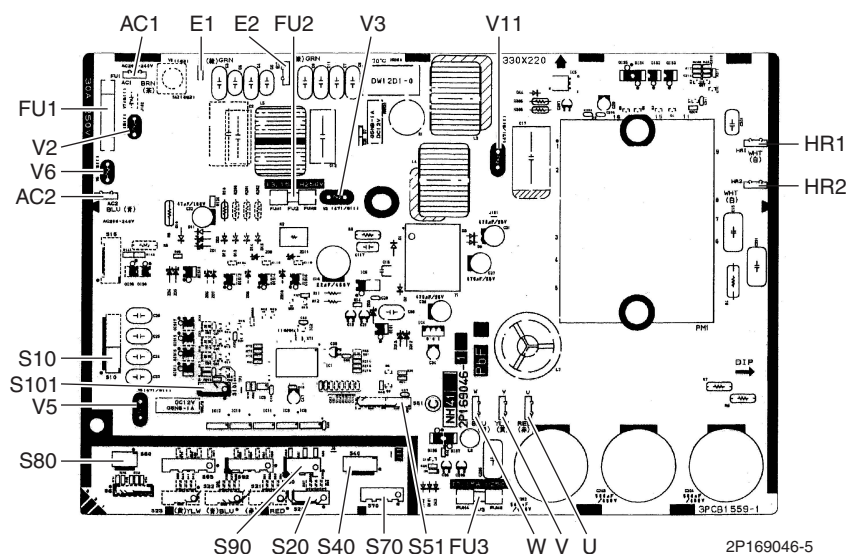

Service Monitor PCB

- | | |
|--------------|--|
| 1) S52, S102 | Connector for main PCB |
| 2) LED A | LED for service monitor (green) |
| 3) SW1 | Forced cooling operation [ON/OFF] button
* Refer to page 146 for detail |
| 4) SW4-B | Switch for facility setting
* Refer to page 152 for detail |
| SW4-C | Switch for improvement of defrost performance
* Refer to page 154 for detail. |

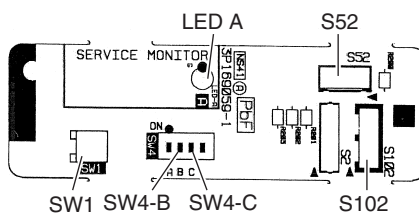


3P169059-1

★ SW4-A has no function. Keep it OFF.

2.5 ARXS50G3V1B

Main PCB

- 1) S10 Connector for [S11] on filter PCB
- 2) S12 Connector for [HL4] [HN4] on filter PCB
- 3) S20 Connector for electronic expansion valve coil
- 4) S40 Connector for overload protector
- 5) S50 Connector for magnetic relay
- 6) S70 Connector for fan motor
- 7) S80 Connector for four way valve coil
- 8) S90 Connector for thermistors
(outdoor temperature, outdoor heat exchanger, discharge pipe)
- 9) HL3, HN3 Connector for [HL2] [HN2] on filter PCB
- 10) U, V, W Terminal for compressor
- 11) FU2 Fuse (3.15 A, 250 V)
- 12) LED A LED for service monitor (green)
- 13) V1 Varistor
- 14) J6 Jumper for facility setting
* Refer to page 152 for detail.
- 15) J8 Jumper for improvement of defrost performance
* Refer to page 154 for detail.

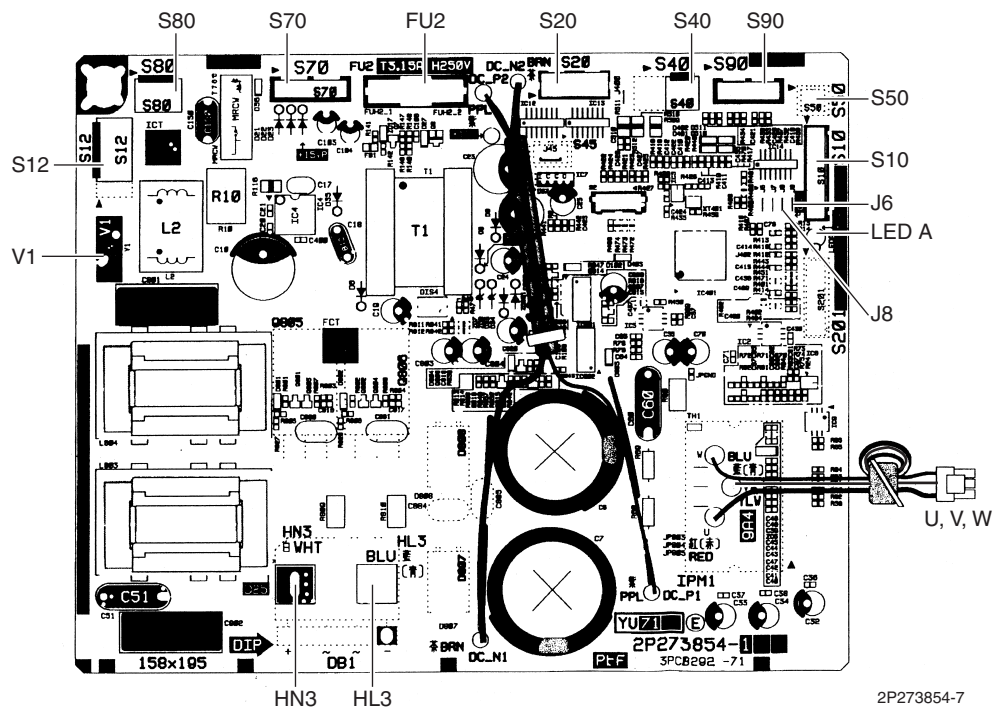


Caution

Replace the PCB if you accidentally cut the jumpers other than J6 and J8.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

Filter PCB

- 1) S11 Connector for [S10] on main PCB
 - 2) HL1, HN1, S Connector for terminal board
 - 3) E1, E2 Terminal for earth wire
 - 4) HL2, HN2 Connector for [HL3] [HN3] on main PCB
 - 5) HL4, HN4 Connector for [S12] on main PCB
 - 6) FU1 Fuse (3.15 A, 250 V)
 - 7) FU3 Fuse (30 A, 250 V)
 - 8) V2, V3 Varistor
 - 9) SW1 Forced cooling operation [ON/OFF] button
- * Refer to page 146 for detail.

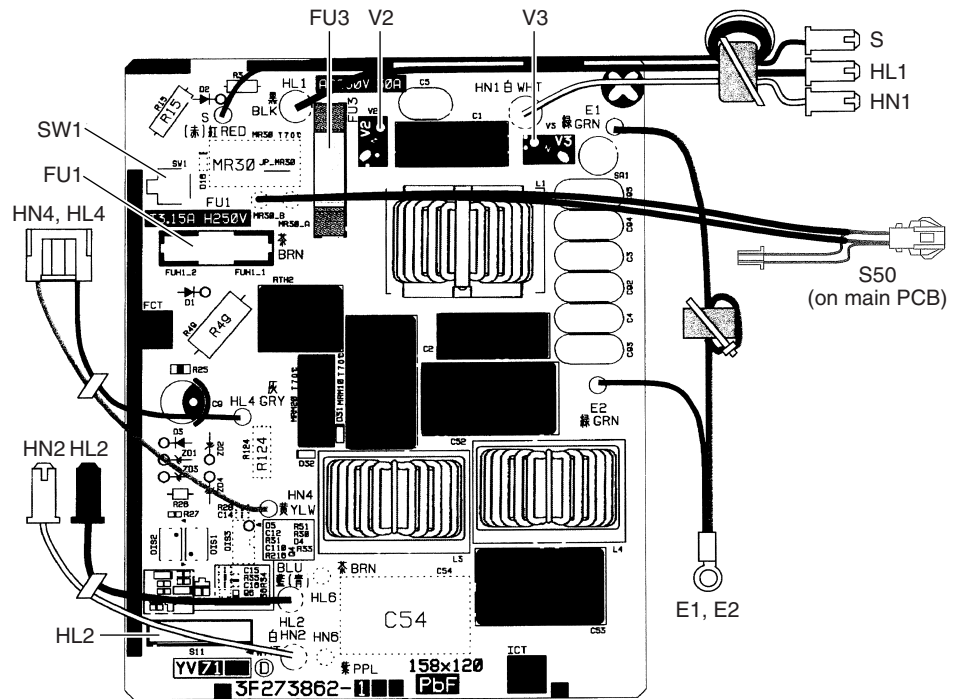

3P273862-4

Part 4

Function and Control

1. Main Functions.....	33
1.1 Temperature Control.....	33
1.2 Frequency Principle.....	33
1.3 Airflow Direction Control.....	35
1.4 Fan Speed Control for Indoor Unit.....	36
1.5 Program Dry Operation.....	37
1.6 Automatic Operation.....	38
1.7 Thermostat Control.....	39
1.8 NIGHT SET Mode.....	40
1.9 ECONO Operation.....	41
1.10 2-Area INTELLIGENT EYE Operation.....	42
1.11 INTELLIGENT EYE Operation.....	44
1.12 Inverter POWERFUL Operation.....	45
1.13 Clock Setting.....	46
1.14 WEEKLY TIMER Operation.....	47
1.15 Other Functions.....	55
2. Function of Thermistor.....	56
3. Control Specification.....	57
3.1 Mode Hierarchy.....	57
3.2 Frequency Control.....	58
3.3 Controls at Mode Changing / Start-up.....	60
3.4 Discharge Pipe Temperature Control.....	62
3.5 Input Current Control.....	63
3.6 Freeze-up Protection Control.....	65
3.7 Heating Peak-cut Control.....	65
3.8 Outdoor Fan Control.....	66
3.9 Liquid Compression Protection Function.....	66
3.10 Defrost Control.....	67
3.11 Electronic Expansion Valve Control.....	68
3.12 Malfunctions.....	71


1. Main Functions

1.1 Temperature Control

Definitions of Temperatures

The definitions of temperatures are classified as following.

- ◆ Room temperature: temperature of lower part of the room
- ◆ Set temperature: temperature set by remote controller
- ◆ Room thermistor temperature: temperature detected by room temperature thermistor
- ◆ Target temperature: temperature determined by microcomputer

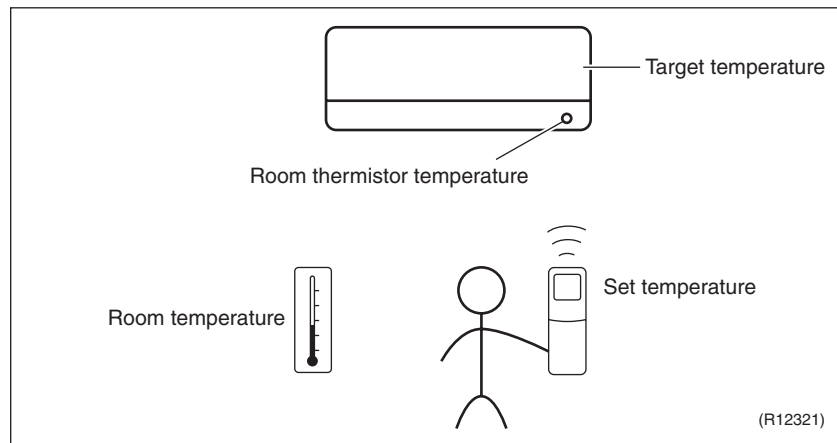

Temperature Control

The temperature of the room is detected by the room temperature thermistor. However, there is a difference between the “temperature detected by room temperature thermistor” and the “temperature of lower part of the room”, depending on the type of the indoor unit or installation condition. Practically, the temperature control is done by the “target temperature appropriately adjusted for the indoor unit” and the “temperature detected by room temperature thermistor”.

1.2 Frequency Principle

Main Control Parameters

The frequency of the compressor is controlled by the following 2 parameters:

- The load condition of the operating indoor unit
- The difference between the room thermistor temperature and the target temperature

Additional Control Parameters

The target frequency is adapted by additional parameters in the following cases:

- Frequency restrictions
- Initial settings
- Forced cooling operation


Inverter Principle

To regulate the capacity, a frequency control is needed. The inverter makes it possible to alter the rotation speed of the compressor. The following table explains the conversion principle:

Phase	Description
1	The supplied AC power source is converted into the DC power source for the present.
2	The DC power source is reconverted into the three phase AC power source with variable frequency. <ul style="list-style-type: none"> ■ When the frequency increases, the rotation speed of the compressor increases resulting in an increased refrigerant circulation. This leads to a higher amount of the heat exchange per unit. ■ When the frequency decreases, the rotation speed of the compressor decreases resulting in a decreased refrigerant circulation. This leads to a lower amount of the heat exchange per unit.

Drawing of Inverter

The following drawing shows a schematic view of the inverter principle:

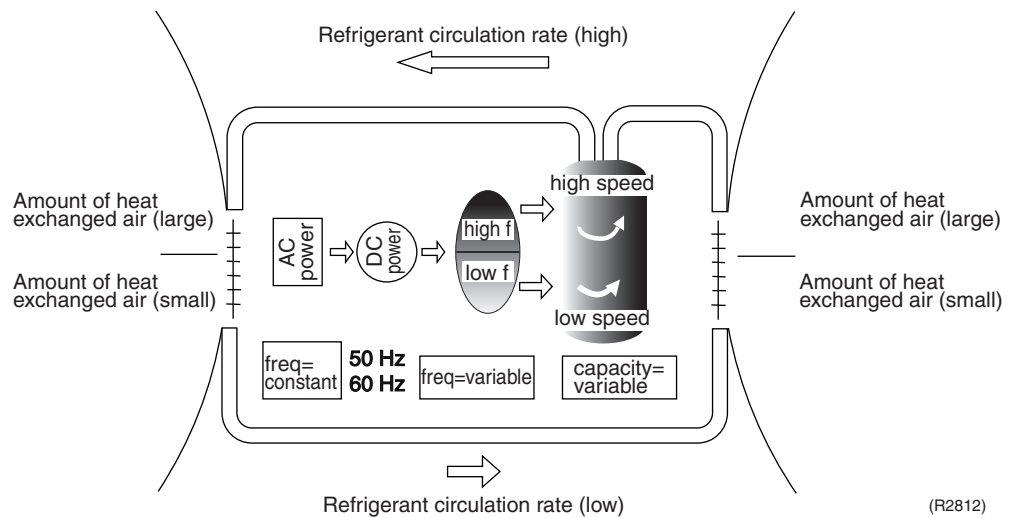

Inverter Features

The inverter provides the following features:

- The regulating capacity can be changed according to the changes in the outdoor temperature and cooling / heating load.
- Quick heating and quick cooling
The rotation speed of the compressor is increased when starting the heating (or cooling). This enables to reach the set temperature quickly.
- Even during extreme cold weather, high capacity is achieved. It is maintained even when the outdoor temperature is 2°C.
- Comfortable air conditioning
A fine adjustment is integrated to keep the room temperature constant.
- Energy saving heating and cooling
Once the set temperature is reached, the energy saving operation enables to maintain the room temperature at low power.

Frequency Limits

The following functions regulate the minimum and maximum frequency:

Frequency	Functions
Low	<ul style="list-style-type: none"> ■ Four way valve operation compensation. Refer to page 61.
High	<ul style="list-style-type: none"> ■ Compressor protection function. Refer to page 61. ■ Discharge pipe temperature control. Refer to page 62. ■ Input current control. Refer to page 63. ■ Freeze-up protection control. Refer to page 65. ■ Heating peak-cut control. Refer to page 65. ■ Defrost control. Refer to page 67.

Forced Cooling Operation

Refer to page 146 for detail.

1.3 Airflow Direction Control

Power-Airflow Dual Flaps

The large flap sends a large volume of air downward to the floor and provides an optimum control in cooling, dry, and heating operation.

<Cooling / Dry>

During cooling or dry operation, the flap retracts into the indoor unit. Then, cool air can be blown far and distributed all over the room.

<Heating>





During heating operation, the large flap directs airflow downward to spread the warm air to the entire room.

Wide-Angle Louvers

The louvers, made of elastic synthetic resin, provide a wide range of airflow that guarantees comfortable air distribution.

Auto-Swing

The following table explains the auto swing process for cooling, dry, heating, and fan:


Vertical Swing (up and down)			Horizontal Swing (right and left)
Cooling / Dry	Heating	Fan	
 <p>(R12182)</p>	 <p>(R11402)</p>	 <p>(R11403)</p>	 <p>(R11404)</p>

3-D Airflow

Alternative repetition of vertical and horizontal swing motions enables uniform air-conditioning of the entire room. This function is effective for starting the air conditioner.



When the horizontal swing and vertical swing are both set to automatic operation, the airflow becomes 3-D airflow. The horizontal and vertical swing motions are alternated and the airflow direction changes in the order shown in the following diagram.

- (1) The vertical blades (louvers) move from the right to the left.
- (2) The horizontal blades (flaps) move downward.
- (3) The vertical blades (louvers) move from the left to the right.
- (4) The horizontal blades (flaps) move upward.

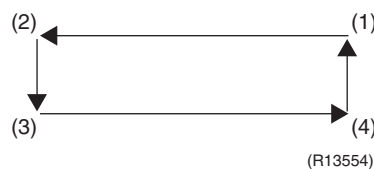

COMFORT AIRFLOW Operation

The vertical swing flap is controlled not to blow the air directly at the people in the room.

Cooling	Heating
 <p>(R11665)</p>	 <p>(R12181)</p>

1.4 Fan Speed Control for Indoor Unit

Outline



Phase control and fan speed control contains 9 steps: LLL, LL, SL, L, ML, M, MH, H, and HH. The airflow rate can be automatically controlled depending on the difference between the room thermistor temperature and the target temperature. This is done through phase control and Hall IC control.




For more information about Hall IC, refer to the troubleshooting for fan motor on page 90.

Automatic Fan Speed Control


In automatic fan speed operation, the step "SL" is not available.

Step	Cooling	Heating
LLL	 (R11681)	 (R6834)
LL		
L		
ML		
M		
MH		
H		
HH (POWERFUL)		

 = The airflow rate is automatically controlled within this range when the [FAN] setting button is set to automatic.

<Cooling>

The following drawing explains the principle of fan speed control for cooling.

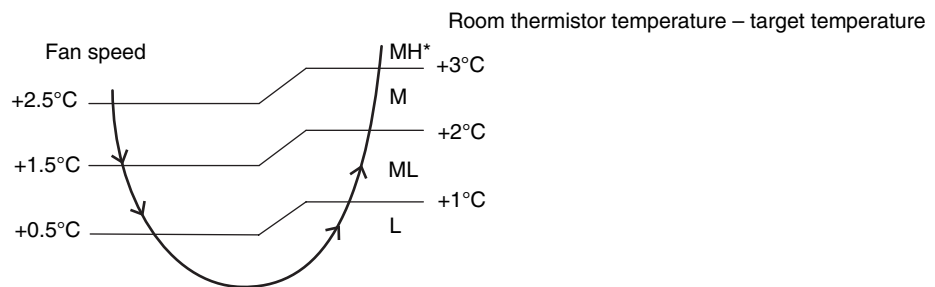

(R14588)

*The upper limit is M tap in 30 minutes from the operation start.

<Heating>

In heating operation, the fan speed is regulated according to the indoor heat exchanger temperature and the difference between the room thermistor temperature and the target temperature.



Note:

1. During POWERFUL operation, the fan rotates at H tap + 50 rpm.
2. The fan stops during defrost control.

COMFORT AIRFLOW Operation

- The fan speed is controlled automatically.
- The latest command has the priority between POWERFUL and COMFORT AIRFLOW.

1.5 Program Dry Operation


Outline

Program dry operation removes humidity while preventing the room temperature from lowering. Since the microcomputer controls both the temperature and airflow rate, the temperature adjustment and [FAN] setting buttons are inoperable.

Detail

The microcomputer automatically sets the temperature and airflow rate. The difference between the room thermistor temperature at start-up and the target temperature is divided into two zones. Then, the unit operates in an appropriate capacity for each zone to maintain the temperature and humidity at a comfortable level.

Room thermistor temperature at start-up	Target temperature X	Thermostat OFF point Y	Thermostat ON point Z
24°C or more	Room thermistor temperature at start-up	X - 2.5°C	X - 0.5°C or Y + 0.5°C (zone B) continues for 10 min.
23.5°C ⋮ 18°C		X - 2.0°C	X - 0.5°C or Y + 0.5°C (zone B) continues for 10 min.
17.5°C ⋮		X - 2.0°C	X - 0.5°C = 17.5°C or Y + 0.5°C (zone B) continues for 10 min.

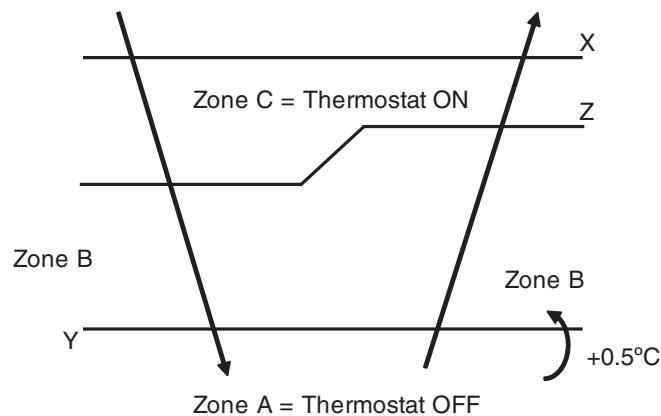

(R11581)

1.6 Automatic Operation

Outline

Automatic Cooling / Heating Function

When the automatic operation is selected with the remote controller, the microcomputer automatically determines the operation mode as cooling or heating according to the room temperature and the set temperature at start-up.

The unit automatically switches the operation mode to maintain the room temperature at the set temperature.

Detail


Ts: set temperature (set by remote controller)

Tt: target temperature (determined by microcomputer)

Tr: room thermistor temperature (detected by room temperature thermistor)

C: correction value

- The set temperature (Ts) determines the target temperature (Tt).
(Ts = 18 ~ 30°C).
- The target temperature (Tt) is calculated as;
 $Tt = Ts + C$
where C is the correction value.
C = 0°C
- Thermostat ON/OFF point and operation mode switching point are as follows.
Tr means the room thermistor temperature.
 - Heating → Cooling switching point:
 $Tr \geq Tt + 2.5^\circ\text{C}$
 - Cooling → Heating switching point:
 $Tr < Tt - 2.5^\circ\text{C}$
 - Thermostat ON/OFF point is the same as the ON/OFF point of cooling or heating operation.
- During initial operation
 - $Tr \geq Ts$: Cooling operation
 - $Tr < Ts$: Heating operation

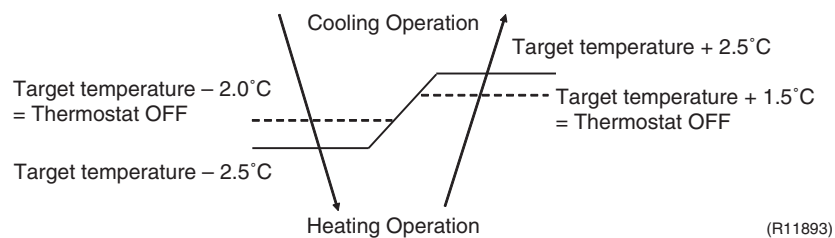

Ex: When the target temperature is 25°C

Cooling → 23°C: Thermostat OFF → 22°C: Switch to heating

Heating → 26.5°C: Thermostat OFF → 27.5°C: Switch to cooling

1.7 Thermostat Control

Outline

Thermostat control is based on the difference between the room thermistor temperature and the target temperature.

Detail


Thermostat OFF Condition

- ◆ The temperature difference is in the zone A.


Thermostat ON Condition

- ◆ The temperature difference returns to the zone C after being in the zone A.
- ◆ The system resumes from defrost control in any zones except A.
- ◆ The operation turns on in any zones except A.
- ◆ The monitoring time has passed while the temperature difference is in the zone B.
(Cooling / Dry: 10 minutes, Heating: 10 seconds)

<Cooling / Dry>

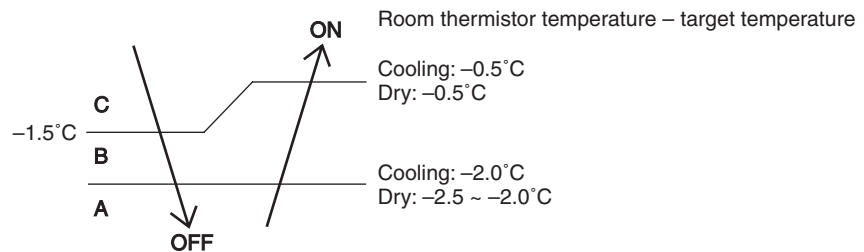

<Heating>

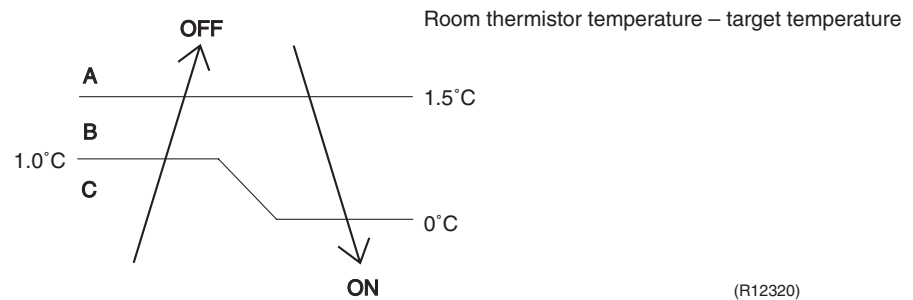


Refer to “Temperature Control” on page 33 for detail.

1.8 NIGHT SET Mode

Outline When the OFF TIMER is set, the NIGHT SET Mode is automatically activated. The NIGHT SET Mode keeps the airflow rate setting.


Detail The NIGHT SET Mode continues operation at the target temperature for the first one hour, then automatically raises the target temperature slightly in the case of cooling, or lowers it slightly in the case of heating. This prevents excessive cooling in summer and excessive heating in winter to ensure comfortable sleeping conditions, and also conserves electricity.

<Cooling>

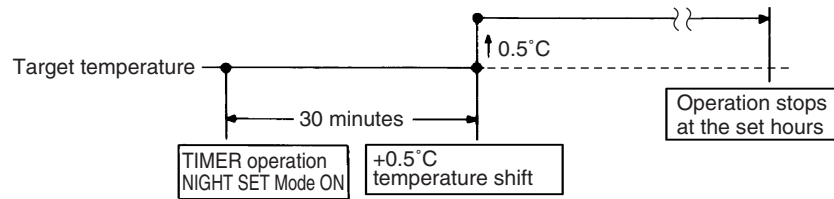

(R18034)

<Heating>

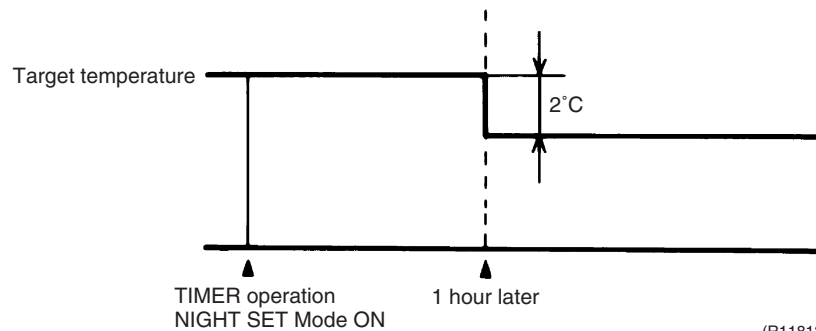

(R11813)


1.9 ECONO Operation

Outline

ECONO operation reduces the maximum operating current and the power consumption. This operation is particularly convenient for energy-saving-oriented users. It is also a major bonus for those whose breaker capacities do not allow the use of multiple electrical devices and air conditioners. It is easily activated from the wireless remote controller by pushing the [ECONO] button.

Detail

- When this function is activated, the maximum capacity also decreases.
- The remote controller can send the ECONO command when the unit is in cooling, heating, dry, or automatic operation. This function can only be set when the unit is running. Pressing the [ON/OFF] button on the remote controller cancels the function.
- This function and POWERFUL operation cannot be used at the same time. The latest command has the priority.

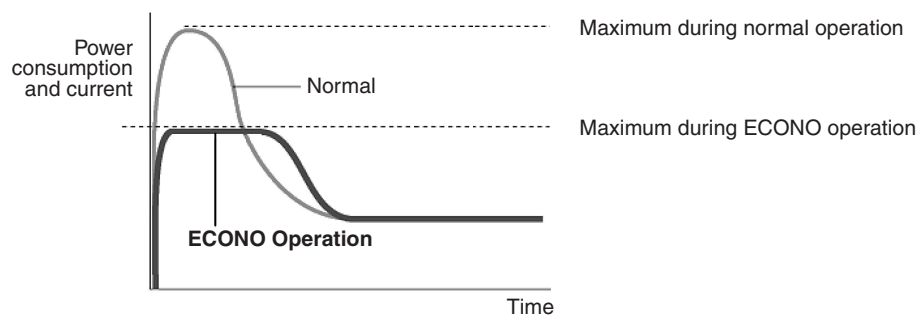

(R9288)

1.10 2-Area INTELLIGENT EYE Operation

Outline


FTK(X)S Series

The following functions can be performed by a motion sensor (INTELLIGENT EYE).


1. Reduction of the capacity when there is nobody in the room in order to save electricity (energy saving operation)
2. Dividing the room into plural areas and detecting existence of humans in each area. Moving the airflow direction to the area with no human automatically to avoid direct airflow on humans.

Detail

1. Detection method of INTELLIGENT EYE

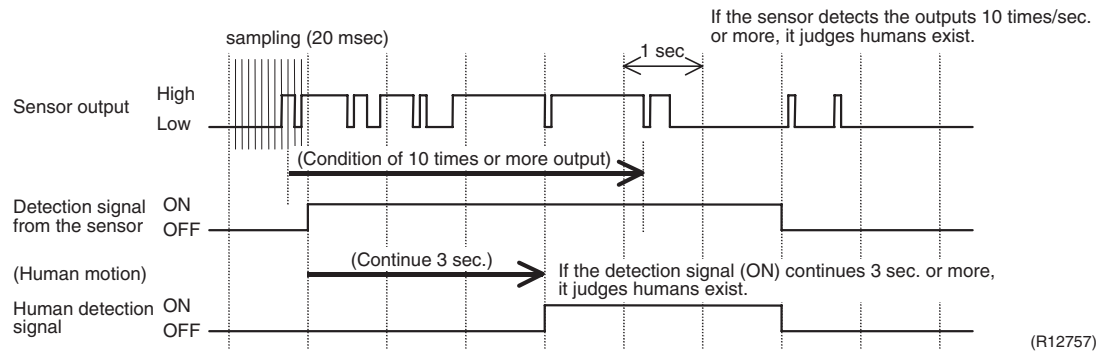


- This sensor detects human motion by receiving infrared rays and displays the pulse wave output.
- The microcomputer in the indoor unit carries out a sampling every 20 msec. and if it detects 10 cycles of the wave in one second in total (corresponding to $20 \text{ msec.} \times 10 = 200 \text{ msec.}$), and when the ON signal continues 3 sec., it judges human is in the room as the motion signal is ON
- 2-area INTELLIGENT EYE sensor is divided into 2 areas and detects humans in each area.
- Image of 2-area INTELLIGENT EYE

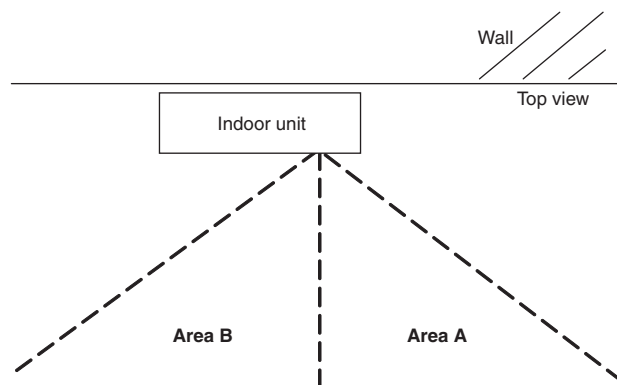

· A microcomputer judges human existence by the sensor signal from each area A and B.

(R12276)


2. Motions (for example: in cooling)

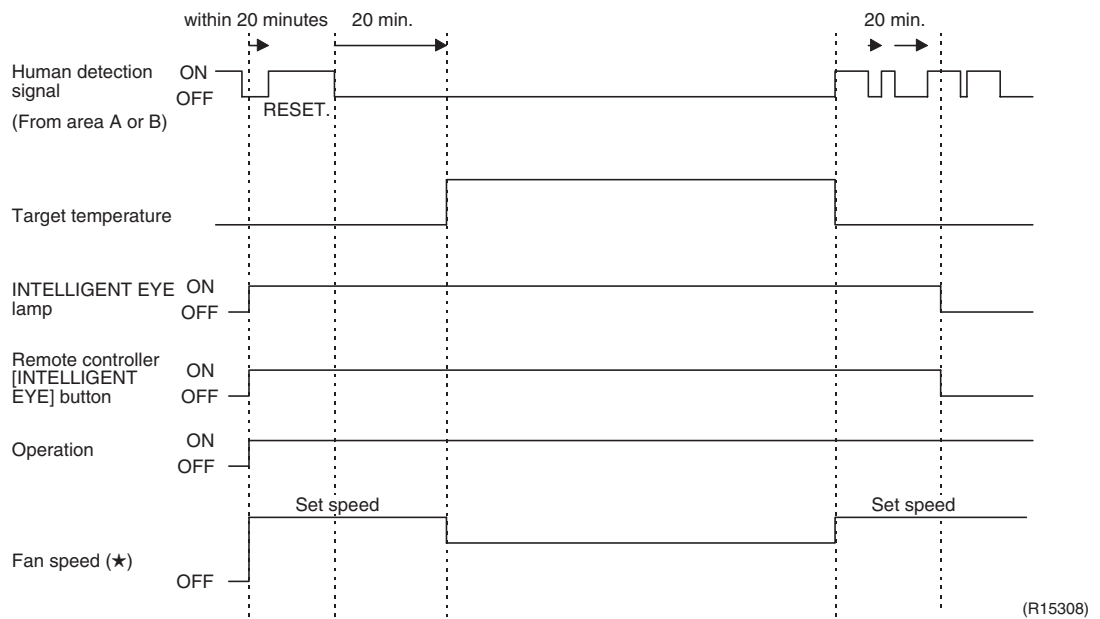

- When the microcomputer does not have a signal from the sensor in 20 minutes, it judges that nobody is in the room and operates the unit in temperature shifted from the target temperature. (Cooling / Dry: 2°C higher, Heating: 2°C lower, Auto: according to the operation mode at that time.)
- ★ In case of FAN operation, the fan speed reduces by 60 rpm.

3. Airflow direction in 2-area INTELLIGENT EYE operation

- Detection method: The opposite area of detected area is set as the target direction.

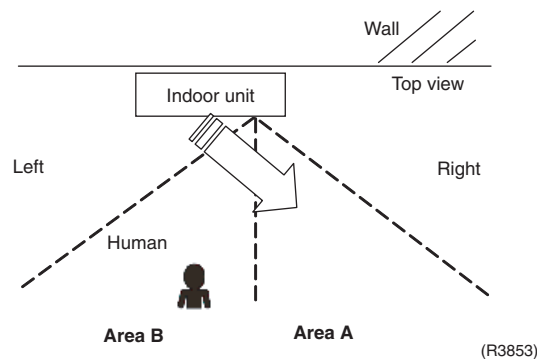

1. Detection signal ON in both area A and B: Shift the airflow direction to area B (left side)
2. Detection signal ON in area A: Shift the airflow direction to area B (left side)
3. Detection signal ON in area B: Shift the airflow direction to area A (right side)
4. Detection signal OFF in both area A and B: No change

- * When the detection signal is OFF for 20 minutes in both area A and B, the unit starts energy saving operation.

Others

- For dry operation, you cannot set the temperature with remote controller, but internally the target temperature is shifted.

1.11 INTELLIGENT EYE Operation


Outline

ATXS Series

This function detects the existence of humans in the room with a motion sensor (INTELLIGENT EYE) and reduces the capacity when there is nobody in the room in order to save electricity.


Detail

1. Detection method by INTELLIGENT EYE

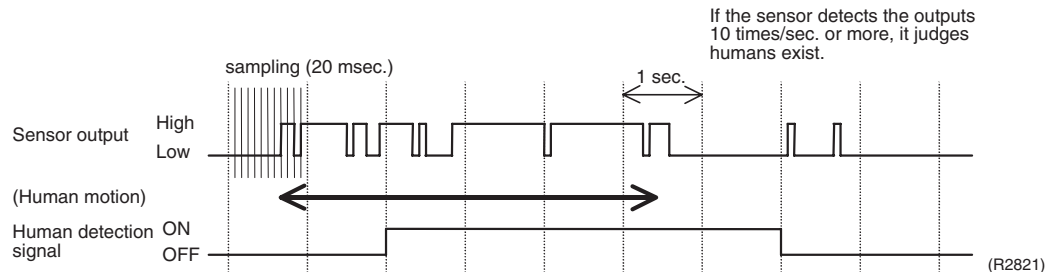

- The sensor detects human motion by receiving infrared rays and displays the pulse wave output.
- The microcomputer in the indoor unit carries out a sampling every 20 msec. and if it detects 10 cycles of the wave in 1 second in total (corresponding to $20 \text{ msec.} \times 10 = 200 \text{ msec.}$), it judges humans are in the room as the motion signal is ON.

2. The motions (for example: in cooling)

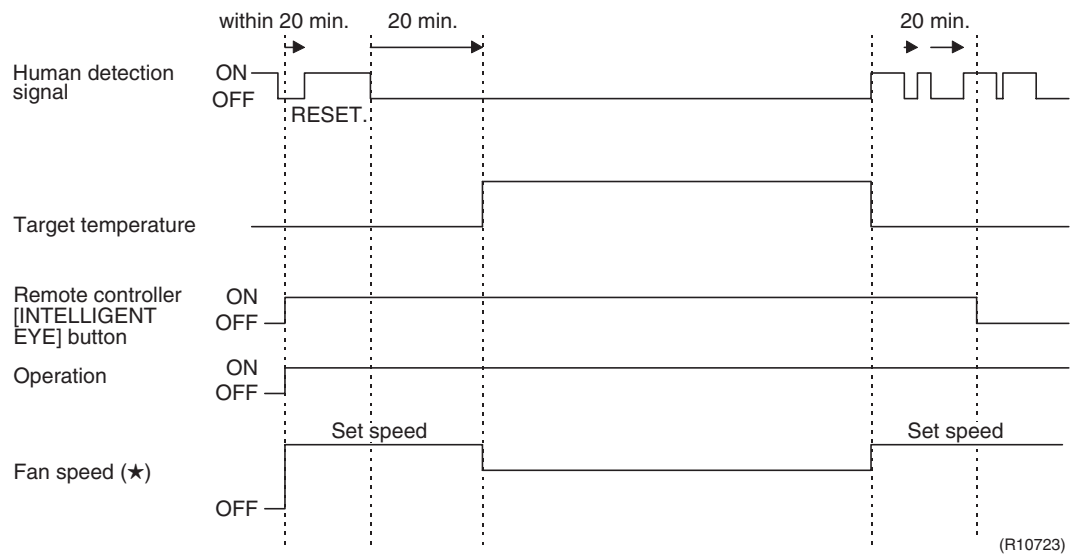

- When the microcomputer does not have a signal from the sensor in 20 minutes, it judges that nobody is in the room and operates the unit at a temperature shifted from the target temperature. (cooling / dry: 2°C higher, heating: 2°C lower, automatic: according to the operation mode at that time.)
- ★ In FAN operation, the fan speed is reduced by 60 rpm.

Others

- For dry operation, you cannot set the temperature with a remote controller, but the target temperature is shifted internally.

1.12 Inverter POWERFUL Operation

Outline

In order to exploit the cooling and heating capacity to full extent, operate the air conditioner by increasing the indoor fan rotating speed and the compressor frequency.


Detail

When the [POWERFUL] button is pressed, the fan speed and target temperature are converted to the following states for 20 minutes.

Operation mode	Fan speed	Target temperature
COOL	H tap + A rpm	18°C
DRY	Dry rotating speed + A rpm	Lowered by 2.5°C
HEAT	H tap + A rpm	31°C
FAN	H tap + A rpm	—
AUTO	Same as cooling / heating in POWERFUL operation	The target temperature is kept unchanged.

A = 50 rpm

Ex: POWERFUL operation in cooling.

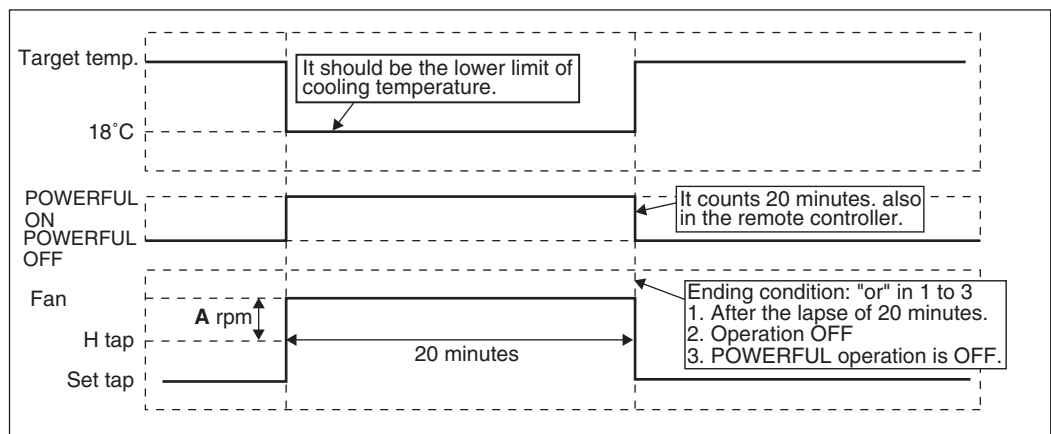


(R13571)

1.13 Clock Setting

ARC452 Series

The clock can be set by taking the following steps:

1. Press the [CLOCK] button.
→ 0:00 is displayed and MON and ☉ blink.
2. Press the [SELECT] ▲ or ▼ button to set the clock to the current day of the week.
3. Press the [CLOCK] button.
→ ☉ blinks.
4. Press the [SELECT] ▲ or ▼ button to set the clock to the present time.
Holding down the [SELECT] ▲ or ▼ button increases or decreases the time display rapidly.
5. Press the [CLOCK] button. (Point the remote controller at the indoor unit when pressing the button.)
→ : blinks and clock setting is completed.

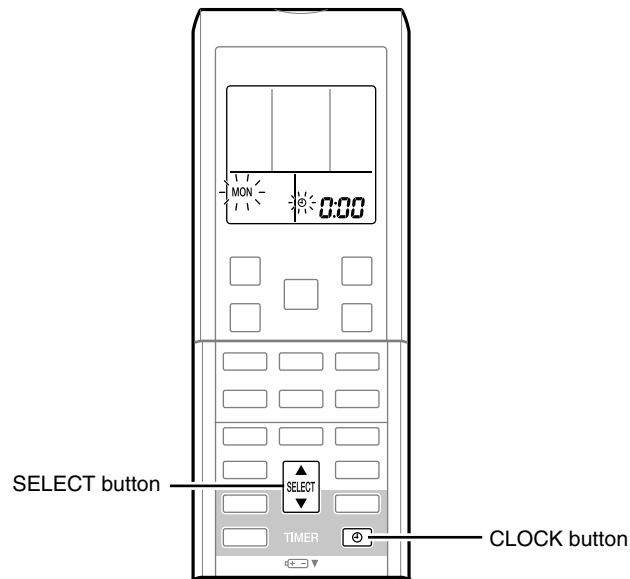


(R18281)

ARC433 Series

The clock can be set by taking the following steps:

1. Press the [CLOCK] button.
→ 0:00 is displayed and ☉ blinks.
2. Press the [TIMER] ▲ or ▼ button to set the clock to the present time.
Holding down the [TIMER] ▲ or ▼ button increases or decreases the time display rapidly.
3. Press the [CLOCK] button again.
→ : blinks and clock setting is completed.

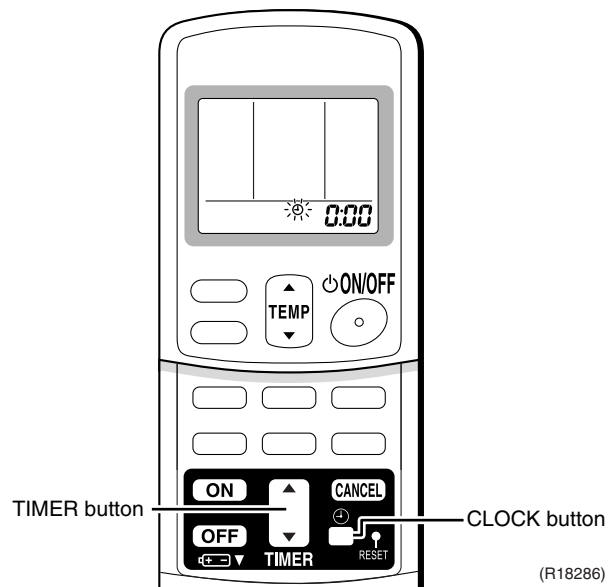

(R18286)

1.14 WEEKLY TIMER Operation

Outline

FTK(X)S Series


Up to 4 timer settings can be saved for each day of the week (up to 28 settings in total). The 3 items: "ON/OFF", "temperature", and "time" can be set.

Detail

■ Using in these cases of WEEKLY TIMER

An example of WEEKLY TIMER settings is shown below.

Example: The same timer settings are made for the week from Monday through Friday while different timer settings are made for the weekend.

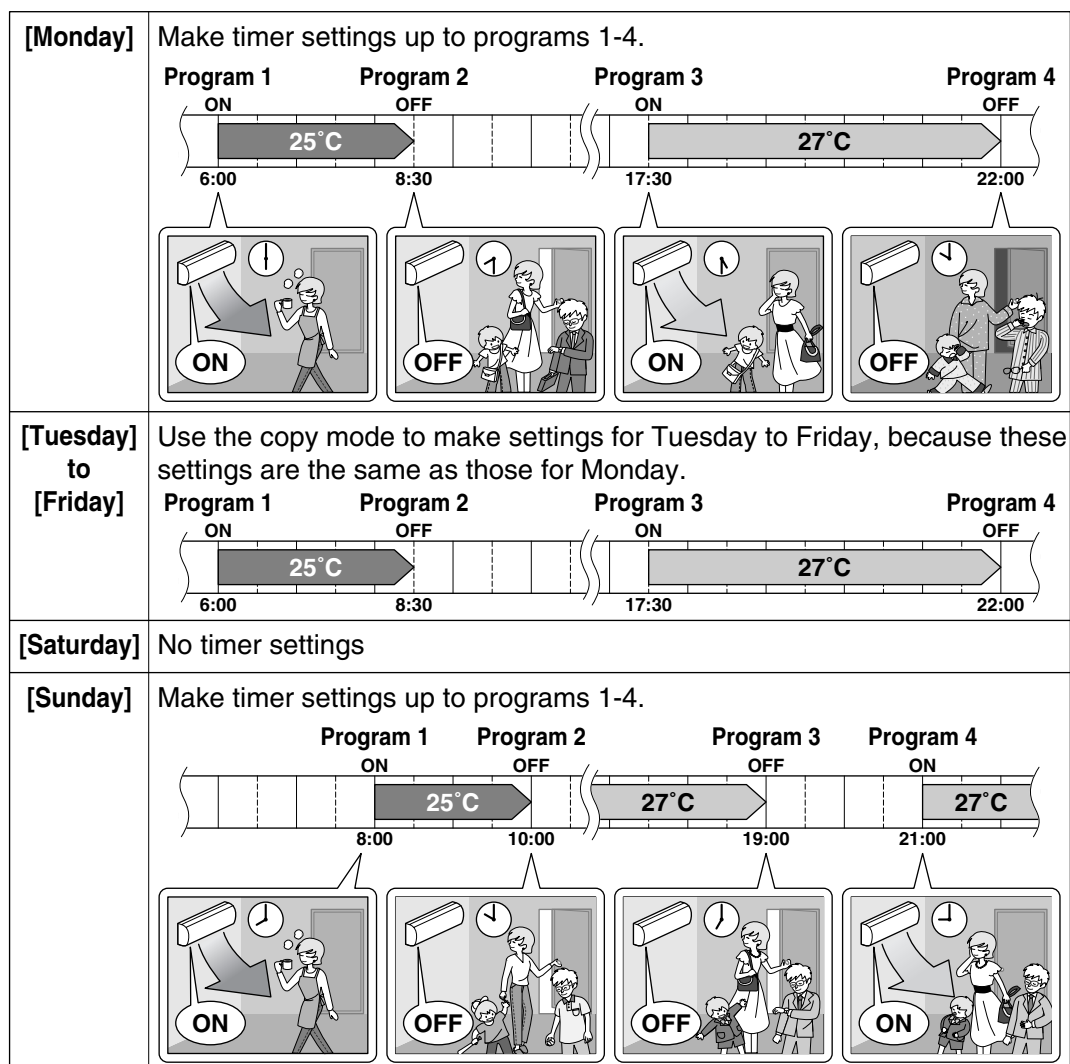


- Up to 4 reservations per day and 28 reservations per week can be set in the WEEKLY TIMER. The effective use of the copy mode ensures ease of making reservations.
- The use of ON-ON-ON-ON settings, for example, makes it possible to schedule operating mode and set temperature changes. Furthermore, by using OFF-OFF-OFF-OFF settings, only the turn-off time of each day can be set. This will turn off the air conditioner automatically if the user forgets to turn it off.

■ To use WEEKLY TIMER operation

Setting mode


- Make sure the day of the week and time are set. If not, set the day of the week and time.

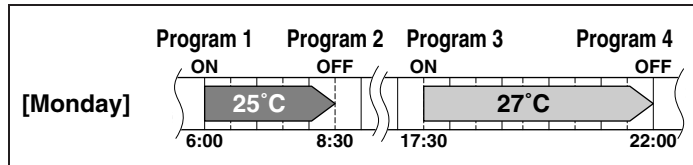


1. Press .

- The day of the week and the reservation number of the current day will be displayed.
- 1 to 4 settings can be made per day.

2. Press to select the desired day of the week and reservation number.


- Pressing the  changes the reservation number and the day of the week.

3. Press .

- The day of the week and reservation number will be set.
- “ WEEKLY” and “ON” blink.


4. Press to select the desired mode.


- Pressing the  changes “ON” or “OFF” setting in sequence.




- In case the reservation has already been set, selecting “blank” deletes the reservation.
- Go to step 9 if “blank” is selected.

5. Press .


- The ON/OFF TIMER mode will be set.
- “ WEEKLY” and the time blink.

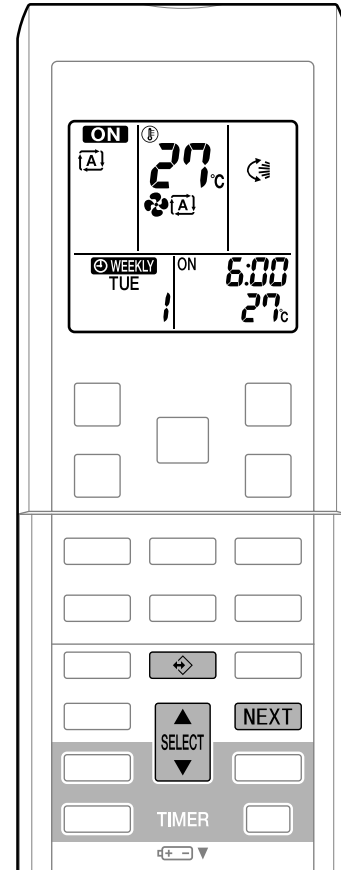



6. Press  to select the desired time.

- The time can be set between 0:00 and 23:50 in 10 minute intervals.
- To return to the ON/OFF TIMER mode setting, press .
- Go to step 9 when setting the OFF TIMER.

7. Press .

- The time will be set.
- “ WEEKLY” and the temperature blink.


8. Press  to select the desired temperature.


- The temperature can be set between 10°C and 32°C.
Cooling: The unit operates at 18°C even if it is set at 10 to 17°C.
Heating: The unit operates at 30°C even if it is set at 31 to 32°C.
- To return to the time setting, press .
- The set temperature is only displayed when the mode setting is on.


9. Press .

- The temperature will be set and go to the next reservation setting.
- To continue further settings, repeat the procedure from step 4.

10. Press  to complete the setting.


- Be sure to direct the remote controller toward the indoor unit and check for a receiving tone and flashing the OPERATION lamp.
- “ WEEKLY” is displayed on the LCD and WEEKLY TIMER operation is activated.
- The TIMER lamp lights up.
- A reservation made once can be easily copied and the same settings used for another day of the week.
Refer to copy mode.

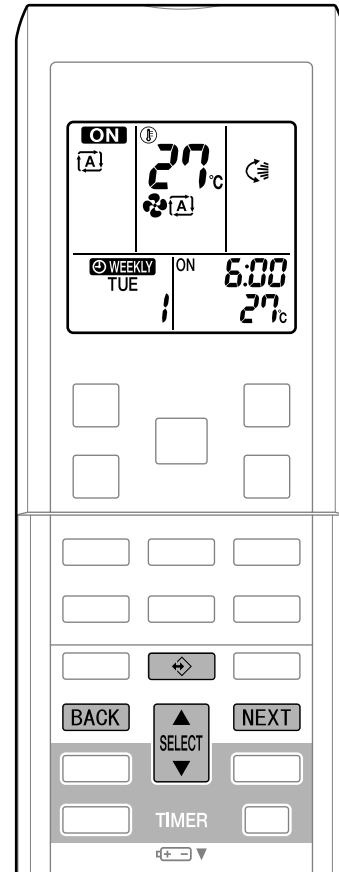

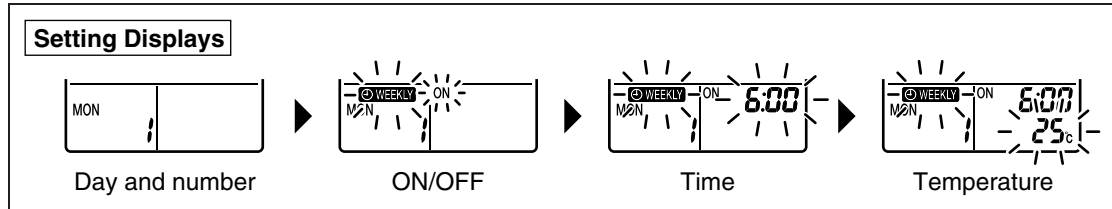


NOTE





■ Notes on WEEKLY TIMER operation


- Do not forget to set the clock on the remote control first.
- The day of the week, ON/OFF TIMER mode, time and set temperature (only for ON TIMER mode) can be set with WEEKLY TIMER. Other settings for ON TIMER are based on the settings just before the operation.
- Both WEEKLY TIMER and ON/OFF TIMER operation cannot be used at the same time. The ON/OFF TIMER operation has priority if it is set while WEEKLY TIMER is still active. The WEEKLY TIMER will go into standby state, and "WEEKLY" will disappear from the LCD. When ON/OFF TIMER is up, the WEEKLY TIMER will automatically become active.
- Only the time and set temperature with the weekly timer are sent with the . Set the weekly timer only after setting the operation mode, the fan strength, and the fan direction ahead of time.
- Shutting the breaker off, power failure, and other similar events will render operation of the indoor unit's internal clock inaccurate. Reset the clock.
- The **BACK** can be used only for the time and temperature settings. It cannot be used to go back to the reservation number.

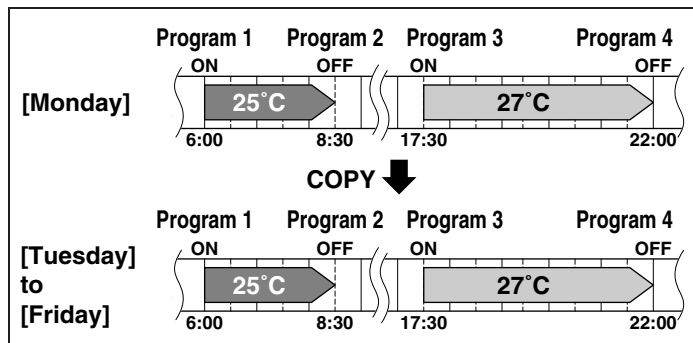Copy mode

- A reservation made once can be copied another day of the week. The whole reservation of the selected day of the week will be copied.



1. Press  .
2. Press  to confirm the day of the week to be copied.
3. Press  to activate copy mode.
 - The whole reservation of the selected day of the week will be copied.
4. Press  to select the destination day of the week.


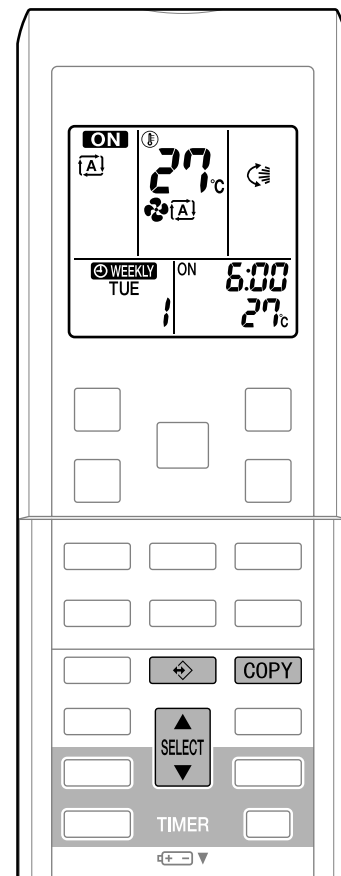


5. Press **COPY** .

- The reservation will be copied to the selected day of the week. The whole reservation of the selected day of the week will be copied.
- To continue copying the settings to other days of the week, repeat step 4 and step 5.


6. Press  to complete the setting.

- “**WEEKLY**” is displayed on the LCD and WEEKLY TIMER operation is activated.

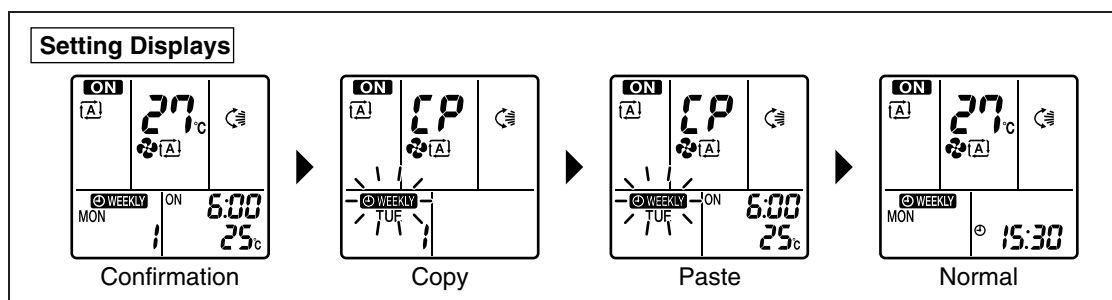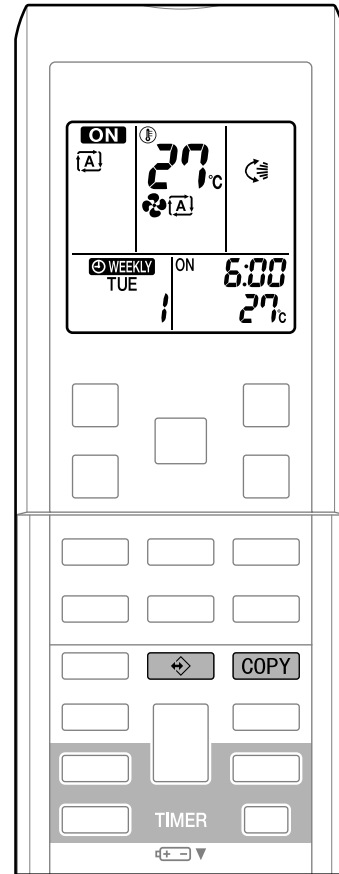

NOTE

■ Note on COPY MODE

- The entire reservation of the source day of the week is copied in the copy mode. In the case of making a reservation change for any day of the week individually after copying the content of weekly reservations, press  and change the settings in the steps of setting mode.



■ Confirming a reservation

- The reservation can be confirmed.


1. Press .



- The day of the week and the reservation number of current day will be displayed.

2. Press to select the day of the week and the reservation number to be confirmed.

- Pressing the  displays the reservation details.
- To change the confirmed reserved settings, select the reservation number and press . The mode is switched to setting mode. Go to setting mode step 4.




3. Press to exit confirming mode.

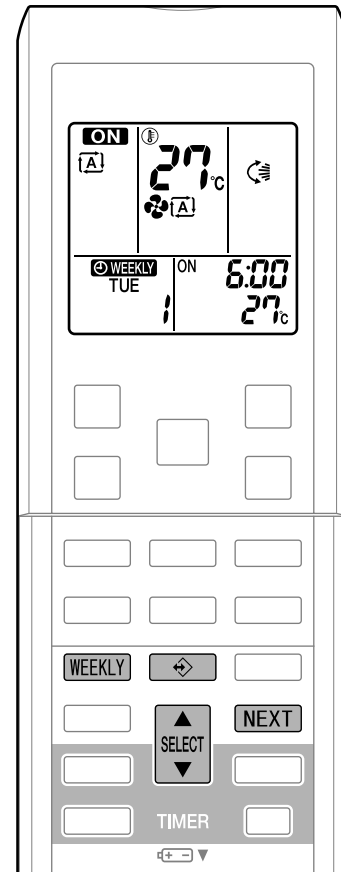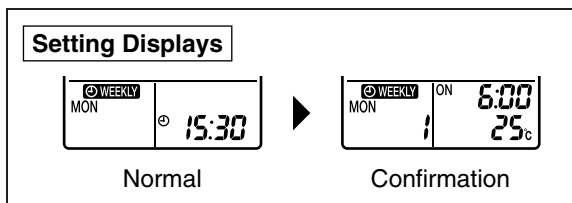- “ WEEKLY” is displayed on the LCD and WEEKLY TIMER operation is activated.
- The TIMER lamp lights up.



■ To deactivate WEEKLY TIMER operation

4. Press while “ WEEKLY” is displayed on the LCD.

- “ WEEKLY” disappears from the LCD.
- The TIMER lamp goes off.
- To reactivate the WEEKLY TIMER operation, press the  again.
- If a reservation deactivated with  is activated once again, the last reservation mode will be used.

■ To delete reservations

The individual reservation

- Refer to setting mode.
When selecting desired mode at step 4 in setting mode, select “blank”. The reservation will be deleted.

The reservations for each day of the week

- This function can be used for deleting reservations for each day of the week.
- It can be used while confirming or setting reservations.

5. Press  .

6. Select the day of the week to be canceled

with  .


7. Hold **WEEKLY** for 5 seconds.

- The reservation of the selected day of the week will be deleted.

All reservations

8. Hold **WEEKLY** for 5 seconds while normal display.

- Be sure to direct the remote control toward the main unit and check for a receiving tone.
- This operation is not effective on the setting display of WEEKLY TIMER.
- All reservations will be deleted.

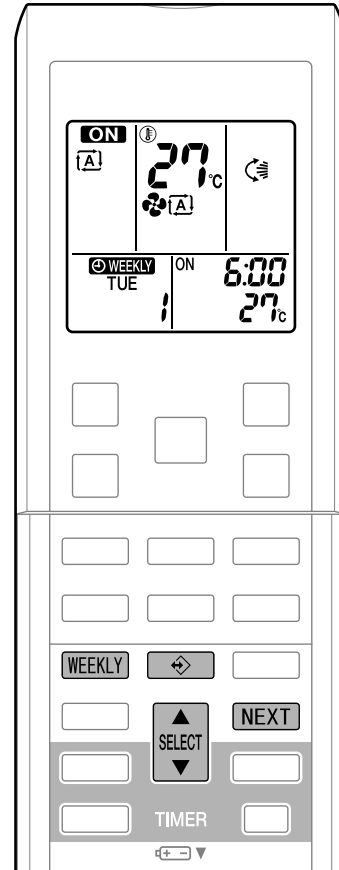

1.15 Other Functions

1.15.1 Hot-Start Function

In order to prevent the cold air blast that normally comes when heating operation is started, the temperature of the indoor heat exchanger is detected, and the airflow is either stopped or made very weak thereby carrying out comfortable heating of the room.

*The cold air blast is also prevented using similar control when the defrost control starts or when the thermostat is turned ON.

1.15.2 Signal Receiving Sign


When the indoor unit receives a signal from the remote controller, the unit emits a signal receiving sound.

1.15.3 Indoor Unit [ON/OFF] Button

An [ON/OFF] button is provided on the display of the unit.

- Press the [ON/OFF] button once to start operation. Press once again to stop it.
- The [ON/OFF] button is useful when the remote controller is missing or the battery has run out.
- The operation mode refers to the following table.

	Operation mode	Temperature setting	Airflow rate
Cooling Only	COOL	22°C	Automatic
Heat Pump	AUTO	25°C	Automatic

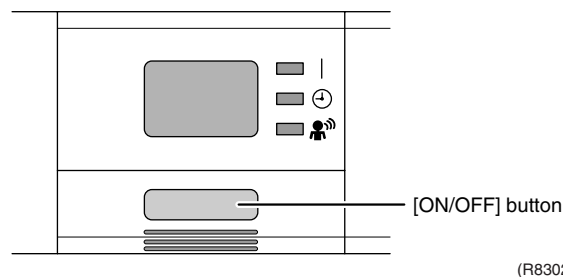

<Forced cooling operation>

Forced cooling operation can be started by pressing the [ON/OFF] button for 5 to 9 seconds while the unit is not operating. Refer to page 146 for detail.

i Note: When the [ON/OFF] button is pressed for 10 seconds or more, the forced cooling operation is stopped.

1.15.4 Titanium Apatite Photocatalytic Air-Purifying Filter


This filter combines the Air-Purifying Filter and Titanium Apatite Photocatalytic Deodorizing Filter as a single highly effective filter. The filter traps microscopic particles, decomposes odors and even deactivates bacteria and viruses. It lasts for 3 years without replacement if washed about once every 6 months.

1.15.5 Auto-restart Function

If a power failure (including one for just a moment) occurs during the operation, the operation restarts automatically when the power is restored in the same condition as before the power failure.

i Note: It takes 3 minutes to restart the operation because the 3-minute standby function is activated.

2. Function of Thermistor

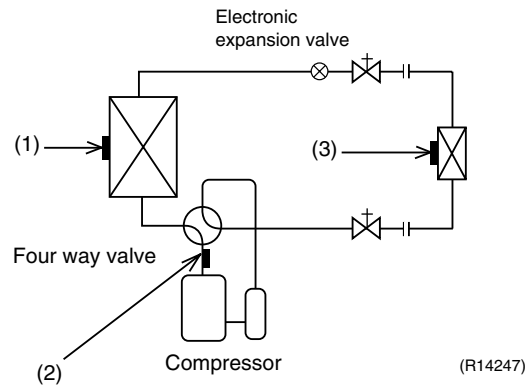

(1) Outdoor Heat Exchanger Thermistor

1. The outdoor heat exchanger thermistor is used for controlling the target discharge pipe temperature. The system sets the target discharge pipe temperature according to the outdoor and indoor heat exchanger temperature, and controls the electronic expansion valve opening so that the target discharge pipe temperature can be obtained.
2. In cooling operation, the outdoor heat exchanger thermistor is used for detecting the disconnection of the discharge pipe thermistor. When the discharge pipe temperature drops below the outdoor heat exchanger temperature by more than a certain value, the discharge pipe thermistor is judged as disconnected.
3. In cooling operation, the outdoor heat exchanger thermistor is used for high pressure protection.

(2) Discharge Pipe Thermistor

1. The discharge pipe thermistor is used for controlling discharge pipe temperature. If the discharge pipe temperature (used in place of the inner temperature of the compressor) rises abnormally, the operating frequency becomes lower or the operation halts.
2. The discharge pipe thermistor is used for detecting disconnection of the discharge pipe thermistor.

(3) Indoor Heat Exchanger Thermistor

1. The indoor heat exchanger thermistor is used for controlling the target discharge pipe temperature. The system sets the target discharge pipe temperature according to the outdoor and indoor heat exchanger temperature, and controls the electronic expansion valve opening so that the target discharge pipe temperature can be obtained.
2. In cooling operation, the indoor heat exchanger thermistor is used for freeze-up protection control. If the indoor heat exchanger temperature drops abnormally, the operating frequency becomes lower or the operation halts.
3. In heating operation, the indoor heat exchanger thermistor is used for detecting the disconnection of the discharge pipe thermistor. When the discharge pipe temperature drops below the indoor heat exchanger temperature by more than a certain value, the discharge pipe thermistor is judged as disconnected.


3. Control Specification

3.1 Mode Hierarchy

Outline Air conditioner control has normal operation mode, forced operation mode, and power transistor test mode for installation and servicing.


Detail

Cooling Only Model

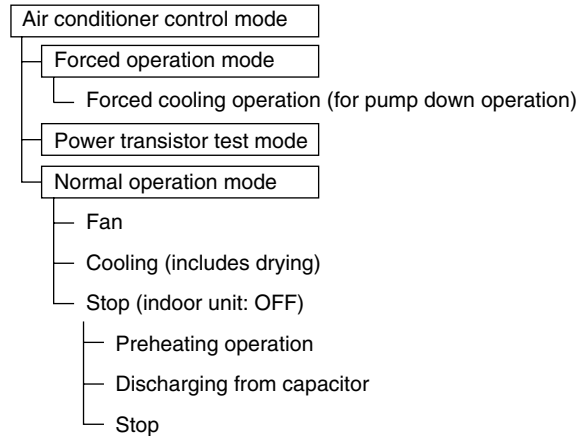

(R17487)

Heat Pump Model

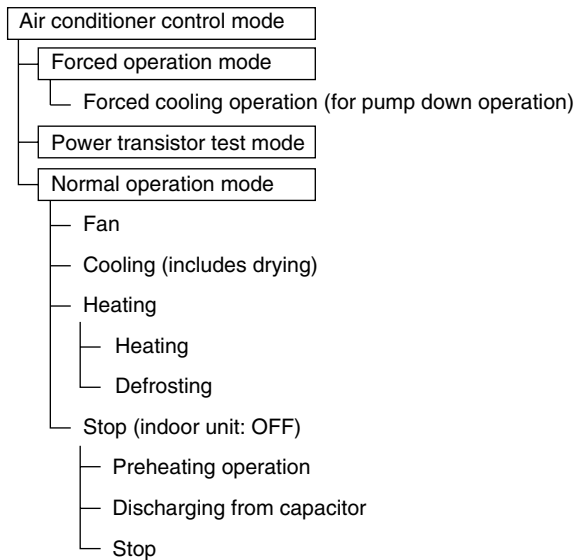

(R17533)



Note: Unless specified otherwise, a dry operation command is regarded as cooling operation.

3.2 Frequency Control


Outline

Frequency is determined according to the difference between the room thermistor temperature and the target temperature.

The function is explained as follows.

1. How to determine frequency
2. Frequency command from the indoor unit (Difference between the room thermistor temperature and the target temperature)
3. Frequency initial setting
4. PI control

When the shift of the frequency is less than zero ($\Delta F < 0$) by PI control, the target frequency is used as the command frequency.

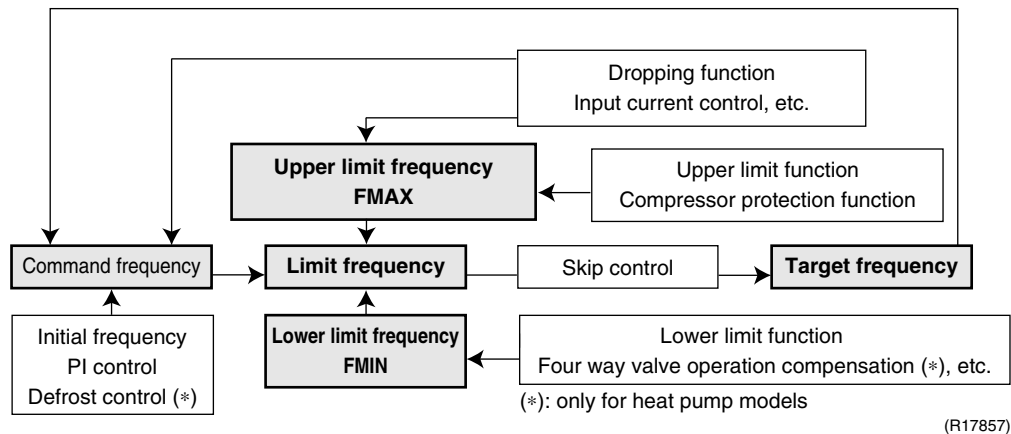

Detail

How to Determine Frequency

The compressor's frequency is determined by taking the following steps.

For Cooling Only Model

1. Determine command frequency

- ◆ Command frequency is determined in the following order of priority.
 1. Forced cooling
 2. Indoor frequency command

2. Determine upper limit frequency

- ◆ The minimum value is set as an upper limit frequency among the frequency upper limits of the following functions:
Compressor protection, input current, discharge pipe temperature, freeze-up protection.

3. Determine lower limit frequency

- ◆ The maximum value is set as a lower limit frequency among the frequency lower limits of the following function:
Pressure difference upkeep.

4. Determine prohibited frequency

- ◆ There is a certain prohibited frequency such as a power supply frequency.

For Heat Pump Model

1. Determine command frequency

- ◆ Command frequency is determined in the following order of priority.
 1. Limiting defrost control time
 2. Forced cooling
 3. Indoor frequency command

2. Determine upper limit frequency

- ◆ The minimum value is set as an upper limit frequency among the frequency upper limits of the following functions:
Compressor protection, input current, discharge pipe temperature, heating peak-cut, freeze-up protection, defrost.

3. Determine lower limit frequency

- ◆ The maximum value is set as a lower limit frequency among the frequency lower limits of the following functions:
Four way valve operation compensation, draft prevention, pressure difference upkeep.

4. Determine prohibited frequency

- ◆ There is a certain prohibited frequency such as a power supply frequency.

Indoor Frequency Command (ΔD signal)

The difference between the room thermistor temperature and the target temperature is taken as the " ΔD signal" and is used for frequency command.

Temperature difference	ΔD signal	Temperature difference	ΔD signal	Temperature difference	ΔD signal	Temperature difference	ΔD signal
-2.0	*Th OFF	0	4	2.0	8	4.0	C
-1.5	1	0.5	5	2.5	9	4.5	D
-1.0	2	1.0	6	3.0	A	5.0	E
-0.5	3	1.5	7	3.5	B	5.5	F

*Th OFF = Thermostat OFF

Frequency Initial Setting**<Outline>**

When starting the compressor, the frequency is initialized according to the ΔD value and the Q value of the indoor unit.

Q value: Indoor unit output determined from indoor unit volume, airflow rate and other factors.

PI Control (Determine Frequency Up / Down by ΔD Signal)**1. P control**

The ΔD value is calculated in each sampling time (15 ~ 20 seconds), and the frequency is adjusted according to its difference from the frequency previously calculated.

2. I control

If the operating frequency does not change for more than a certain fixed time, the frequency is adjusted according to the ΔD value.

When the ΔD value is low, the frequency is lowered.

When the ΔD value is high, the frequency is increased.

3. Frequency management when other controls are functioning

- ◆ When frequency is dropping;
Frequency management is carried out only when the frequency drops.
- ◆ For limiting lower limit
Frequency management is carried out only when the frequency rises.

4. Upper and lower limit of frequency by PI control

The frequency upper and lower limits are set according to the command of the indoor unit.

When the indoor or outdoor unit quiet operation command comes from the indoor unit, the upper limit frequency is lower than the usual setting.

3.3 Controls at Mode Changing / Start-up

3.3.1 Preheating Control

Outline The inverter operation in open phase starts with the conditions of the preheating command from the indoor unit, the outdoor temperature, and the discharge pipe temperature. The control does not work on ARXS42G3V1B.

Detail

■ RK(X)S20-42G2V1B, ARXS20-42G2V1B

ON Condition

- ◆ When the discharge pipe temperature is below 10°C, the inverter operation in open phase starts.

OFF Condition

- ◆ When the discharge pipe temperature is higher than 12°C, the inverter operation in open phase stops.

■ Other models

Outdoor temperature $\geq A^{\circ}\text{C}$ → Control I

Outdoor temperature $< A^{\circ}\text{C}$ → Control II

Control I

- ◆ ON condition
Discharge pipe temperature $< B^{\circ}\text{C}$
- ◆ OFF condition
Discharge pipe temperature $> C^{\circ}\text{C}$
Radiation fin temperature $\geq 90^{\circ}\text{C}$

Control II

- ◆ ON condition
Discharge pipe temperature $< D^{\circ}\text{C}$
- ◆ OFF condition
Discharge pipe temperature $> E^{\circ}\text{C}$
Radiation fin temperature $\geq 90^{\circ}\text{C}$

	A (°C)	B (°C)	C (°C)	D (°C)	E (°C)
RK(X)S20-35G2V1B9, ARXS20-35G3V1B	7	10	12	20	22
RK(X)S50G2V1B, ARXS50G2V1B	10	6	8	10.5	12
ARXS20-35G4V1B, ARXS50G3V1B	-2.5	0	2	10	12

3.3.2 Four Way Valve Switching

Outline In heating operation, current is conducted, and in cooling operation and defrost control, current is not conducted. In order to eliminate the switching sound as the four way valve coil switches from ON to OFF when the heating is stopped, the OFF delay switch of the four way valve is carried out.

Detail

OFF delay switch of four way valve:

The four way valve coil is energized for 150 ~ 160 seconds after the operation is stopped.

3.3.3 Four Way Valve Operation Compensation

Outline

At the beginning of the operation as the four way valve is switched, the pressure difference to activate the four way valve is acquired by having output frequency which is more than a certain fixed frequency, for a certain fixed time.

Detail

Starting Conditions

1. When the compressor starts and the four way valve switches from OFF to ON
2. When the four way valve switches from ON to OFF during operation
3. When the compressor starts after resetting
4. When the compressor starts after the fault of four way valve switching

The lower limit of frequency keeps **A** Hz for **B** seconds with any conditions 1 through 4 above.


	20/25/35 class		42 class		50 class	
	Cooling	Heating	Cooling	Heating	Cooling	Heating
A (Hz)	68	66	48	54	48	
B (seconds)	45		60		70	

3.3.4 3-minute Standby

Turning on the compressor is prohibited for 3 minutes after turning it off.
(Except when defrosting.)

3.3.5 Compressor Protection Function

When turning the compressor from OFF to ON, the upper limit of frequency is set as follows.
(The function is not activated when defrosting.)

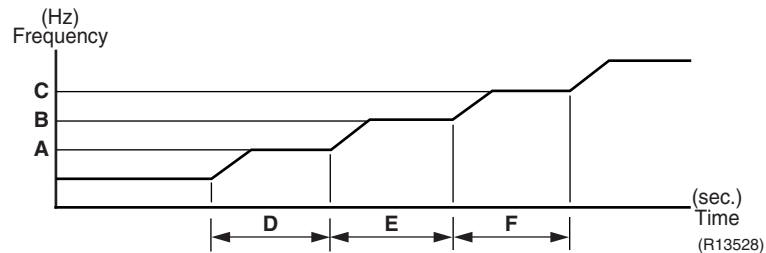


	20/25/35 class	42 class	50 class
A (Hz)	48	55	55
B (Hz)	64	70	70
C (Hz)	88	85	85
D (seconds)	240	150 ~ 240	120
E (seconds)	360	180	200
F (seconds)	180	300	470

3.4 Discharge Pipe Temperature Control

Outline

The discharge pipe temperature is used as the internal temperature of the compressor. If the discharge pipe temperature rises above a certain level, the upper limit of frequency is set to keep the discharge pipe temperature from rising further.

Detail

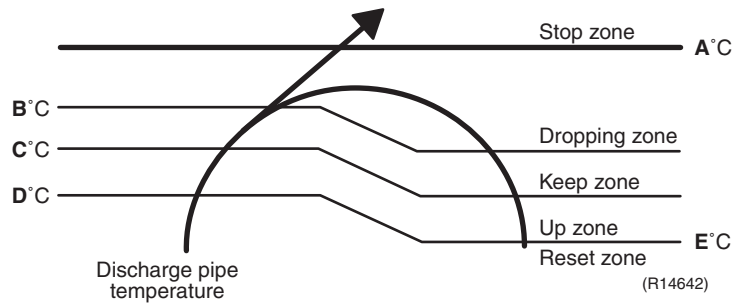

Zone	Control
Stop zone	When the temperature reaches the stop zone, the compressor stops.
Dropping zone	The upper limit of frequency decreases.
Keep zone	The upper limit of frequency is kept.
Up zone	The upper limit of frequency increases.
Reset zone	The upper limit of frequency is canceled.


	20/25/35 class	42 class	50 class
A (°C)	110	110	110
B (°C)	105	103	103
C (°C)	101	102	101.5
D (°C)	99	100	100
E (°C)	97	95	95

3.5 Input Current Control

Outline

The microcomputer calculates the input current while the compressor is running, and sets the frequency upper limit from the input current. In case of heat pump models, this control which is the upper limit control of the frequency takes priority over the lower limit of control of four way valve operation compensation.

Detail

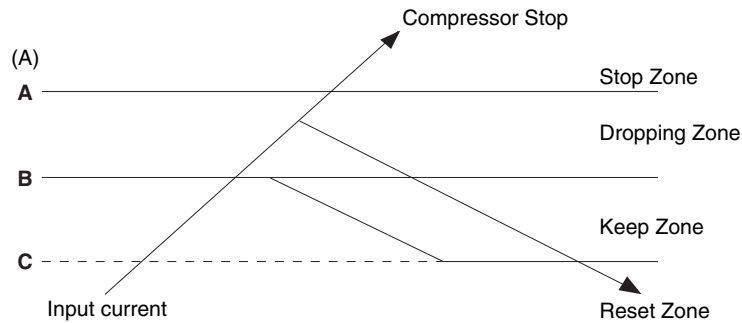

(R14643)

Frequency control in each zone

Stop zone

- ◆ After 2.5 seconds in this zone, the compressor is stopped.

Dropping zone

- ◆ The upper limit of the compressor frequency is defined as operation frequency – 2 Hz.
- ◆ After this, the output frequency is lowered by 2 Hz every second until it reaches the keep zone.

Keep zone

- ◆ The present maximum frequency goes on.

Reset zone

- ◆ Limit of the frequency is canceled.

■ RK(X)S20-50G2V1B, ARXS20-50G2V1B

	20 class		25 class		35 class	
	Cooling	Heating	Cooling	Heating	Cooling	Heating
A (A)	9.25		9.25		9.25	
B (A)	6.0	7.5	6.5	7.5	7.25	8.25
C (A)	5.25	6.75	5.75	6.75	6.5	7.5

	42 class		50 class	
	Cooling	Heating	Cooling	Heating
A (A)	14.25		20.0	
B (A)	10.0	10.5	10.0	15.0
C (A)	9.0	9.5	9.0	14.0

■ **RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B, ARXS42/50G3V1B**

	20 class		25 class		35 class	
	Cooling	Heating	Cooling	Heating	Cooling	Heating
A (A)	9.25		9.25		9.25	
B (A)	6.0	7.5	6.25	7.5	8.25	
C (A)	5.25	6.75	5.5	6.75	7.5	

	42 class		50 class	
	Cooling	Heating	Cooling	Heating
A (A)	14.25		20.0	
B (A)	10.0	10.5	13.0	15.0
C (A)	9.0	9.5	12.0	14.0


Limitation of current dropping and stop value according to the outdoor temperature

- ♦ The current drops when outdoor temperature becomes higher than a certain level (depending on the model).

3.6 Freeze-up Protection Control

Outline During cooling operation, the signal sent from the indoor unit controls the operating frequency limitation and prevents freezing of the indoor heat exchanger. (The signal from the indoor unit is divided into zones.)

Detail The operating frequency limitation is judged with the indoor heat exchanger temperature.

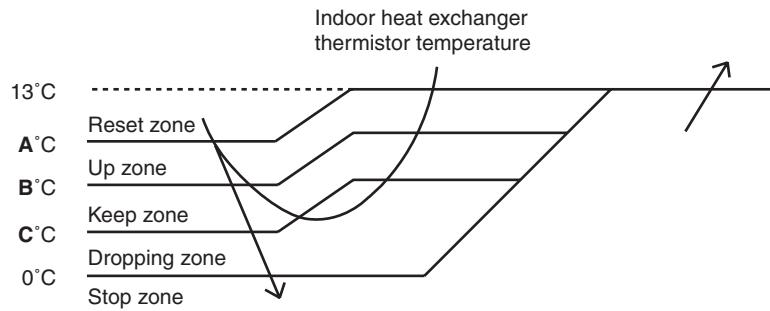


(R14718)

A (°C)	B (°C)	C (°C)
9.5	7.5	5.5

3.7 Heating Peak-cut Control

Outline During heating operation, the indoor heat exchanger temperature determines the frequency upper limit to prevent abnormal high pressure.

Detail

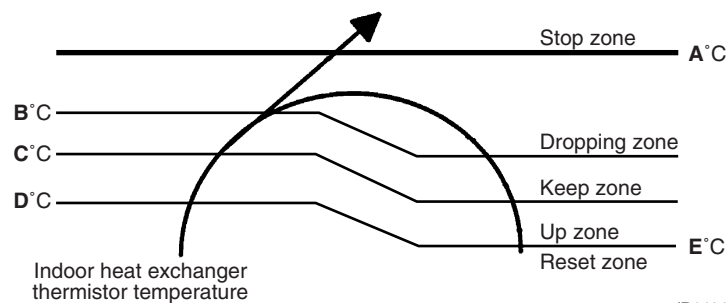

(R14645)

Zone	Control
Stop zone	When the temperature reaches the stop zone, the compressor stops.
Dropping zone	The upper limit of frequency decreases.
Keep zone	The upper limit of frequency is kept.
Up zone	The upper limit of frequency increases.
Reset zone	The upper limit of frequency is canceled.

	20/25/35 class	42 class	50 class
A (°C)	65	65	65
B (°C)	56	55	56
C (°C)	53	54	55
D (°C)	51	52	53
E (°C)	46	50	51

3.8 Outdoor Fan Control

1. Fan ON control to cool down the electrical box

The outdoor fan is turned ON when the electrical box temperature is high while the compressor is OFF.

2. Fan OFF control during defrosting

The outdoor fan is turned OFF during defrosting.

3. Fan OFF delay when stopped

The outdoor fan is turned OFF 60 seconds after the compressor stops.

4. Fan speed control for pressure difference upkeep

The rotation speed of the outdoor fan is controlled for keeping the pressure difference during cooling operation with low outdoor temperature.

- ◆ When the pressure difference is low, the rotation speed of the outdoor fan is reduced.
- ◆ When the pressure difference is high, the rotation speed of the outdoor fan is controlled as well as normal operation.

5. Fan speed control during forced cooling operation

The outdoor fan is controlled as well as normal operation during forced cooling operation.

6. Fan speed control during POWERFUL operation

The rotation speed of the outdoor fan is increased during POWERFUL operation.

7. Fan speed control during indoor / outdoor unit quiet operation

The rotation speed of the outdoor fan is reduced by the command of the indoor / outdoor unit quiet operation.

8. Fan ON/OFF control when operation starts / stops

The outdoor fan is turned ON when the operation starts. The outdoor fan is turned OFF when the operation stops.

3.9 Liquid Compression Protection Function

Outline

In order to obtain the dependability of the compressor, the compressor is stopped according to the outdoor temperature and the outdoor heat exchanger temperature.

Detail

Operation stops depending on the outdoor temperature.

Compressor turns off under the conditions that the system is in cooling operation and outdoor temperature is below -12°C .

3.10 Defrost Control

Outline

Defrosting is carried out by the cooling cycle (reverse cycle). The defrosting time or outdoor heat exchanger temperature must be more than a certain value to finish.


Detail

Conditions for Starting Defrost

- The starting conditions are determined with the outdoor temperature and the outdoor heat exchanger temperature.
- The system is in heating operation.
- The compressor operates for 6 minutes.
- More than **A** minutes of accumulated time have passed since the start of the operation, or ending the previous defrosting.

Conditions for Canceling Defrost

The judgment is made with the outdoor heat exchanger temperature. (**B**°C)

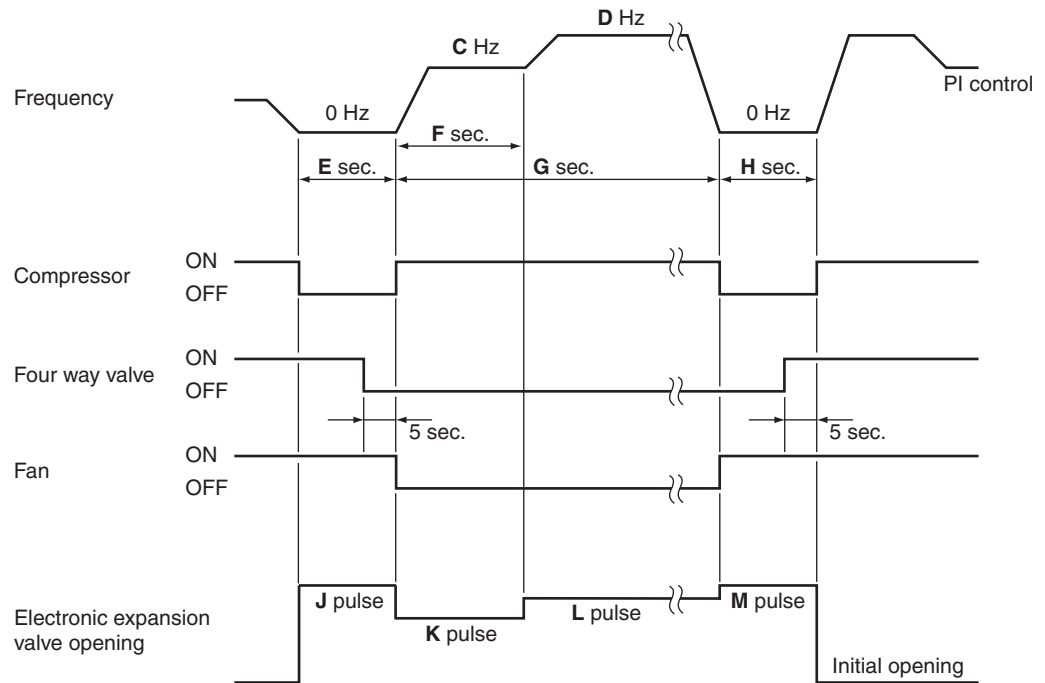

(R18215)

	20 class	25/35 class	42 class	50 class
A (minutes)	28	28	30	44
B (°C)	4 ~ 18	4 ~ 18	4 ~ 15	4 ~ 12
C (Hz)	76	76	48	55
D (Hz)	86	86	70	90
E (seconds)	50	50	60	60
F (seconds)	60	60	120	120
G (seconds)	480	480	530	340
H (seconds)	50	60	30	30
J (pulse)	450	450	450	450 ★
K (pulse)	350 ★	350 ★	350	450 ★
L (pulse)	350 ★	350 ★	400	450 ★
M (pulse)	450	450	450	450 ★

★: The same value continues.

3.11 Electronic Expansion Valve Control

Outline

The following items are included in the electronic expansion valve control.

Electronic expansion valve is fully closed

1. Electronic expansion valve is fully closed when turning on the power.
2. Pressure equalizing control

Open Control

1. Electronic expansion valve control when starting operation
2. Electronic expansion valve control when the frequency changes
3. Electronic expansion valve control for defrosting
4. Electronic expansion valve control when the discharge pipe temperature is abnormally high
5. Electronic expansion valve control when the discharge pipe thermistor is disconnected

Feedback Control

Target discharge pipe temperature control

Detail

The followings are the examples of electronic expansion valve control which function in each operation mode.

	When the power turns on or when the compressor stops	When the operation starts	When the frequency changes under starting control	During target discharge pipe temperature control	When the frequency changes under target discharge pipe temperature control	When the disconnection of the discharge pipe thermistor is ascertained	When the frequency changes under the control for disconnection of the discharge pipe thermistor	Under defrost control
● : Holding Functions — : No Functions								
Cooling								
Starting control	—	●	—	—	—	—	—	—
Control when the frequency changes	—	—	●	—	●	—	—	—
Target discharge pipe temperature control	—	—	—	●	—	—	—	—
Control for disconnection of the discharge pipe thermistor	—	—	—	—	—	●	●	—
High discharge pipe temperature control	—	●	●	●	●	—	—	—
Pressure equalizing control	●	—	—	—	—	—	—	—
Opening limit control	—	●	●	●	●	●	●	—
Heating								
Starting control	—	●	—	—	—	—	—	—
Control when the frequency changes	—	—	●	—	●	—	—	—
Target discharge pipe temperature control	—	—	—	●	—	—	—	—
Control for disconnection of the discharge pipe thermistor	—	—	—	—	—	●	●	—
High discharge pipe temperature control	—	●	●	●	●	—	—	—
Defrost control	—	—	—	—	—	—	—	●
Pressure equalizing control	●	—	—	—	—	—	—	—
Opening limit control	—	●	●	●	●	●	●	—

3.11.1 Fully Closing with Power ON

The electronic expansion valve is initialized when turning on the power. The opening position is set and the pressure equalization is developed.

3.11.2 Pressure Equalizing Control

When the compressor is stopped, the pressure equalizing control is activated. The electronic expansion valve opens, and develops the pressure equalization.

3.11.3 Opening Limit Control

Outline

A maximum and minimum opening of the electronic expansion valve are limited.

Detail

	20/25/35 class	42 class	50 class
Maximum opening (pulse)	480	450	480
Minimum opening (pulse)	52	60	54

The electronic expansion valve is fully closed when cooling operation stops, and is opened at a fixed degree during defrosting.

3.11.4 Starting Operation Control

The electronic expansion valve opening is controlled when the operation starts, and prevents superheating or liquid compression.

3.11.5 Control when the Frequency Changes

When the target discharge pipe temperature control is active, if the target frequency is changed to a specified value in a certain time period, the target discharge pipe temperature control is canceled and the target opening of the electronic expansion valve is changed according to the shift.

3.11.6 High Discharge Pipe Temperature Control

When the compressor is operating, if the discharge pipe temperature exceeds a certain value, the electronic expansion valve opens and the refrigerant runs to the low pressure side. This procedure lowers the discharge pipe temperature.

3.11.7 Control for Disconnection of the Discharge Pipe Thermistor

Outline

The disconnection of the discharge pipe thermistor is detected by comparing the discharge pipe temperature with the condensation temperature. If the discharge pipe thermistor is disconnected, the electronic expansion valve opens according to the outdoor temperature and the operation frequency, operates for a specified time, and then stops.

After 3 minutes, the operation restarts and checks if the discharge pipe thermistor is disconnected. If the discharge pipe thermistor is disconnected, the system stops after operating for a specified time.

If the disconnection is detected repeatedly, the system is shut down. When the compressor runs for 60 minutes without any error, the error counter is reset.

Detail

When the starting control (cooling: **A** seconds, heating: **B** seconds) finishes, the detection timer for disconnection of the discharge pipe thermistor (**C** seconds) starts. When the timer is over, the following adjustment is made.

1. When the operation mode is cooling

When the following condition is fulfilled, the discharge pipe thermistor disconnection is ascertained.

Discharge pipe temperature + 6°C < outdoor heat exchanger temperature

2. When the operation mode is heating

When the following condition is fulfilled, the discharge pipe thermistor disconnection is ascertained.

Discharge pipe temperature + 6°C < indoor heat exchanger temperature

	20/25/35 class	42 class	RK(X)S50G2V1B ARXS50G2V1B	ARXS50G3V1B
A (seconds)	10	60	10	60
B (seconds)	120	30	30	30
C (seconds)	810	540	540	540


Adjustment when the thermistor is disconnected

When the disconnection is ascertained, the compressor continues operation for 9 minutes and then stops.

If the compressor stops repeatedly, the system is shut down.

3.11.8 Target Discharge Pipe Temperature Control

The target discharge pipe temperature is obtained from the indoor and outdoor heat exchanger temperature, and the electronic expansion valve opening is adjusted so that the actual discharge pipe temperature becomes close to the target discharge pipe temperature. (Indirect SH (superheating) control using the discharge pipe temperature)

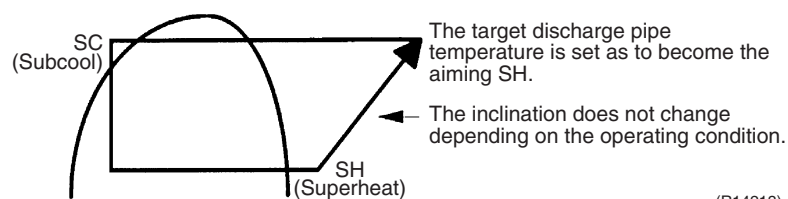

(R14213)

The electronic expansion valve opening and the target discharge pipe temperature are adjusted every 20 seconds. The target discharge pipe temperature is controlled by indoor heat exchanger temperature and outdoor heat exchanger temperature. The opening degree of the electronic expansion valve is controlled by the followings.

- ◆ Target discharge pipe temperature
- ◆ Actual discharge pipe temperature
- ◆ Previous discharge pipe temperature

3.12 Malfunctions

3.12.1 Sensor Malfunction Detection

Sensor malfunction may occur in the thermistor.

Relating to Thermistor Malfunction

1. Outdoor heat exchanger thermistor
2. Discharge pipe thermistor
3. Radiation fin thermistor
4. Outdoor temperature thermistor

3.12.2 Detection of Overcurrent and Overload

Outline

An excessive output current is detected and the OL temperature is observed to protect the compressor.

Detail

- If the OL (compressor head) temperature exceeds 120°C, the system shuts down the compressor.
- If the inverter current exceeds 9.25 ~ 20 A (depending on the model), the system shuts down the compressor.


3.12.3 Refrigerant Shortage Control

Outline

I: Detecting by power consumption


If the power consumption is below the specified value and the frequency is higher than the specified frequency, it is regarded as refrigerant shortage.

The power consumption is low comparing with that in the normal operation when refrigerant is insufficient, and refrigerant shortage is detected by checking power consumption.

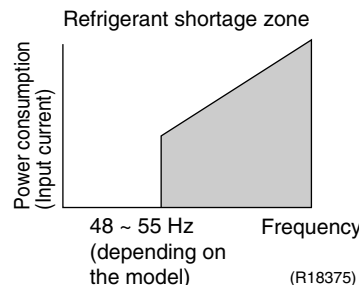

II: Detecting by discharge pipe temperature

If the discharge pipe temperature is higher than the target discharge pipe temperature, and the electronic expansion valve is fully open for more than the specified time, it is regarded as refrigerant shortage.

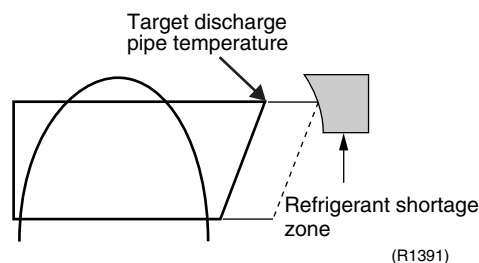

III: Detecting by the difference of temperature

If the difference between suction and discharge temperature is smaller than the specified value, it is regarded as refrigerant shortage.




Refer to page 93 for detail.

Part 5

Remote Controller

1. FTXS20/25/35/42/50G2V1B	73
2. ATXS20/25/35/42/50G2V1B	75

1. FTXS20/25/35/42/50G2V1B

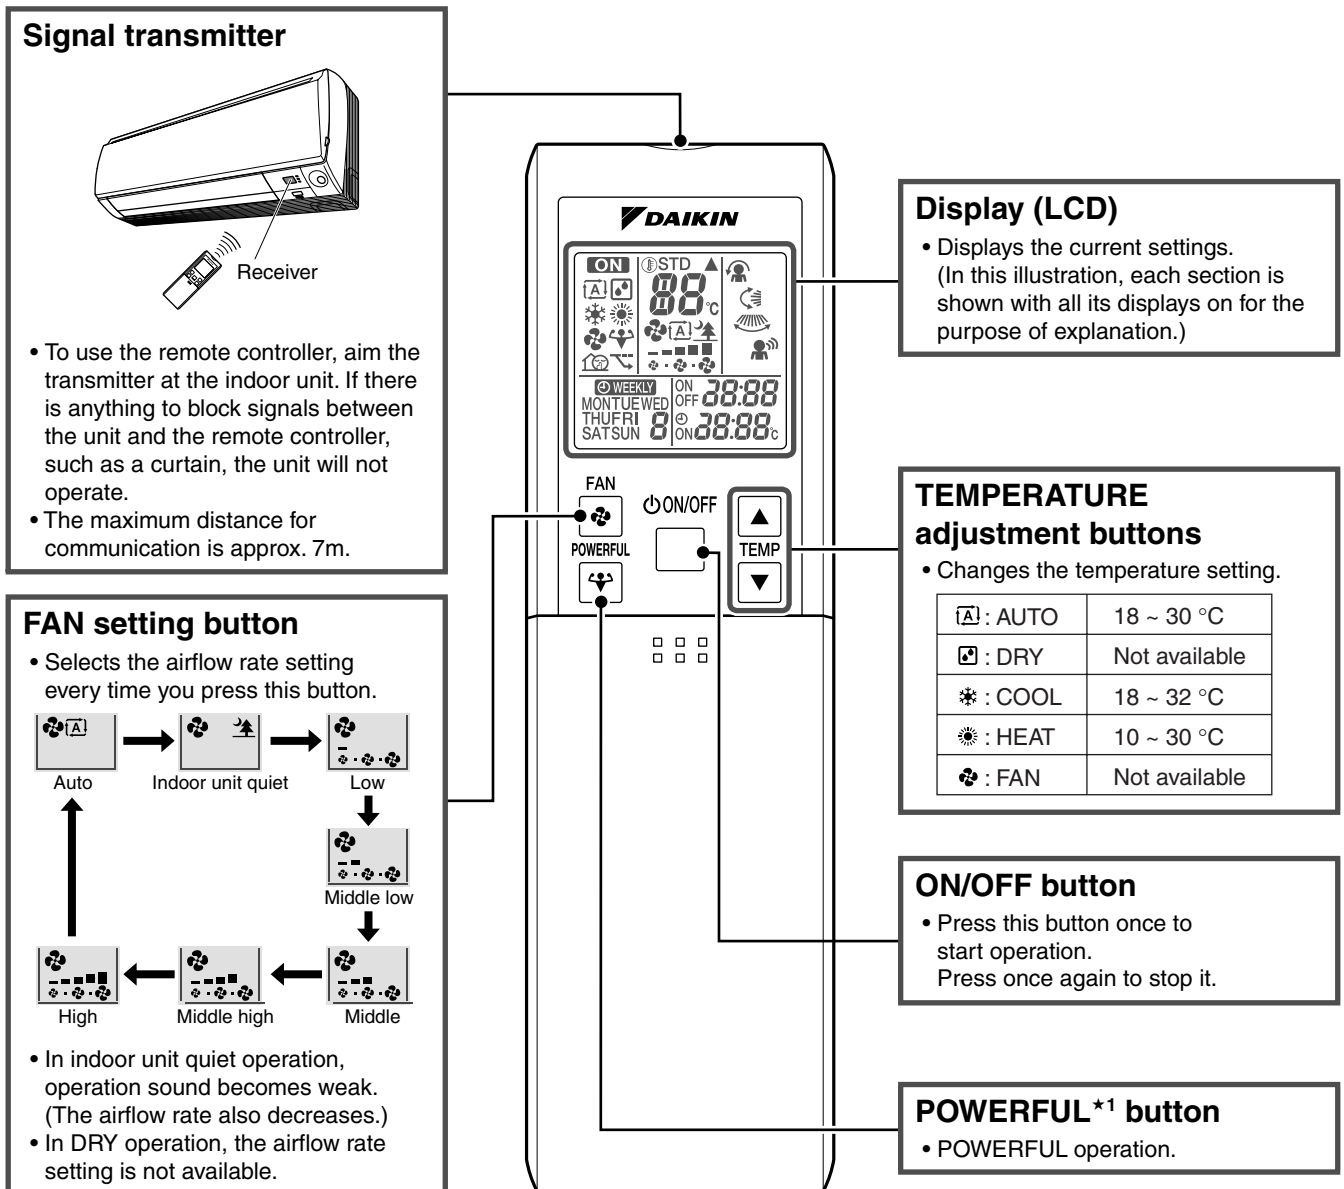

< ARC452A3 >

(R18208)

The remote controller is compatible with both cooling only and heat pump models*2.

Reference

Refer to the following pages for detail.



★1	POWERFUL operation	P.45
★2	Model Type Setting	P.150



Note:

Refer to the operation manual of applicable model for detail. You can download operation manual from 'DISTRIBUTOR'S PAGE':
 DISTRIBUTOR'S PAGE → Product Information → Operation/Installation Manual
 (URL: http://global.daikin.com/Daikin/global/Distributors_admin/user_mng/login.php)

Open the Front Cover

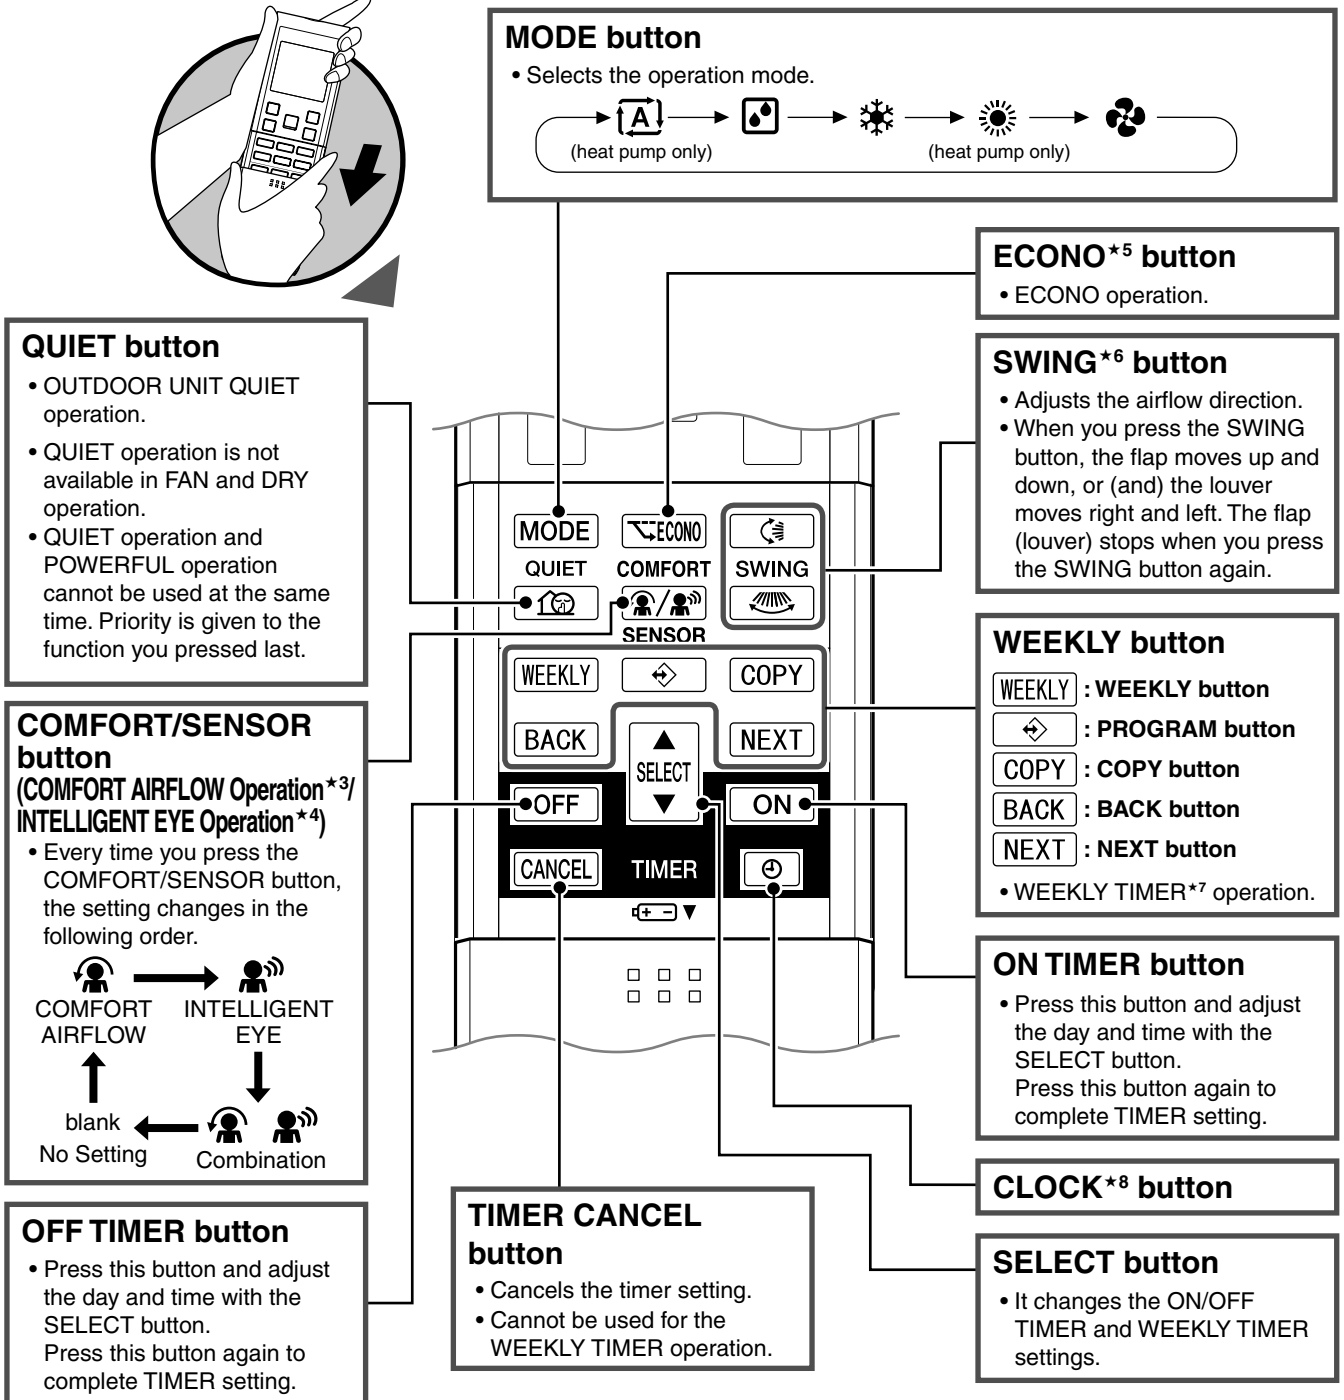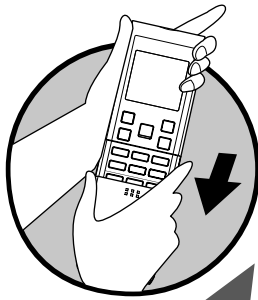

(R18209)

Reference

Refer to the following pages for detail.

★3	COMFORT AIRFLOW operation	P.35, 36
★4	2-area INTELLIGENT EYE operation	P.42
★5	ECONO operation	P.41


★6	Auto swing setting	P.35
★7	WEEKLY TIMER operation	P.47
★8	Clock setting	P.46



Note:

Refer to the operation manual of applicable model for detail. You can download operation manual from 'DISTRIBUTOR'S PAGE':
 DISTRIBUTOR'S PAGE → Product Information → Operation/Installation Manual
 (URL: http://global.daikin.com/Daikin/global/Distributors_admin/user_mng/login.php)

2. ATXS20/25/35/42/50G2V1B

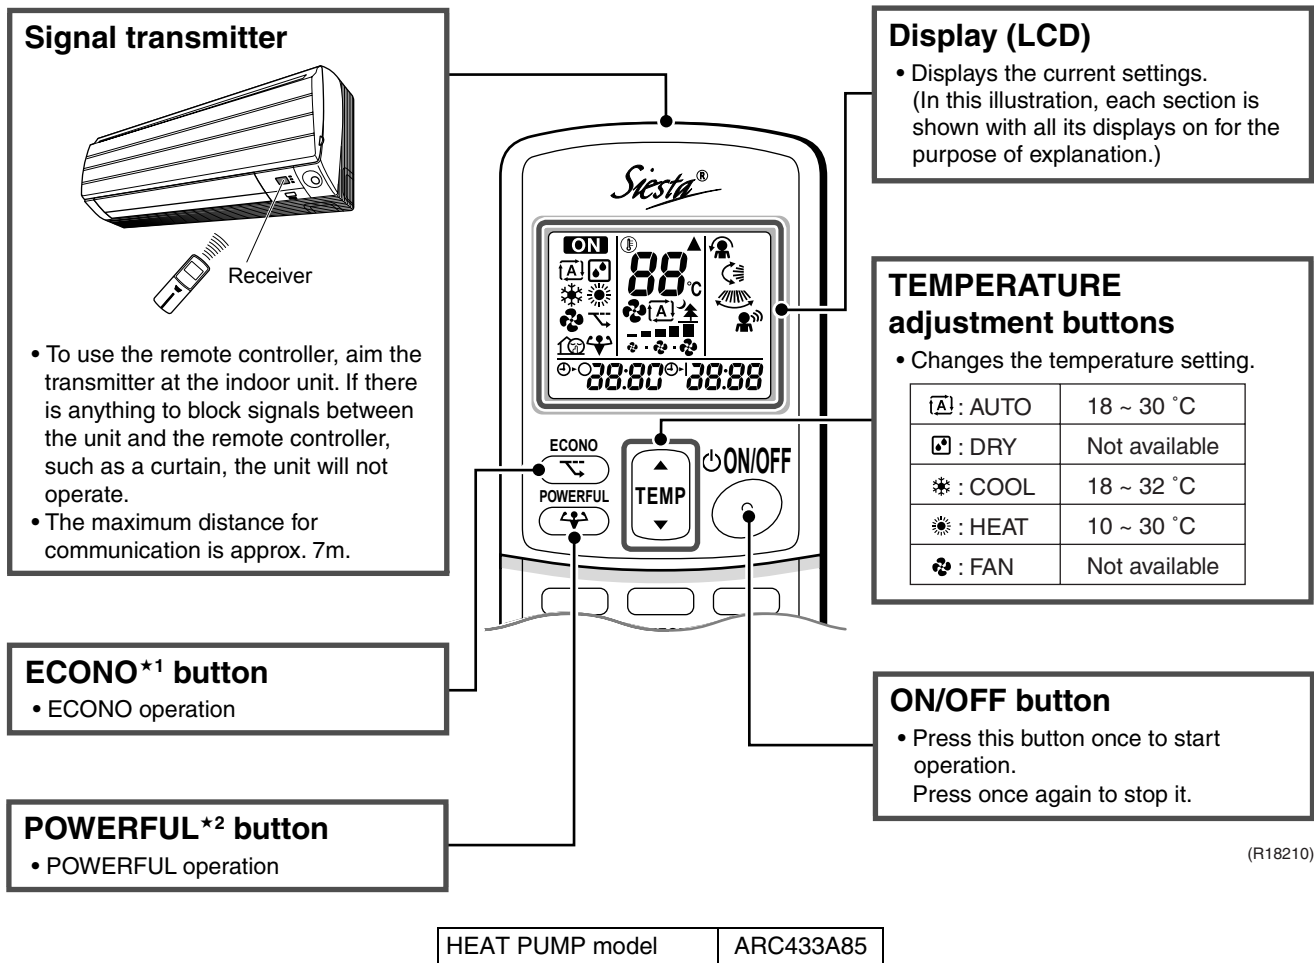

Reference

Refer to the following pages for detail.

★1	ECONO operation	P.41
★2	POWERFUL operation	P.45




Note:

Refer to the operation manual of applicable model for detail. You can download operation manuals from 'DISTRIBUTOR'S PAGE':

DISTRIBUTOR'S PAGE → Product Information → Operation/Installation Manual

(URL: http://global.daikin.com/Daikin/global/Distributors_admin/user_mng/login.php)

Open the Front Cover



MODE button

- Selects the operation mode.

QUIET button

- OUTDOOR UNIT QUIET operation.
- QUIET operation is not available in FAN and DRY operation.
- QUIET operation and POWERFUL operation cannot be used at the same time. Priority is given to the function you pressed last.

ON TIMER button


- Press this button and adjust the day and time with TIMER setting button. Press this button again to complete TIMER setting.

OFF TIMER button

- Press this button and adjust the day and time with TIMER setting button. Press this button again to complete TIMER setting.

TIMER Setting button

- It changes the ON/OFF TIMER settings.

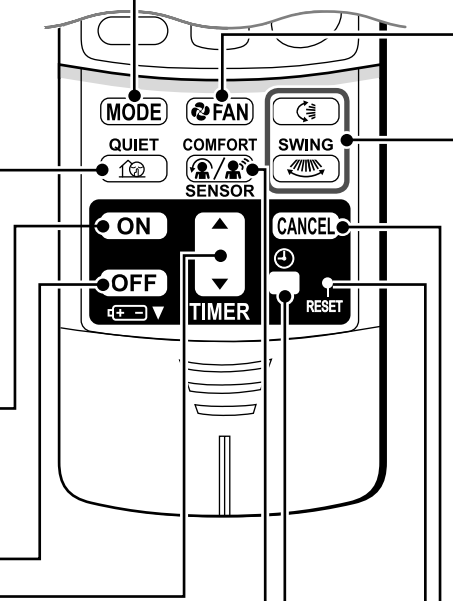

COMFORT/SENSOR button (COMFORT AIRFLOW Operation^{★4}/ INTELLIGENT EYE Operation^{★5})

- Every time you press the COMFORT/SENSOR button, the setting changes in the following order.

FAN setting button

- Selects the airflow rate setting every time you press this button.

- In indoor unit quiet operation, operation sound becomes weak. (The airflow rate also decreases.)
- In DRY operation, the airflow rate setting is not available.

SWING^{★3} button

- Adjusts the airflow direction.
- When you press the SWING button, the flap moves up and down, or (and) the louver moves right and left. The flap (louver) stops when you pressed the SWING button again.

TIMER CANCEL button

- Cancels the timer setting.

RESET button

- Restarts the unit if it freezes.
- Use a thin object to push.

CLOCK^{★6} button

(R18211)

Reference

Refer to the following pages for detail.

★3	Auto swing setting	P.35
★4	COMFORT AIRFLOW operation	P.35, 36

★5	INTELLIGENT EYE operation	P.44
★6	Clock setting	P.46



Note:

Refer to the operation manual of applicable model for detail. You can download operation manuals from 'DISTRIBUTOR'S PAGE':
 DISTRIBUTOR'S PAGE → Product Information → Operation/Installation Manual
 (URL: http://global.daikin.com/Daikin/global/Distributors_admin/user_mng/login.php)

Part 6

Service Diagnosis

1. Troubleshooting with LED	79
1.1 Indoor Unit.....	79
1.2 Outdoor Unit.....	79
2. Problem Symptoms and Measures	80
3. Service Check Function	81
3.1 ARC452 Series.....	81
3.2 ARC433 Series.....	84
4. Troubleshooting	87
4.1 Error Codes and Description	87
4.2 Indoor Unit PCB Abnormality	88
4.3 Freeze-up Protection Control or Heating Peak-cut Control.....	89
4.4 Fan Motor (DC Motor) or Related Abnormality.....	90
4.5 Thermistor or Related Abnormality (Indoor Unit).....	92
4.6 Refrigerant Shortage.....	93
4.7 Low-voltage Detection or Over-voltage Detection.....	96
4.8 Signal Transmission Error (between Indoor Unit and Outdoor Unit)	98
4.9 Signal Transmission Error on Outdoor Unit PCB (RK(X)S50G2V1B, ARXS50G2V1B Only)	100
4.10 Unspecified Voltage (between Indoor Unit and Outdoor Unit)	101
4.11 Outdoor Unit PCB Abnormality.....	102
4.12 OL Activation (Compressor Overload)	105
4.13 Compressor Lock	107
4.14 DC Fan Lock	108
4.15 Input Overcurrent Detection	109
4.16 Four Way Valve Abnormality.....	110
4.17 Discharge Pipe Temperature Control.....	112
4.18 High Pressure Control in Cooling	113
4.19 Compressor System Sensor Abnormality	114
4.20 Position Sensor Abnormality	116
4.21 DC Voltage / Current Sensor Abnormality (20/25/35/42 Class Only) ...	119
4.22 CT or Related Abnormality (RK(X)S50G2V1B, ARXS50G2V1B Only)	120
4.23 Thermistor or Related Abnormality (Outdoor Unit).....	122
4.24 Electrical Box Temperature Rise.....	124
4.25 Radiation Fin Temperature Rise	126
4.26 Output Overcurrent Detection	128
5. Check	130
5.1 Thermistor Resistance Check	130
5.2 Fan Motor Connector Output Check	131
5.3 Power Supply Waveforms Check.....	131
5.4 Electronic Expansion Valve Check.....	132
5.5 Four Way Valve Performance Check.....	133
5.6 Inverter Units Refrigerant System Check.....	133
5.7 Inverter Analyzer Check.....	134
5.8 Rotation Pulse Check on the Outdoor Unit PCB.....	136

5.9 Installation Condition Check.....	137
5.10 Discharge Pressure Check.....	137
5.11 Outdoor Fan System Check.....	138
5.12 Main Circuit Short Check.....	138
5.13 Capacitor Voltage Check.....	140
5.14 Power Module Check.....	141


1. Troubleshooting with LED

1.1 Indoor Unit

Operation Lamp

The operation lamp blinks when any of the following errors is detected.

1. When a protection device of the indoor or outdoor unit is activated, or when the thermistor malfunctions.
 2. When a signal transmission error occurs between the indoor and outdoor units.
- In either case, conduct the diagnostic procedure described in the following pages.

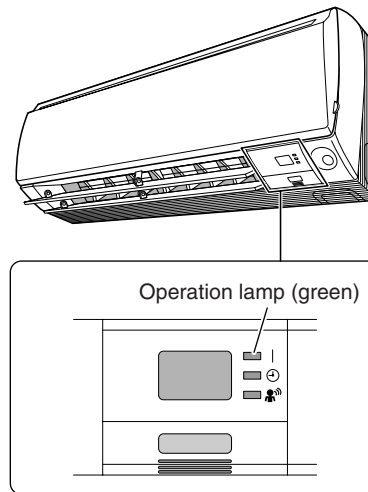

(R12187)

* The design of the front panel varies depending on the model.

Service Monitor

The indoor unit has one green LED (LED A) on the control PCB. When the microcomputer works in order, the LED A blinks.

1.2 Outdoor Unit

The outdoor unit has one green LED (LED A) on the PCB. When the microcomputer works in order, the LED A blinks.


2. Problem Symptoms and Measures

Symptom	Check Item	Details of Measure	Reference Page
The unit does not operate.	Check the power supply.	Check if the rated voltage is supplied.	—
	Check the type of the indoor unit.	Check if the indoor unit type is compatible with the outdoor unit.	—
	Check the outdoor temperature.	Heating operation cannot be used when the outdoor temperature is 18°CWB or higher, and cooling operation cannot be used when the outdoor temperature is below -10°CDB.	—
	Diagnose with remote controller indication.	—	87
	Check the remote controller addresses.	Check if address settings for the remote controller and indoor unit are correct.	150
Operation sometimes stops.	Check the power supply.	A power failure of 2 to 10 cycles stops air conditioner operation. (Operation lamp OFF)	—
	Check the outdoor temperature.	Heating operation cannot be used when the outdoor temperature is 18°CWB or higher, and cooling operation cannot be used when the outdoor temperature is below -10°CDB.	—
	Diagnose with remote controller indication.	—	87
The unit operates but does not cool, or does not heat.	Check for wiring and piping errors in the connection between the indoor unit and outdoor unit.	—	—
	Check for thermistor detection errors.	Check if the thermistor is mounted securely.	—
	Check for faulty operation of the electronic expansion valve.	Set the unit to cooling operation, and check the temperature of the liquid pipe to see if the electronic expansion valve works.	—
	Diagnose with remote controller indication.	—	87
	Diagnose by service port pressure and operating current.	Check for refrigerant shortage.	93
Large operating noise and vibrations	Check the output voltage of the power module.	—	141
	Check the power module.	—	—
	Check the installation condition.	Check if the required spaces for installation (specified in the installation manual) are provided.	—

3. Service Check Function

3.1 ARC452 Series

- Check Method 1**
- When the timer cancel button is held down for 5 seconds, **00** is displayed on the temperature display screen.

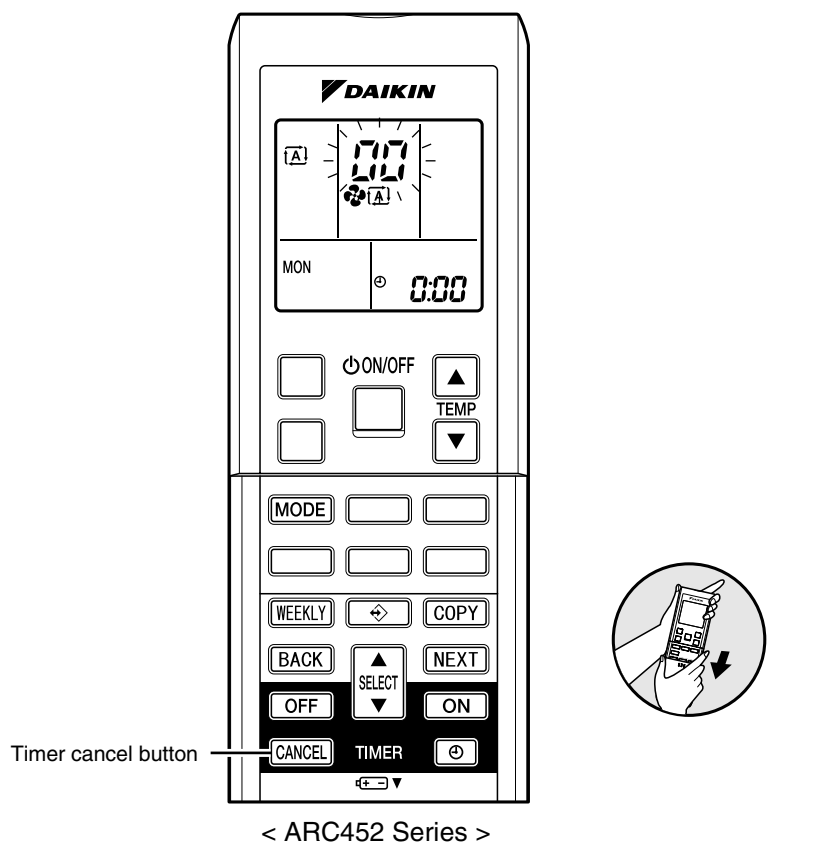

- Press the timer cancel button repeatedly until a long beep sounds.
 - The code indication changes in the sequence shown below.

No.	Code	No.	Code	No.	Code
1	00	13	07	25	UR
2	04	14	R3	26	UR
3	05	15	H8	27	P4
4	E6	16	H9	28	L3
5	H6	17	09	29	L4
6	H0	18	04	30	H7
7	R6	19	05	31	U2
8	E7	20	J3	32	ER
9	U0	21	J6	33	RR
10	F3	22	E5	34	FR
11	R5	23	R1		
12	F6	24	E1		




Note:


- A short beep or two consecutive beeps indicate non-corresponding codes.
- To return to the normal mode, hold the timer cancel button down for 5 seconds. When the remote controller is left untouched for 60 seconds, it also returns to the normal mode.
- Not all the error codes are displayed. When you cannot find the error code, try the check method 2. (→ Refer to page 82.)

Check Method 2


1. Press the 3 buttons (TEMP▲, TEMP▼, MODE) at the same time to enter the diagnosis mode.

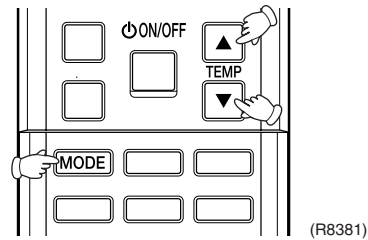

The left-side number blinks.

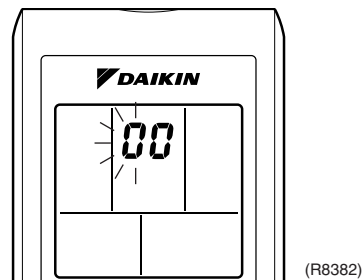


2. Press the [TEMP] ▲ or ▼ button and change the number until you hear the two consecutive beeps or the long beep.

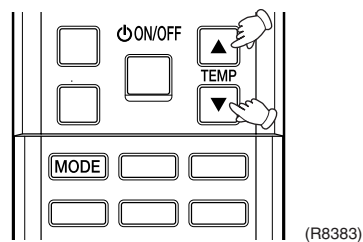


3. Diagnose by the sound.
 - ★beep: The left-side number does not correspond with the error code.
 - ★two consecutive beeps: The left-side number corresponds with the error code but the right-side number does not.
 - ★long beep: Both the left-side and right-side number correspond with the error code. The numbers indicated when you hear the long beep are the error code. → Refer to page 87.


4. Press the [MODE] button.

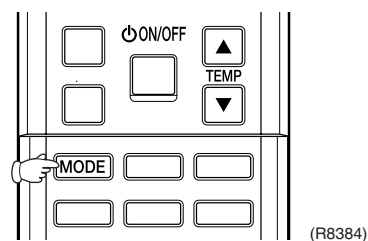


The right-side number blinks.

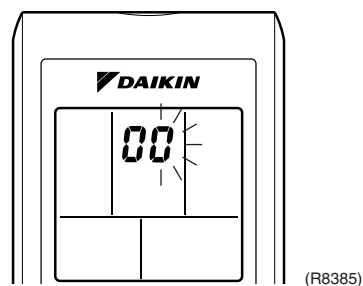


5. Press the [TEMP] ▲ or ▼ button and change the number until you hear the long beep.

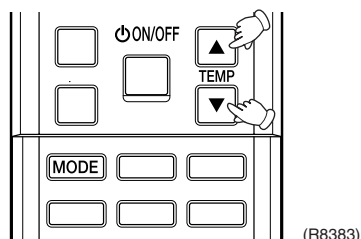


6. Diagnose by the sound.
- ★beep: The left-side number does not correspond with the error code.
 - ★two consecutive beeps: The left-side number corresponds with the error code but the right-side number does not.
 - ★long beep: Both the left-side and right-side number corresponds with the error code.
7. Determine the error code.
The numbers indicated when you hear the long beep are the error code.
Error codes and description → Refer to page 87.
8. Press the [MODE] button to exit from the diagnosis mode.

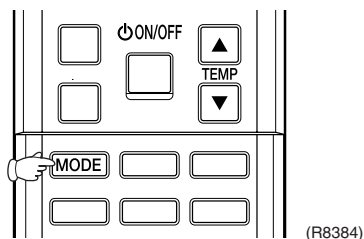

The display 7° means the trial operation mode.
Refer to page 148 for trial operation.

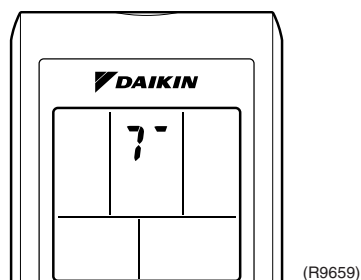

9. Press the [ON/OFF] button twice to return to the normal mode.

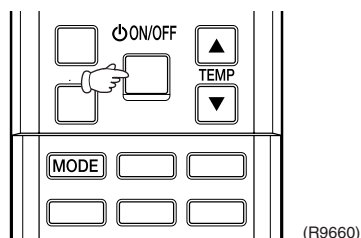


Note: When the remote controller is left untouched for 60 seconds, it returns to the normal mode.

3.2 ARC433 Series

Check Method 1

1. When the timer cancel button is held down for 5 seconds, **00** is displayed on the temperature display screen.

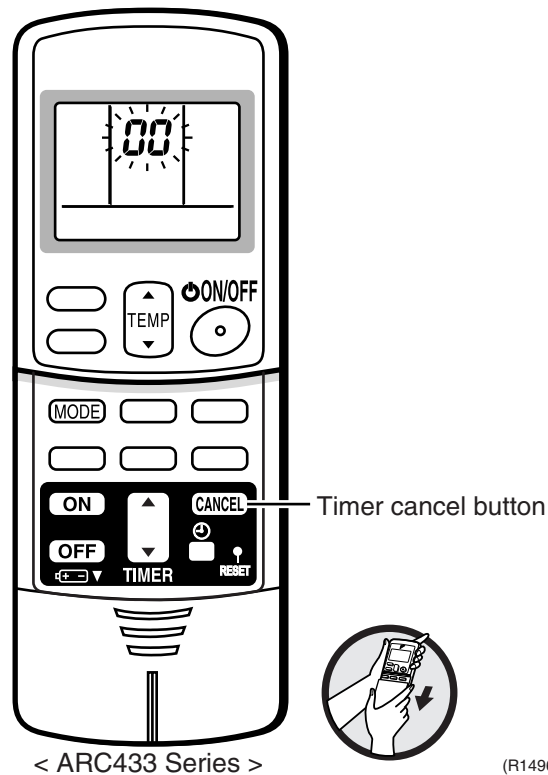

(R14966)

2. Press the timer cancel button repeatedly until a long beep sounds.
 - The code indication changes in the sequence shown below.

No.	Code	No.	Code	No.	Code
1	00	12	F6	23	R1
2	U4	13	E7	24	E1
3	L5	14	R3	25	UR
4	E6	15	H8	26	UN
5	H6	16	H9	27	P4
6	H0	17	E9	28	L3
7	R6	18	E4	29	L4
8	E7	19	E5	30	H7
9	U0	20	J3	31	U2
10	F3	21	J6	32	ER
11	R5	22	E5	33	R4




Note:


1. A short beep or two consecutive beeps indicate non-corresponding codes.
2. To return to the normal mode, hold the timer cancel button down for 5 seconds. When the remote controller is left untouched for 60 seconds, it also returns to the normal mode.
3. Not all the error codes are displayed. When you cannot find the error code, try the check method 2. (→ Refer to page 85.)

Check Method 2


1. Press the center of the [TEMP] button and the [MODE] button at the same time to enter the diagnosis mode.

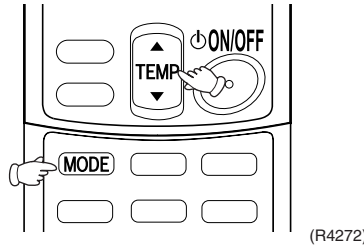

The left-side number blinks.

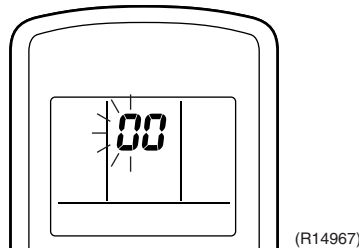


2. Press the [TEMP] ▲ or ▼ button and change the number until you hear the two consecutive beeps or the long beep.

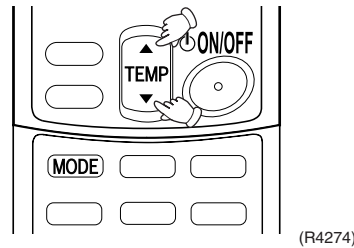


3. Diagnose by the sound.
 - ★beep: The left-side number does not correspond with the error code.
 - ★two consecutive beeps: The left-side number corresponds with the error code but the right-side number does not.
 - ★long beep: Both the left-side and right-side number correspond with the error code. The numbers indicated when you hear the long beep are the error code. Error codes and description → Refer to page 87.


4. Press the [MODE] button.

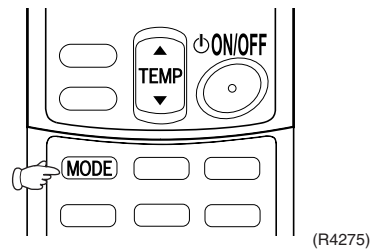

The right-side number blinks.

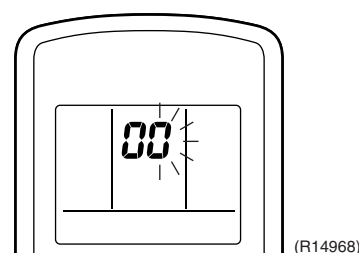


5. Press the [TEMP] ▲ or ▼ button and change the number until you hear the long beep.




(R4277)

6. Diagnose by the sound.
- ★beep: The left-side number does not correspond with the error code.
 - ★two consecutive beeps: The left-side number corresponds with the error code but the right-side number does not.
 - ★long beep: Both the left-side and right-side number correspond with the error code.
7. Determine the error code.
The numbers indicated when you hear the long beep are the error code.
Error codes and description → Refer to page 87.
8. Press the [MODE] button to exit from the diagnosis mode.




(R4278)

The display 7⁻ means the trial operation mode.
Refer to page 148 for trial operation.



(R14969)

9. Press the [ON/OFF] button twice to return to the normal mode.



(R9670)



Note: When the remote controller is left untouched for 60 seconds, it returns to the normal mode.

4. Troubleshooting

4.1 Error Codes and Description


	Error Codes	Description	Reference Page
System	00	Normal	—
	U0★	Refrigerant shortage	93
	U2	Low-voltage detection or over-voltage detection	96
	U4	Signal transmission error (between indoor unit and outdoor unit)	98
	U8	Unspecified voltage (between indoor unit and outdoor unit)	101
Indoor Unit	P1	Indoor unit PCB abnormality	88
	P5	Freeze-up protection control or heating peak-cut control	89
	P6	Fan motor (DC motor) or related abnormality	90
	C4	Indoor heat exchanger thermistor or related abnormality	92
	C9	Room temperature thermistor or related abnormality	92
Outdoor Unit	E1	Outdoor unit PCB abnormality	102
	E5★	OL activation (compressor overload)	105
	E6★	Compressor lock	107
	E7★	DC fan lock	108
	E8	Input overcurrent detection	109
	E9	Four way valve abnormality	110
	F3	Discharge pipe temperature control	112
	F6	High pressure control in cooling	113
	H0	Compressor system sensor abnormality	114
	H6	Position sensor abnormality	116
	H8	DC voltage / current sensor abnormality (20/25/35/42 class only)	119
		CT or related abnormality (RK(X)S50G2V1B, ARXS50G2V1B only)	120
	H9	Outdoor temperature thermistor or related abnormality	122
	J3★	Discharge pipe thermistor or related abnormality	122
	J6	Outdoor heat exchanger thermistor or related abnormality	122
	L3	Electrical box temperature rise	124
	L4	Radiation fin temperature rise	126
	L5★	Output overcurrent detection	128
	P4	Radiation fin thermistor or related abnormality	122
	U7	Signal transmission error on outdoor unit PCB (RK(X)S50G2V1B, ARXS50G2V1B only)	100

★: Displayed only when system-down occurs.

4.2 Indoor Unit PCB Abnormality

Error Code	A1
Method of Error Detection	The system checks if the circuit works properly within the microcomputer of the indoor unit.
Error Decision Conditions	The system cannot set the internal settings.
Supposed Causes	<ul style="list-style-type: none"> ■ Wrong models interconnected ■ Defective indoor unit PCB ■ Disconnection of connector ■ Reduction of power supply voltage

Troubleshooting

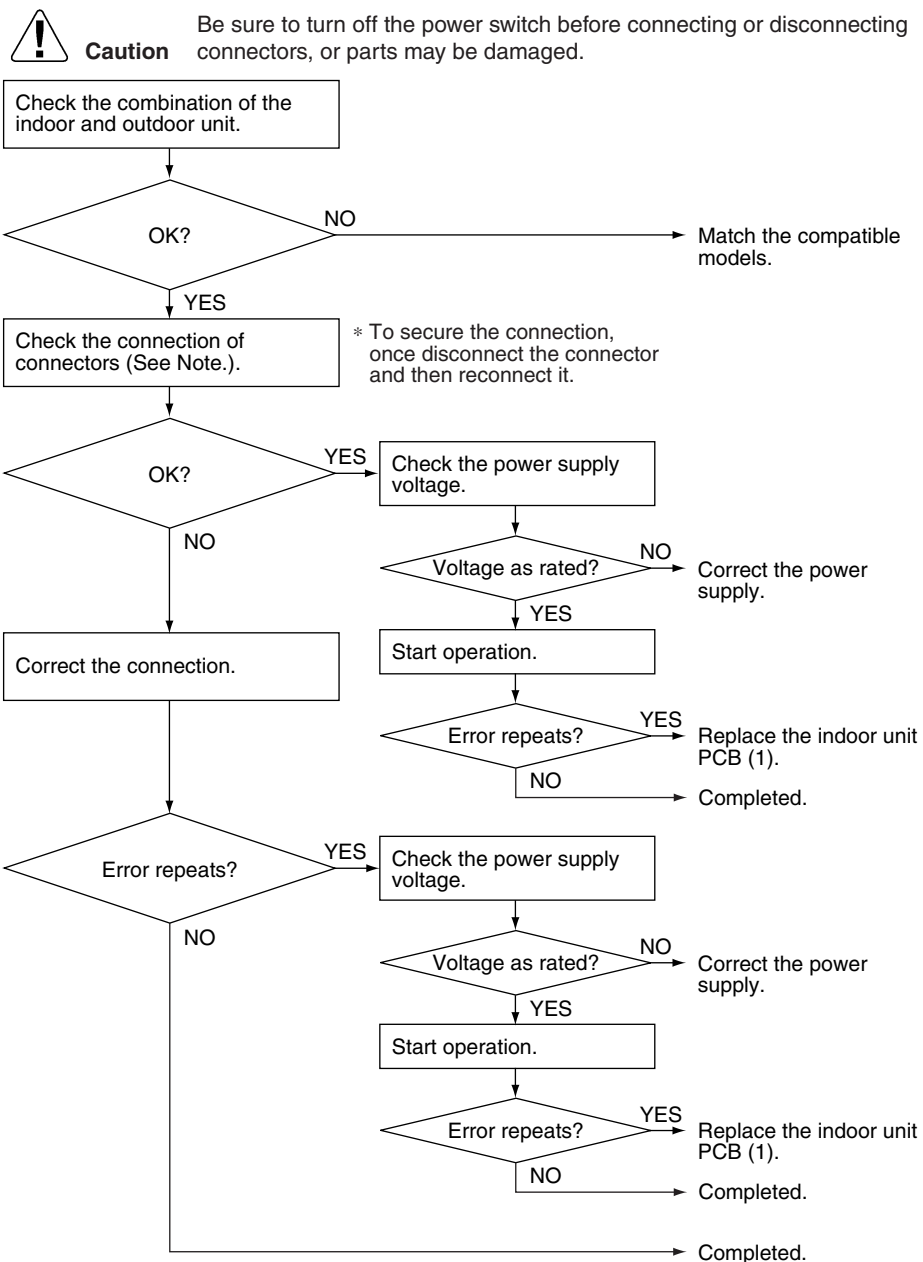

Note: Check the following connector.

Model Type	Connector
Wall mounted type	Terminal board ~ Control PCB (H1, H2, H3)

(R15270)

4.3 Freeze-up Protection Control or Heating Peak-cut Control

Error Code	A5
Method of Error Detection	<ul style="list-style-type: none"> ■ Freeze-up protection control During cooling operation, the freeze-up protection control (operation halt) is activated according to the temperature detected by the indoor heat exchanger thermistor. ■ Heating peak-cut control During heating operation, the temperature detected by the indoor heat exchanger thermistor is used for the heating peak-cut control (operation halt, outdoor fan stop, etc.)
Error Decision Conditions	<ul style="list-style-type: none"> ■ Freeze-up protection control During cooling operation, the indoor heat exchanger temperature is below 0°C. ■ Heating peak-cut control During heating operation, the indoor heat exchanger temperature is above 65°C.
Supposed Causes	<ul style="list-style-type: none"> ■ Short-circuited air ■ Clogged air filter of the indoor unit ■ Dust accumulation on the indoor heat exchanger ■ Defective indoor heat exchanger thermistor ■ Defective indoor unit PCB

Troubleshooting




Check No.01
Refer to P.130



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

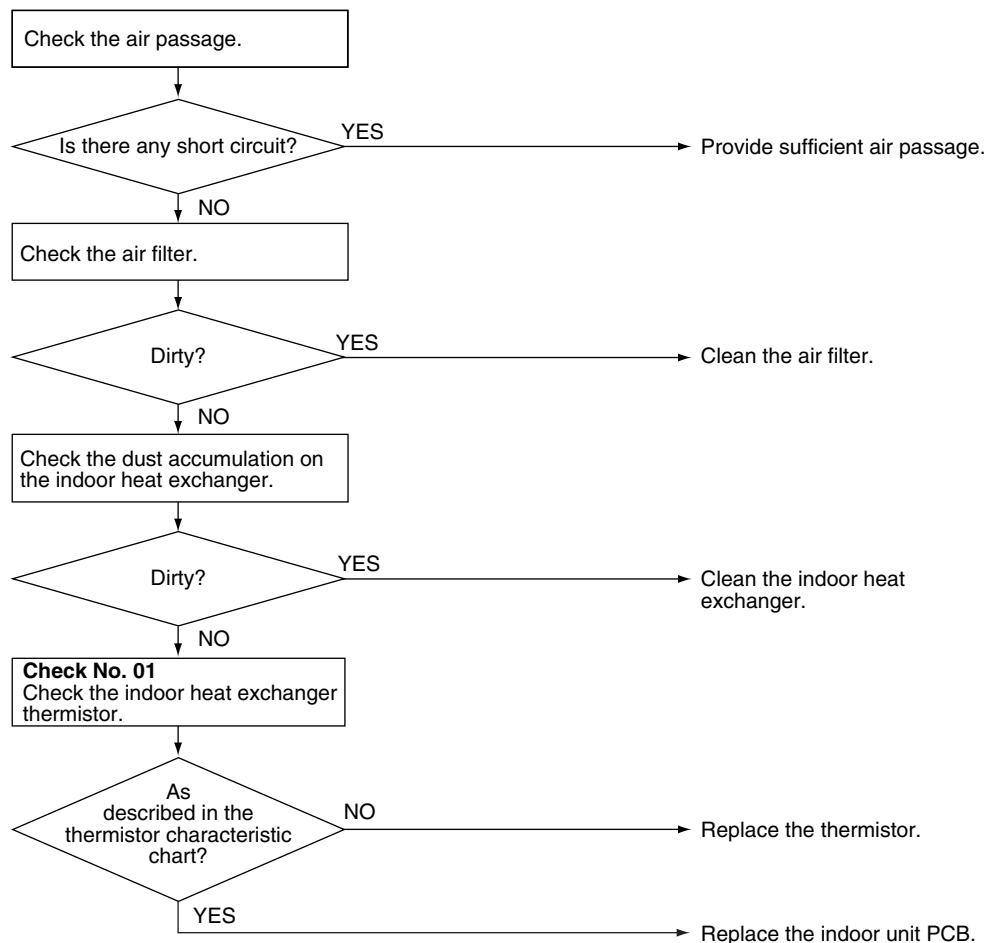

(R15715)

4.4 Fan Motor (DC Motor) or Related Abnormality

Error Code	FE
Method of Error Detection	The rotation speed detected by the Hall IC during fan motor operation is used to determine abnormal fan motor operation.
Error Decision Conditions	The detected rotation speed does not reach the demanded rotation speed of the target tap, and is less than 50% of the maximum fan motor rotation speed.
Supposed Causes	<ul style="list-style-type: none">■ Layer short inside the fan motor winding■ Breaking of wire inside the fan motor■ Breaking of the fan motor lead wires■ Defective capacitor of the fan motor■ Defective indoor unit PCB

Troubleshooting




Check No.02
Refer to P.131



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

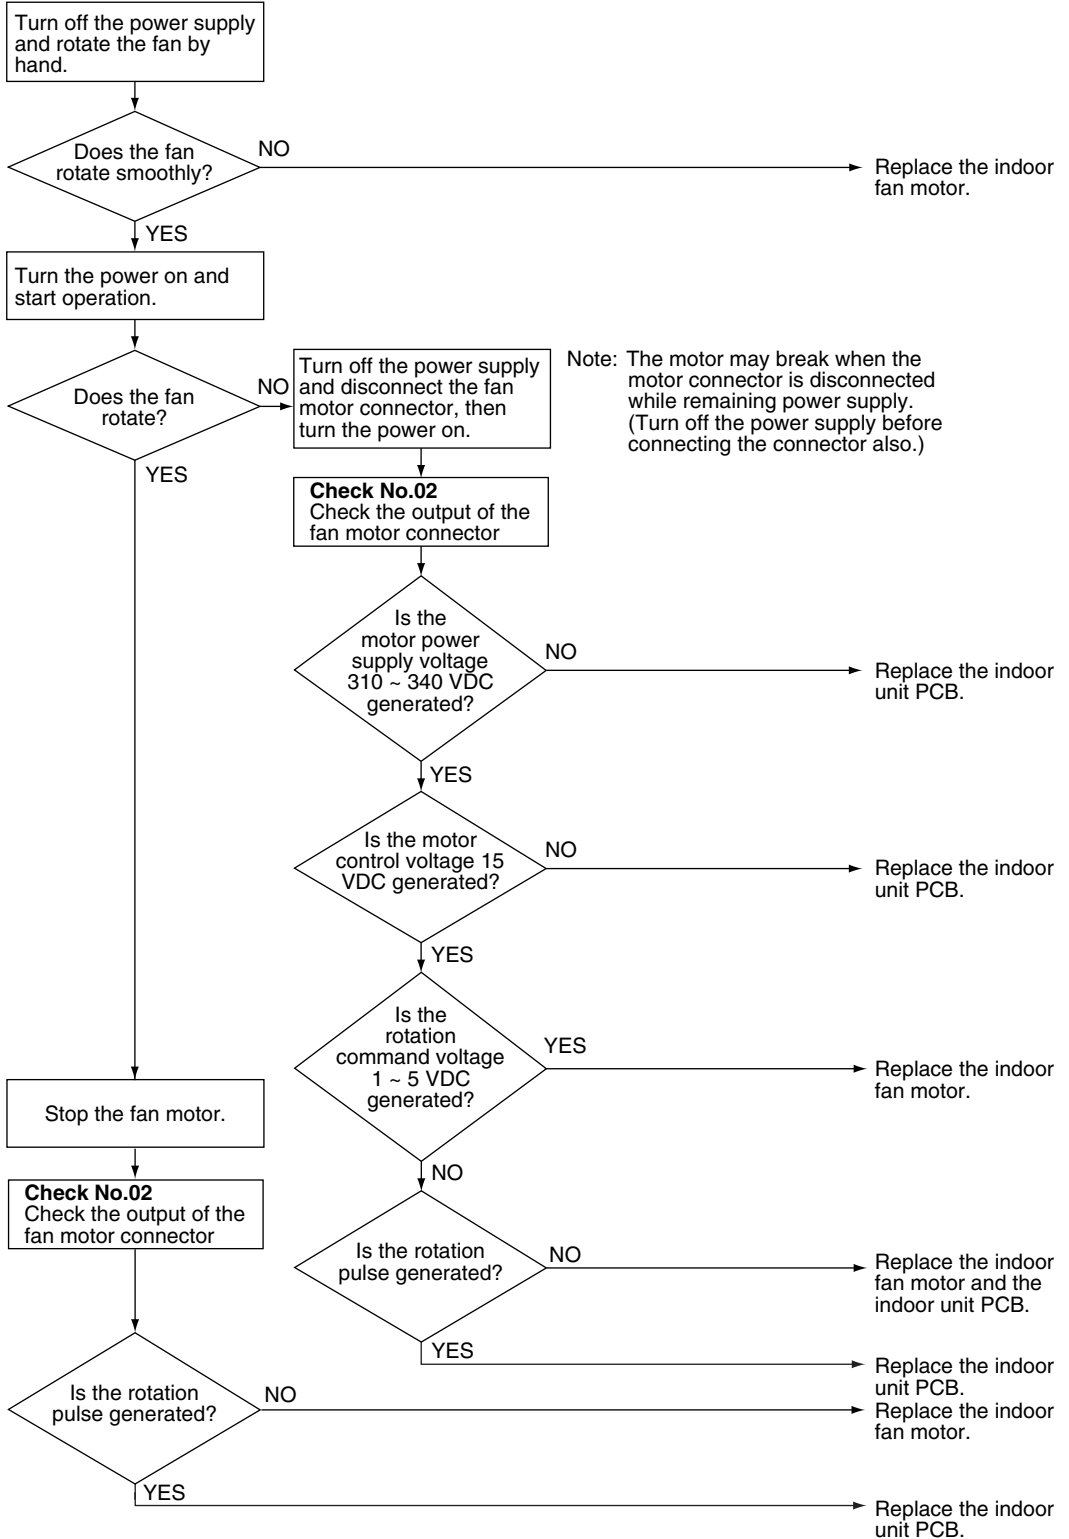


(R14970)

4.5 Thermistor or Related Abnormality (Indoor Unit)

Error Code	U4, U9
Method of Error Detection	The temperatures detected by the thermistors determine thermistor errors.
Error Decision Conditions	The thermistor input is more than 4.96 V or less than 0.04 V during compressor operation.
Supposed Causes	<ul style="list-style-type: none"> ■ Disconnection of connector ■ Defective thermistor corresponding to the error code ■ Defective indoor unit PCB

Troubleshooting


Check No.01
Refer to P.130

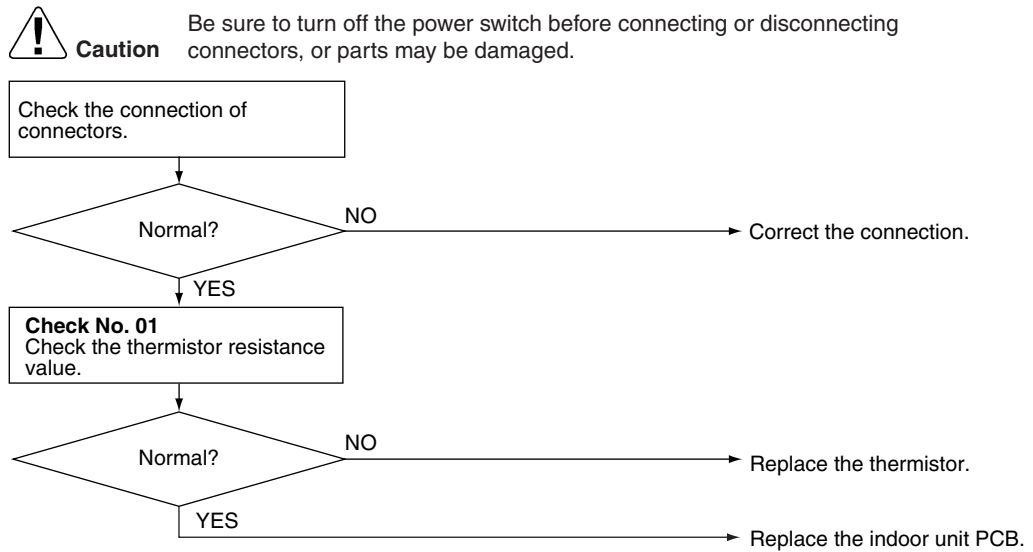

(R15717)

U4 : Indoor heat exchanger thermistor
 U9 : Room temperature thermistor

4.6 Refrigerant Shortage

Error Code	U0																																												
Method of Error Detection	<p>Refrigerant shortage detection I: Refrigerant shortage is detected by checking the input current value and the compressor running frequency. If the refrigerant is short, the input current is lower than the normal value.</p> <p>Refrigerant shortage detection II: Refrigerant shortage is detected by checking the discharge pipe temperature and the opening of the electronic expansion valve. If the refrigerant is short, the discharge pipe temperature tends to rise.</p> <p>Refrigerant shortage detection III: Refrigerant shortage is detected by checking the difference between suction and discharge temperature.</p>																																												
Error Decision Conditions	<p>Refrigerant shortage detection I: The following conditions continue for 7 minutes.</p> <p><20/25/35/42 class, ARXS50G3V1B></p> <ul style="list-style-type: none"> ◆ Input current × input voltage ≤ A × output frequency + B ◆ Output frequency > C <table border="1"> <thead> <tr> <th></th> <th>A (-)</th> <th>B (W)</th> <th>C (Hz)</th> </tr> </thead> <tbody> <tr> <td>20/25/35 class</td> <td>640/256</td> <td>0</td> <td>55</td> </tr> <tr> <td>42 class</td> <td>3446/256</td> <td>-346</td> <td>48</td> </tr> <tr> <td>ARXS50G3V1B</td> <td>2000/256</td> <td>-181</td> <td>55</td> </tr> </tbody> </table> <p><RK(X)S50G2V1B, ARXS50G2V1B></p> <ul style="list-style-type: none"> ◆ Input current ≤ D × output frequency + E ◆ Output frequency > F <table border="1"> <thead> <tr> <th></th> <th>D (-)</th> <th>E (A)</th> <th>F (Hz)</th> </tr> </thead> <tbody> <tr> <td>RK(X)S50G2V1B ARXS50G2V1B</td> <td>18/1000</td> <td>0.7</td> <td>55</td> </tr> </tbody> </table> <p>Refrigerant shortage detection II: The following conditions continue for 80 seconds.</p> <ul style="list-style-type: none"> ◆ Opening of the electronic expansion valve ≥ G ◆ Discharge pipe temperature > H × target discharge pipe temperature + J <table border="1"> <thead> <tr> <th></th> <th>G (pulse)</th> <th>H (-)</th> <th>J (°C)</th> </tr> </thead> <tbody> <tr> <td>20/25/35 class</td> <td>480</td> <td>128/128</td> <td>30</td> </tr> <tr> <td>42 class</td> <td>450</td> <td>128/128</td> <td>40</td> </tr> <tr> <td>RK(X)S50G2V1B ARXS50G2V1B</td> <td>480</td> <td>128/128</td> <td>cooling: 20, heating: 45</td> </tr> <tr> <td>ARXS50G3V1B</td> <td>480</td> <td>128/128</td> <td>cooling: 60, heating: 45</td> </tr> </tbody> </table>		A (-)	B (W)	C (Hz)	20/25/35 class	640/256	0	55	42 class	3446/256	-346	48	ARXS50G3V1B	2000/256	-181	55		D (-)	E (A)	F (Hz)	RK(X)S50G2V1B ARXS50G2V1B	18/1000	0.7	55		G (pulse)	H (-)	J (°C)	20/25/35 class	480	128/128	30	42 class	450	128/128	40	RK(X)S50G2V1B ARXS50G2V1B	480	128/128	cooling: 20, heating: 45	ARXS50G3V1B	480	128/128	cooling: 60, heating: 45
	A (-)	B (W)	C (Hz)																																										
20/25/35 class	640/256	0	55																																										
42 class	3446/256	-346	48																																										
ARXS50G3V1B	2000/256	-181	55																																										
	D (-)	E (A)	F (Hz)																																										
RK(X)S50G2V1B ARXS50G2V1B	18/1000	0.7	55																																										
	G (pulse)	H (-)	J (°C)																																										
20/25/35 class	480	128/128	30																																										
42 class	450	128/128	40																																										
RK(X)S50G2V1B ARXS50G2V1B	480	128/128	cooling: 20, heating: 45																																										
ARXS50G3V1B	480	128/128	cooling: 60, heating: 45																																										

Refrigerant shortage detection III: (20/25/35 class only)

When the difference of the temperature is smaller than **K**°C, it is regarded as refrigerant shortage.

Operation mode	Description	K (°C)
Cooling	room thermistor temperature – indoor heat exchanger temperature	4.0
	outdoor heat exchanger temperature – outdoor temperature	4.0
Heating	indoor heat exchanger temperature – room thermistor temperature	3.0
	outdoor temperature – outdoor heat exchanger temperature	3.0

- If the error repeats, the system is shut down.
- Reset condition: Continuous run for about 60 minutes without any other error

Supposed Causes

-
- Disconnection of the discharge pipe thermistor, indoor or outdoor heat exchanger thermistor, room or outdoor temperature thermistor
 - Closed stop valve
 - Refrigerant shortage (refrigerant leakage)
 - Poor compression performance of compressor
 - Defective electronic expansion valve

Troubleshooting




Check No.01
Refer to P.130



Check No.12
Refer to P.132



Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

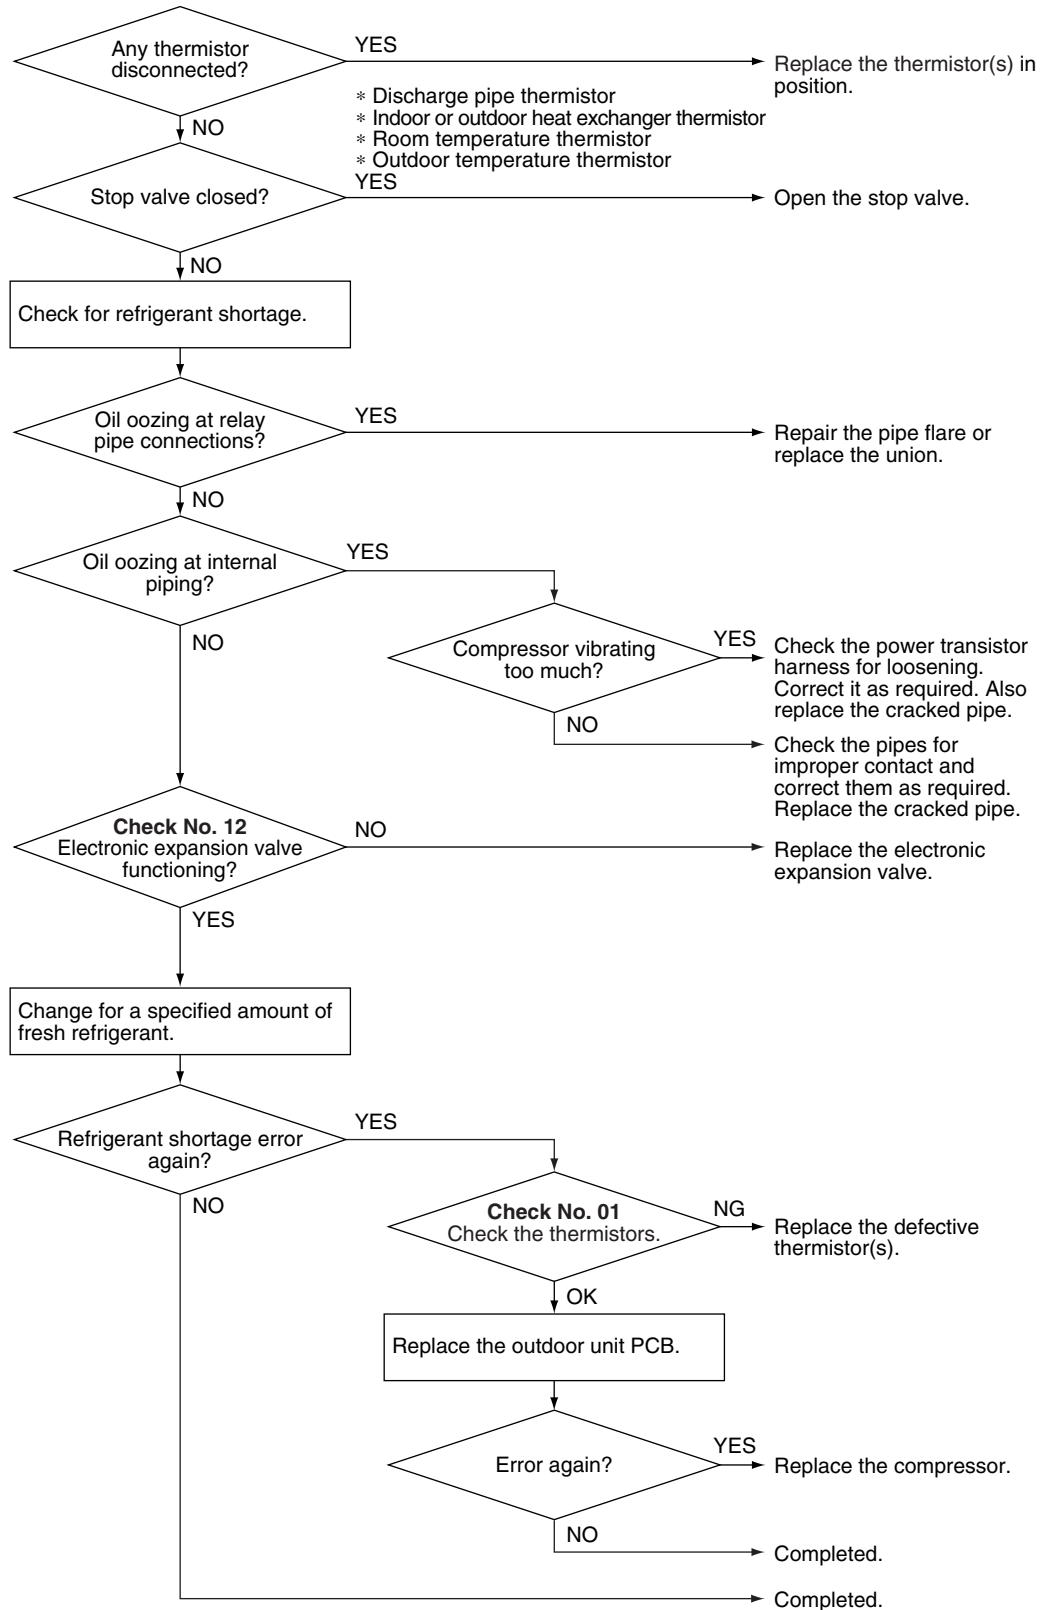

(R16015)

4.7 Low-voltage Detection or Over-voltage Detection


Error Code	U2
Method of Error Detection	<p>Low-voltage detection: An abnormal voltage drop is detected by the DC voltage detection circuit.</p> <p>Over-voltage detection: An abnormal voltage rise is detected by the over-voltage detection circuit.</p>
Error Decision Conditions	<p>Low-voltage detection:</p> <ul style="list-style-type: none"> ■ The voltage detected by the DC voltage detection circuit is below 150 ~ 200 V (depending on the model). ■ The compressor stops if the error occurs, and restarts automatically after 3-minute standby. <p>Over-voltage detection:</p> <ul style="list-style-type: none"> ■ An over-voltage signal is fed from the over-voltage detection circuit to the microcomputer. ■ The compressor stops if the error occurs, and restarts automatically after 3-minute standby.
Supposed Causes	<ul style="list-style-type: none"> ■ Power supply voltage is not as specified. ■ Defective DC voltage detection circuit ■ Defective over-voltage detection circuit ■ Defective PAM control part ■ Disconnection of compressor harness ■ Short circuit inside the fan motor winding ■ Noise ■ Momentary fall of voltage ■ Momentary power failure

Troubleshooting



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

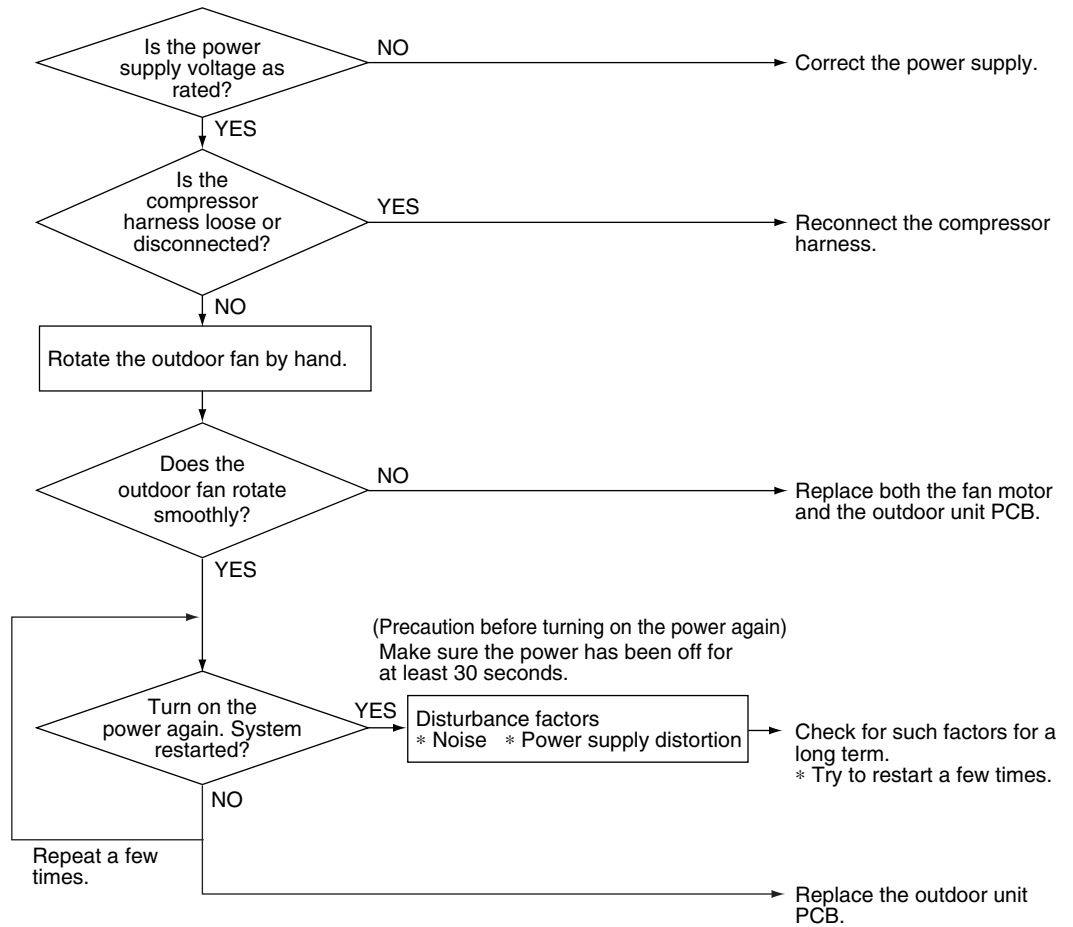

(R17948)

4.8 Signal Transmission Error (between Indoor Unit and Outdoor Unit)

Error Code	U4
Method of Error Detection	The data received from the outdoor unit in signal transmission is checked whether it is normal.
Error Decision Conditions	The data sent from the outdoor unit cannot be received normally, or the content of the data is abnormal.
Supposed Causes	<ul style="list-style-type: none">■ Reduction of power supply voltage■ Wiring error■ Breaking of the connecting wires between the indoor and outdoor units (wire No. 3)■ Defective outdoor unit PCB■ Short circuit inside the fan motor winding■ Defective indoor unit PCB■ Disturbed power supply waveform


Troubleshooting



Check No.11
Refer to P.131

**Caution**

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

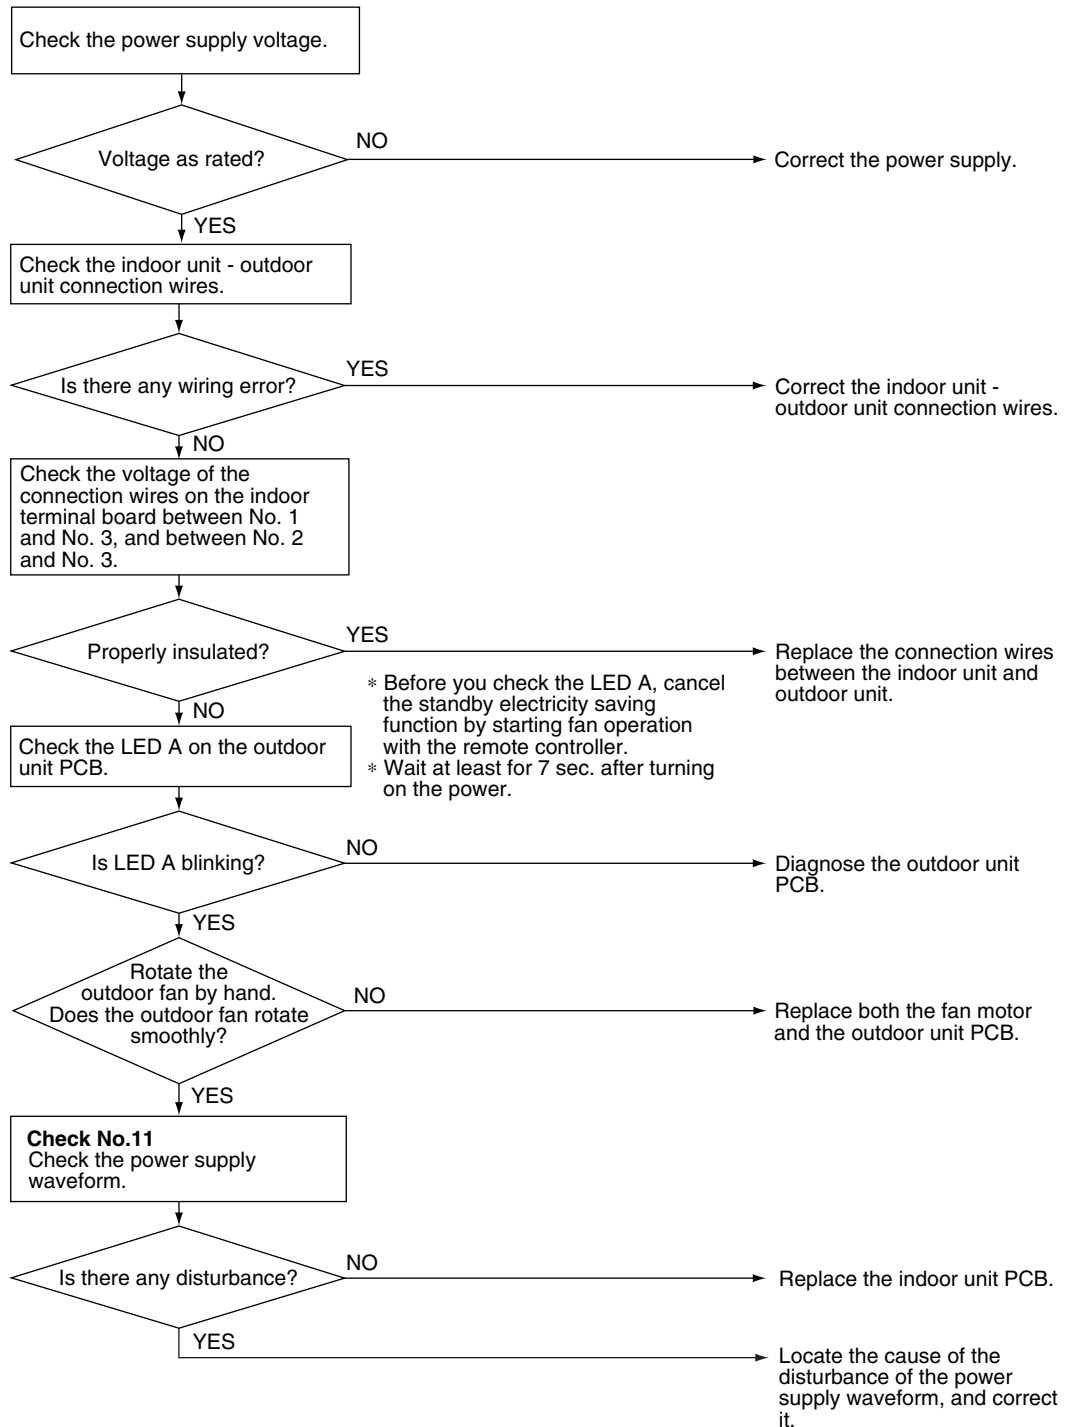


(R18180)

4.9 Signal Transmission Error on Outdoor Unit PCB (RK(X)S50G2V1B, ARXS50G2V1B Only)

Error Code	U7
Method of Error Detection	Communication error between microcomputer mounted on the main microcomputer and PM1.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The abnormality is determined when the data sent from the PM1 can not be received for 9 seconds. ■ The error counter is reset when the data from the PM1 can be successfully received.
Supposed Causes	<ul style="list-style-type: none"> ■ Defective outdoor unit PCB

Troubleshooting

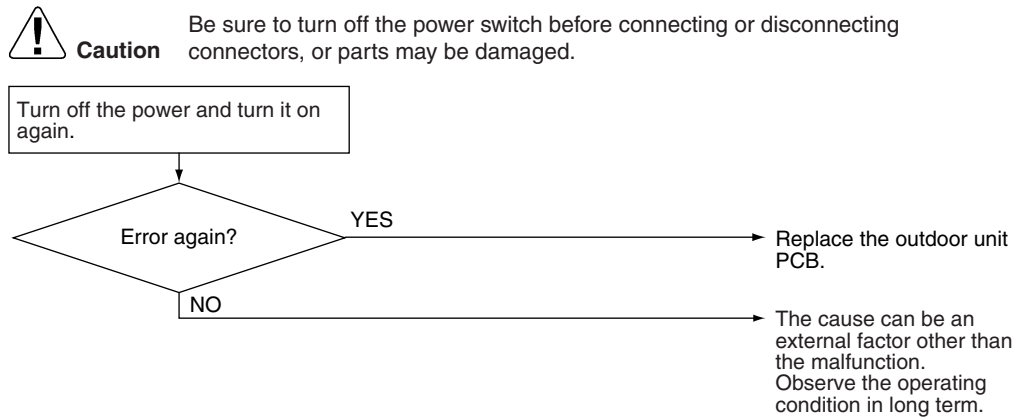


(R7185)

4.10 Unspecified Voltage (between Indoor Unit and Outdoor Unit)

Error Code	U8
Method of Error Detection	The supply power is detected for its requirements (different from pair type and multi type) by the indoor / outdoor transmission signal.
Error Decision Conditions	The pair type and multi type are interconnected.
Supposed Causes	<ul style="list-style-type: none"> ■ Wrong models interconnected ■ Wrong wiring of connecting wires ■ Wrong indoor unit PCB or outdoor unit PCB mounted ■ Defective indoor unit PCB ■ Defective outdoor unit PCB

Troubleshooting

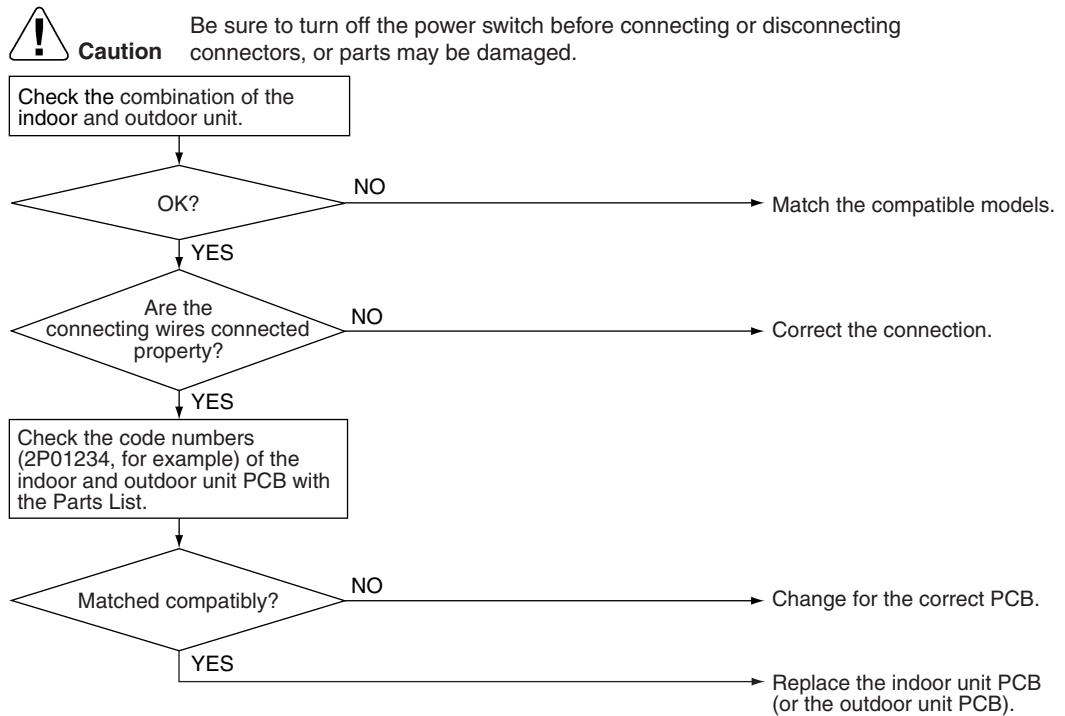


(R11707)

4.11 Outdoor Unit PCB Abnormality

Error Code	E1
Method of Error Detection	<ul style="list-style-type: none"> ■ The system checks if the microprocessor is working in order. ■ The system checks if the zero-cross signal comes in properly.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The microprocessor program runs out of control. ■ The zero-cross signal is not detected.
Supposed Causes	<ul style="list-style-type: none"> ■ Defective outdoor unit PCB ■ Broken harness between PCBs ■ Noise ■ Momentary fall of voltage ■ Momentary power failure

Troubleshooting 20/25/35 class, ARXS50G3V1B

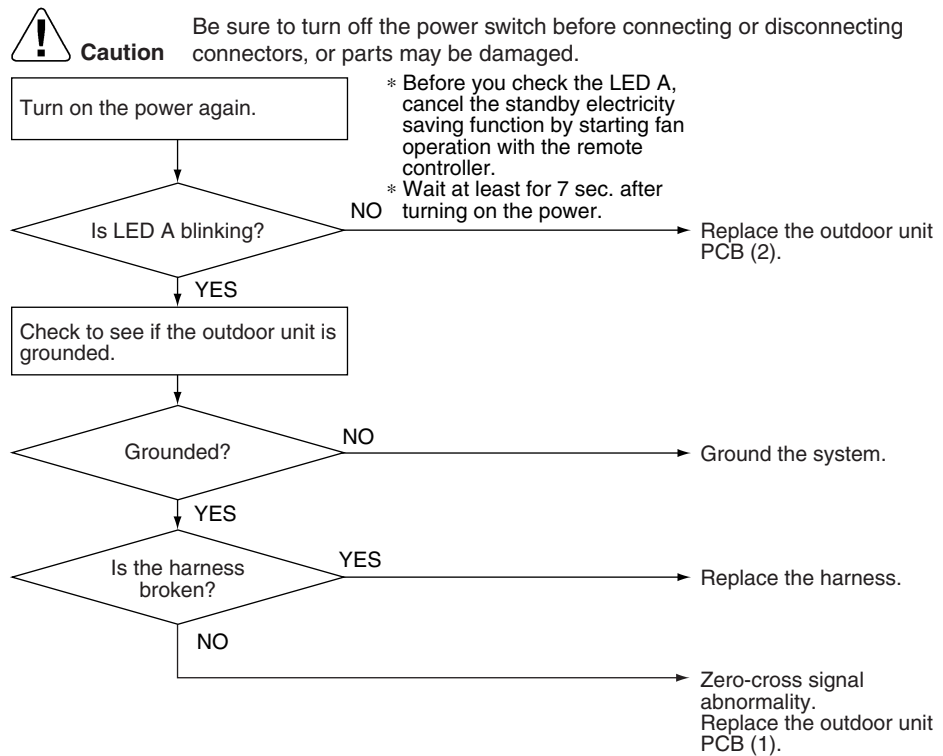


(R16910)

Troubleshooting 42 class



Caution

Be sure to turn off power switch before connect or disconnect connector, or parts damage may be occurred.

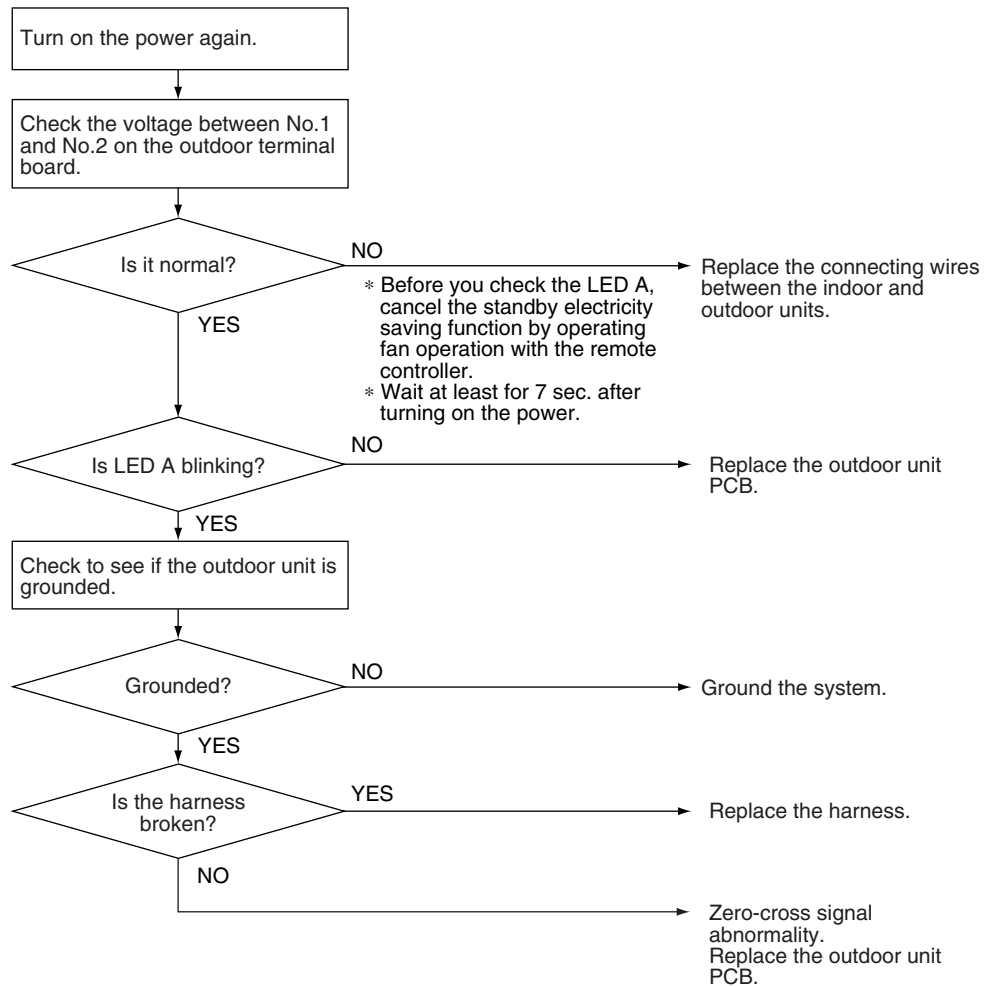

(R12188)


Troubleshooting

RK(X)S50G2V1B, ARXS50G2V1B



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

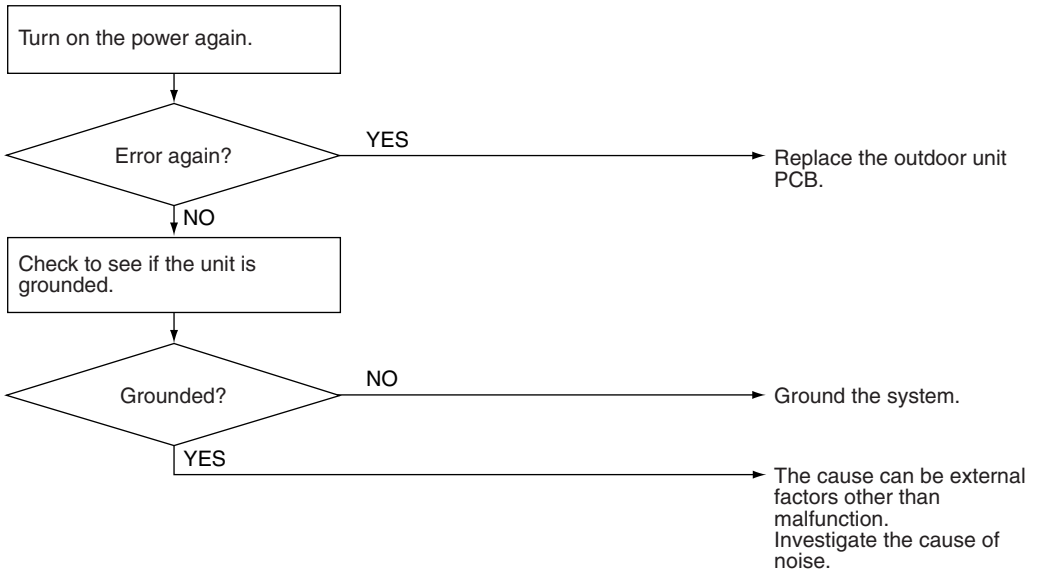

(R16690)

4.12 OL Activation (Compressor Overload)

Error Code	E5
Method of Error Detection	A compressor overload is detected through compressor OL.
Error Decision Conditions	<ul style="list-style-type: none">■ If the error repeats, the system is shut down.■ Reset condition: Continuous run for about 60 minutes without any other error
Supposed Causes	<ul style="list-style-type: none">■ Disconnection of discharge pipe thermistor■ Defective discharge pipe thermistor■ Disconnection of connector [S40]■ Disconnection of 2 terminals of OL (Q1L)■ Defective OL (Q1L)■ Broken OL harness■ Defective electronic expansion valve or coil■ Defective four way valve or coil■ Defective outdoor unit PCB■ Refrigerant shortage■ Water mixed in refrigerant■ Defective stop valve

Troubleshooting



Check No.01
Refer to P.130



Check No.12
Refer to P.132




Check No.13
Refer to P.133



Check No.14
Refer to P.133



Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

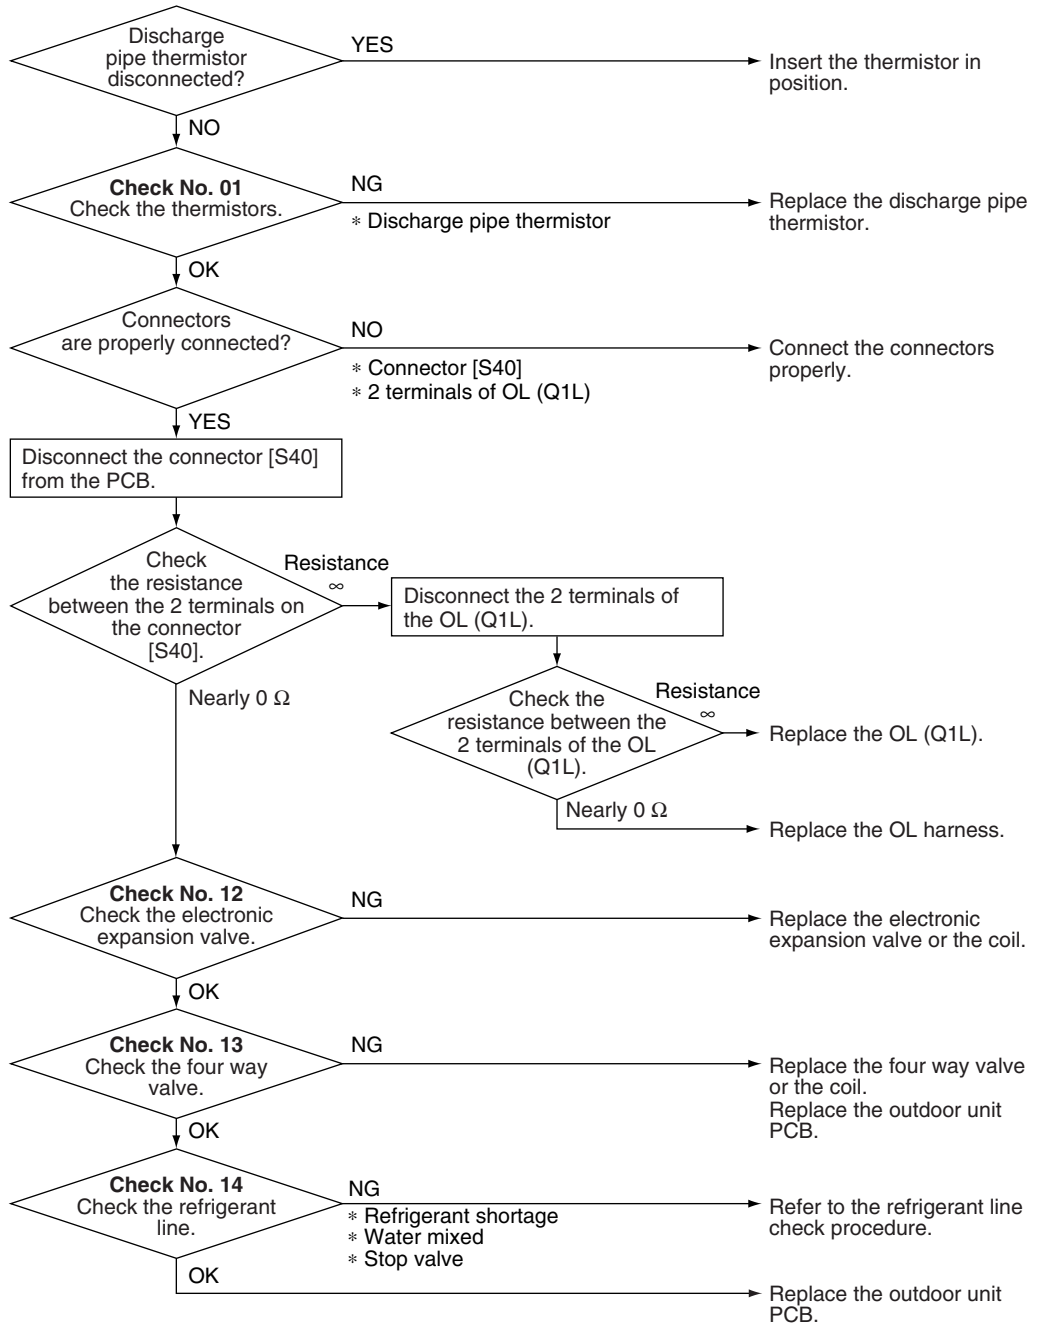

(R18316)



Note: OL (Q1L) activating temperature: 120°C
OL (Q1L) recovery temperature: 95°C

4.13 Compressor Lock

Error Code **E6**

Method of Error Detection A compressor lock is detected by checking the compressor running condition through the position detection circuit.

Error Decision Conditions **20/25/35/42 class**

- Operation stops due to overcurrent.
- If the error repeats, the system is shut down.
- Reset condition: Continuous run for about 11 minutes without any other error

50 class

- A compressor lock is detected by the current waveform generated when applying high-frequency voltage to the motor.
- If the error repeats, the system is shut down
- Reset condition: Continuous run for about 5 minutes without any other error

Supposed Causes

- Compressor locked
- Compressor harness disconnected

Troubleshooting



Check No.15
Refer to P.134




Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

(Precaution before turning on the power again)

Make sure the power has been off for at least 30 seconds.

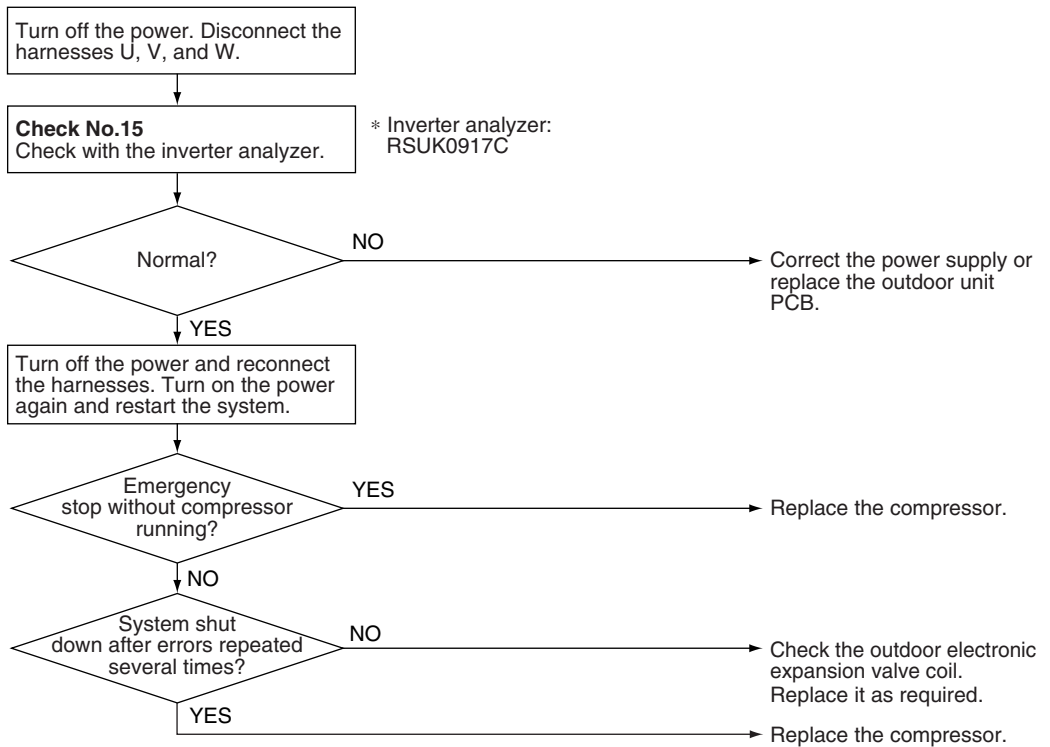


(R18317)

4.14 DC Fan Lock

Error Code	E7
Method of Error Detection	An error is determined with the high-voltage fan motor rotation speed detected by the Hall IC.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The fan does not start in about 15 ~ 60 seconds even when the fan motor is running. ■ If the error repeats, the system is shut down. ■ Reset condition: Continuous run for about 11 minutes (20/25/35/42 class) or 5 minutes (50 class) without any other error
Supposed Causes	<ul style="list-style-type: none"> ■ Disconnection of the fan motor ■ Foreign matter stuck in the fan ■ Defective fan motor ■ Defective outdoor unit PCB

Troubleshooting


Check No.16
 Refer to P.136

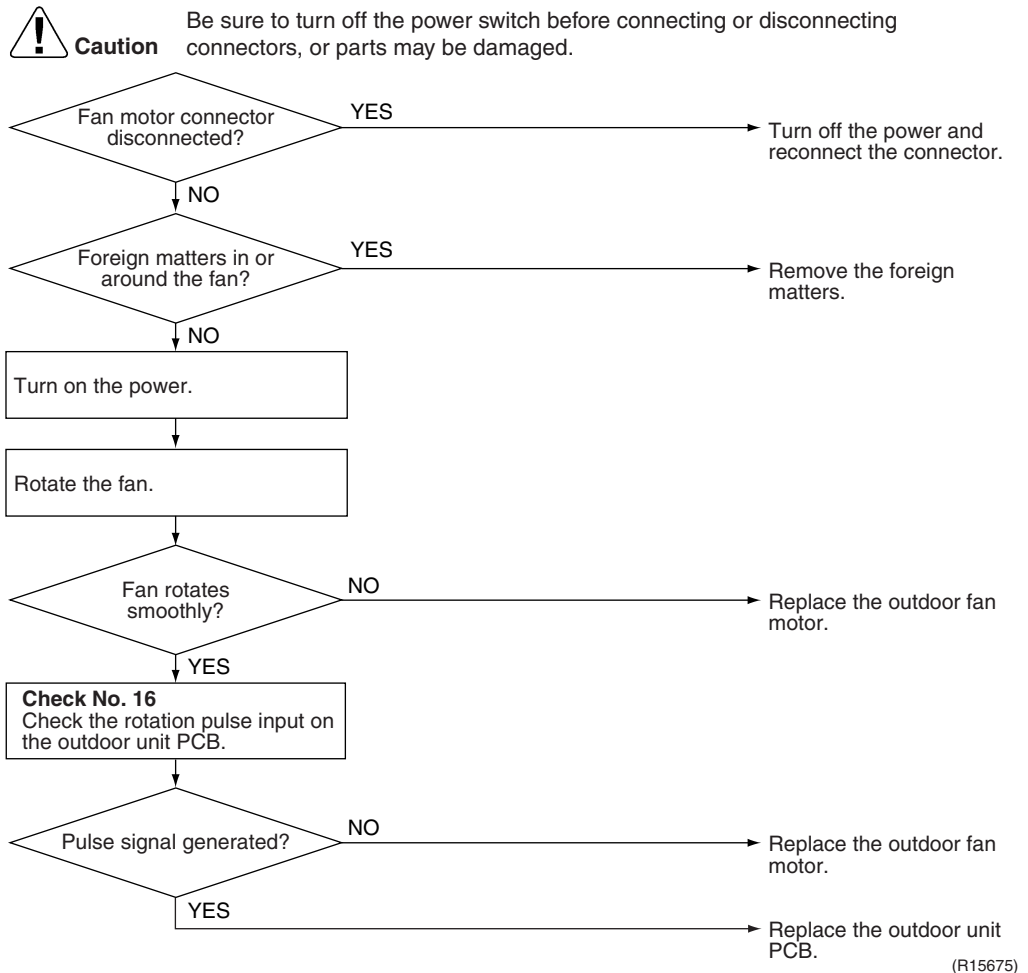

4.15 Input Overcurrent Detection


Error Code	E8
Method of Error Detection	An input overcurrent is detected by checking the input current value with the compressor running.
Error Decision Conditions	The current exceeds about 9.25 ~ 20 A for 2.5 seconds with the compressor running. (The upper limit of the current decreases when the outdoor temperature exceeds a certain level.)
Supposed Causes	<ul style="list-style-type: none"> ■ Outdoor temperature is out of operation range. ■ Defective compressor ■ Defective power module ■ Defective outdoor unit PCB ■ Short circuit

Troubleshooting


Check No.15
 Refer to P.134


Check No.17
 Refer to P.137


Check No.18
 Refer to P.137

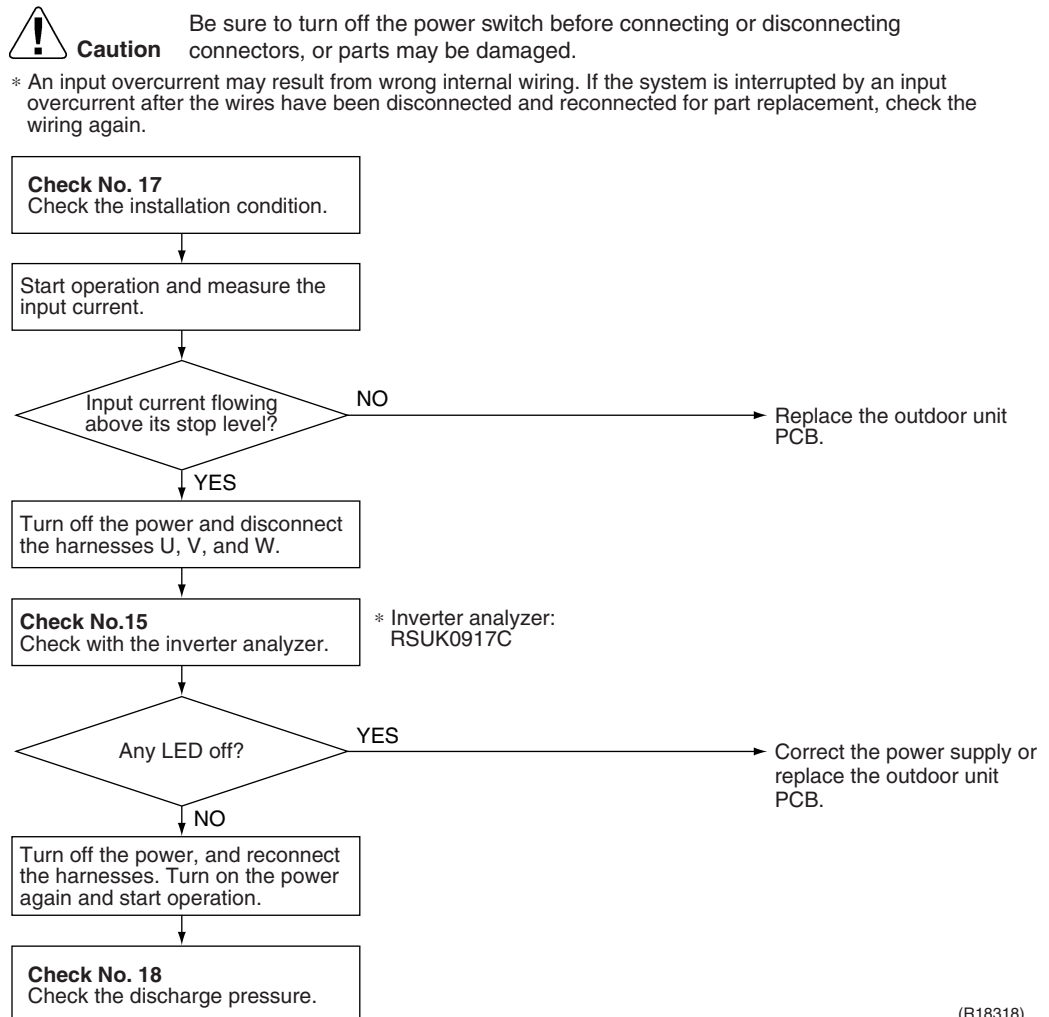

4.16 Four Way Valve Abnormality

Error Code	E8
Method of Error Detection	The room temperature thermistor and the indoor heat exchanger thermistor are checked if they function within their normal ranges in each operation mode.
Error Decision Conditions	<p>A following condition continues over 1 ~ 10 minutes (depending on the model) after operating for 5 ~ 10 minutes (depending on the model).</p> <ul style="list-style-type: none">■ Cooling / Dry (room thermistor temp. – indoor heat exchanger temp.) < –5°C■ Heating (indoor heat exchanger temp. – room thermistor temp.) < –5°C <p>■ If the error repeats, the system is shut down. ■ Reset condition: Continuous run for about 60 minutes without any other error</p>
Supposed Causes	<ul style="list-style-type: none">■ Disconnection of four way valve coil■ Defective four way valve, coil, or harness■ Defective outdoor unit PCB■ Defective thermistor■ Refrigerant shortage■ Water mixed in refrigerant■ Defective stop valve

Troubleshooting



Check No.01
Refer to P.130




Check No.13
Refer to P.133



Check No.14
Refer to P.133



Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

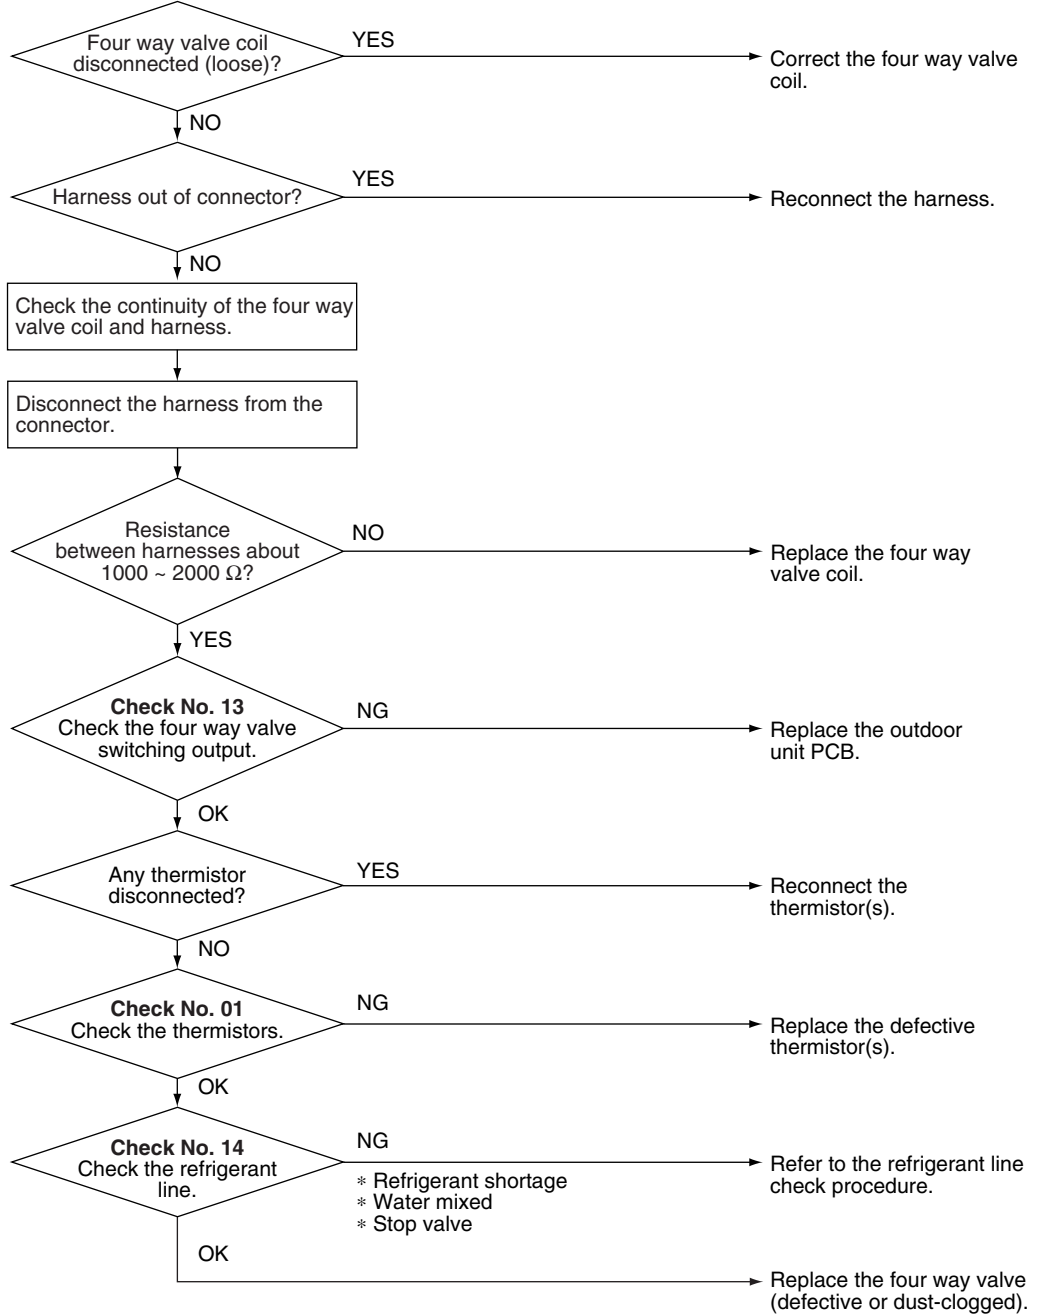

(R15824)

4.17 Discharge Pipe Temperature Control

Error Code



Method of Error Detection

An error is determined with the temperature detected by the discharge pipe thermistor.

Error Decision Conditions

- If the temperature detected by the discharge pipe thermistor rises above **A**°C, the compressor stops.
- The error is cleared when the discharge pipe temperature has dropped below **B**°C.

<20/25/35 class>

Frequency	A (°C)	B (°C)
(1) above 45 Hz (rising), above 40 Hz (dropping)	110	97
(2) 30 ~ 45 Hz (rising), 25 ~ 40 Hz (dropping)	105	92
(3) below 30 Hz (rising), below 25 Hz (dropping)	99	86

<42 class>

Frequency	A (°C)	B (°C)
(1) above 35Hz (rising), above 30Hz (dropping)	110	95
(2) below 35Hz (rising), below 30Hz (dropping)	108	93

<50 class>

A (°C)	B (°C)
110	95

- If the error repeats, the system is shut down.
- Reset condition: Continuous run for about 60 minutes without any other error

Supposed Causes


- Defective discharge pipe thermistor (Defective outdoor heat exchanger thermistor or outdoor temperature thermistor)
- Defective electronic expansion valve or coil
- Refrigerant shortage
- Defective four way valve
- Water mixed in refrigerant
- Defective stop valve
- Defective outdoor unit PCB

Troubleshooting

Check No.01
Refer to P.130

Check No.12
Refer to P.132

Check No.14
Refer to P.133

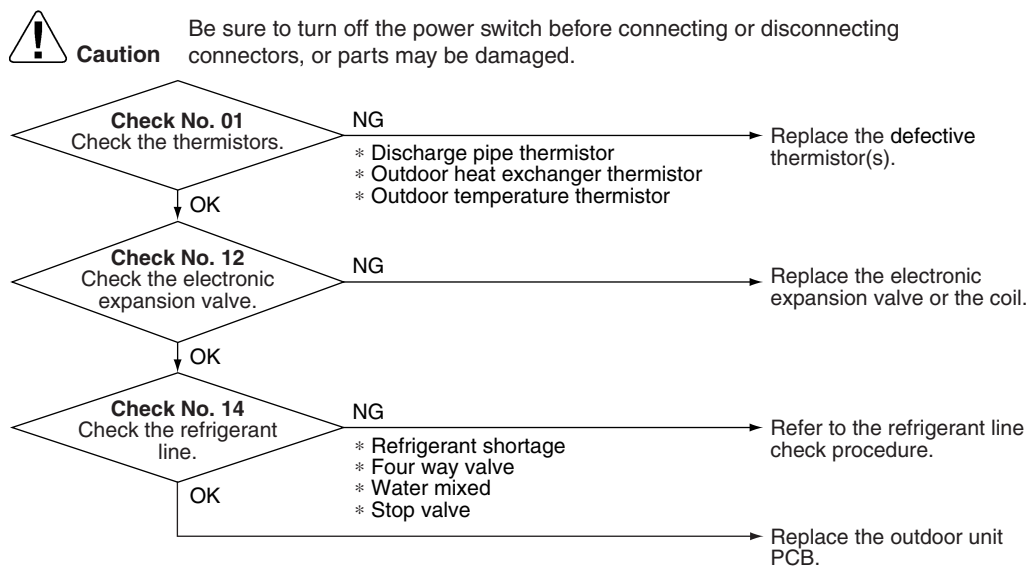






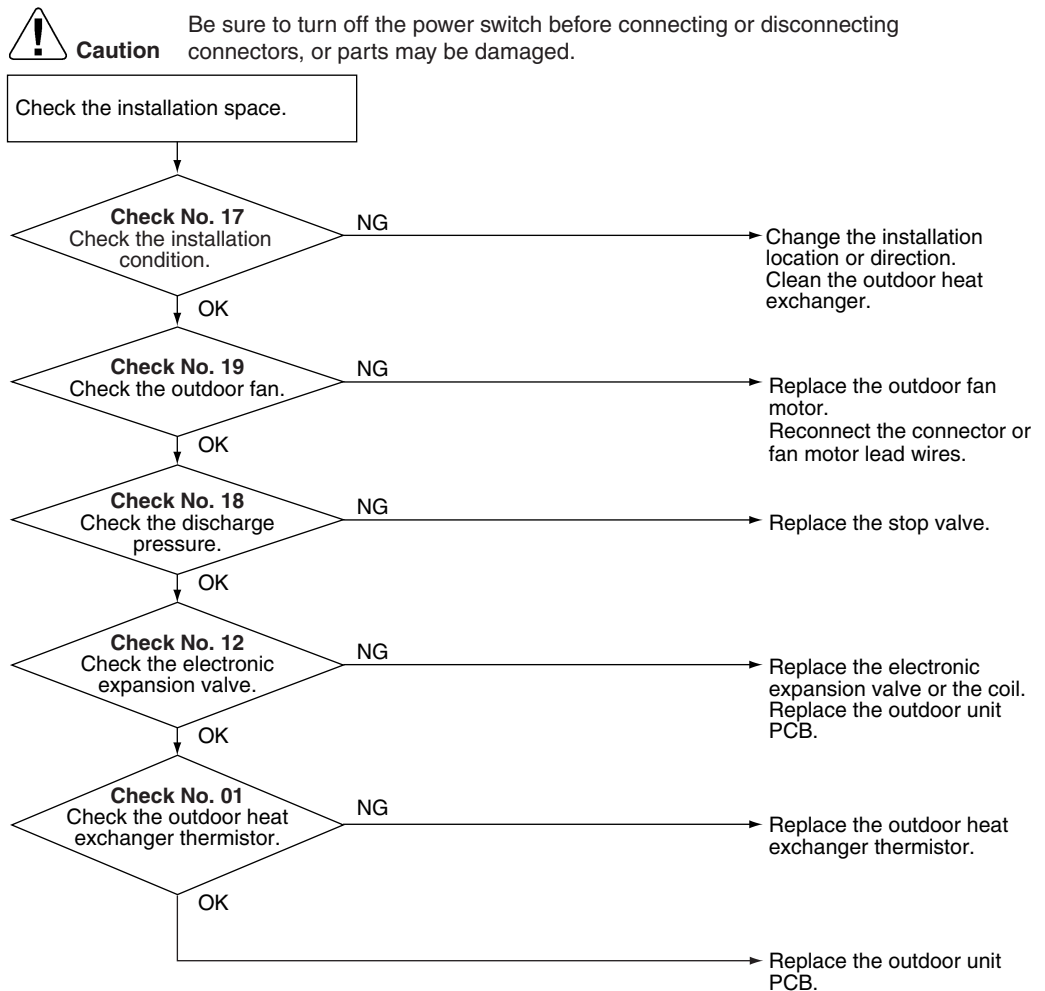
(R15825)

4.18 High Pressure Control in Cooling

Error Code	F6
Method of Error Detection	High-pressure control (operation halt, frequency drop, etc.) is activated in cooling operation if the temperature sensed by the outdoor heat exchanger thermistor exceeds the limit.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The temperature sensed by the outdoor heat exchanger thermistor rises above about 60 ~ 65°C (depending on the model). ■ The error is cleared when the temperature drops below about 50 ~ 55°C (depending on the model).
Supposed Causes	<ul style="list-style-type: none"> ■ The installation space is not large enough. ■ Dirty outdoor heat exchanger ■ Defective outdoor fan motor ■ Defective stop valve ■ Defective electronic expansion valve or coil ■ Defective outdoor heat exchanger thermistor ■ Defective outdoor unit PCB

Troubleshooting

- 
Check No.01
Refer to P.130
- 
Check No.12
Refer to P.132
- 
Check No.17
Refer to P.137
- 
Check No.18
Refer to P.137
- 
Check No.19
Refer to P.138




(R15667)

4.19 Compressor System Sensor Abnormality

4.19.1 20/25/35/42 Class, ARXS50G3V1B

Error Code	H0
Method of Error Detection	The system checks the DC current before the compressor starts.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The DC current before compressor start-up is out of the range 0.5 ~ 4.5 V (sensor output converted to voltage value) ■ The DC voltage before compressor start-up is below 50 V.
Supposed Causes	<ul style="list-style-type: none"> ■ Broken or disconnected harness ■ Defective outdoor unit PCB

Troubleshooting

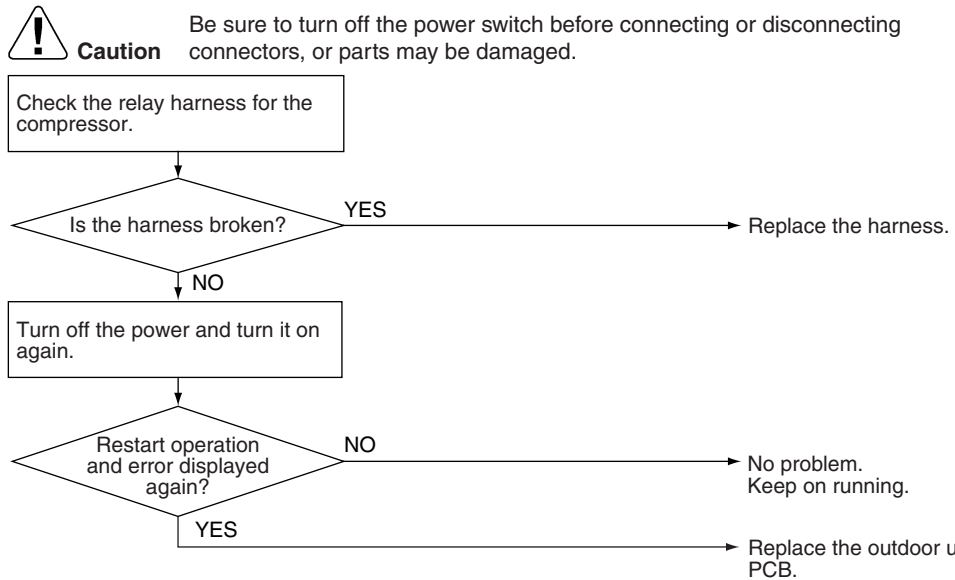

(R11712)

4.19.2 RK(X)S50G2V1B, ARXS50G2V1B

Error Code

H0

Method of Error Detection

- The system checks the power supply voltage and the DC voltage before the compressor starts.
- The system checks the compressor current right after the compressor starts.


Error Decision Conditions

- The power supply voltage and the DC voltage is obviously low or high.
- The compressor current does not run when the compressor starts.

Supposed Causes

- Disconnection of reactor
- Disconnection of compressor harness
- Defective outdoor unit PCB
- Defective compressor

Troubleshooting

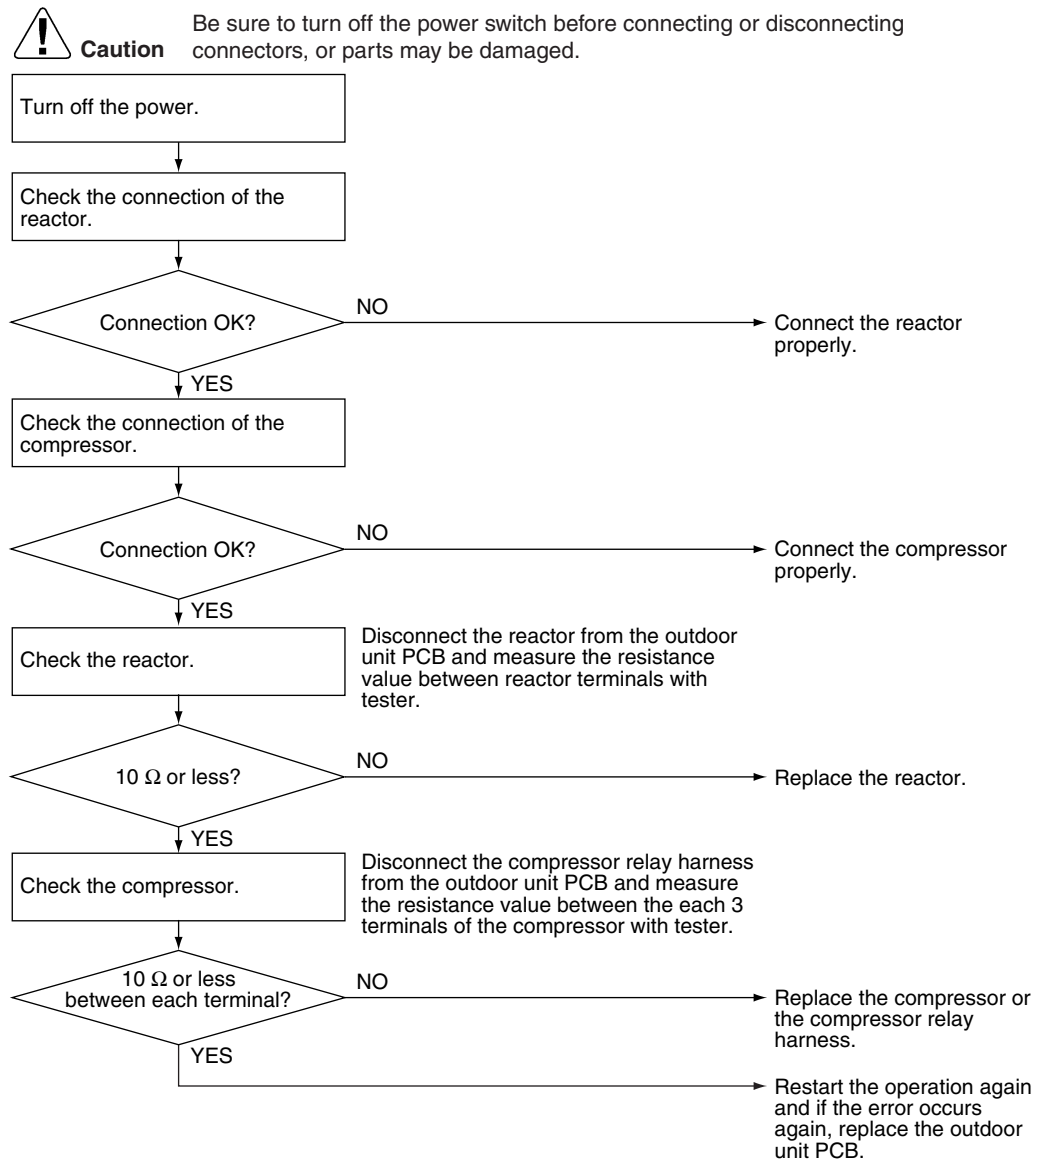

(R15891)

4.20 Position Sensor Abnormality

Error Code	H6
Method of Error Detection	A compressor start-up failure is detected by checking the compressor running condition through the position detection circuit.
Error Decision Conditions	<ul style="list-style-type: none">■ If the error repeats, the system is shut down.■ Reset condition: Continuous run for about 11 minutes (20/25/35/42 class) or 5 minutes (50 class) without any other error
Supposed Causes	<ul style="list-style-type: none">■ Disconnection of the compressor relay cable■ Defective compressor■ Defective outdoor unit PCB■ Start-up failure caused by the closed stop valve■ Input voltage is outside the specified range.


Troubleshooting

20/25/35/42 class, ARXS50G3V1B

 **Check No.15**
Refer to P.134

 **Check No.18**
Refer to P.137

 **Check No.20**
Refer to P.138

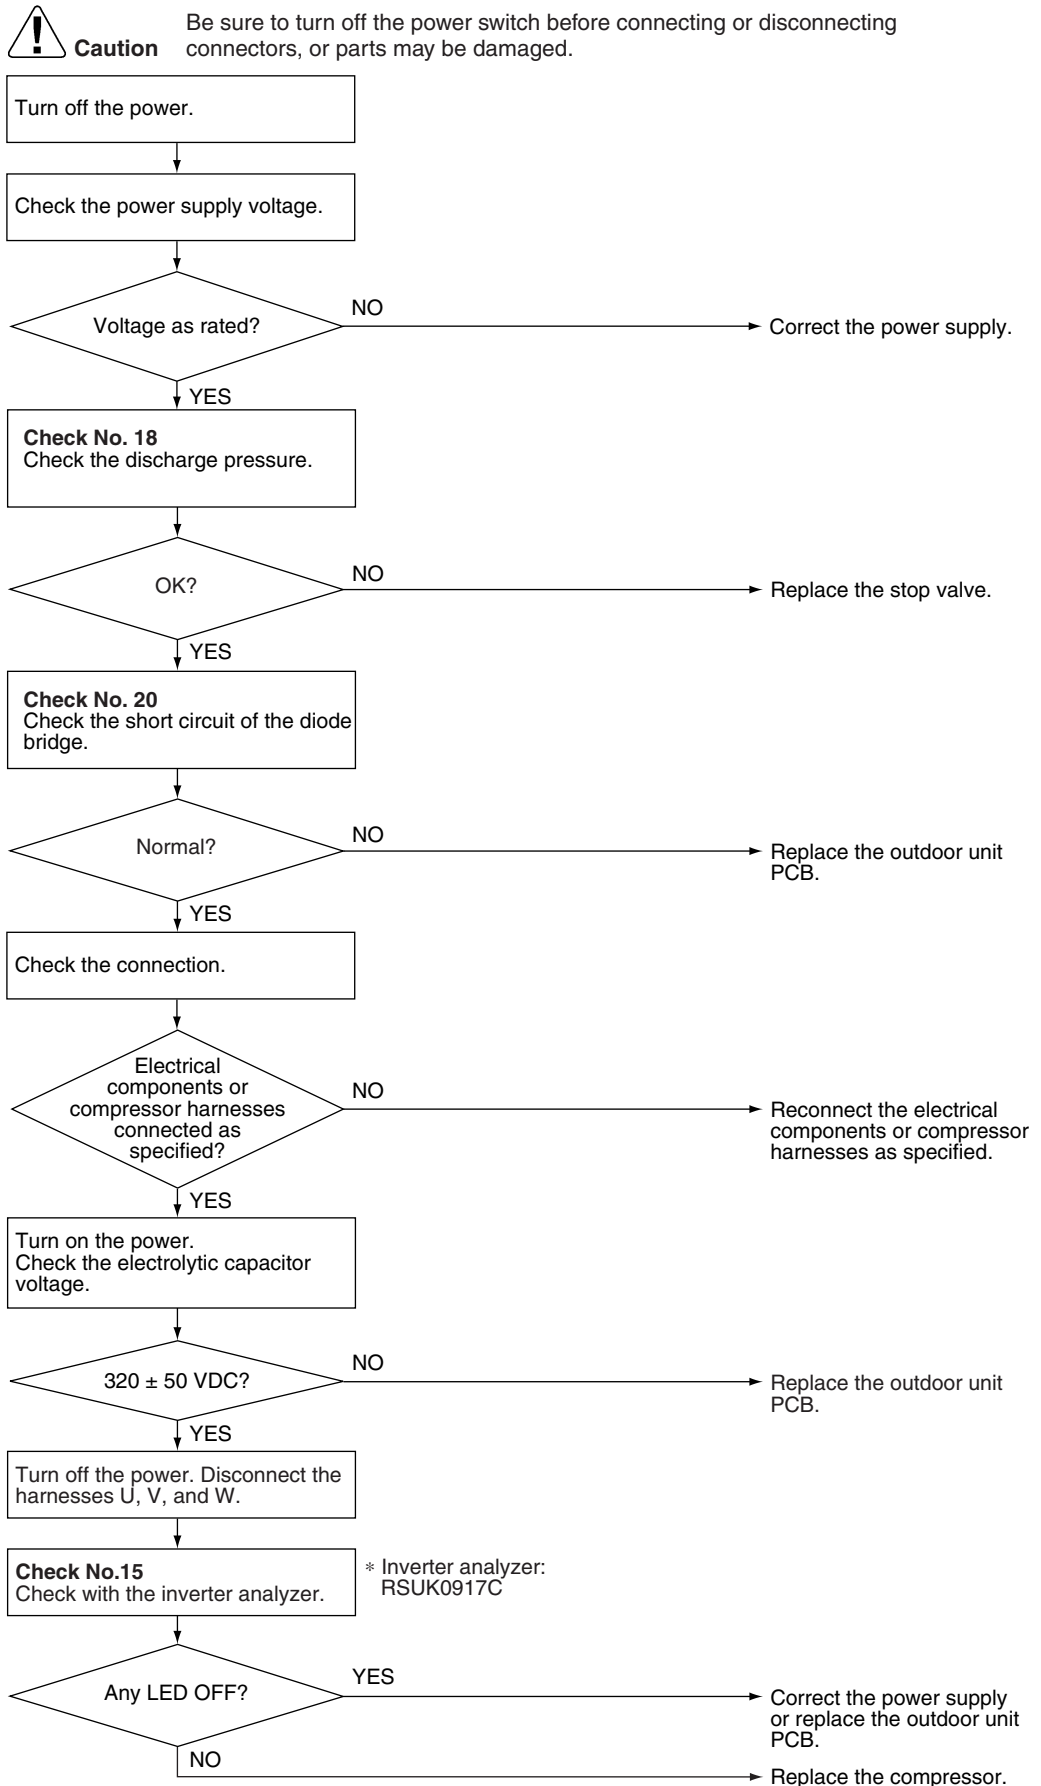

(R18319)

Troubleshooting


RK(X)S50G2V1B, ARKS50G2V1B

 **Check No.15**
Refer to P.134

 **Check No.18**
Refer to P.137




Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

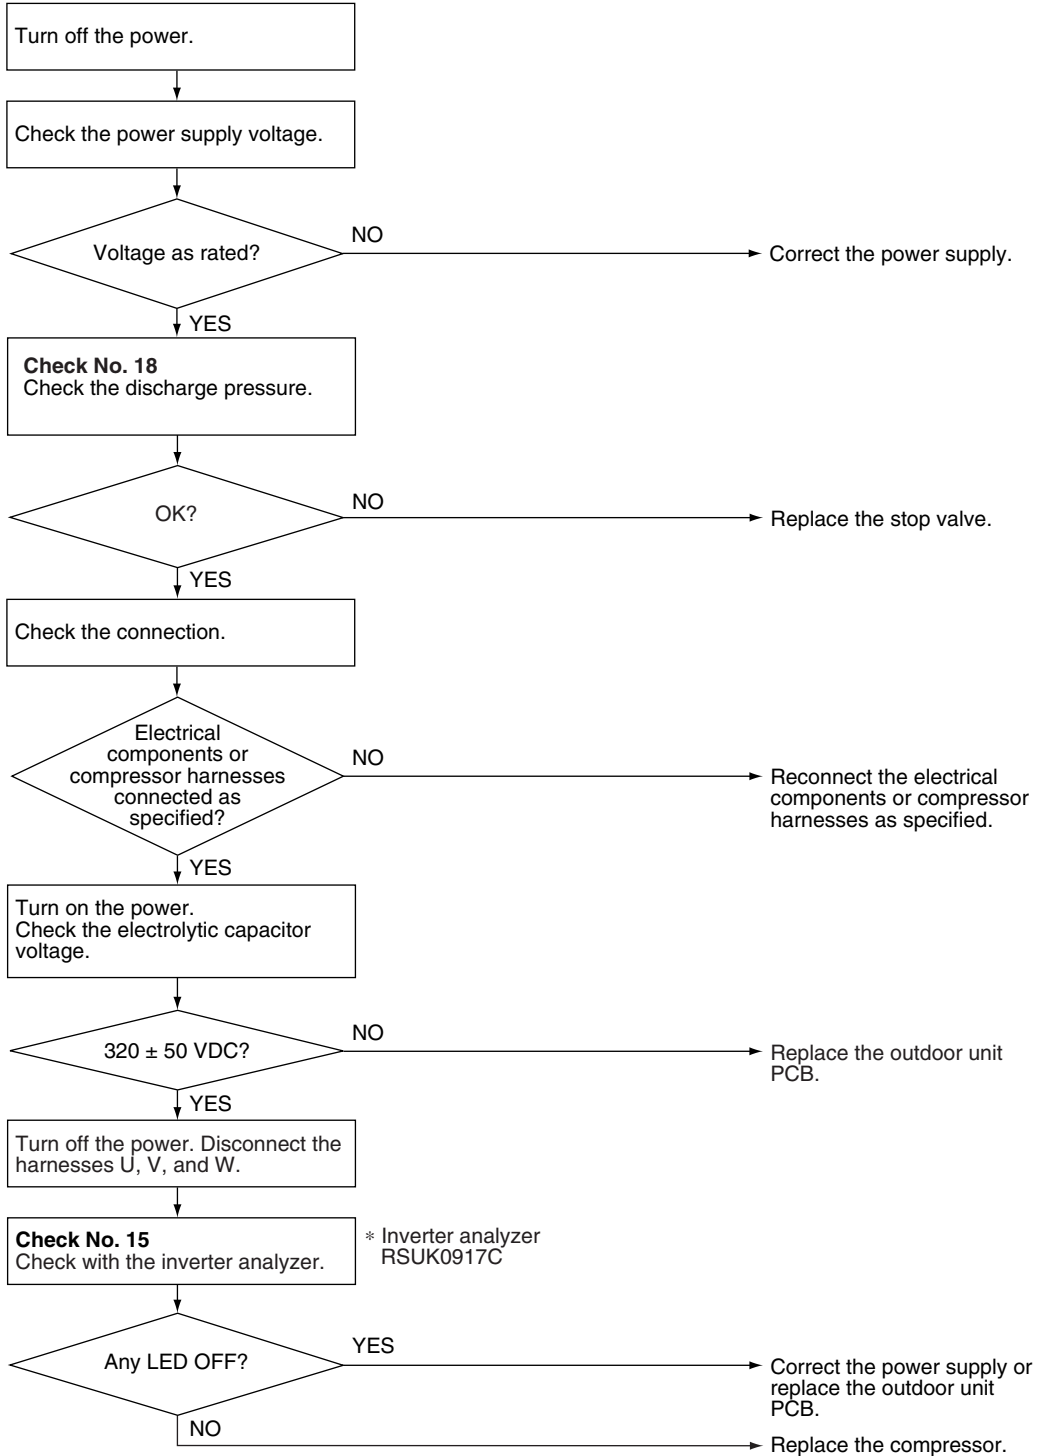

(R18343)

4.21 DC Voltage / Current Sensor Abnormality (20/25/35/42 Class Only)


Error Code	H0
Method of Error Detection	DC voltage or DC current sensor abnormality is identified based on the compressor running frequency and the input current.
Error Decision Conditions	<ul style="list-style-type: none"> ■ If the error repeats, the system is shut down. ■ Reset condition: Continuous run for about 60 minutes without any other error
Supposed Causes	<ul style="list-style-type: none"> ■ Defective outdoor unit PCB
Troubleshooting	<p> Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.</p> <p>Replace the outdoor unit PCB.</p>

4.22 CT or Related Abnormality (RK(X)S50G2V1B, ARXS50G2V1B Only)

Error Code	H0				
Method of Error Detection	A CT or related error is detected by checking the compressor running frequency and CT-detected input current.				
Error Decision Conditions	<ul style="list-style-type: none"> ■ The compressor running frequency is more than A Hz, and the CT input current is less than B A. <table border="1" style="margin-left: 20px;"> <thead> <tr> <th style="text-align: center;">A (Hz)</th> <th style="text-align: center;">B (A)</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">55</td> <td style="text-align: center;">0.5</td> </tr> </tbody> </table> <ul style="list-style-type: none"> ■ If the error repeats, the system is shut down. ■ Reset condition: Continuous run for about 60 minutes without any other error 	A (Hz)	B (A)	55	0.5
A (Hz)	B (A)				
55	0.5				
Supposed Causes	<ul style="list-style-type: none"> ■ Defective power module ■ Broken or disconnected wiring ■ Defective reactor ■ Defective outdoor unit PCB 				

Troubleshooting

 **Check No.15**
Refer to P.134

 **Check No.21**
Refer to P.140



Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.


Turn off the power and turn it on again.

Start operation.

* Running current as shown at right with relay cable 1 or 2?

YES

Replace the outdoor unit PCB.

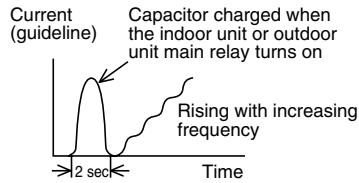

Check No. 21
Check the capacitor voltage.

320 ± 50 VDC?

YES

Turn off the power. Disconnect the harnesses U, V, and W.

Measure the rectifier input voltage.

Check No.15
Check with the inverter analyzer.

* Inverter analyzer: RSUK0917C

Any LED OFF?

YES

Correct the power supply or replace the outdoor unit PCB.

NO

Turn off the power and reconnect the harnesses. Then turn on the power again and restart operation.

Compressor running?

YES

Replace the outdoor unit PCB.

NO

Replace the compressor.

Voltage within the allowable range (Power supply voltage ± 15%)?

YES


Replace the outdoor unit PCB.

NO

Check the power supply voltage.

(R18335)

4.23 Thermistor or Related Abnormality (Outdoor Unit)

Error Code	H3, U3, U5, P4
Method of Error Detection	This fault is identified based on the thermistor input voltage to the microcomputer. A thermistor fault is identified based on the temperature sensed by each thermistor.
Error Decision Conditions	<ul style="list-style-type: none"> ■ The thermistor input voltage is above 4.96 ~ 4.98 V or below 0.02 ~ 0.04 V with the power on. ■ U3 error is judged if the discharge pipe temperature is lower than the heat exchanger temperature.
Supposed Causes	<ul style="list-style-type: none"> ■ Disconnection of the connector for the thermistor ■ Defective thermistor corresponding to the error code ■ Defective heat exchanger thermistor in the case of U3 error (outdoor heat exchanger thermistor in cooling operation, or indoor heat exchanger thermistor in heating operation) ■ Defective outdoor unit PCB
Troubleshooting	<p>In case of "P4"</p> <p> Caution Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.</p> <p>Replace the outdoor unit PCB.</p> <p>P4: Radiation fin thermistor</p>

Troubleshooting



Check No.01
 Refer to P.130

In case of "H3" "J3" "J5"



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

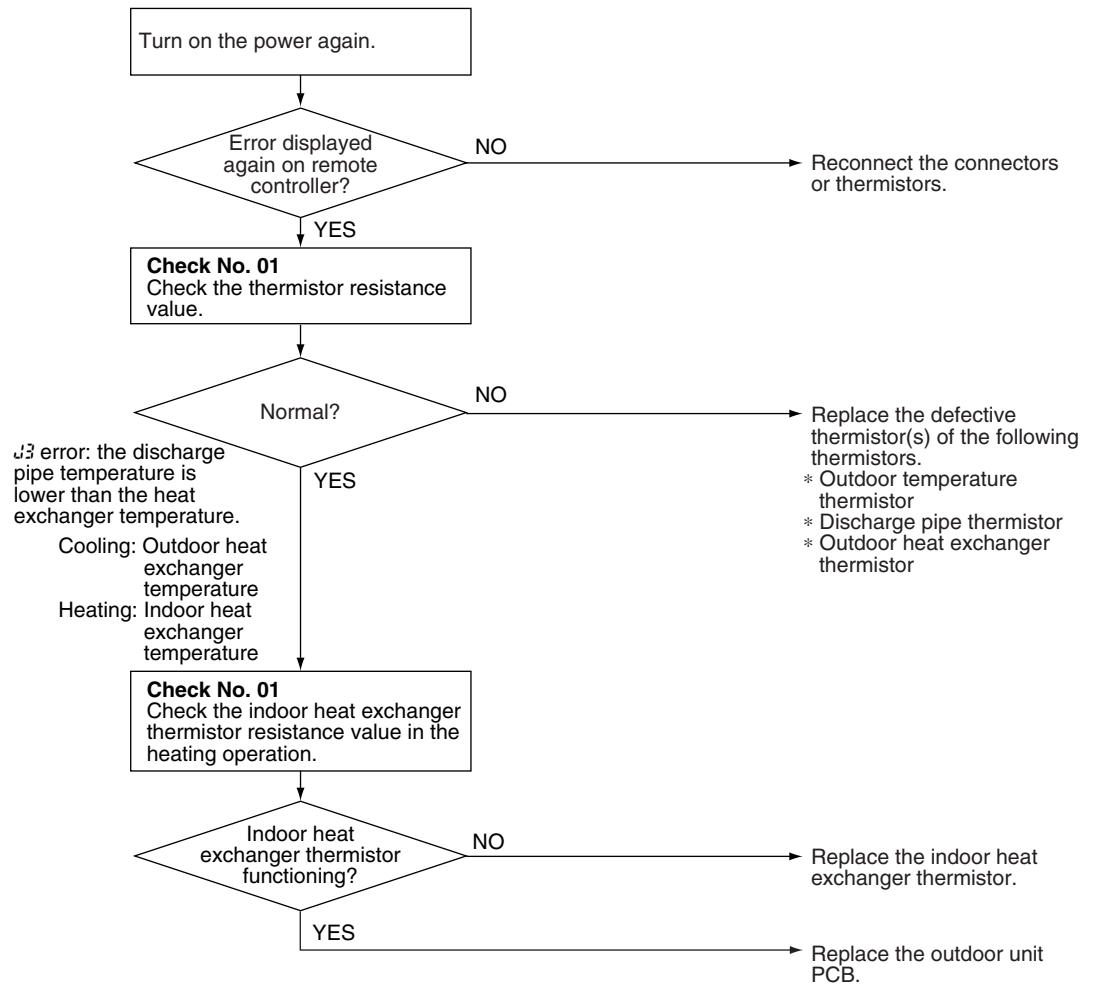

J3 error: the discharge pipe temperature is lower than the heat exchanger temperature.
 Cooling: Outdoor heat exchanger temperature
 Heating: Indoor heat exchanger temperature

(R16059)

- H3 : Outdoor temperature thermistor
- J3 : Discharge pipe thermistor
- J5 : Outdoor heat exchanger thermistor

4.24 Electrical Box Temperature Rise

Error Code	L3		
Method of Error Detection	An electrical box temperature rise is detected by checking the radiation fin thermistor with the compressor off.		
Error Decision Conditions	<ul style="list-style-type: none"> ■ With the compressor off, the radiation fin temperature is above A°C. ■ The error is cleared when the radiation fin temperature drops below B°C. ■ To cool the electrical components, the outdoor fan starts when the radiation fin temperature rises above C°C and stops when it drops below B°C. 		
	A (°C)	B (°C)	C (°C)
RK(X)S20-35G2V1B, ARXS20-35G2V1B	80	70	80
RK(X)S20-35G2V1B9, ARXS20-35G3V1B ARXS20-35G4V1B	98	75	83
RK(X)S42G2V1B, ARXS42G2V1B ARXS42G3V1B	80	70	75
RK(X)S50G2V1B, ARXS50G2V1B	95	80	85
ARXS50G3V1B	122	64	113
Supposed Causes	<ul style="list-style-type: none"> ■ Defective outdoor fan motor ■ Short circuit ■ Defective radiation fin thermistor ■ Disconnection of connector ■ Defective outdoor unit PCB 		


Troubleshooting



Check No.17
Refer to P.137



Check No.19
Refer to P.138

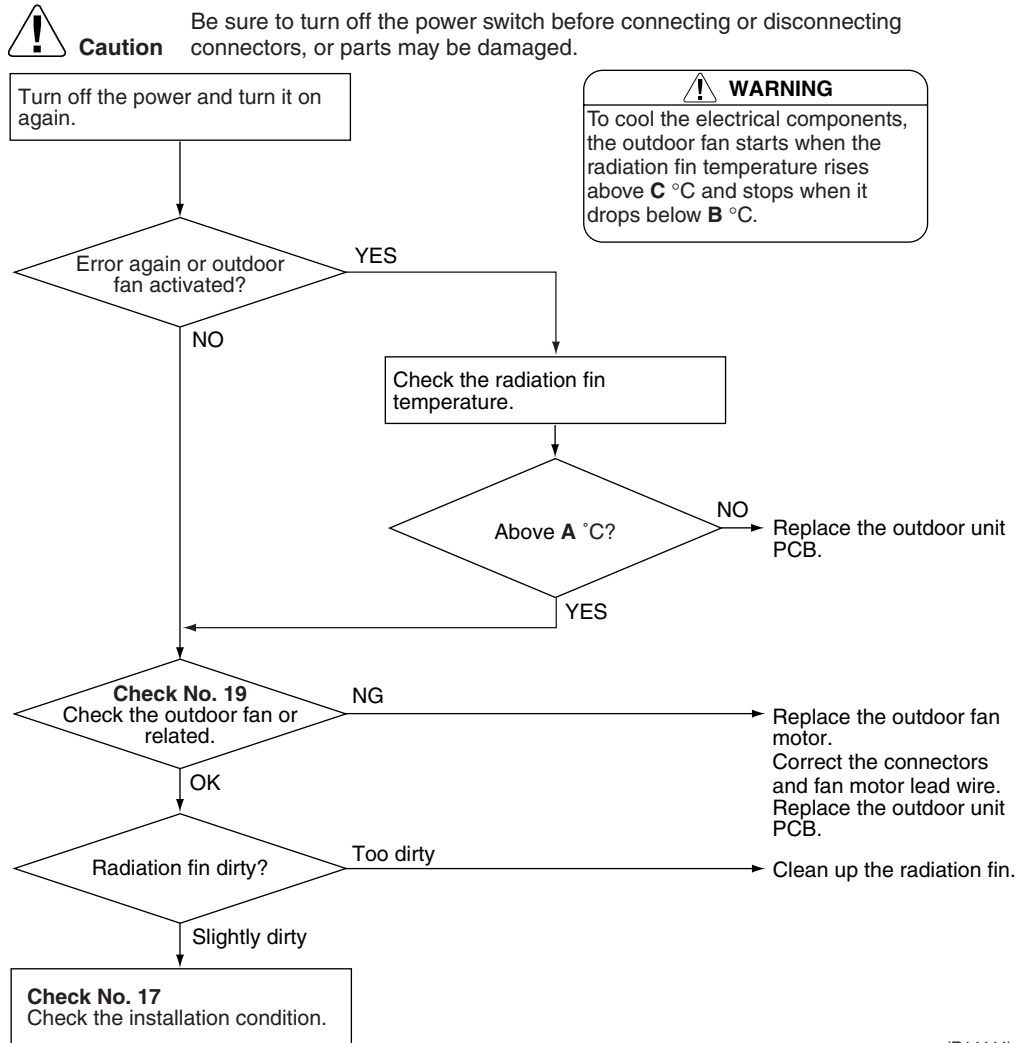

(R14444)

	A (°C)	B (°C)	C (°C)
RK(X)S20-35G2V1B, ARXS20-35G2V1B	80	70	80
RK(X)S20-35G2V1B9, ARXS20-35G3V1B ARXS20-35G4V1B	98	75	83
RK(X)S42G2V1B, ARXS42G2V1B ARXS42G3V1B	80	70	75
RK(X)S50G2V1B, ARXS50G2V1B	95	80	85
ARXS50G3V1B	122	64	113

4.25 Radiation Fin Temperature Rise

Remote
Controller
Display

L4

Method of
Malfunction
Detection

A radiation fin temperature rise is detected by checking the radiation fin thermistor with the compressor on.

Malfunction
Decision
Conditions

- If the radiation fin temperature with the compressor on is above **A**°C.
- The error is cleared when the radiation fin temperature drops below **B**°C.
- If the error repeats, the system is shut down.
- Reset condition: Continuous run for about 60 minutes without any other error

	A (°C)	B (°C)
RK(X)S20-35G2V1B, ARXS20-35G2V1B	90	85
RK(X)S20-35G2V1B9, ARXS20-35G3V1B ARXS20-35G4V1B	98	78
RK(X)S42G2V1B, ARXS42G2V1B ARXS42G3V1B	92.5	85
RK(X)S50G2V1B, ARXS50G2V1B	105	99
ARXS50G3V1B	85	56


Supposed
Causes

- Defective outdoor fan motor
- Short circuit
- Defective radiation fin thermistor
- Disconnection of connector
- Defective outdoor unit PCB
- Silicon grease is not applied properly on the radiation fin after replacing the outdoor unit PCB.

Troubleshooting


Check No.17
 Refer to P.137


Check No.19
 Refer to P.138

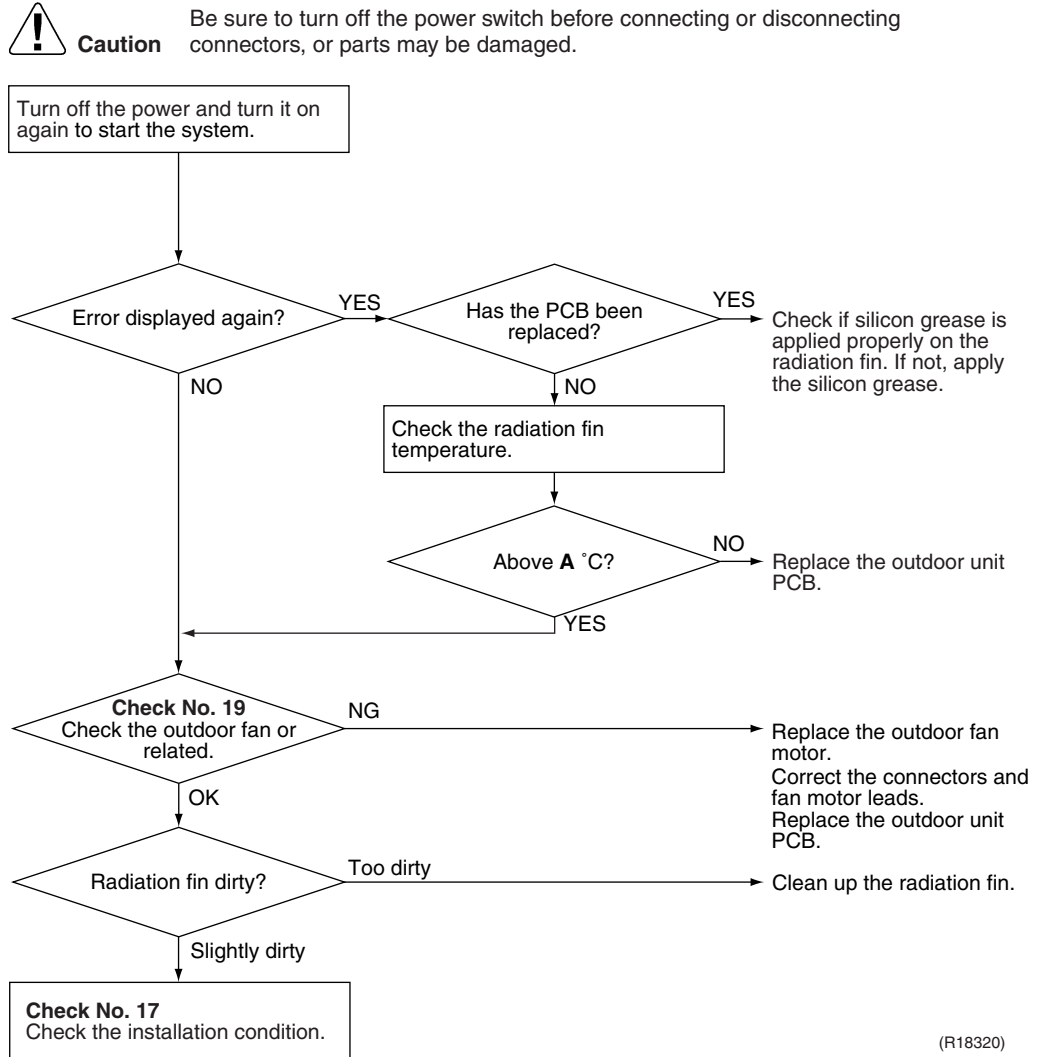

(R18320)

	A (°C)
RK(X)S20-35G2V1B, ARXS20-35G2V1B	90
RK(X)S20-35G2V1B9, ARXS20-35G3V1B ARXS20-35G4V1B	98
RK(X)S42G2V1B, ARXS42G2V1B ARXS42G3V1B	92.5
RK(X)S50G2V1B, ARXS50G2V1B	105
ARXS50G3V1B	85

 **Note:** Refer to “Silicon Grease on Power Transistor / Diode Bridge” on page 155 for detail.

4.26 Output Overcurrent Detection

Error Code U5

Method of Error Detection An output overcurrent is detected by checking the current that flows in the inverter DC section.

Error Decision Conditions

- A position signal error occurs while the compressor is running.
- A rotation speed error occurs while the compressor is running.
- An output overcurrent signal is fed from the output overcurrent detection circuit to the microcomputer.
- If the error repeats, the system is shut down.
- Reset condition: Continuous run for about 11 minutes (20/25/35/42 class) or 5 minutes (50 class) without any other error

Supposed Causes

- Poor installation condition
- Closed stop valve
- Defective power module
- Wrong internal wiring
- Abnormal power supply voltage
- Defective outdoor unit PCB
- Defective compressor

Troubleshooting



Check No.15
Refer to P.134



Check No.17
Refer to P.137



Check No.18
Refer to P.137




Check No.22
Refer to P.141



Caution

Be sure to turn off the power switch before connecting or disconnecting connectors, or parts may be damaged.

* An output overcurrent may result from wrong internal wiring. If the system is interrupted by an output overcurrent after the wires have been disconnected and reconnected for part replacement, check the wiring again.

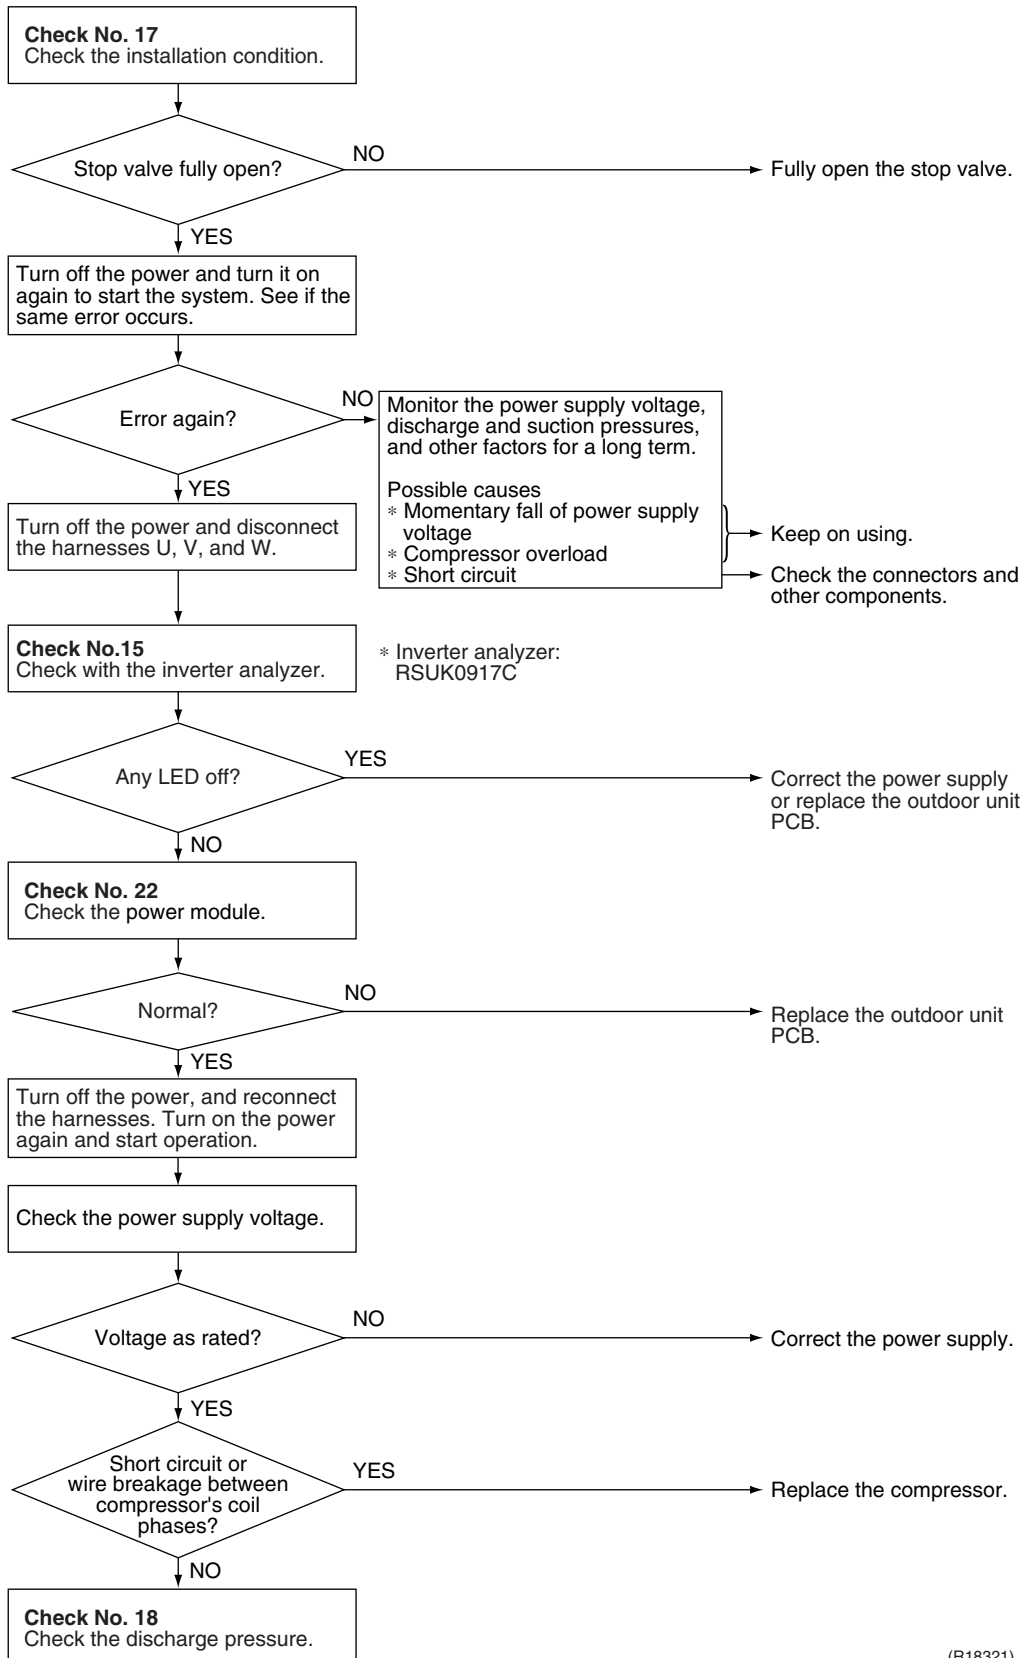

(R18321)

5. Check

5.1 Thermistor Resistance Check

Check No.01


Disconnect the connectors of the thermistors from the PCB, and measure the resistance of each thermistor using tester.

The relationship between normal temperature and resistance is shown in the table and the graph below.


The data is for reference purpose only.

Thermistor temperature (°C)	Resistance (kΩ)
-20	197.8
-15	148.2
-10	112.1
-5	85.60
0	65.93
5	51.14
10	39.99
15	31.52
20	25.02
25	20.00
30	16.10
35	13.04
40	10.62
45	8.707
50	7.176

(R25°C = 20 kΩ, B = 3950 K)

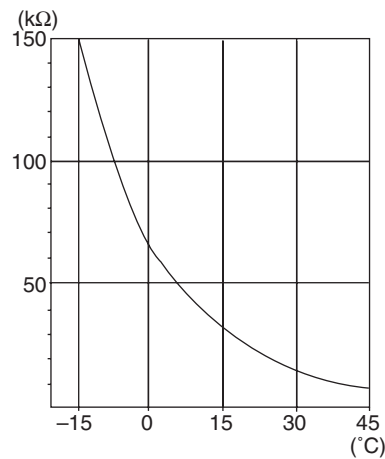

(R11905)

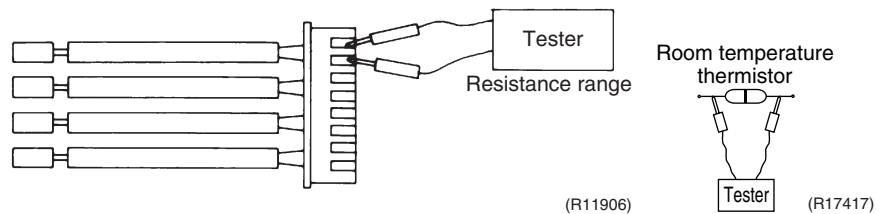


- When the room temperature thermistor is directly mounted on the display PCB, remove the display PCB from the control PCB to measure the resistance.
- When the connector of indoor heat exchanger thermistor is soldered on the PCB, remove the thermistor and measure the resistance.

5.2 Fan Motor Connector Output Check

Check No.02

1. Check the connection of connector.
2. Check the motor power supply voltage output (pins 4 - 7).
3. Check the motor control voltage (pins 4 - 3).
4. Check the rotation command voltage (pins 4 - 2).
5. Check the rotation pulse (pins 4 - 1).

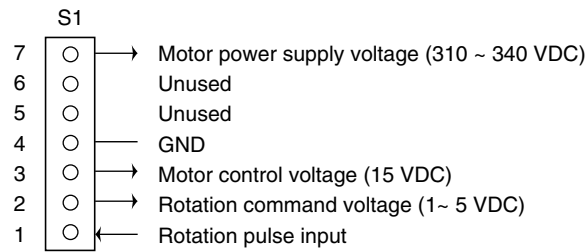

(R12404)


5.3 Power Supply Waveforms Check

Check No.11

Measure the power supply waveform between No. 1 and No. 2 on the terminal board, and check the waveform disturbance.


- Check to see if the power supply waveform is a sine wave. (Fig.1)
- Check to see if there is waveform disturbance near the zero cross. (sections circled in Fig.2)

Fig.1

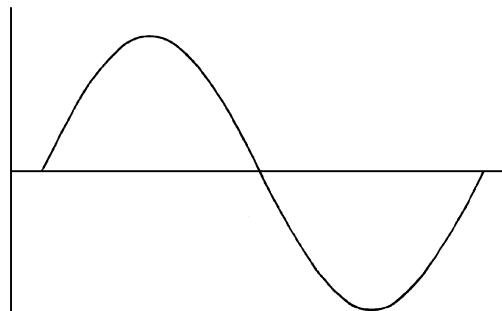

(R1736)

Fig.2

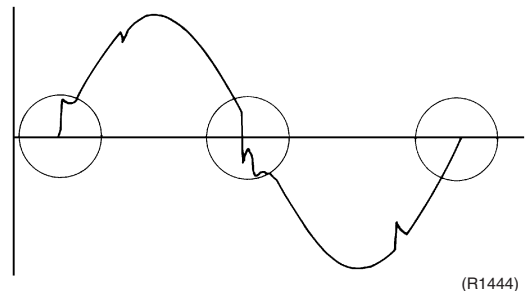


(R1444)

5.4 Electronic Expansion Valve Check

Check No.12

Conduct the followings to check the electronic expansion valve (EV).

1. Check to see if the EV connector is correctly connected to the PCB.
2. Turn the power off and on again, and check to see if the EV generates a latching sound.
3. If the EV does not generate a latching sound in the above step 2, disconnect the connector and check the continuity using a tester.
4. Check the continuity between the pins 1 - 6, 3 - 6, 2 - 5, 4 - 5 (between the pins 1 - 6, 2 - 6, 3 - 6, 4 - 6 for the harness 5P models). If there is no continuity between the pins, the EV coil is faulty.

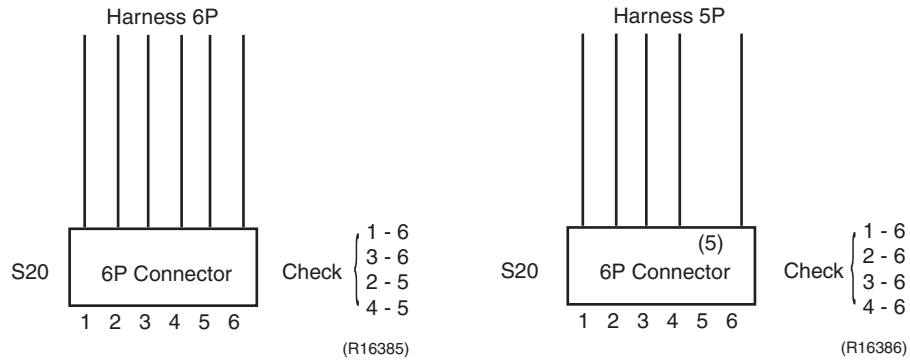



5. If the continuity is confirmed in step 3, the outdoor unit PCB is faulty.



Note: Please note that the latching sound varies depending on the valve type.


5.5 Four Way Valve Performance Check

Check No.13

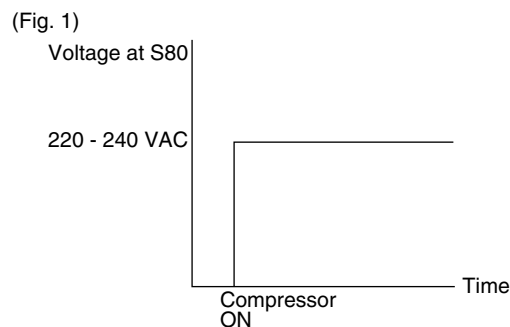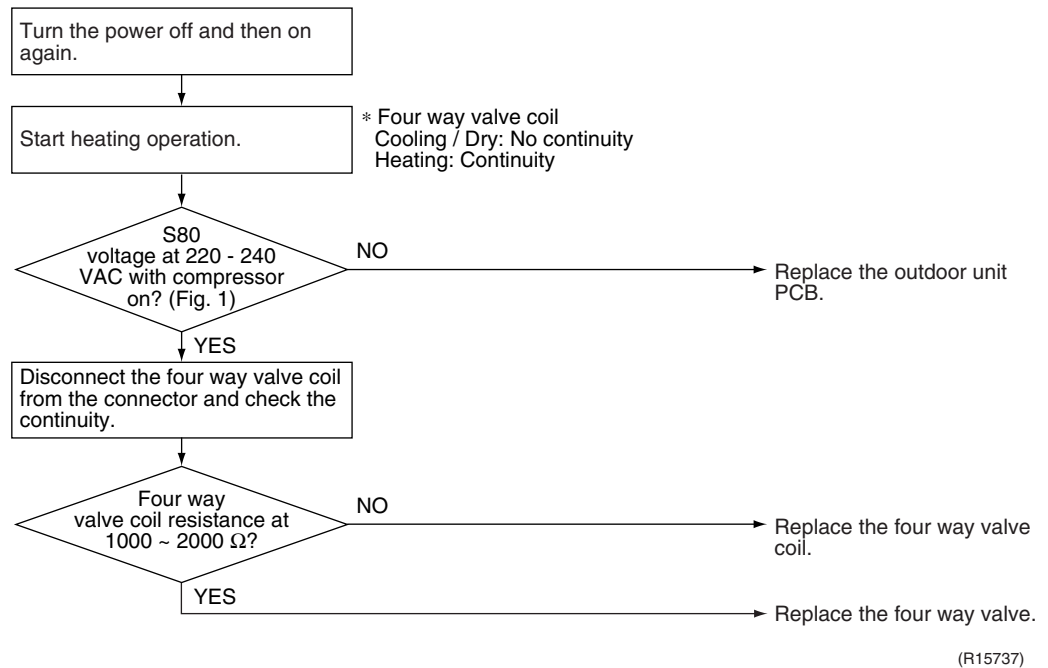

5.6 Inverter Units Refrigerant System Check

Check No.14

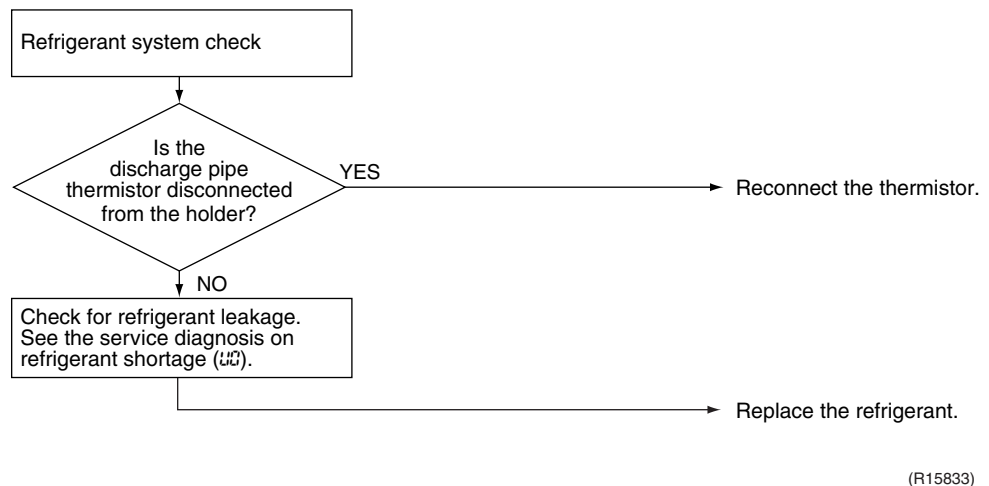

5.7 Inverter Analyzer Check

Check No.15

■ Characteristics

Inverter analyzer: RSUK0917C

If an abnormal stop occurs due to compressor startup failure or overcurrent output when using an inverter unit, it is difficult to judge whether the stop is caused by the compressor failure or some other failure (main PCB, power module, etc.). The inverter analyzer makes it possible to judge the cause of trouble easily and securely. (Connect an inverter analyzer as a quasi-compressor instead of compressor and check the output of the inverter)

■ Operation Method

Step 1


Be sure to turn the power off.

Step 2

Install an inverter analyzer instead of a compressor.

Note:

Make sure the charged voltage of the built-in smoothing electrolytic capacitor drops to 10 VDC or below before carrying out the service work.

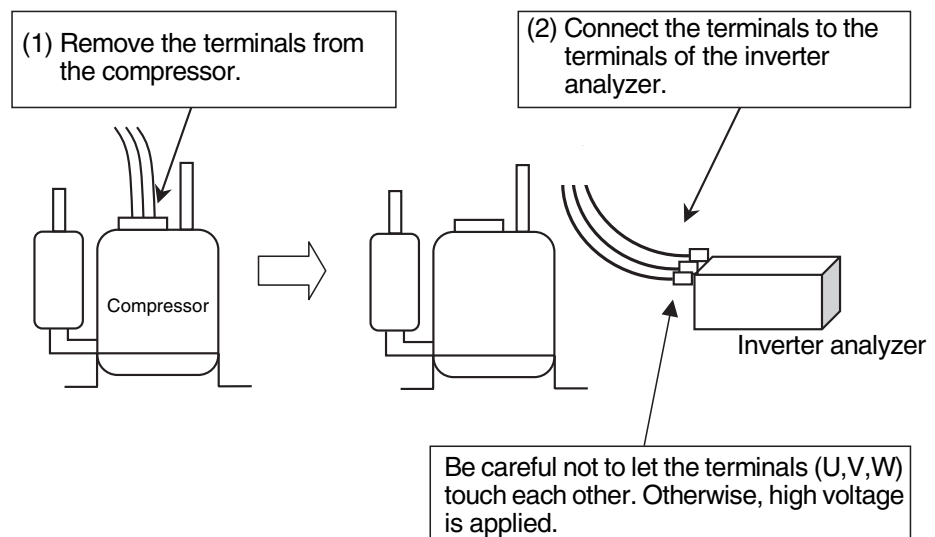

(R18322)

Reference:

If the terminals of the compressor are not FASTON terminals (difficult to remove the wire on the terminals), it is possible to connect wires available on site to the outdoor unit from output side of PCB. (Do not connect them to the compressor at the same time, otherwise it may result in incorrect detection.)

Step 3

20/25/35/50 class: Activate power transistor test operation from the outdoor unit.

1) Press the forced cooling operation ON/OFF button for 5 seconds.

(Refer to page 146 for the position.)

→ Power transistor test operation starts.

42 class: Activate power transistor test operation from indoor unit.

- 1) Turn the power on.
- 2) Select FAN operation with the [MODE] button on the remote controller.
- 3) Press the 3 buttons (TEMP▲, TEMP▼, MODE) simultaneously.
→ 00 is displayed with the figure of ten's place blinking.
- 4) Press the [MODE] button.
→ 01 is displayed with the figure of one's place blinking.
- 5) Press the [MODE] button.
→ 7` is displayed.
- 6) Press the [ON/OFF] button.
→ Power transistor test operation starts.


■ **Diagnose method (Diagnose according to 6 LEDs lighting status.)**

- (1) If all the LEDs are lit uniformly, the compressor is defective.
→ Replace the compressor.
- (2) If the LEDs are not lit uniformly, check the power module.
→ Refer to **Check No.22**.
- (3) If NG in **Check No.22**, replace the power module.
(Replace the main PCB. The power module is united with the main PCB.)
If OK in **Check No.22**, check if there is any solder cracking on the PCB.
- (4) If any solder cracking is found, replace the PCB or repair the soldered section.
If there is no solder cracking, replace the PCB.



Caution

- (1) When the output frequency is low, the LEDs blink slowly. As the output frequency increases, the LEDs blink quicker. (The LEDs look like they are lit.)
- (2) On completion of the inverter analyzer diagnosis, be sure to re-crimp the FASTON terminals. Otherwise, the terminals may be burned due to loosening.

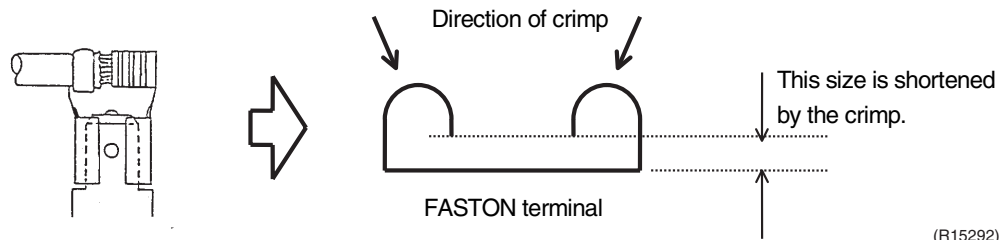

(R15292)

5.8 Rotation Pulse Check on the Outdoor Unit PCB

Check No.16

RK(X)S20-50G2V1B, ARXS20-50G2V1B, ARXS42/50G3V1B

Make sure that the voltage of 320 ± 30 V is applied.


1. Set operation off and power off. Disconnect the connector S70.
2. Check that the voltage between the pins 4 - 7 is 320 VDC.
3. Check that the control voltage between the pins 3 - 4 is 15 VDC.
4. Check that the rotation command voltage between the pins 2 - 4 is 0 ~ 15 VDC.
5. Keep operation off and power off. Connect the connector S70.
6. Check whether 2 pulses (0 ~ 15 VDC) are output at the pins 1 - 4 when the fan motor is rotated 1 turn by hand.

When the fuse is melted, check the outdoor fan motor for proper function.

If NG in step 2 → Defective PCB → Replace the outdoor unit PCB.

If NG in step 4 → Defective Hall IC → Replace the outdoor fan motor.


If OK in both steps 2 and 4 → Replace the outdoor unit PCB.

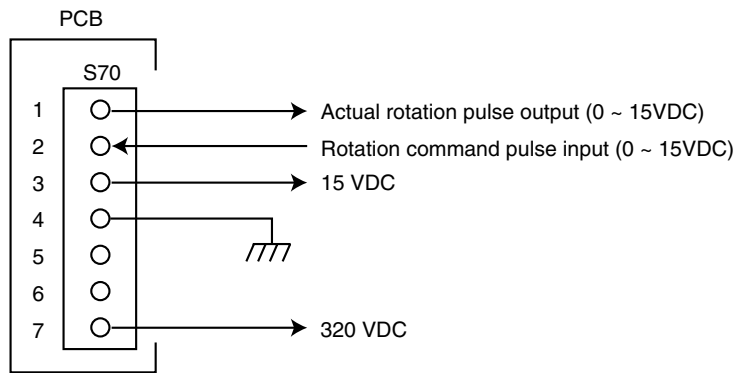

(R10811)

RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B


1. Check that the voltage between the pins 10 - 11 is 15 VDC.
2. Check if the Hall IC generates the rotation pulse (0 ~ 15 VDC) 4 times between the pins 10 - 12, 10 - 13, when the fan motor is manually rotated once.

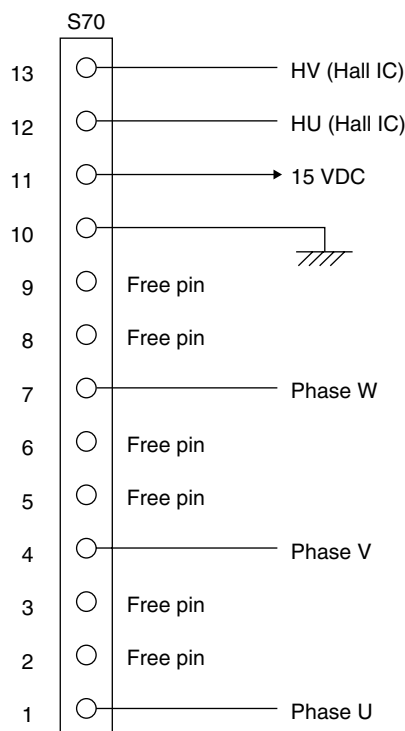

(R11907)


5.9 Installation Condition Check

Check No.17

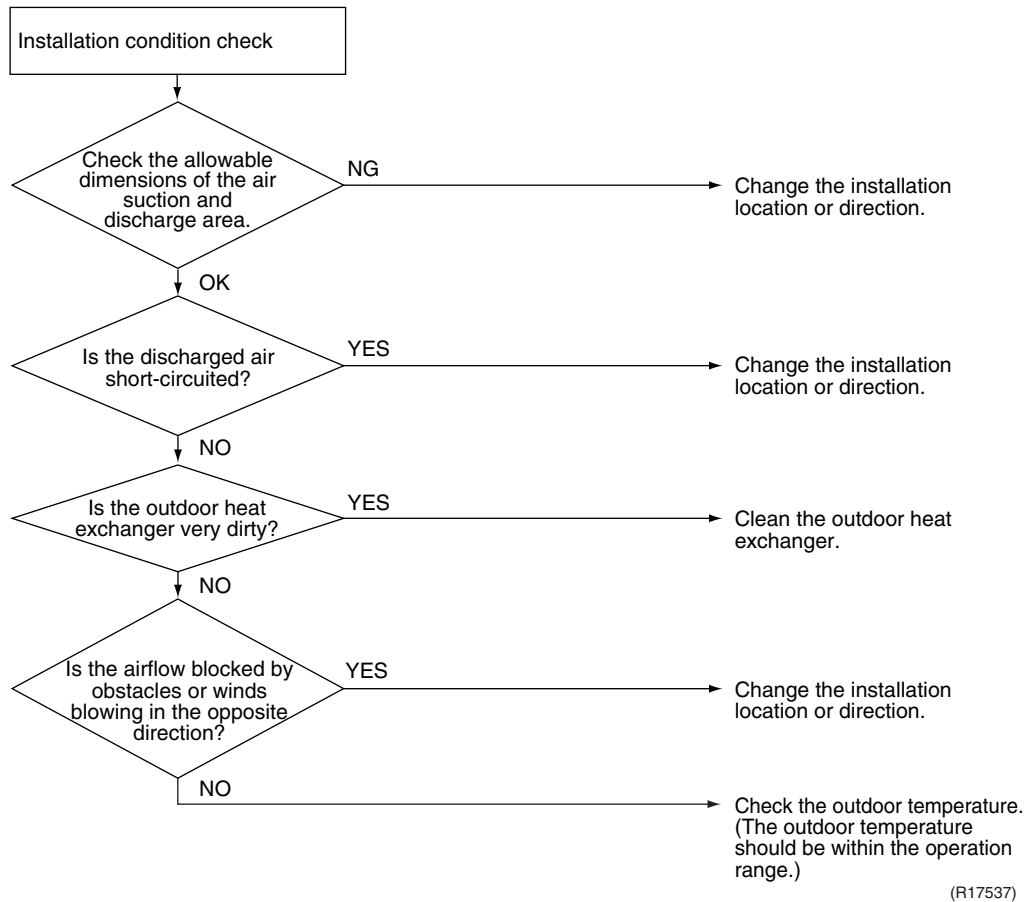

5.10 Discharge Pressure Check


Check No.18

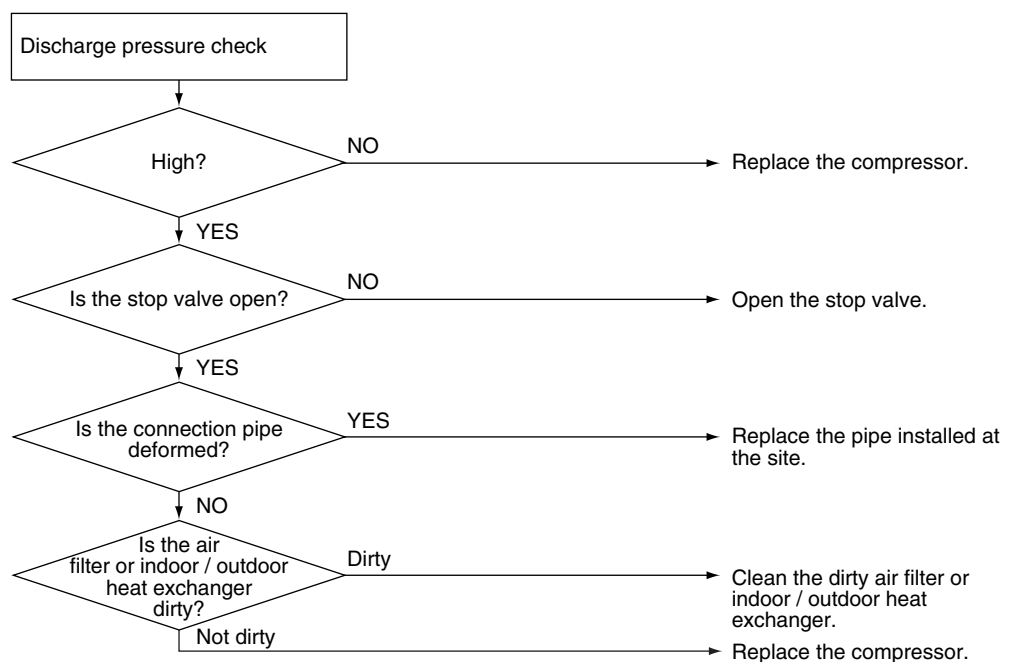

5.11 Outdoor Fan System Check

Check No.19

DC motor

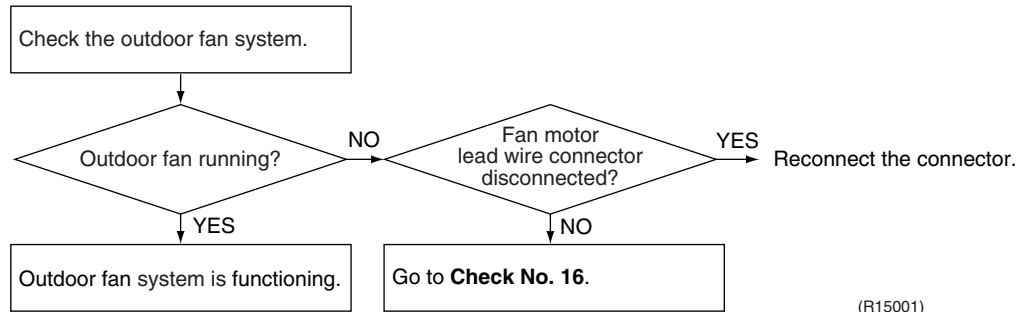

(R15001)

5.12 Main Circuit Short Check

Check No.20




Note: Check to make sure that the voltage between (+) and (-) of the diode bridge (DB1) is approx. 0 V before checking.

- Measure the resistance between the pins of the DB1 referring to the table below.
- If the resistance is ∞ or less than 1 k Ω , short circuit occurs on the main circuit.


Negative (-) terminal of tester (positive terminal (+) for digital tester)	~ (2, 3)	+ (4)	~ (2, 3)	- (1)
Positive (+) terminal of tester (negative terminal (-) for digital tester)	+ (4)	~ (2, 3)	- (1)	~ (2, 3)
Resistance is OK.	several k Ω ~ several M Ω	∞	∞	several k Ω ~ several M Ω
Resistance is NG.	0 Ω or ∞	0	0	0 Ω or ∞

RK(X)S20-35G2V1B, ARXS20-35G2V1B

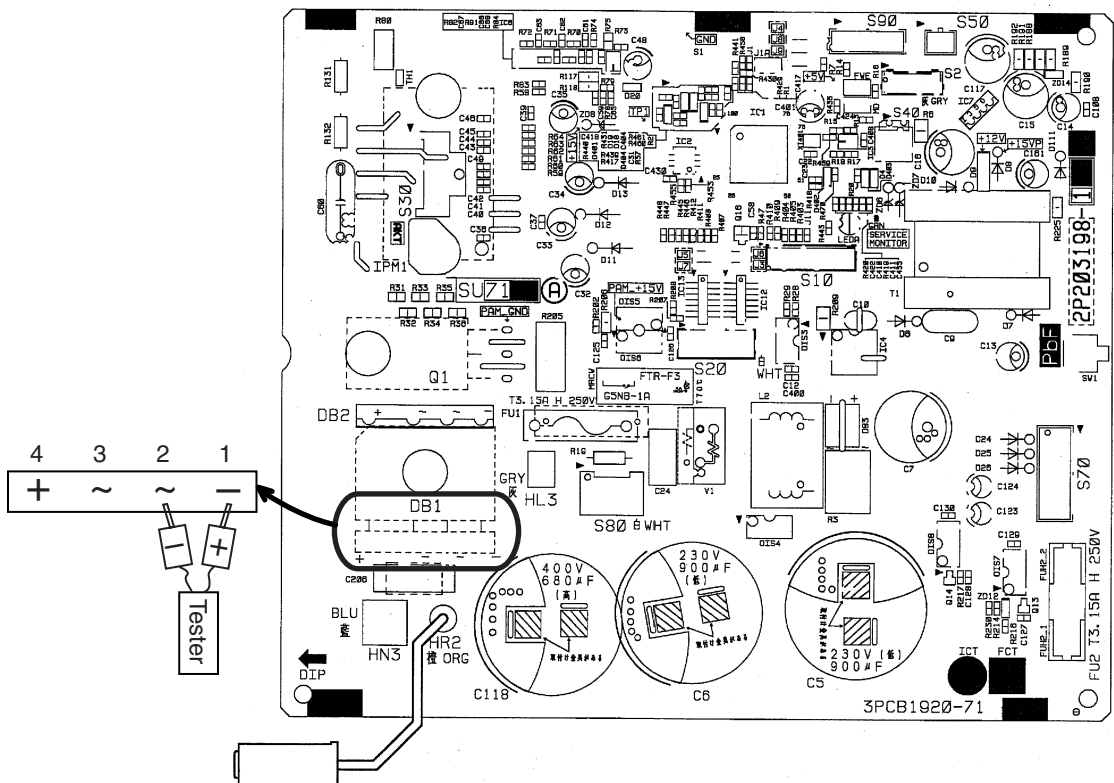


(R18376)

RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B

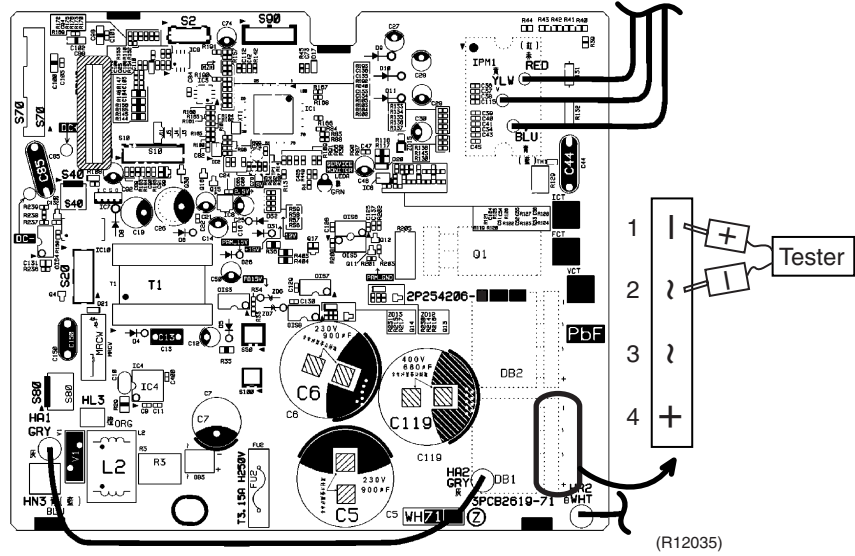


(R12035)

RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B

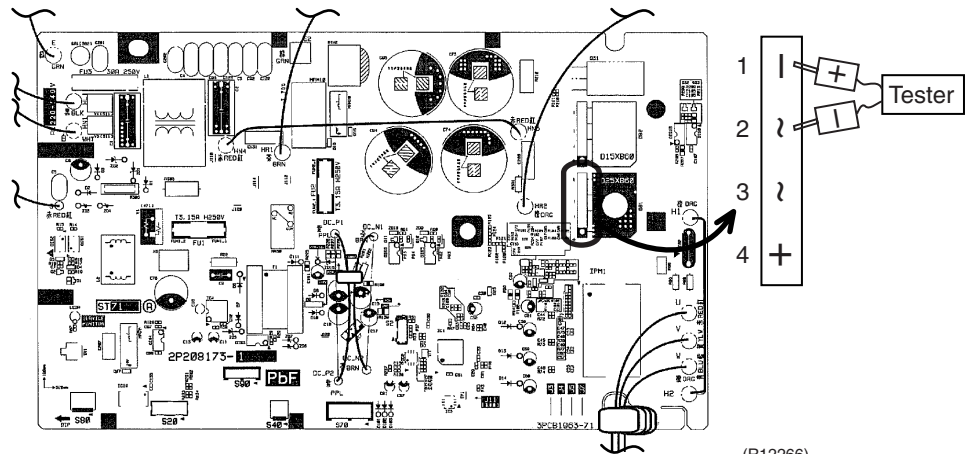

(R12266)

ARXS50G3V1B

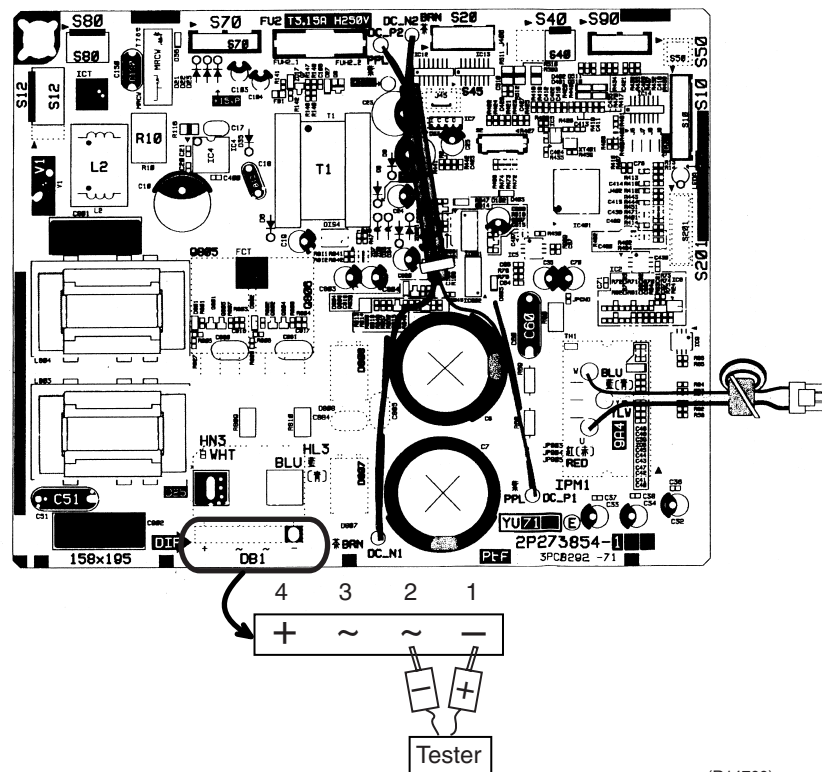

(R14700)

5.13 Capacitor Voltage Check


Check No.21

RK(X)S50G2V1B, ARXS50G2V1B

Before this check, be sure to check the main circuit for short circuit.

With the circuit breaker still on, measure the voltage according to the drawing of the model in question. Be careful never to touch any live parts.

Multimeter
(DC voltage range)

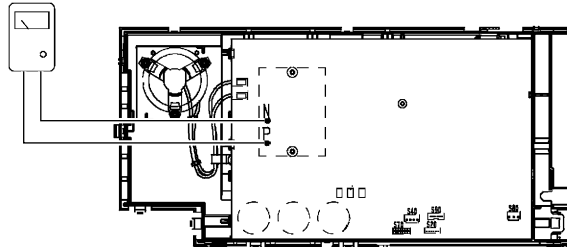

(R18183)

5.14 Power Module Check

Check No.22




Note: Check to make sure that the voltage between (+) and (-) of the power module is approx. 0 V before checking.


- Disconnect the compressor harness connector from the outdoor unit PCB. To disengage the connector, press the protrusion on the connector.
- Follow the procedure below to measure resistance between the terminals of the power module and the terminals of the compressor with a multi-tester. Evaluate the measurement results referring to the following table.

Negative (-) terminal of tester (positive terminal (+) for digital tester)	Power module (+)	UVW	Power module (-)	UVW
Positive (+) terminal of tester (negative terminal (-) for digital tester)	UVW	Power module (+)	UVW	Power module (-)
Resistance is OK.	several kΩ ~ several MΩ			
Resistance is NG.	0 Ω or ∞			


RK(X)S20-35G2V1B, ARXS20-35G2V1B

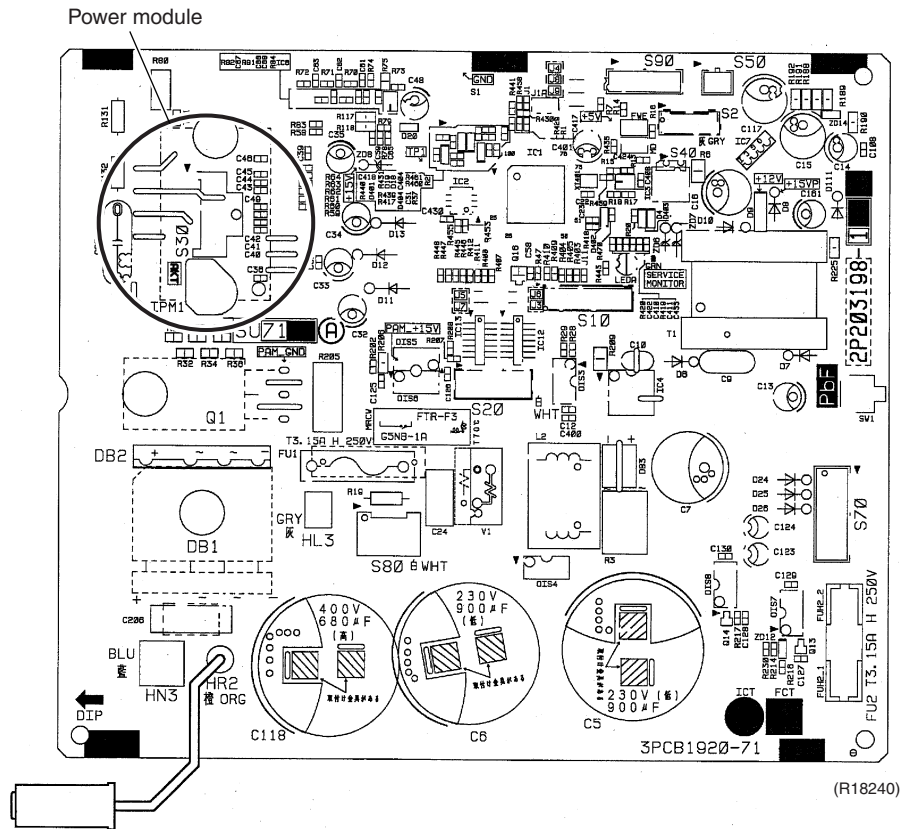


RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B

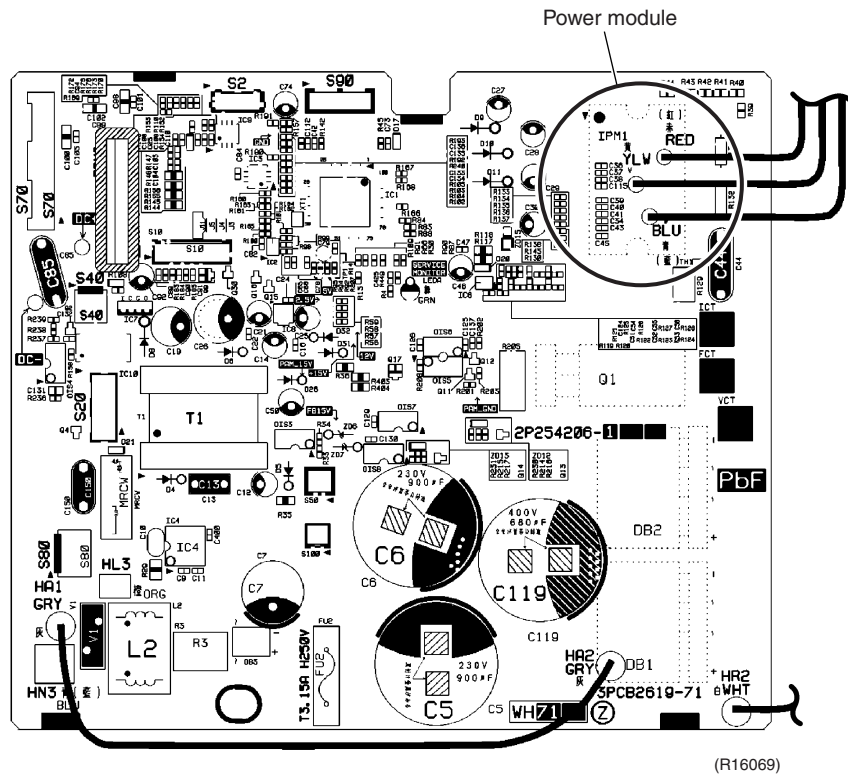

RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B

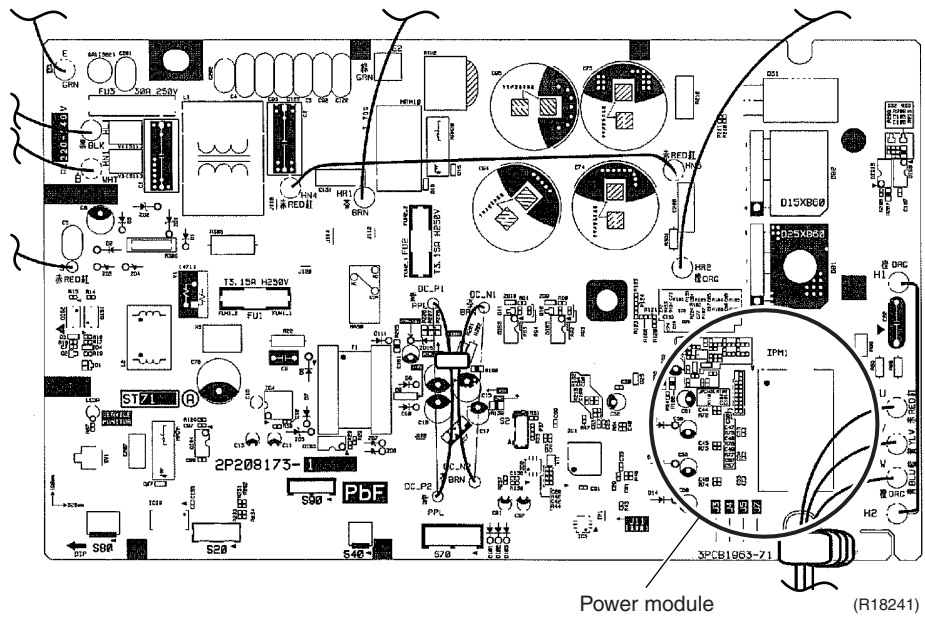


RK(X)S50G2V1B, ARXS50G2V1B

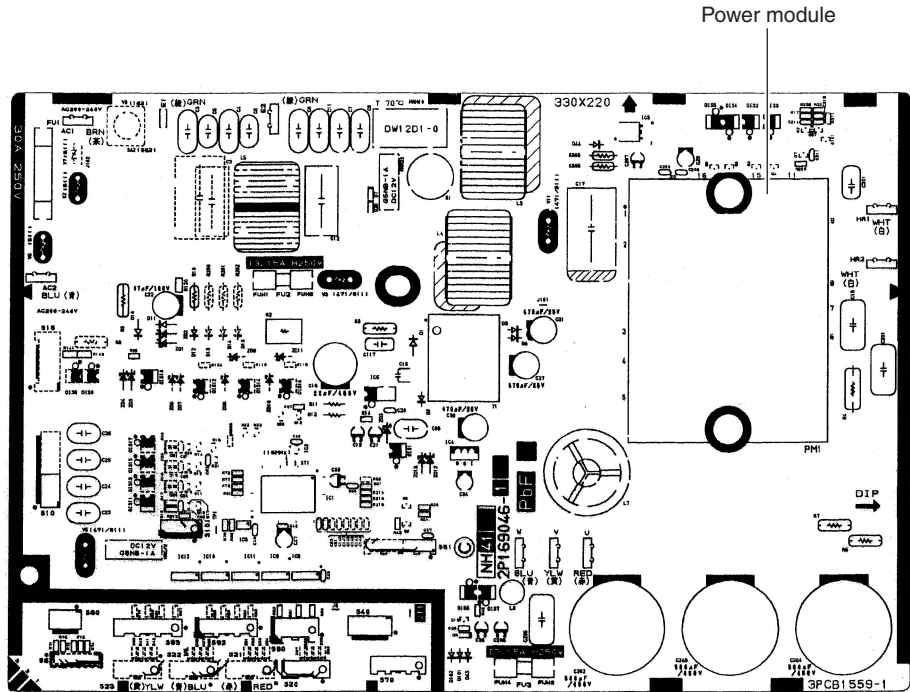

(R18212)

ARXS50G3V1B

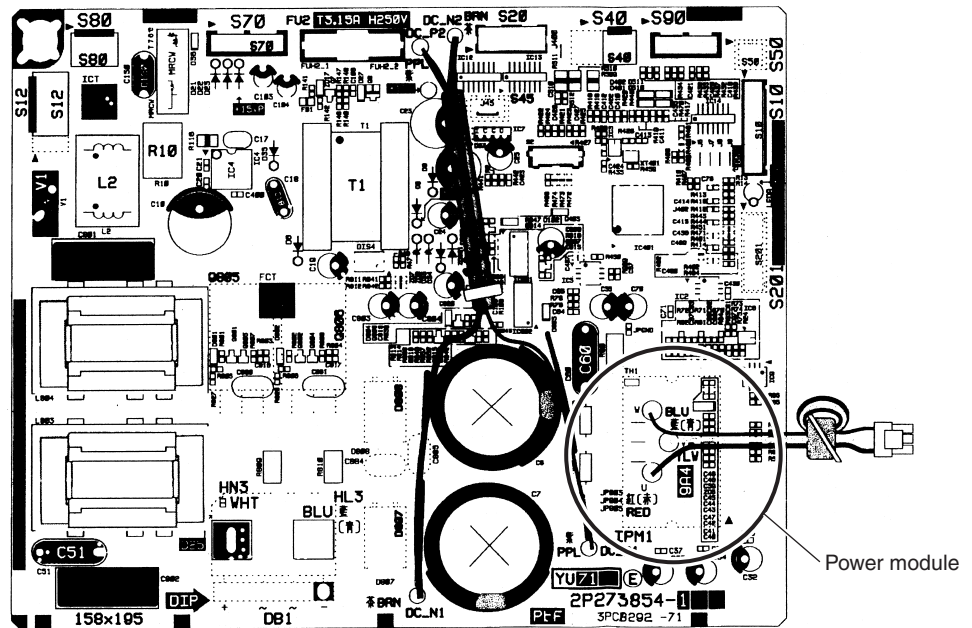

(R16692)

Part 7

Trial Operation and Field Settings

1. Pump Down Operation.....	145
2. Forced Cooling Operation.....	146
3. Trial Operation	148
4. Field Settings	150
4.1 Model Type Setting	150
4.2 When 2 Units are Installed in 1 Room.....	150
4.3 Standby Electricity Saving.....	151
4.4 Facility Setting Jumper and Switch (cooling at low outdoor temperature).....	152
4.5 Jumper and Switch Settings.....	154
5. Silicon Grease on Power Transistor / Diode Bridge.....	155


1. Pump Down Operation

Outline

In order to protect the environment, be sure to conduct pump down operation when relocating or disposing the unit.

Detail

- 1) Remove the valve caps from the liquid stop valve and the gas stop valve.
- 2) Carry out forced cooling operation.
- 3) After 5 to 10 minutes, close the liquid stop valve with a hexagonal wrench.
- 4) After 2 to 3 minutes, close the gas stop valve and stop the forced cooling operation.

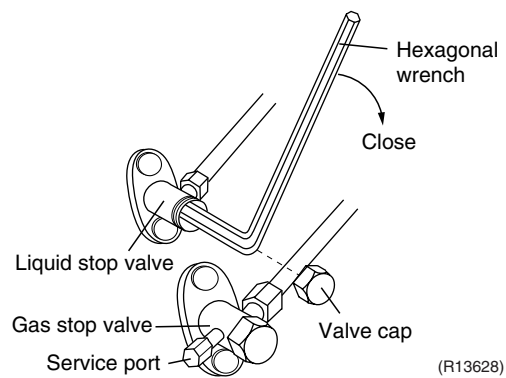


Refer to page 146 for forced cooling operation.

2. Forced Cooling Operation

Item	Forced Cooling
Conditions	The forced cooling operation is allowed when both of the following conditions are met. 1) The outdoor unit is not abnormal and not in the 3-minute standby mode. 2) The outdoor unit is not operating.
Start	The forced cooling operation starts when any of the following conditions is fulfilled. 1) Press the forced cooling operation [ON/OFF] button (SW1) on the indoor unit for 5 seconds. 2) Press the forced cooling operation ON/OFF button (SW1) on the outdoor unit within around 3 minutes after power is supplied. (20/25/35/50 class only)
Command frequency	RK(X)S20-35G2V1B, ARXS20-35G2V1B: 68 Hz RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B: 58 Hz RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B: 47 Hz RK(X)S50G2V1B, ARXS50G2V1B, ARXS50G3V1B: 66 Hz
End	The forced cooling operation ends when any of the following conditions is fulfilled. 1) The operation ends automatically after 15 minutes. 2) Press the forced cooling operation [ON/OFF] button (SW1) on the indoor unit again. 3) Press the [ON/OFF] button on the remote controller. 4) Press the forced cooling operation ON/OFF button (SW1) on the outdoor unit. (20/25/35/50 class only)
Others	Protection functions have priority over all other functions during forced cooling operation.


Indoor Unit

Indoor Unit

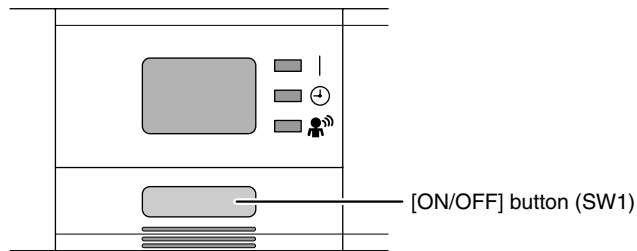


(R18213)

Outdoor Unit: RK(X)S20-35G2V1B, ARXS20-35G2V1B

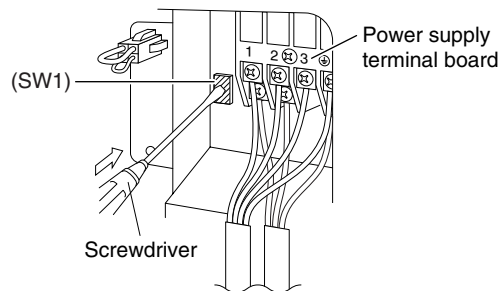


(R14039)


Outdoor Unit: RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B

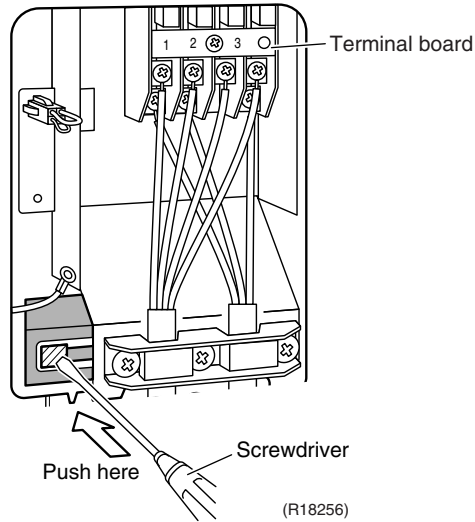

Outdoor Unit: RK(X)S50G2V1B, ARXS50G2V1B

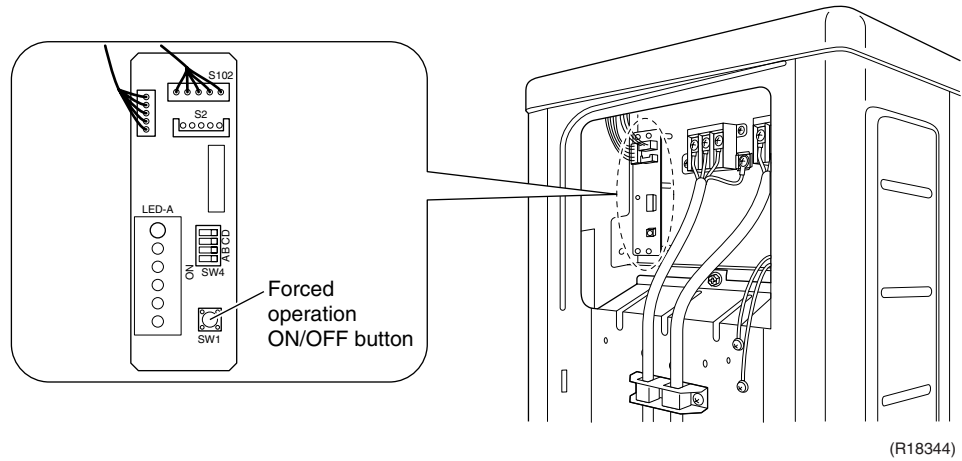

Outdoor Unit: ARXS50G3V1B

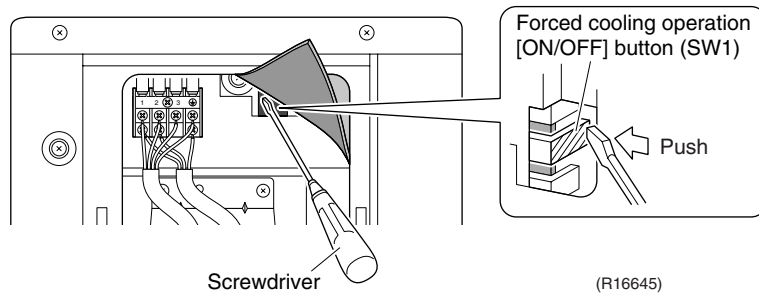

Caution

When pressing the button, do not touch the terminal board. It has a high voltage and may cause electric shock.



Note

42 class models have no forced cooling operation ON/OFF button on the outdoor unit PCB. Carry out forced cooling operation from indoor unit.

3. Trial Operation

Outline

1. Measure the power supply voltage and make sure that it falls within the specified range.
2. Trial operation should be carried out in either cooling or heating operation.
3. Carry out the trial operation in accordance with the operation manual to ensure that all functions and parts, such as flap movement, are working properly.
 - The air conditioner requires a small amount of power in standby mode. If the system is not to be used for some time after installation, shut off the circuit breaker to eliminate unnecessary power consumption.
 - If the circuit breaker trips to shut off the power to the air conditioner, the system backs up the operation mode. The system then restarts operation with the previous operation mode when the circuit breaker is restored.


In cooling operation, select the lowest programmable temperature (18°C); in heating operation, select the highest programmable temperature (30°C).

- Trial operation may be disabled in either operation mode depending on the room temperature.
- After trial operation is complete, set the temperature to a normal level. (26°C ~ 28°C in cooling, 20°C ~ 24°C in heating operation)
- For protection, the system does not start for 3 minutes after it is turned off.

Detail


ARC452 Series

- (1) Press the [ON/OFF] button to turn on the system.
- (2) Press the both of [TEMP] buttons and the [MODE] button at the same time.
- (3) Press the [MODE] button twice.
(? appears on the display to indicate that trial operation is selected.)
- (4) Press the [MODE] button and select the operation mode.
- (5) Trial operation terminates in approx. 30 minutes and switches into normal mode. To quit trial operation, press the [ON/OFF] button.

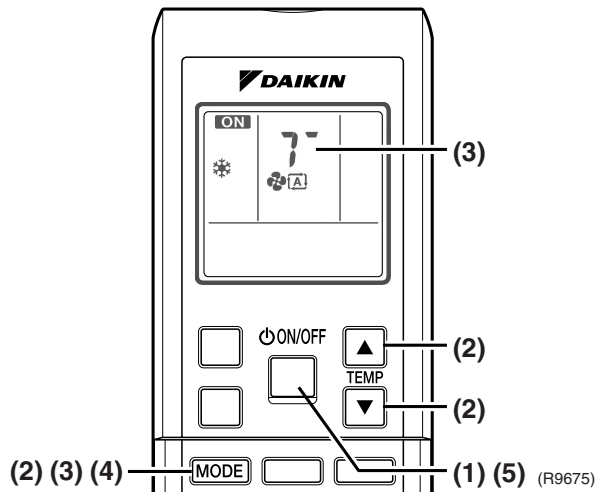

ARC433 Series

- (1) Press the [ON/OFF] button to turn on the system.
- (2) Press the center of the [TEMP] button and the [MODE] button at the same time.
- (3) Press the [MODE] button twice.
(7° appears on the display to indicate that trial operation is selected.)
- (4) Press the [MODE] button and select operation mode.
- (5) Trial operation terminates in approx. 30 minutes and switches into normal mode. To quit a trial operation, press the [ON/OFF] button.

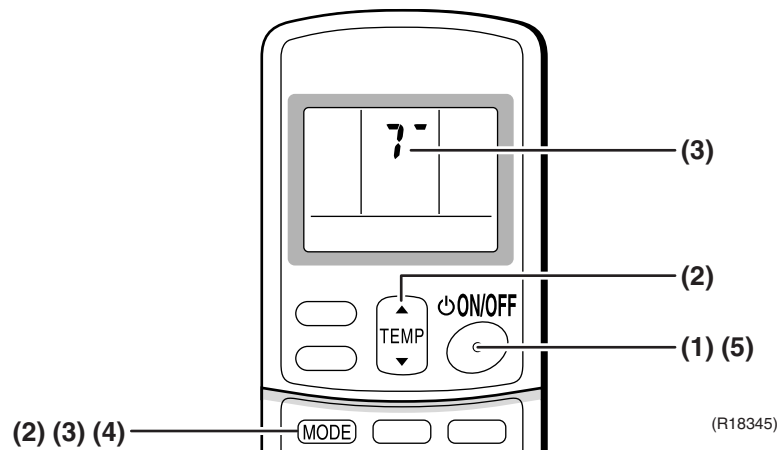


4. Field Settings

4.1 Model Type Setting

ARC452A3

- The remote controller is common to the heat pump model and cooling only model. Check that the DIP switch is set to the right position. Set the DIP switch to the right position as shown in the illustration if the position of the DIP switch is wrong.

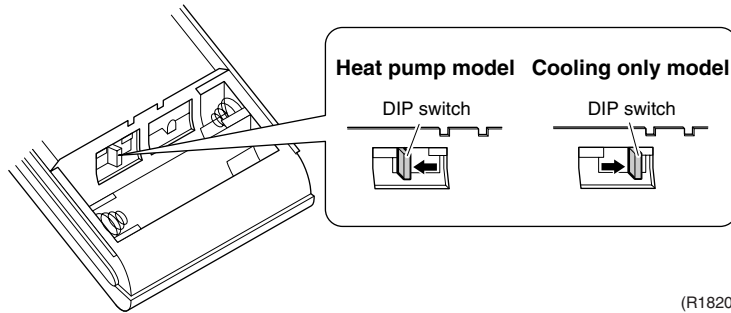

(R18201)


4.2 When 2 Units are Installed in 1 Room

Outline

When 2 indoor units are installed in 1 room, 1 of the 2 indoor units and the corresponding wireless remote controller can be set for different addresses. Both the indoor unit PCB and the wireless remote controller need alteration.

Indoor Unit PCB

- Cut the address setting jumper JA on the control PCB.

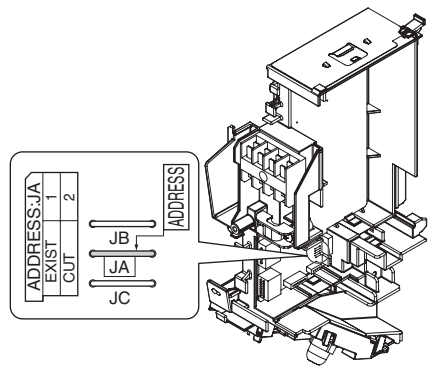

(R18214)



Caution


Replace the PCB if you accidentally cut a wrong jumper.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

Wireless Remote Controller


- Cut the address setting jumper.

ARC452 series

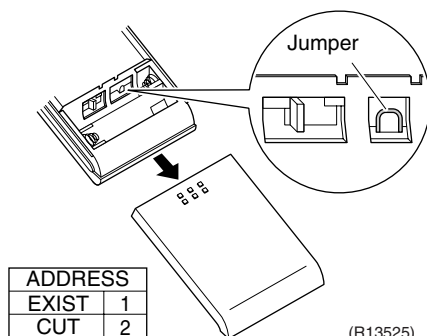

(R13525)

ARC433 series

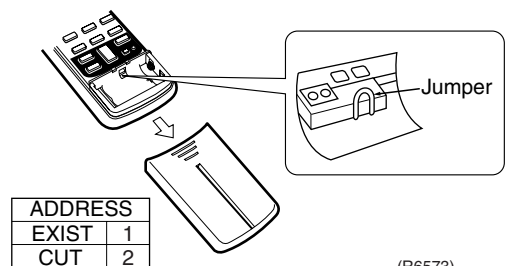

(R6573)

4.3 Standby Electricity Saving

Outline


20-42 Class Only

This function turns power supply OFF to the outdoor unit and sets the indoor unit into standby electricity saving mode, thus reducing the power consumption of the air conditioner.

Detail

For 20/25/35 class models, following procedure is required for turning ON the function.

1. Check that the main power supply is turned OFF. Turn OFF if it has not been turned OFF.
2. Remove the stop valve cover.
3. Disconnect the selective connector for standby electricity saving.
4. Turn ON the main power supply.

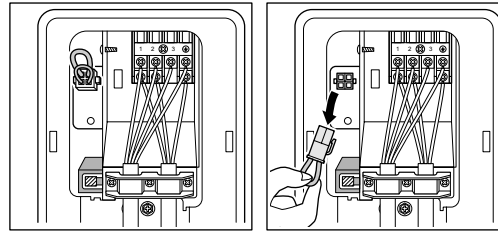

Function OFF

Function ON

The standby electricity saving function is turned OFF before shipping.

(R11820)



Caution

1. Before connecting or disconnecting the selective connector for standby electricity saving, make sure that the main power supply is turned OFF.
2. For ARXS50G3V1B, the selective connector for standby electricity saving is required. Do not disconnect it.

4.4 Facility Setting Jumper and Switch (cooling at low outdoor temperature)


Outline

This function is limited only for facilities (the target of air conditioning is equipment (such as computer)). Never use it in a residence or office (the space where there is a human).


20-35 Class

You can expand the operation range to -15°C by cutting the jumper on the outdoor unit PCB. If the outdoor temperature falls to -20°C or lower, the operation stops. If the outdoor temperature rises, the operation starts again.

- **RK(X)S20-35G2V1B, ARXS20-35G2V1B**
Main PCB

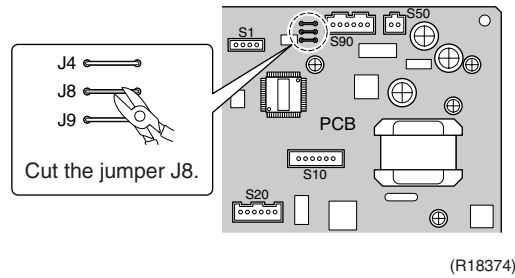


- **RK(X)S20-35G2V1B9, ARXS20-35G3V1B, ARXS20-35G4V1B**
Main PCB

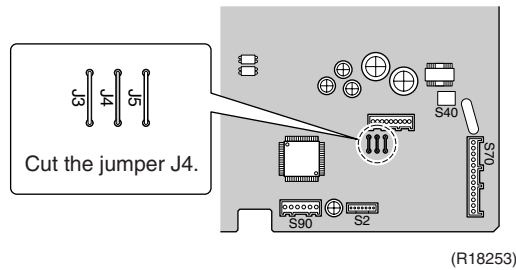

42 Class

- **RK(X)S42G2V1B, ARXS42G2V1B, ARXS42G3V1B**


You can expand the operation range to -15°C by cutting the jumper on the outdoor unit PCB. If the outdoor temperature falls to -20°C or lower, the operation stops. If the outdoor temperature rises, the operation starts again.

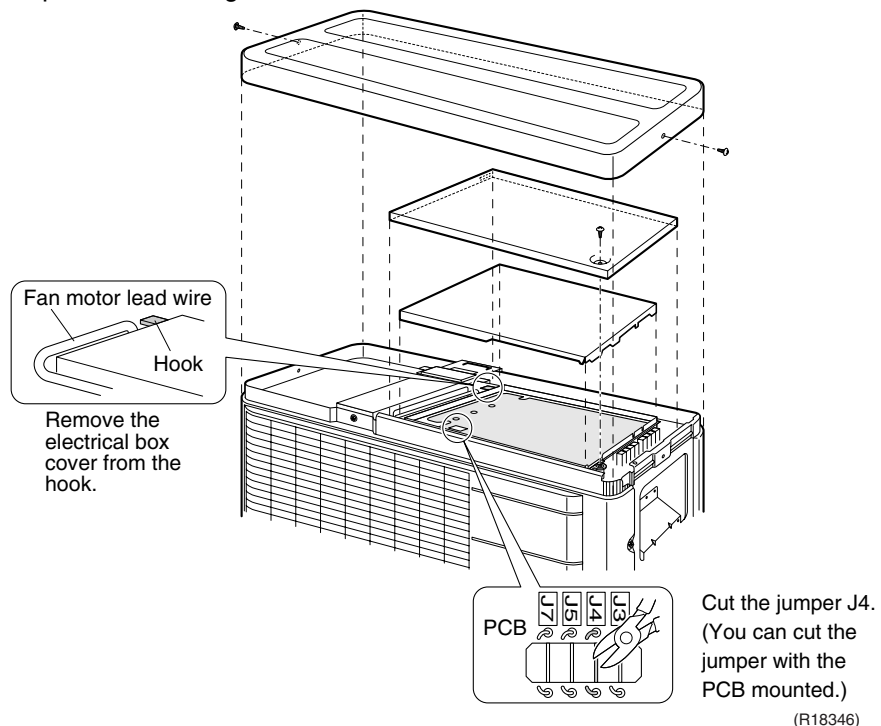

50 Class

■ **RK(X)S50G2V1B, ARXS50G2V1B**


You can expand the operation range to -15°C by turning on the switch on the service monitor PCB. If the outdoor temperature falls to -20°C or lower, the operation stops. If the outdoor temperature rises, the operation starts again.

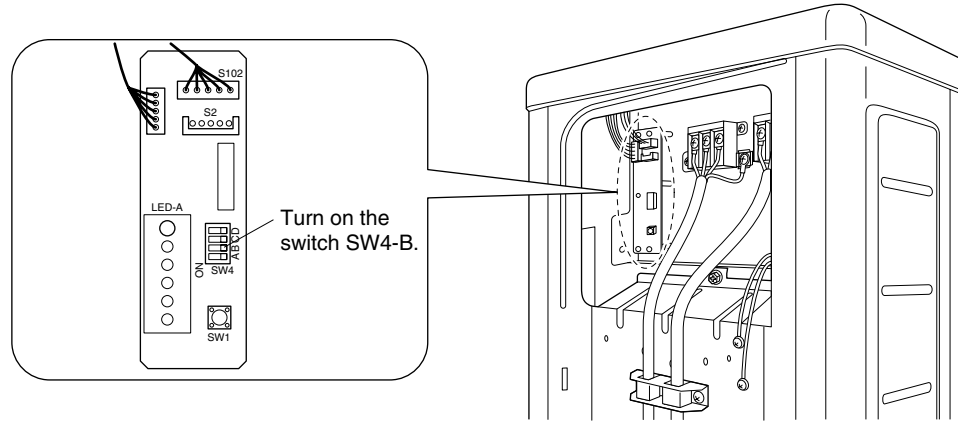

(R12186)

■ **ARXS50G3V1B**

You can expand the operation range to -10°C by cutting the jumper (J6) on the outdoor unit PCB. If the outdoor temperature falls to -18°C or lower, the operation stops. If the outdoor temperature rises, the operation starts again.

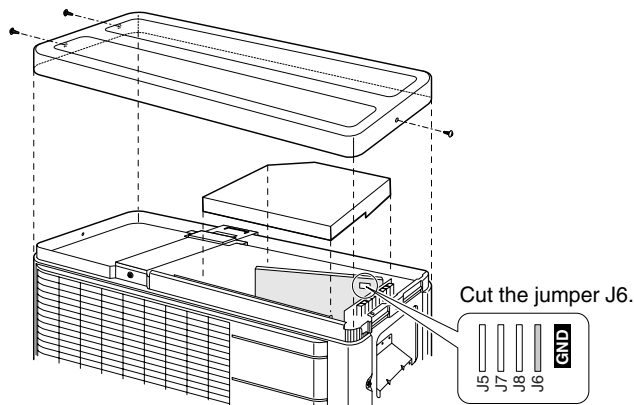

(R18276)



Caution

1. If the outdoor unit is installed where the outdoor heat exchanger of the unit is exposed to direct wind, provide a windbreak wall.
2. Intermittent noises may be produced by the indoor unit due to the outdoor fan turning on and off when using facility settings.
3. Do not place humidifiers or other items which might raise the humidity in rooms where facility settings are being used.
A humidifier might cause dew jumping from the indoor unit outlet vent.
4. Cutting jumper sets the indoor fan tap to the highest position. (20/25/35/42 class, ARXS50G3V1B)
5. Use the indoor unit at the highest level of airflow rate. (RK(X)S50G2V1B, ARXS50G2V1B)



Caution

Replace the PCB if you accidentally cut a wrong jumper.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

4.5 Jumper and Switch Settings

Indoor Unit

Function	Jumper	When connected (factory set)	When cut
Fan speed setting when compressor stops for thermostat OFF. (effective only in cooling operation)	JB	Fan speed setting; Remote controller setting	Fan speed setting; "0" (The fan stops.)
Power failure recovery function	JC	Auto-restart	The unit does not resume operation after recovering from a power failure. Timer settings are cleared.



For the location of the jumper, refer to page 22.



Caution

Replace the PCB if you accidentally cut a wrong jumper.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

Outdoor Unit

Function	Switch / Jumper	Switch: OFF Jumper: connected (factory set)	Switch: ON Jumper: cut
Improvement of defrost performance	RK(X)S20-35G2V1B → J5 RK(X)S20-35G2V1B9 → J5 ARXS20-35G2V1B → J5 ARXS20-35G3V1B → J5 ARXS20-35G4V1B → J5 42 class → J5 RK(X)S50G2V1B → SW4-C ARXS50G2V1B → SW4-C ARXS50G3V1B → J8	Standard control	Reinforced control (ex. The frequency increases, the duration time of defrost lengthens.)



For the location of the switch / jumper, refer to page 24, 26, 28, 29, 30.



Caution

Replace the PCB if you accidentally cut a wrong jumper.

Jumpers are necessary for electronic circuit. Improper operation may occur if you cut any of them.

5. Silicon Grease on Power Transistor / Diode Bridge

Outline


Apply the specified silicon grease to the heat radiation part of a power transistor / diode bridge when you replace an outdoor unit PCB. The silicon grease encourages the heat radiation of a power transistor / diode bridge.

Detail


1. Wipe off the old silicon grease completely.
2. Apply the silicon grease evenly. See the illustrations below for examples of application.
3. Tighten the screws of the power transistor / diode bridge.
4. Make sure that the heat radiation parts are firmly contacted to the radiation fin.

Note: Smoke emission may be caused by bad heat radiation when the silicon grease is not appropriately applied.


- OK: Evenly applied

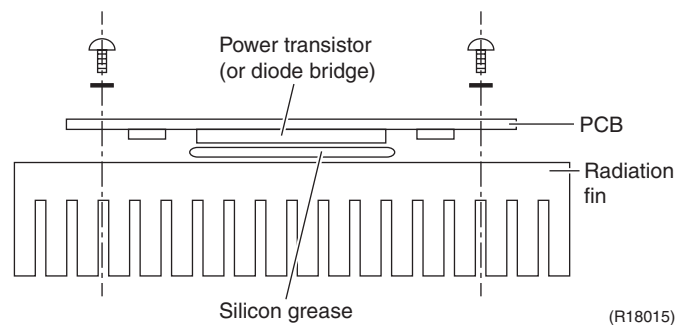

- NG: Not evenly applied

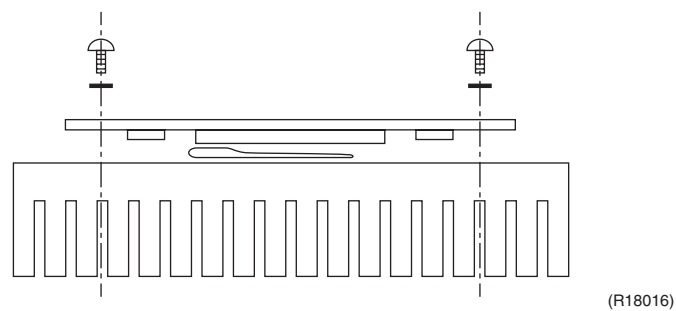

- NG: Foreign matter is stuck.

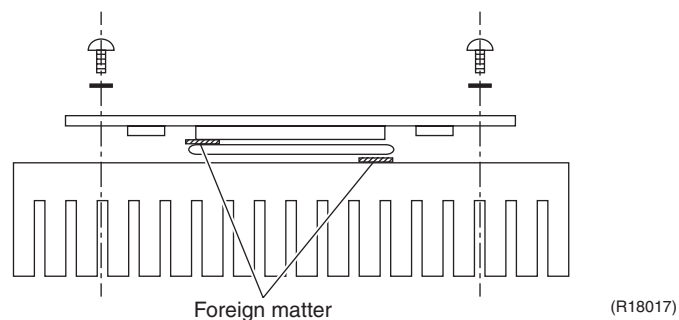

Part 8

Appendix


1. Piping Diagrams.....	157
1.1 Indoor Unit.....	157
1.2 Outdoor Unit.....	158
2. Wiring Diagrams.....	163
2.1 Indoor Unit.....	163
2.2 Outdoor Unit.....	163
3. Removal Procedure (Booklet No.)	167

1. Piping Diagrams


1.1 Indoor Unit

FTXS20/25/35/42G2V1B,
ATXS20/25/35/42G2V1B

FTXS50G2V1B, ATXS50G2V1B

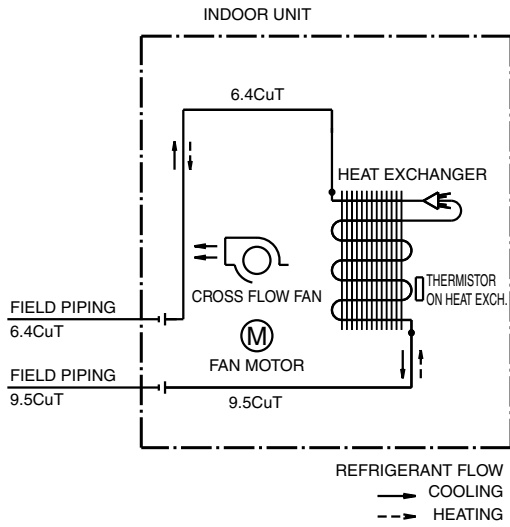

4D058897K

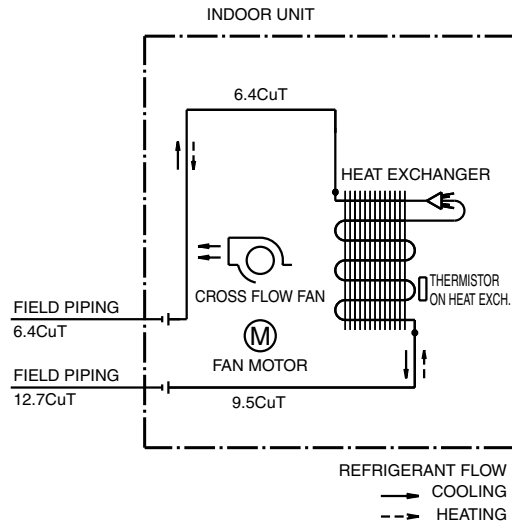


4D058898G

1.2 Outdoor Unit


1.2.1 Cooling Only

RKS20G2V1B, RKS20G2V1B9

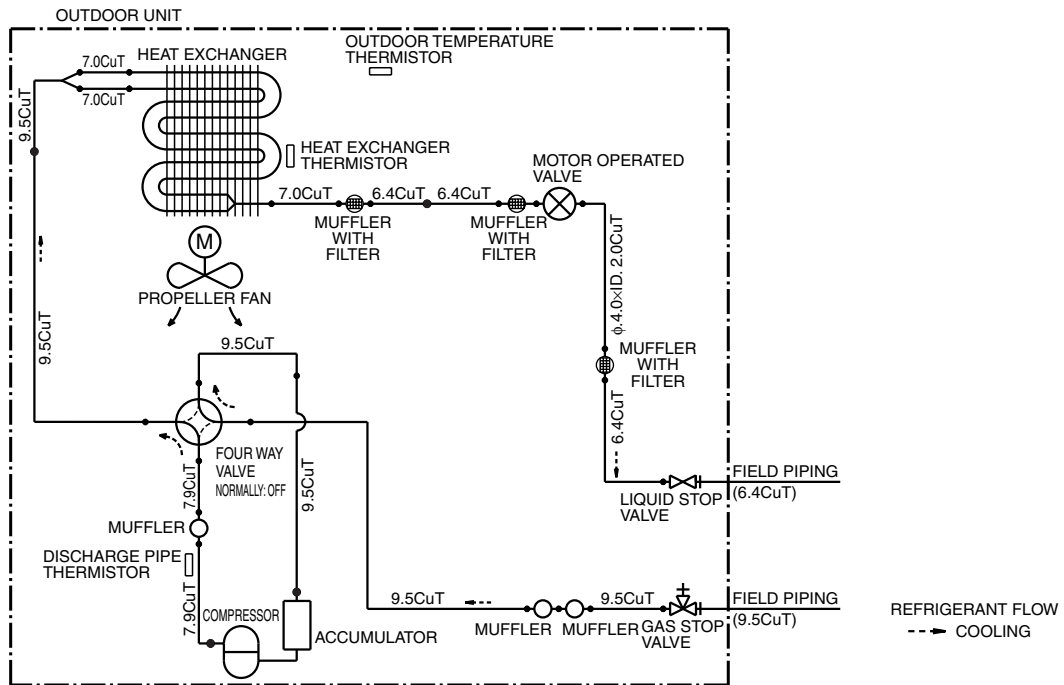

3D059588B


RKS25/35G2V1B, RKS25/35G2V1B9

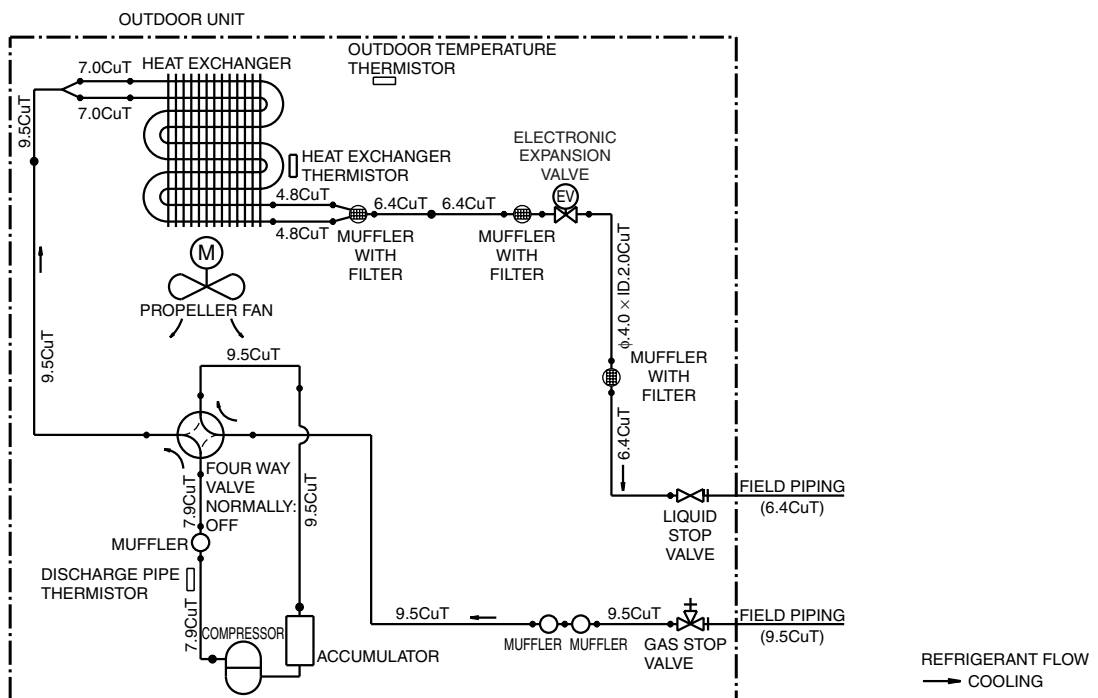

3D059589G


1.2.2 Heat Pump

RXS20G2V1B, ARXS20G2V1B, RXS20G2V1B9, ARXS20G3V1B, ARXS20G4V1B

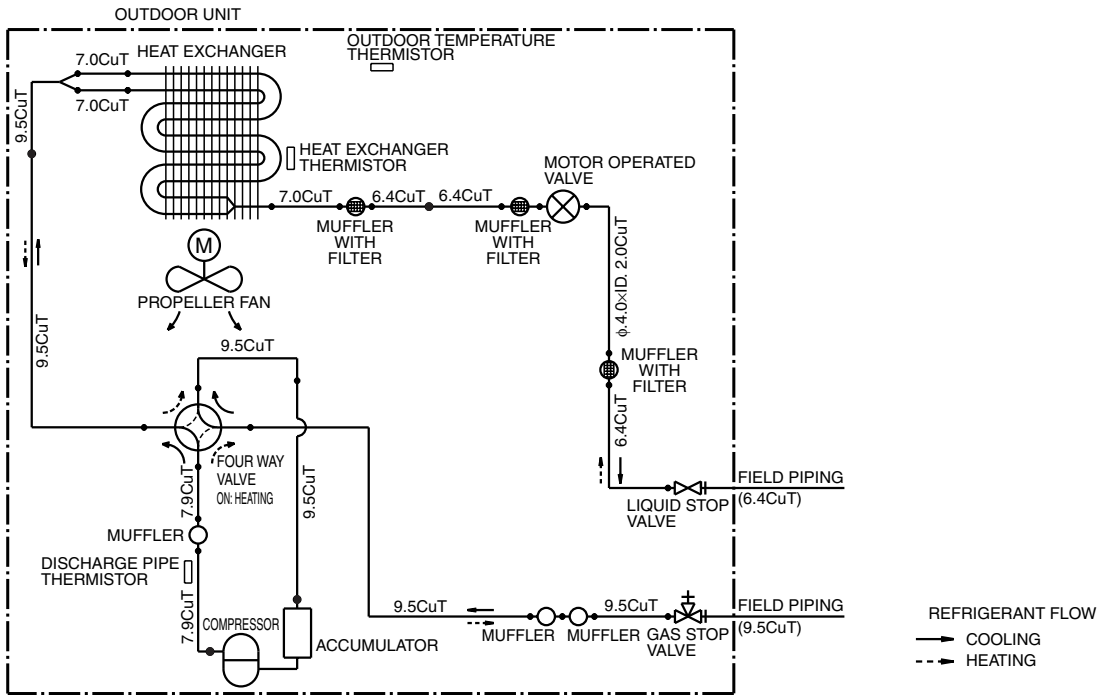


3D059587C

RXS25/35G2V1B, ARXS25/35G2V1B, RXS25/35G2V1B9, ARXS25/35G3V1B, ARXS25/35G4V1B

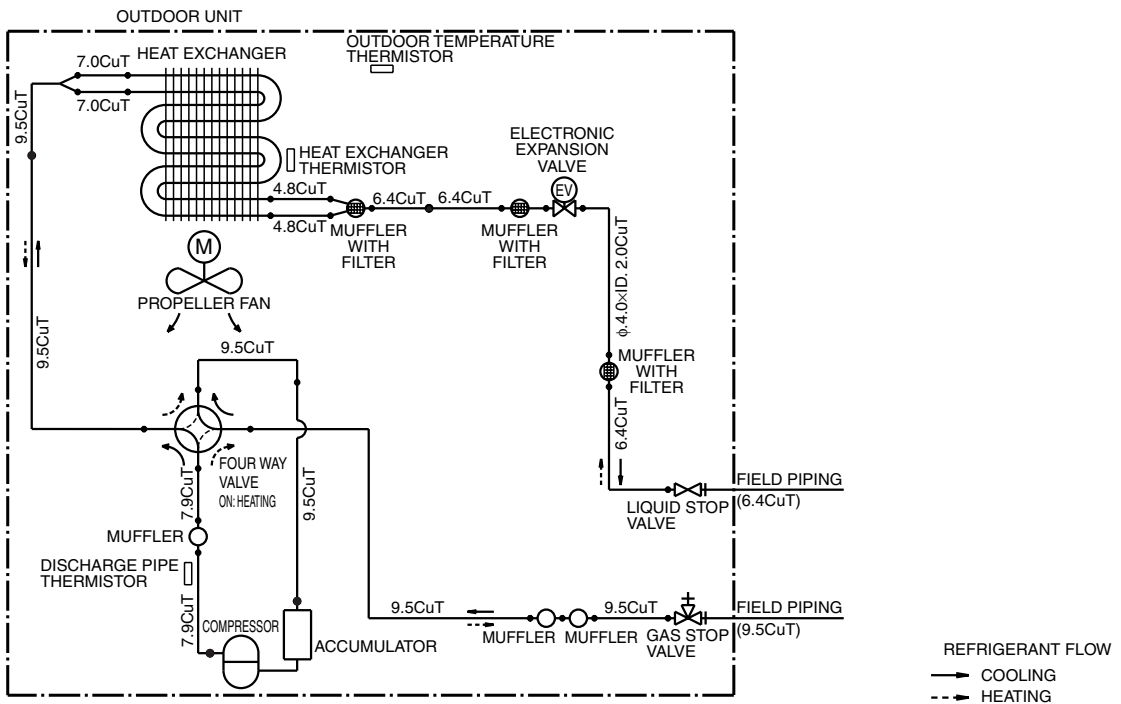


3D059586Q

RXS42G2V1B, ARXS42G2V1B, ARXS42G3V1B

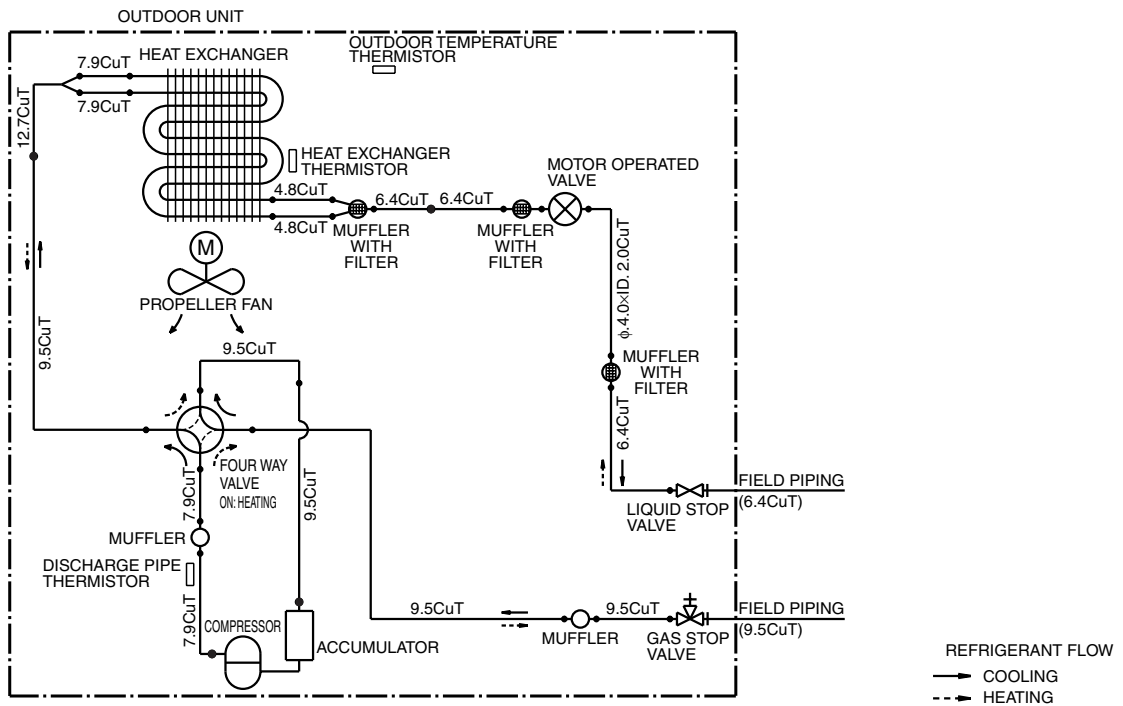


3D059590D

RXS50G2V1B, ARXS50G2V1B

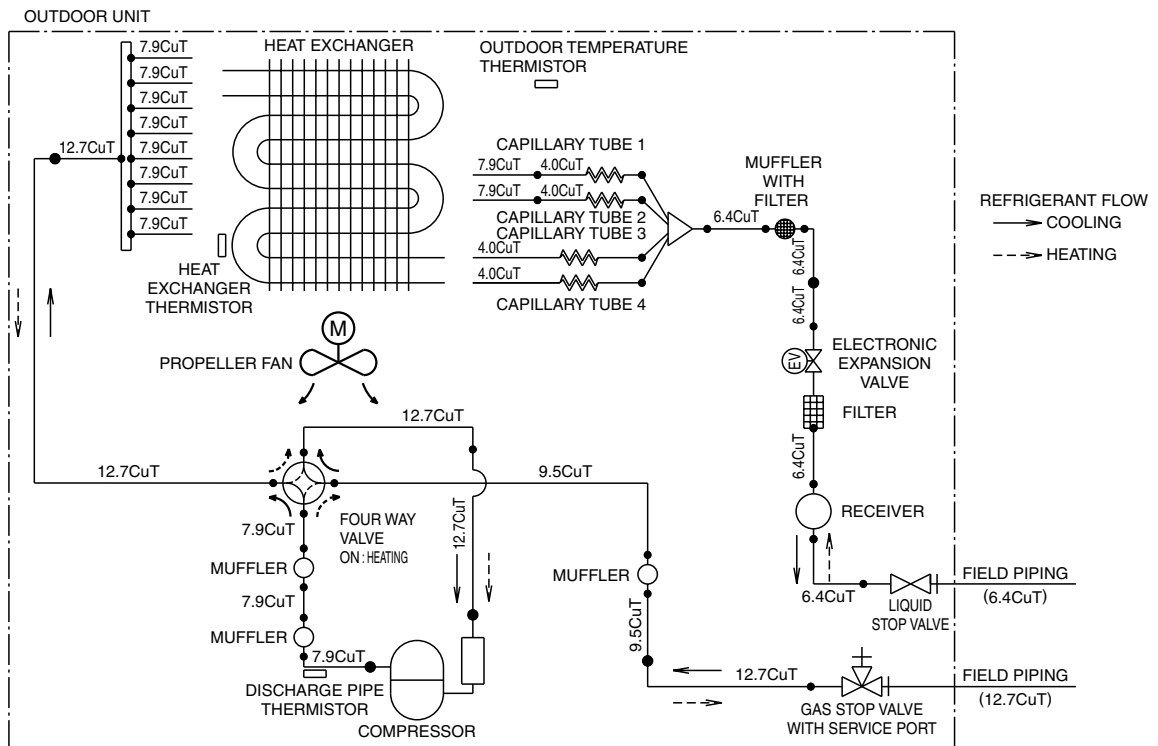

3D051637Y

ARXS50G3V1B

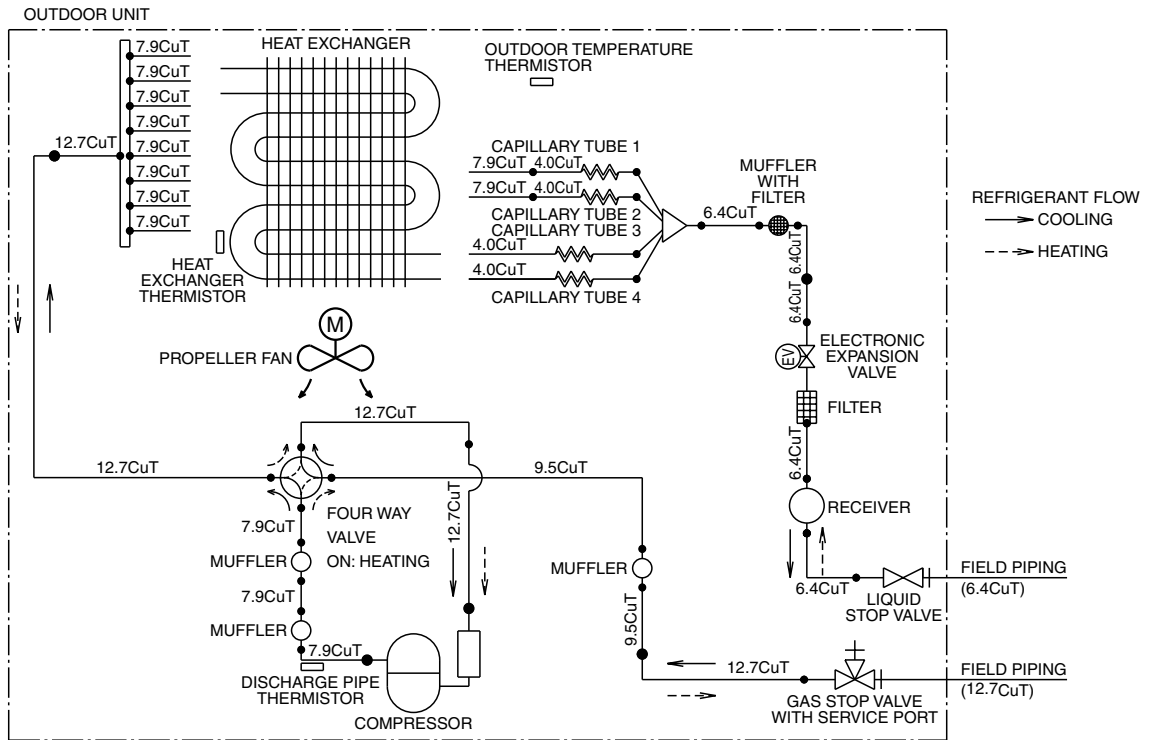


3D080605

2. Wiring Diagrams


2.1 Indoor Unit

FTXS20/25/35/42/50G2V1B, ATXS20/25/35/42/50G2V1B

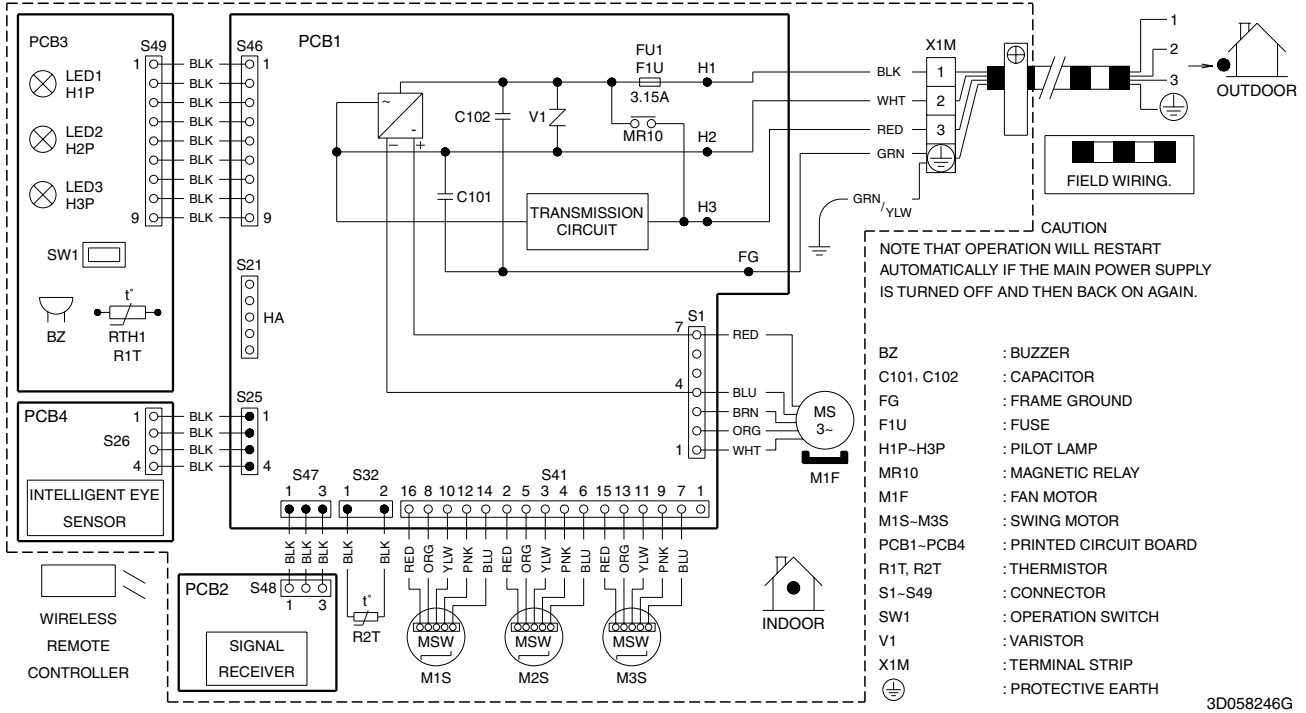


2.2 Outdoor Unit


RK(X)S20/25/35G2V1B, ARXS20/25/35G2V1B

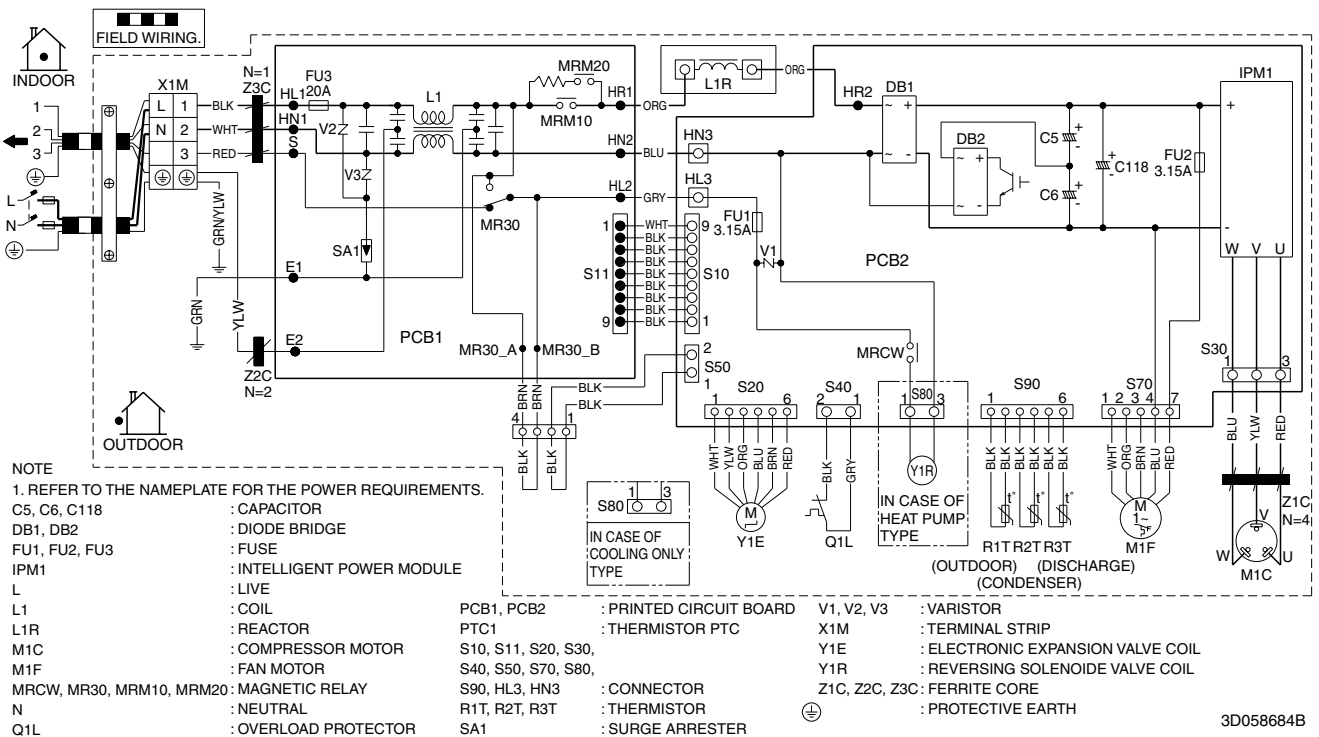


RK(X)S20/25/35G2V1B9, ARXS20/25/35G3V1B, ARXS20/25/35G4V1B

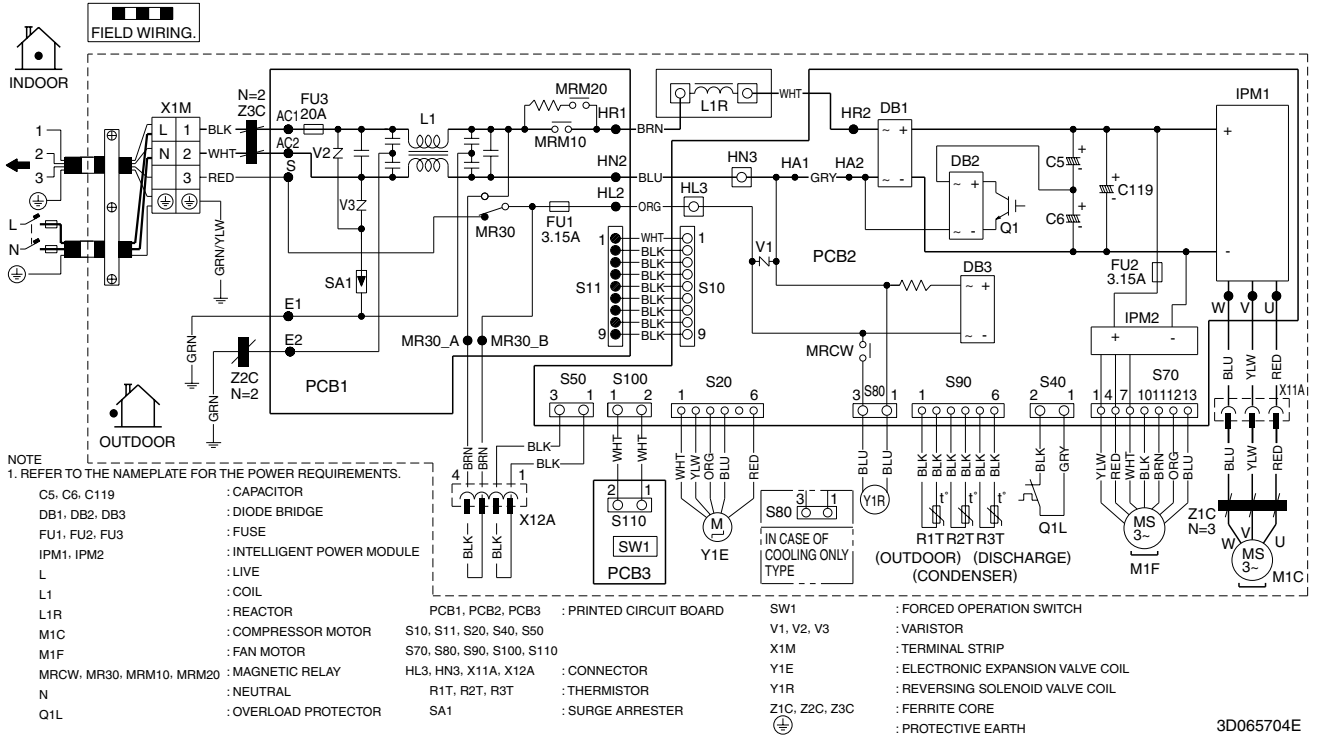

RKS42G2V1B

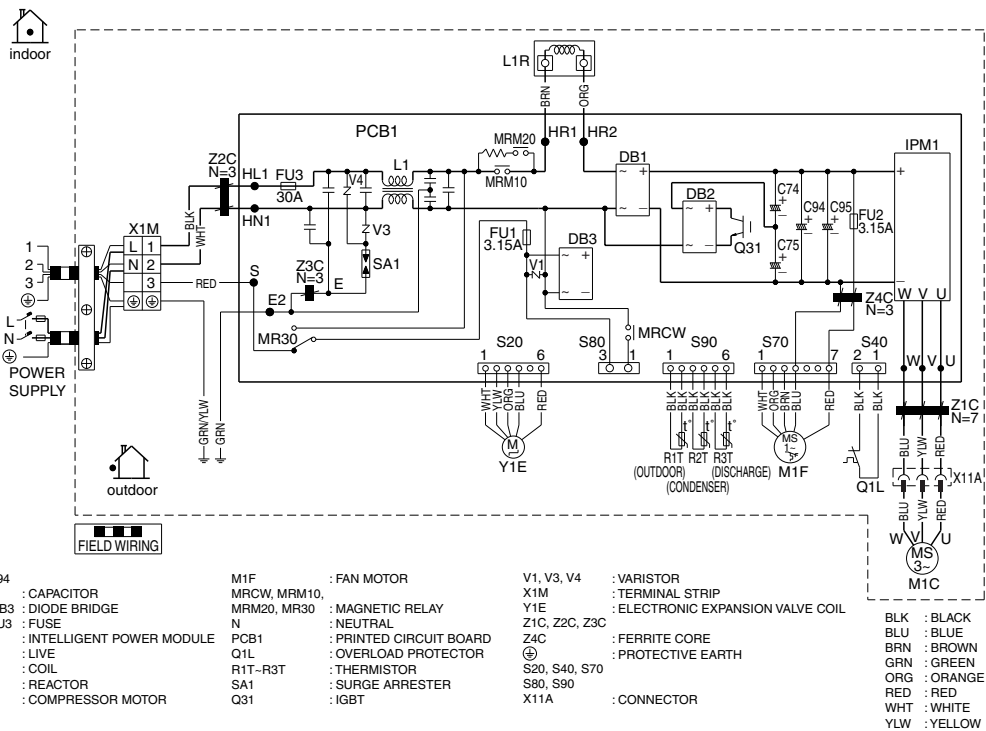


RXS42G2V1B, ARXS42G2V1B, ARXS42G3V1B

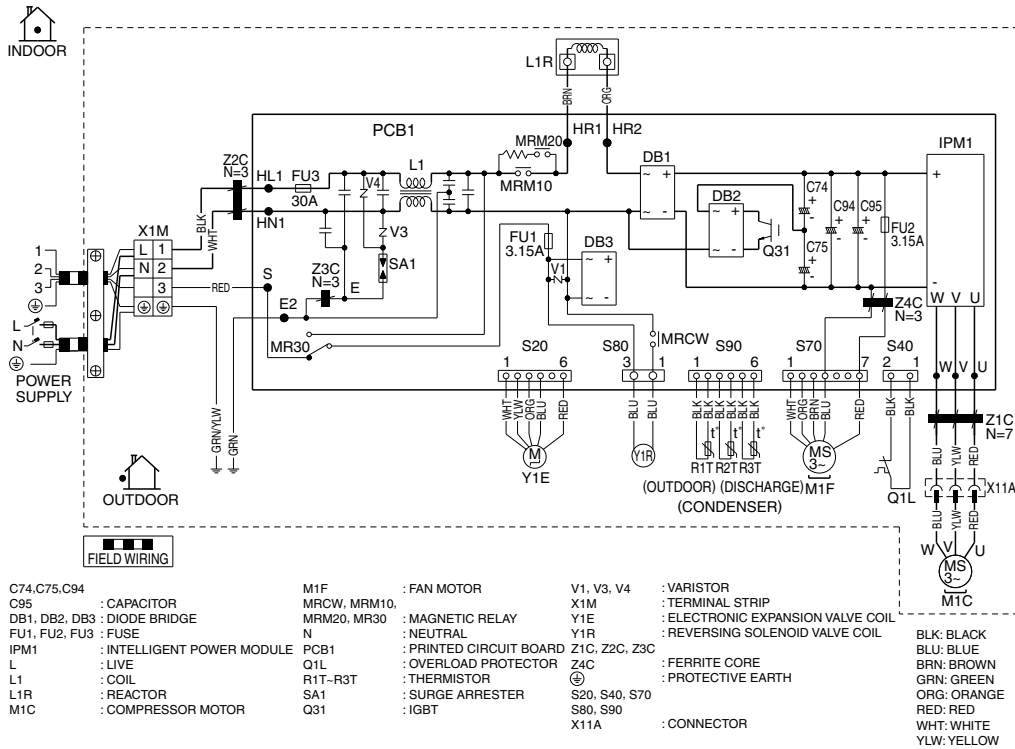


3D059601B

RKS50G2V1B

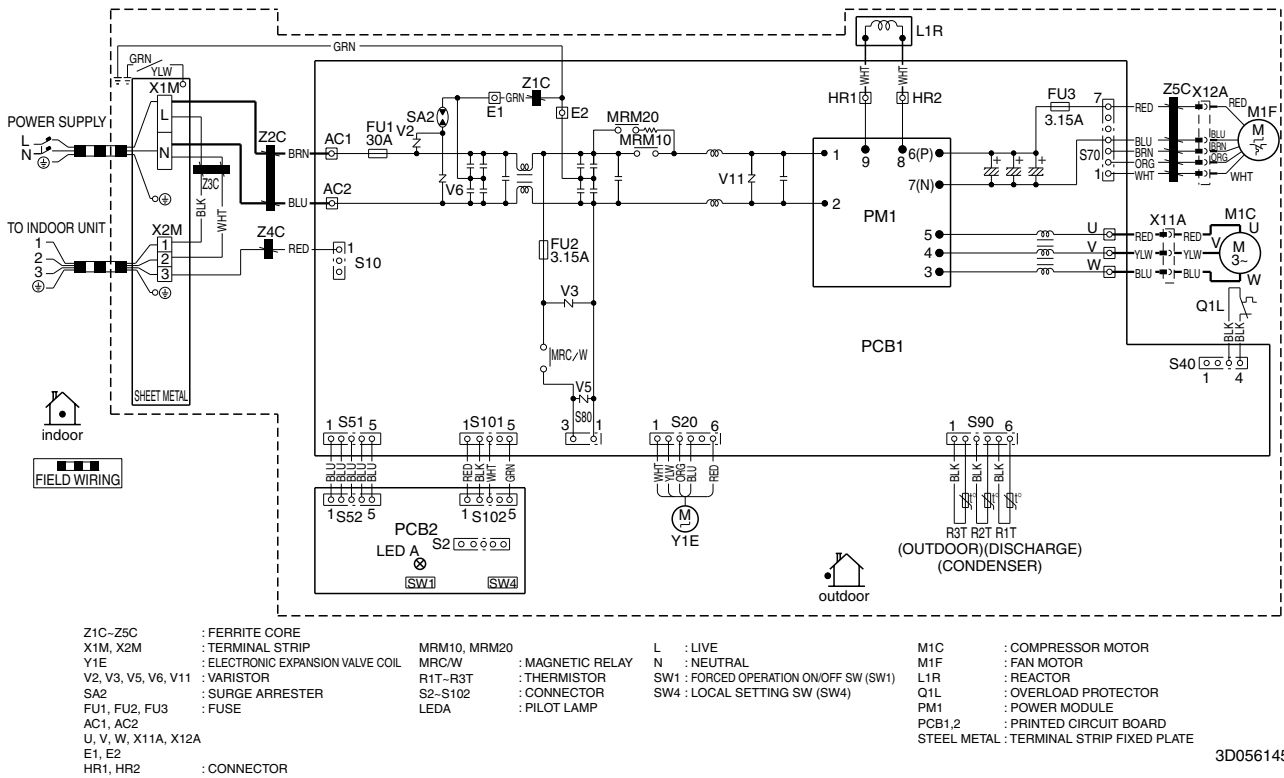


3D056145B

RXS50G2V1B, ARXS50G2V1B

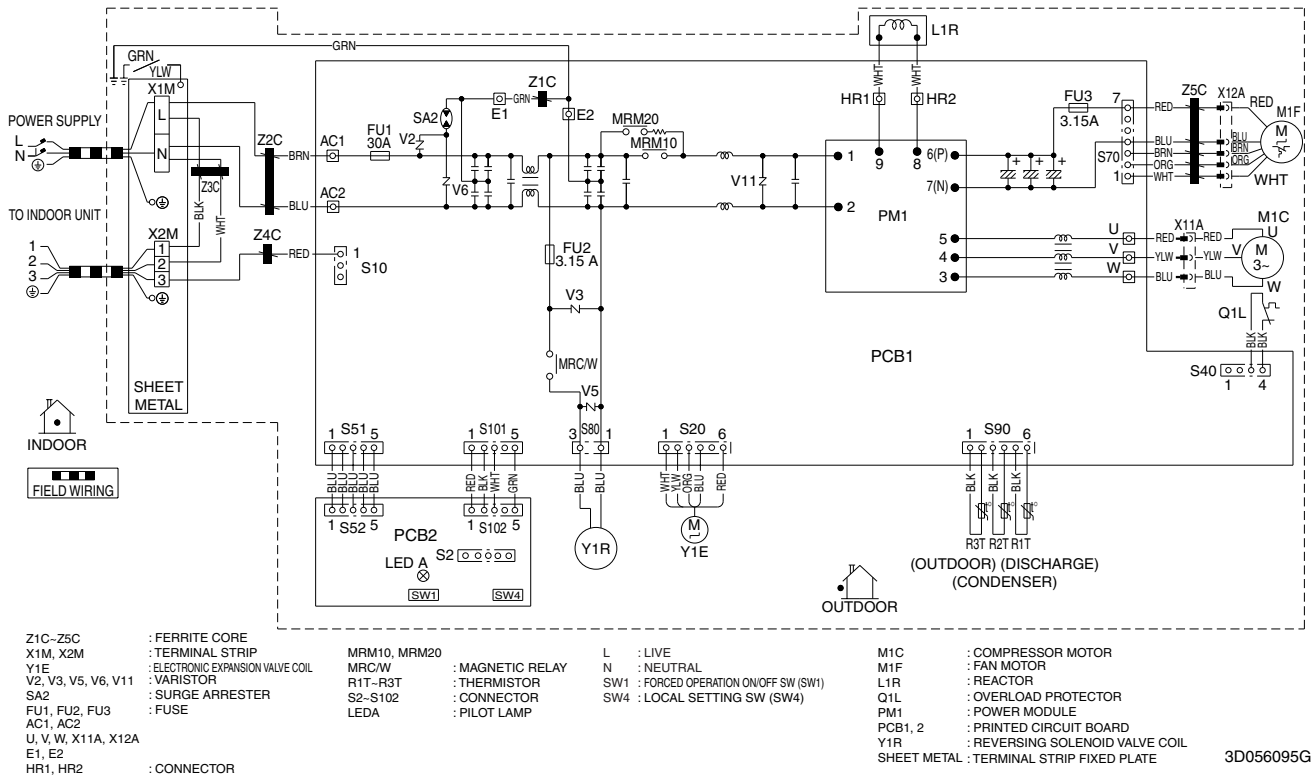

ARXS50G3V1B

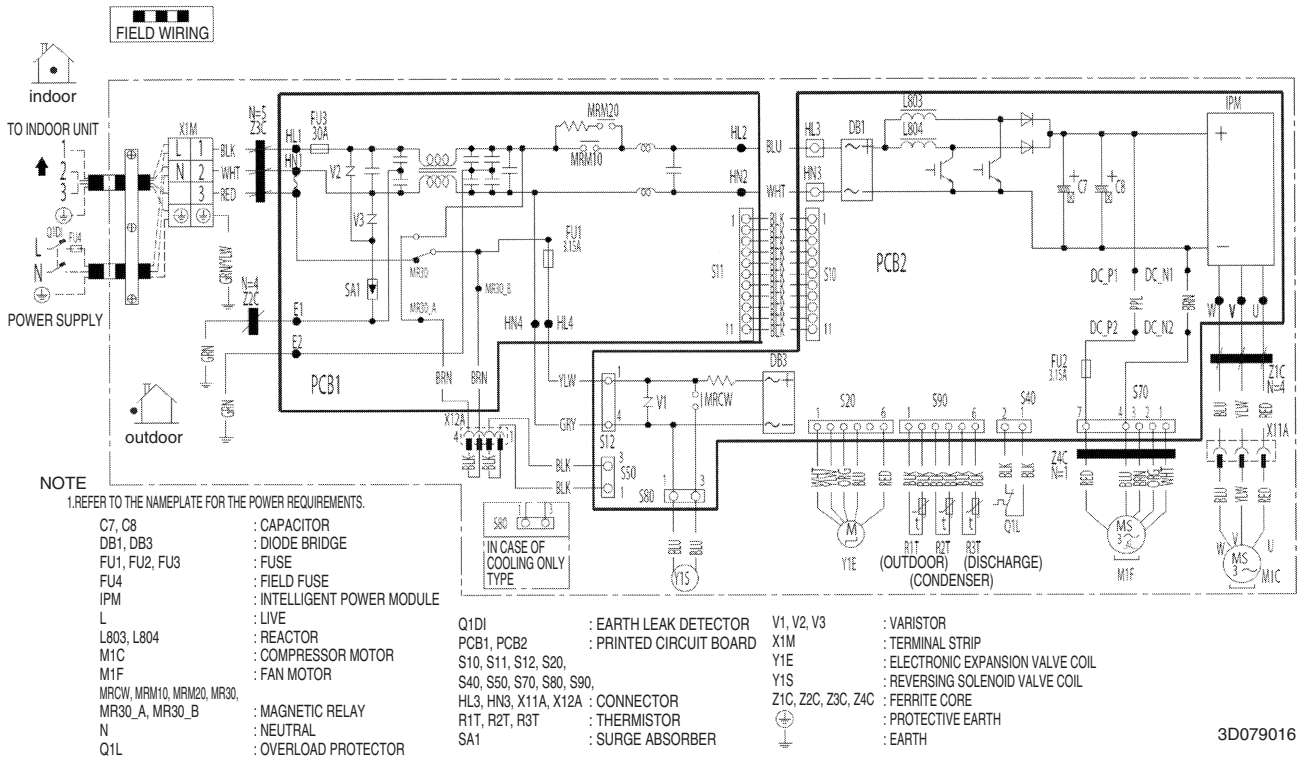

3. Removal Procedure (Booklet No.)

Refer to the following booklets for removal procedure.

*FTXS20/25/35/42/50G2V1B



Refer to **SiBE04-808_B**.

*ATXS20/25/35/42/50G2V1B



Refer to **Si041252_A**.

*RK(X)S20-35G2V1B, ARXS20-35G2V1B



Refer to **SiBE04-808_B**.

*RK(X)S20-35G2V1B9, ARXS20-35G3V1B



Refer to **SiBE04-808_B**.

*ARXS20-35G4V1B



Refer to **Si001273**.

*RK(X)S42G2V1B, ARXS42G2V1B



Refer to **SiBE04-808_B**.

*ARXS42G3V1B



Refer to **Si001277**.

*RK(X)S50G2V1B, ARXS50G2V1B



Refer to **SiBE04-808_B**.

*ARXS50G3V1B



Refer to **Si001274**.

Revision History

Month / Year	Version	Revised contents
02 / 2008	SiBE04-808	First edition
04 / 2010	SiBE04-808_A	Model addition: RK(X)S20/25/35G2V1B9, ARXS20/25/35G3V1B
12 / 2010	SiBE04-808_B	Revision of contents
12 / 2012	SiBE04-808_C	Model addition: ARXS20/25/35G4V1B, ARXS42/50G3V1B

Warning



- Daikin products are manufactured for export to numerous countries throughout the world. Prior to purchase, please confirm with your local authorised importer, distributor and/or retailer whether this product conforms to the applicable standards, and is suitable for use, in the region where the product will be used. This statement does not purport to exclude, restrict or modify the application of any local legislation.
- Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorised parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Read the User's Manual carefully before using this product. The User's Manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any enquiries, please contact your local importer, distributor and/or retailer.

Cautions on product corrosion

1. Air conditioners should not be installed in areas where corrosive gases, such as acid gas or alkaline gas, are produced.
2. If the outdoor unit is to be installed close to the sea shore, direct exposure to the sea breeze should be avoided. If you need to install the outdoor unit close to the sea shore, contact your local distributor.

Dealer

DAIKIN INDUSTRIES, LTD.

Head Office:
Umeda Center Bldg., 2-4-12, Nakazaki-Nishi,
Kita-ku, Osaka, 530-8323 Japan

Tokyo Office:
JR Shinagawa East Bldg., 2-18-1, Konan,
Minato-ku, Tokyo, 108-0075 Japan

http://www.daikin.com/global_ac/

©All rights reserved